


Fire Flow Analysis

Legend

- Lakes
- Area of Deficient Fire Flow
- Pressure Zone
- Water Mains
- Streets

Minimum Fire Flow Service Criteria

- 3,500 gpm
- 2,500 gpm
- 2,000 gpm
- 1,000 gpm
- 0 gpm - Parks
- 0 gpm - Maple Bluff
- 0 gpm - Shorewood Hills

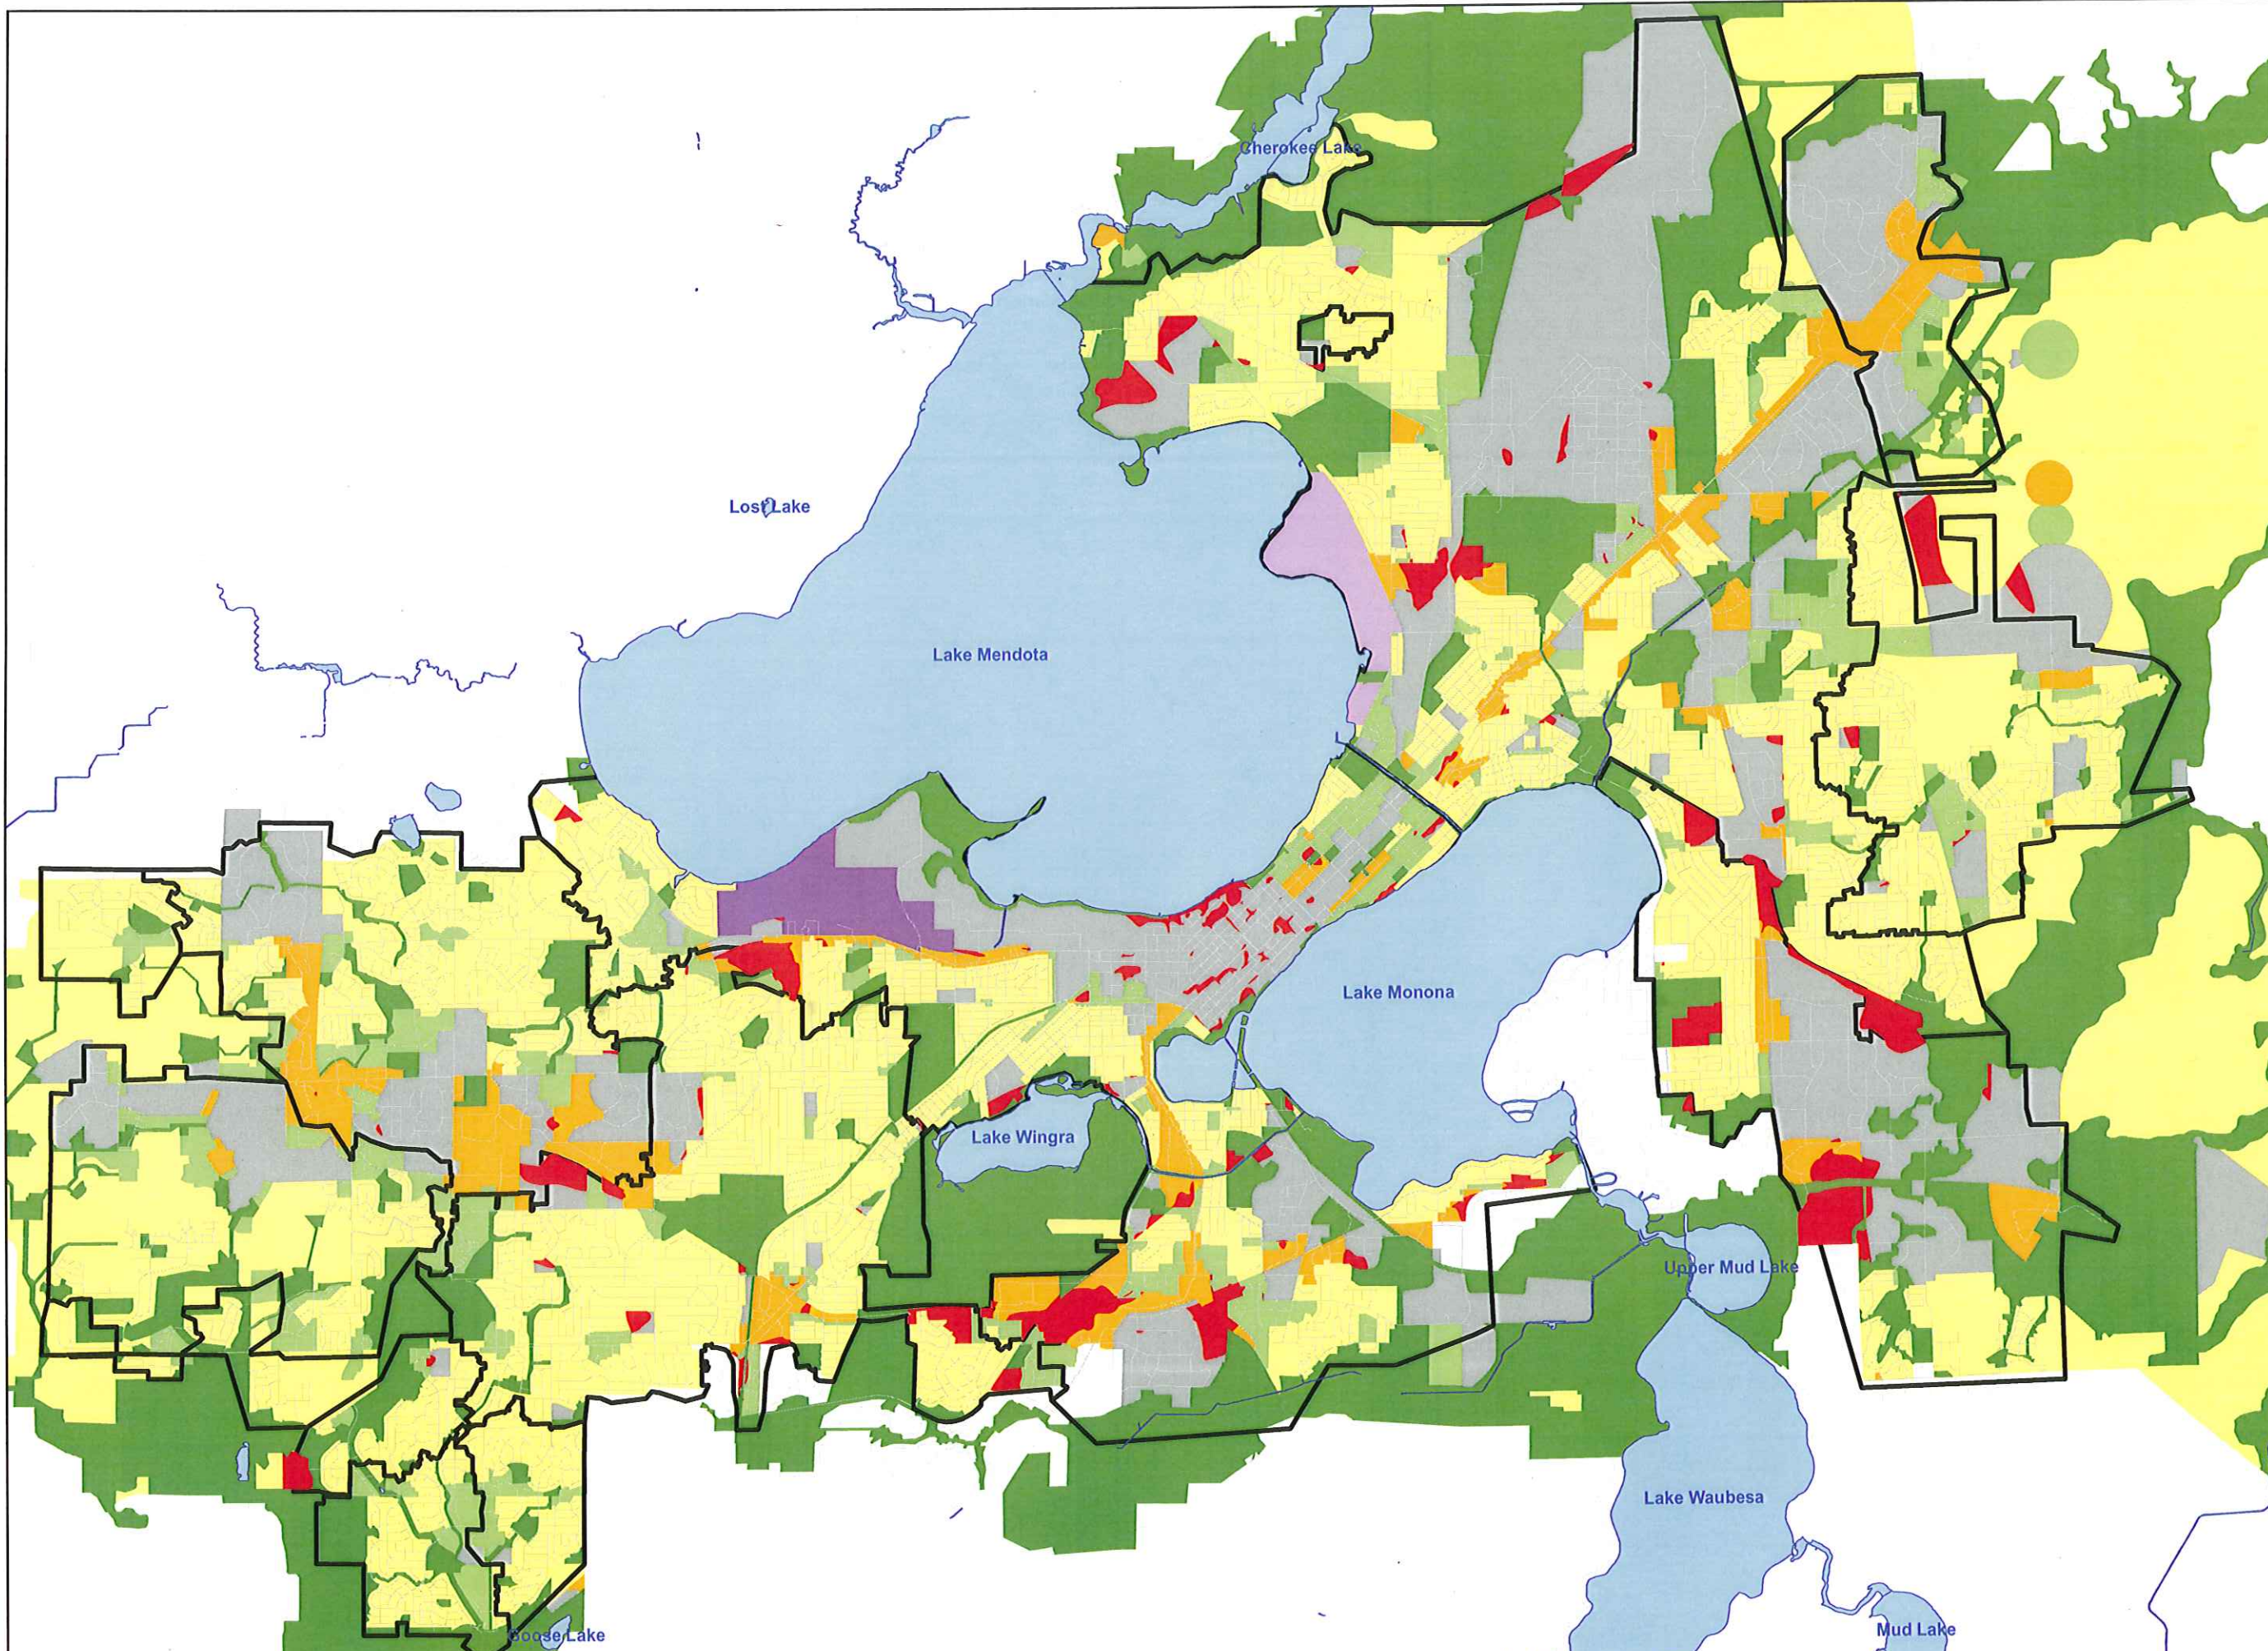

Miles

1:74,000