



CONTRACT NO

KEY NOTES:

- 1 EXCAVATION SLOPE TO BE DETERMINED BY CONTRACTOR AND SHALL MEET OSHA REQUIREMENTS.
- (2) 4-INCH PERFORATED UNDERDRAIN. SLOPE PIPE TO DRAIN TOWARDS THE SOUTH END OF THE SITE. DAYLIGHT PIPE AT APPROX. ELEVATION 896. PROVIDE PIPE DRAIN GRATE AT END
- FORM WORK FOR NEW WALL MUST BE TIED TO THE EX. WALL SUCH THAT THE PRESSURE FROM THE WET CONCRETE IS BALANCED BETWEEN THE NEW FORM AND EX. WALL. EXTERNAL BRACING OF ONLY THE WALL FORM, COULD CAUSE THE EXISTING WALL TO FAIL UNDER THE PRESSURE OF WET CONCRETE IF NOT PROPERLY BRACED, ADHESIVE ANCHORS INTO THE EXISTING WALL MAY BE REQUIRED WHERE THE EAST SIDE OF WALL IS NOT ACCESSIBLE. CONTACT ENGINEER FOR REVIEW IF FORMING REQUIREMENTS ARE NOT CLEAR.

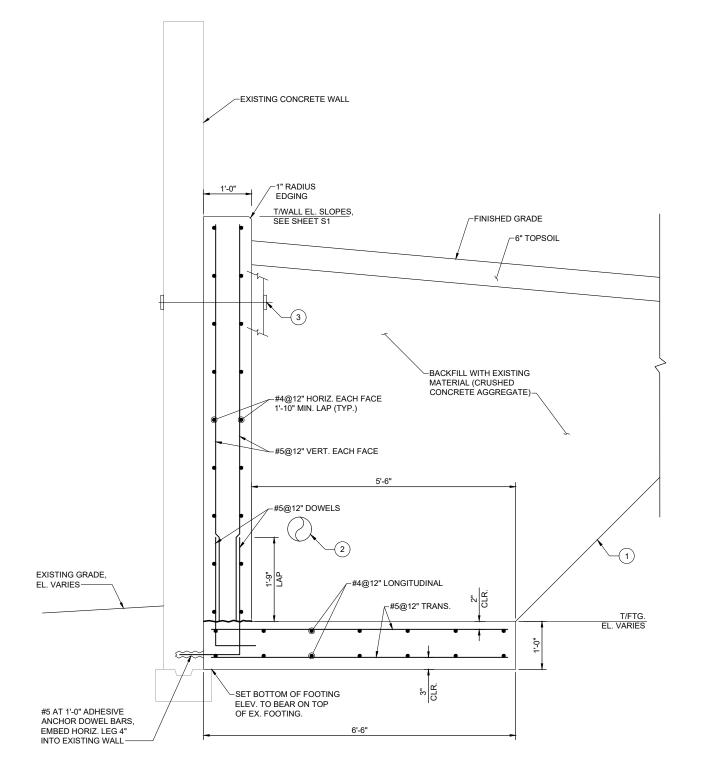

TYPICAL WALL SECTION (NO SCALE)

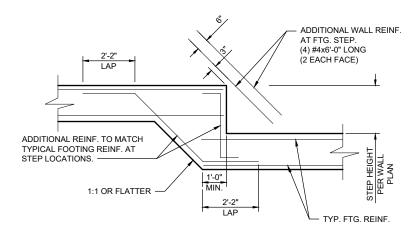

NOTES:

- SEE PLAN FOR FOOTING STEP DIMENSIONS AND TYPICAL WALL AND FOOTING REINFORCING.
- 2. STEPPED FOOTING TO BE POURED MONOLITHICALLY.

