

URBAN DESIGN COMMISSION APPLICATION

UDC

City of Madison
Planning Division
Madison Municipal Building, Suite 017
215 Martin Luther King, Jr. Blvd.
P.O. Box 2985
Madison, WI 53701-2985
(608) 266-4635



FOR OFFICE USE ONLY:

Date Received 5/28/24 10:09 a.m. Initial Submittal

Paid _____ Revised Submittal

Complete all sections of this application, including the desired meeting date and the action requested. If your project requires both UDC and Land Use application submittals, a completed [Land Use Application](#) and accompanying submittal materials are also required to be submitted.

If you need an interpreter, translator, materials in alternate formats or other accommodations to access these forms, please call the Planning Division at (608) 266-4635.

Si necesita interprete, traductor, materiales en diferentes formatos, u otro tipo de ayuda para acceder a estos formularios, por favor llame al (608) 266-4635.

Yog tias koj xav tau ib tug neeg txhais lus, tus neeg txhais ntawv, los sis xav tau cov ntaub ntawv ua lwm hom ntawv los sis lwm cov kev pab kom paub txog cov lus qhia no, thov hu rau Koog Npaj (Planning Division) (608) 266-4635.

1. Project Information

Address (list all addresses on the project site): 3535 -3553 University Ave

Title: 3575 University Avenue

2. Application Type (check all that apply) and Requested Date

UDC meeting date requested July 17, 2024

- New development Alteration to an existing or previously-approved development
 Informational Initial Approval Final Approval

3. Project Type

- Project in an Urban Design District
 Project in the Downtown Core District (DC), Urban Mixed-Use District (UMX), or Mixed-Use Center District (MXC)
 Project in the Suburban Employment Center District (SEC), Campus Institutional District (CI), or Employment Campus District (EC)
 Planned Development (PD)
 General Development Plan (GDP)
 Specific Implementation Plan (SIP)
 Planned Multi-Use Site or Residential Building Complex

Signage

- Comprehensive Design Review (CDR)
 Modifications of Height, Area, and Setback
 Sign Exceptions as noted in [Sec. 31.043\(3\)](#), MGO

Other

- Please specify _____

4. Applicant, Agent, and Property Owner Information

Applicant name Randy Christianson
Street address 702 N. High Point Rd
Telephone 608.235.9020

Company Walter Wayne Development
City/State/Zip Madison WI, 53717
Email rc@starkcommercial.com

Project contact person Patrick Terry
Street address 800 W Broadway - Suite 200
Telephone 608.442.3823

Company JLA Architects + Planners
City/State/Zip Monona WI, 53713
Email pterry@jla-ap.com

Property owner (if not applicant) University 3000 LLC
Street address 1741 Commercial Ave
Telephone 608.255.3573

City/State/Zip Madison WI, 53713
Email bbosben@apexrents.com

Introduction

The City of Madison's Urban Design Commission (UDC) has been created to:

- Encourage and promote high quality in the design of new buildings, developments, remodeling, and additions so as to maintain and improve the established standards of property values within the City.
- Foster civic pride in the beauty and nobler assets of the City, and in all other ways possible assure a functionally efficient and visually attractive City in the future.

Types of Approvals

There are three types of requests considered by the UDC:

- Informational Presentation. A request for an Informational Presentation to the UDC may be requested prior to seeking any approvals to obtain early feedback and direction before undertaking detailed design efforts. Applicants should provide details on the context of the site, design concept, site and building plans, and other relevant information to help the UDC understand the proposal and provide feedback. (Does not apply to CDR's or Signage Modification requests)
- Initial Approval. Applicants may, at their discretion, request Initial Approval of a proposal by presenting preliminary design information. As part of their review, the Commission will provide feedback on the design information that should be addressed at Final Approval stage.
- Final Approval. Applicants may request Final Approval of a proposal by presenting all final project details. Recommendations or concerns expressed by the UDC in the Initial Approval must be addressed at this time.

Presentations to the Commission

The Urban Design Commission meets virtually via Zoom, typically on the second and fourth Wednesdays of each month at 4:30 p.m. Applicant presentations are strongly encouraged, although not required. Prior to the meeting, each individual speaker is required to complete an online registration form to speak at the meeting. A link to complete the online registration will be provided by staff prior to the meeting. Please note that individual presentations will be limited to a **maximum of three (3) minutes**. The pooling of time may be utilized to provide one speaker more time to present, however the additional time will be based on the number of registrants from the applicant team, i.e. two (2) applicant registrants = six (6) minutes for one (1) speaker.

Primarily, the UDC is interested in the appearance and design quality of projects. Emphasis should be given to the site plan, landscape plan, lighting plan, building elevations, exterior building materials, color scheme, and graphics. Please note that presentation slides, in a PDF file format, are required to be submitted **the Friday before** the UDC meeting.

URBAN DESIGN DEVELOPMENT PLANS CHECKLIST

The items listed below are minimum application requirements for the type of approval indicated. Please note that the UDC and/or staff may require additional information in order to have a complete understanding of the project.

1. Informational Presentation

- Locator Map
- Letter of Intent (If the project is within an Urban Design District, a summary of how the development proposal addresses the district criteria is required)
- Contextual site information, including photographs and layout of adjacent buildings/structures
- Site Plan
- Two-dimensional (2D) images of proposed buildings or structures.

Providing additional information beyond these minimums may generate a greater level of feedback from the Commission.

Requirements for All Plan Sheets

1. Title block
2. Sheet number
3. North arrow
4. Scale, both written and graphic
5. Date
6. Fully dimensioned plans, scaled at 1"= 40' or larger

*** All plans must be legible, including the full-sized landscape and lighting plans (if required)*

2. Initial Approval

- Locator Map
- Letter of Intent (If the project is within a Urban Design District, a summary of how the development proposal addresses the district criteria is required)
- Contextual site information, including photographs and layout of adjacent buildings/structures
- Site Plan showing location of existing and proposed buildings, walks, drives, bike lanes, bike parking, and existing trees over 18" diameter
- Landscape Plan and Plant List (*must be legible*)
- Building Elevations in **both** black & white and color for all building sides, including material and color callouts
- PD text and Letter of Intent (if applicable)

Providing additional information beyond these minimums may generate a greater level of feedback from the Commission.

3. Final Approval

All the requirements of the Initial Approval (see above), **plus**:

- Grading Plan
- Lighting Plan, including fixture cut sheets and photometrics plan (must be legible)
- Utility/HVAC equipment location and screening details (with a rooftop plan if roof-mounted)
- Site Plan showing site amenities, fencing, trash, bike parking, etc. (if applicable)
- PD text and Letter of Intent (if applicable)
- Samples of the exterior building materials
- Proposed sign areas and types (if applicable)

4. Signage Approval (*Comprehensive Design Review (CDR), Sign Modifications, and Sign Exceptions (per [Sec. 31.043\(3\)](#))*)

- Locator Map
- Letter of Intent (a summary of how the proposed signage is consistent with the CDR or Signage Modifications criteria is required)
- Contextual site information, including photographs of existing signage both on site and within proximity to the project site
- Site Plan showing the location of existing signage and proposed signage, dimensioned signage setbacks, sidewalks, driveways, and right-of-ways
- Proposed signage graphics (fully dimensioned, scaled drawings, including materials and colors, and night view)
- Perspective renderings (emphasis on pedestrian/automobile scale viewsheds)
- Illustration of the proposed signage that meets [Ch. 31, MGO](#) compared to what is being requested
- Graphic of the proposed signage as it relates to what the [Ch. 31, MGO](#) would permit

5. Required Submittal Materials

Application Form

- A completed application form is required for each UDC appearance. For projects also requiring Plan Commission approval, applicants must also have submitted an accepted application for Plan Commission consideration prior to obtaining any formal action (Initial or Final Approval) from the UDC.

Letter of Intent

- If the project is within an Urban Design District, a summary of how the development proposal addresses the district criteria is required.
- For signage applications, a summary of how the proposed signage is consistent with the applicable Comprehensive Design Review (CDR) or Signage Modification review criteria is required.

Development Plans (Refer to checklist on Page 4 for plan details)

Filing Fee (Refer to Section 7 (below) for a list of application fees by request type)

Electronic Submittal

- Complete electronic submittals must be received prior to the application deadline before an application will be scheduled for a UDC meeting. Late materials will not be accepted. All plans must be legible and scalable when reduced. Individual PDF files of each item submitted should be submitted via email to UDCapplications@cityofmadison.com. The email must include the project address, project name, and applicant name.
- Email Size Limits. Note that an individual email cannot exceed 20MB and it is the responsibility of the applicant to present files in a manner that can be accepted. Applicants who are unable to provide the materials electronically should contact the Planning Division at (608) 266-4635 for assistance.

Notification to the District Alder

- Please provide an email to the District Alder notifying them that you are filing this UDC application. Please send this as early in the process as possible and provide a copy of that email with the submitted application.

6. Applicant Declarations

1. Prior to submitting this application, the applicant is required to discuss the proposed project with Urban Design Commission staff. This application was discussed with Jessica Vaughn on May 23, 2024.
2. The applicant attests that all required materials are included in this submittal and understands that if any required information is not provided by the application deadline, the application will not be placed on an Urban Design Commission agenda for consideration.

Name of applicant Randy Christianson Relationship to property Owner's Agent

Authorizing signature of property owner Randy Christianson Date 5/28/2024

7. Application Filing Fees

Fee payments are due by the submittal date. Payments received after the submittal deadline may result in the submittal being scheduled for the next application review cycle. Fees may be paid in-person, via US Mail, or City drop box. If mailed, please mail to: *City of Madison Building Inspection, P.O. Box 2984, Madison, WI 53701-2984*. The City's drop box is located outside the Municipal Building at 215 Martin Luther King, Jr. Blvd. on the E Doty Street side of the building. Please make checks payable to *City Treasurer*, and include a completed application form or cover letter indicating the project location and applicant information with all checks mailed or submitted via the City's drop box.

Please consult the schedule below for the appropriate fee for your request:

- Urban Design Districts: \$350 (per [§33.24\(6\) MGO](#)).
- Minor Alteration in the Downtown Core District (DC) or Urban Mixed-Use District (UMX) : \$150 (per [§33.24\(6\)\(b\) MGO](#))
- Comprehensive Design Review: \$500 (per [§31.041\(3\)\(d\)\(1\)\(a\) MGO](#))
- Minor Alteration to a Comprehensive Sign Plan: \$100 (per [§31.041\(3\)\(d\)\(1\)\(c\) MGO](#))
- All other sign requests to the Urban Design Commission, including, but not limited to: appeals from the decisions of the Zoning Administrator, requests for Sign Modifications (of height, area, and setback), and additional sign code approvals: \$300 (per [§31.041\(3\)\(d\)\(2\) MGO](#))

A filing fee is not required for the following project applications if part of the combined application process involving both Urban Design Commission and Plan Commission:

- Project in the Downtown Core District (DC), Urban Mixed-Use District (UMX), or Mixed-Use Center District (MXC)
- Project in the Suburban Employment Center District (SEC), Campus Institutional District (CI), or Employment Campus District (EC)
- Planned Development (PD): General Development Plan (GDP) and/or Specific Implementation Plan (SIP)
- Planned Multi-Use Site or Residential Building Complex



JLA
ARCHITECTS

City of Madison Plan Commission & Urban Design Commission
c/o City of Madison Planning Division
215 Martin Luther King Jr. Blvd | Suite 017
Madison, WI 53701

May 28, 2024

sent via email only:

Plan Commission: PCApplications@cityofmadison.com
Urban Design Commission: UDCAplications@cityofmadison.com

Re: Letter of Intent
Plan Commission Land Use Application & Urban Design Commission Final Approval
Project: 3575 University Ave Mixed-Use Development (Working Name)
Madison, WI 53705

City of Madison Plan Commission & Urban Design Commission -

On behalf of our client and 'Applicant' – University 3000 LLC – we are pleased to submit applications to the City of Madison Plan Commission & Urban Design Commission for final land use & design for 3575 University Avenue Mixed-Use Development – as well as the demolition of existing structures associated with it. Enclosed in the digital application submittals to each Commission are the submittal requirements that detail this project. This 'Letter of Intent' serves to summarize this Project.

Project Team:

Owner: University 3000 LLC, 1741 Commercial Ave, Madison, WI 53713
Developer: Walter Wayne Development, 702 N. High Point Rd | Suite 200, Madison, WI 53717
Architect of Record: JLA Architects + Planners, 800 West Broadway | Suite 200, Monona, WI 53713
Civil Engineer & Landscape: JSD Engineers, 507 W Verona Ave | Suite 500, Verona, WI 53593
Structural Engineer: Spire Engineering, 305 N. Plankinton Avenue | Suite 101, Milwaukee, WI 53203

Site:

The project consists of two 0.35-acre parcels on the south side of University Ave, currently addressed as 3535 University Ave and 3553 University Ave. These parcels will be combined into one parcel with a concurrent Certified Survey Map (CSM) process.

The Project site is within the confines of the Sunset Village Community, Urban Design District 6 and the 5th Aldermanic District. It is also part of Madison's Bus Rapid Transit system.

Lot Size = 30,250 SF / .70 acre
Lot Area/Dwelling Unit = 426 SF/Unit
Open Space Requirement = 40 SF/Unit

Dwelling Units = 71
Density = 101 Units/Acre
Total Open Space Required = 2,840 SF

Zoning:

The parcels are currently zoned as PD. A new CSM will create one parcel, addressed as 3575 University Ave, and zoned Commercial Corridor -Transitional District (CC-T).

The parcel abuts residential districts on the west and south property lines. Per Madison Zoning Ordinance Section 28.067 where the CCT district abuts a residential district there is a vertical setback of one foot run to one foot rise above 25'. This project is asking for conditional approval to build within this vertical setback along the south property line. This is illustrated on U300 of the submittal documents 'Building Sections.' The building is within the vertical setback on the west property line. We have worked to honor the intent of the ordinance by creating a step back on the fifth floor, but strict adherence to the ordinance would make the building impractical and inefficient. In addition, the residential district to the south is approximately 6' higher than the setback line the vertical offset is measured from. Please reference sheets U400 and U401 that contain shadow studies for the property as they show the building will not cast shadows on the neighboring residences.

Demolition:

Two existing structures will be razed as part of the project. They are both two-story commercial buildings (address between 3535 & 3553 University Ave). This is illustrated on sheet C200 of the submittal documents – 'Demolition Plan.' Photos of the existing structure are included on pages U003 through U009 of the submittal.

Existing Conditions – Utilities

An existing 10' public storm and sanitary easement; that bisects the parcels and extends from Bruce Court to University Ave, will be vacated. A new easement will route sanitary and storm utilities around the west end of the proposed building and reconnect to the existing storm and sanitary laterals located under University Ave.

Existing Conditions – Trees

Four mature trees line the terrace of the project. After coordination with Brad Hoffman, City of Madison Forestry, it was decided the eastern-most and western-most trees will remain. The trees closest to the existing driveway approach will be removed. University 3000 LLC will provide soil amendments to the replacement tree site due to the loss of the center two trees.

Project Overview:

The Project is a five story multi-family/commercial mixed-use building with approximately 67,000 gross square feet – as illustrated in the submitted design documents. The ground floor of the project contains 1,435 sq ft of ground floor multi-tenant commercial/retail space, tenant lobby, private fitness area and parking. There are two levels of underground parking, and 71 residential dwelling units. The fifth floor will house a community room with an outdoor terrace. The exact square footage may vary slightly as the design is refined and finalized.

The 71 residential units will have the following unit mix – as illustrated in the submitted design document.

- Studios Units: 39 units (55%)
- 1 bedroom: 23 units (32%)
- 2 bedrooms: 9 units (13%)

In addition to the 'program' spaces described above, the project will also contain service and support spaces like storage and mechanical rooms, and an interior refuse room.

Traffic, Circulation and Parking:

All parking for the project will be structured/internal parking. Tenants can enter the building using the existing University Ave approach or the new curb cut at the west end of the property. The center entrance will be limited to left in/left out turns between 7:00 to 9:00 AM and 4:00 to 6:00 PM Monday through Friday.

The approach on the west end will allow trash, delivery and moving vans to enter and turn around on site as shown on Exhibit 2 & 3 in the submittal documents. JLA coordinated with Waste Management to determine refuse trucks are 36' long. Refuse/recycling will be accessed from the south side of the building.

Retail patrons will park inside the building. Patrons will either be let in by the tenant by appointment or have the west overhead door open during hours of operation.

The final parking count will contain:

- At least 10% 'Electric Vehicle Ready' Spaces – per MGO 28.141(8)(e)
- At least 2% 'Electric Vehicle Installed' Spaces – per MGO 28.141(8)(e)

In addition to vehicular parking, the project will have 80 bicycle parking spaces to meet the requirements of MGP 28.141(11).

- Residential Long Term (Interior) 62
- Residential Short Term (Interior) 9
- Commercial Short Term (Interior) 1
- Guest / Short Term (Exterior) 8

To prevent overflow parking on Bruce Court the applicant will maintain (or replace if necessary) the existing fence. In addition to the fence there will be a retaining wall to discourage pedestrian traffic from University Ave onto Bruce Court.

Architecture:

The building is designed with a traditional aesthetic – meant to relate to the urban and residential design aesthetic of the area. It will be built with high quality materials, primarily consisting of masonry and fiber-cement siding. Covered parking is accessed from an existing curb cut on University Ave.

Urban Design Commission:

The project was presented to the Urban Design Commission on May 8, 2024. It was received with mixed reviews. Notable items that were discussed include:

- The ground floor needed to be redesigned to activate the pedestrian experience.
 - Celebrate the building entry and commercial spaces.
- Increase the ratio of glass to masonry.
- Recess the balconies instead of hanging balconies.

To address these issues the lobby has been moved to the east corner of the building allowing the commercial space and lobby to anchor the street corners of the building.

Balconies along University Ave are all semi/recessed.

Storefront windows were added along the entire façade.

Neighborhood Engagement:

The ownership and design team has met with City officials on numerous occasions, and will continue to collaborate with City staff through design, entitlements and during construction.

- DAT meeting was held April 11, 2024
- Preapplication Meeting was held April 17, 2024
- List-SERV Notice – April 17, 2024
- Alder Meeting – April 22, 2024
- UDC Informational Submittal – April 22, 2024
- UDC Informational Meeting – May 8, 2024
- Neighborhood Meeting – May 20, 2024
- Land Use Application Submittal – May 28, 2024
- UDC Meeting – July 17, 2024
- Plan Commission Meeting – July 28, 2024
- Common Council Meeting – August 8, 2024

Project Schedule:

Demolition – December 2024

Construction – February 2025 – March 2026

Thank you for your time in reviewing our proposal.

Sincerely,



Patrick Terry
Project Manager

3575 UNIVERSITY AVENUE

(CURRENTLY ADDRESSED 3535 - 3553 UNIVERSITY AVENUE)



SHEET INDEX	
	COVER
U001	PROJECT DATA
U002	SITE CONTEXT
U003	EXISTING SITE PLAN
U004	WEST BUILDING - EXTERIOR PHOTOS
U005	WEST BUILDING - EXTERIOR PHOTOS
U006	WEST BUILDING - INTERIOR PHOTOS
U007	EAST BUILDING - EXTERIOR PHOTOS
U008	EAST BUILDING - EXTERIOR PHOTOS
U009	EAST BUILDING - EXTERIOR PHOTOS
U010	USABLE OPEN SPACE - FIRST FLOOR
U011	USEABLE OPEN SPACE - 2ND THRU 5TH FLR
U012	LIGHTING CALCULATIONS
1 OF 1	EXISTING CONDITIONS SURVEY
C100	NOTES & LEGEND
C101	NOTES & LEGEND
C200	DEMOLITION PLAN
C300	DIMENSIONED SITE PLAN
C301	ANNOTATED SITE PLAN
C302	SITE PLAN, NW EAS/MNET EXHIBIT
C400	GRADING & EROSION CONTROL PLAN
C500	UTILITY PLAN
C600	DETAILS
C601	UTILITY DETAILS
C602	CITY OF MADISON DETAILS
L100	OVERALL LANDSCAPE PLAN
L101	DETAILED LANDSCAPE PLAN
L200	LANDSCAPE DETAILS & NOTES
EX. 1	FIRE ACCESS
EX. 2	TRASH TRUCK TURN MOVEMENT
EX. 3	DELIVERY TRUCK TURN MOVEMENT
U100	TYPICAL BELOW GRADE PARKING LAYOUT
U101	FIRST FLOOR PLAN
U102	SECOND FLOOR PLAN
U103	FIFTH FLOOR PLAN
U104	ROOF PLAN
U105	BUILDING SECTIONS
U106	UNIVERSITY AVENUE SETBACK DIAGRAM
U201	NORTH ELEVATION
U202	SOUTH ELEVATION
U203	EAST & WEST ELEVATION
U204	NORTH ELEVATION - B/W
U205	SOUTH ELEVATION - B/W
U206	EAST & WEST ELEVATION - B/W
U207	NORTH ELEVATION - BIRDGLASS
U208	SOUTH ELEVATION - BIRDGLASS
U209	EAST & WEST ELEVATION - BIRDGLASS
U210	BIRDGLASS CALCULATIONS
U400	SHADOW STUDY - MARCH/JUNE
U401	SHADOW STUDY - SEPT/DEC
U402	BUILDING RENDERING LOOKING WEST
U403	BUILDING RENDERING LOOKING EAST
U404	STREET VIEW LOOKING WEST
U405	STREET VIEW LOOKING WEST
U406	PROPOSED VIEW - BRUCE COURT
N500	MATERIAL BOARD

7/9/2024 7:26:38 PM



3575 UNIVERSITY AVENUE

COVER

JLA PROJECT No: W23-0222

CITY OF MADISON LAND USE AND URBAN DESIGN COMMISSION SUBMITTAL

7/10/24

UNIT NAME	STUDIO				1 BEDROOM					2 BEDROOMS			(1) TOTAL UNITS	(1) TOTAL BEDROOMS	COMMERCIAL NET AREA LEASABLE	COMMON AMENITY SPACE (1/2)	RESIDENTIAL NET AREA LEASABLE	GROSS AREA (S.F.)	EFFICIENCY	PARKING AREA (S.F.)	RESIDENTIAL PARKING			COMMERCIAL PARKING			PARKING TOTAL	PARKING RATIOS			BICYCLES TOTAL						
	A1	A2	A3	A4	B1	B2	B3	B4	B5	D1	D2	D3									COVERED	SURFACE	TOTAL	COVERED	SURFACE	TOTAL		RESIDENTIAL	RETAIL	TOTAL							
BEDROOMS	1	1	1	1	1	1	1	1	1	2	2	2																									
AREA (S.F.)	491	532	578	597	717	752	761	775	781	1,186	1,395	1,475																									
5	1	3	2				1					1	11	14	-	1,730	9,050	13,130	82.1%																		
4	1	5	3	2	2	4		1		2			20	22	-	-	13,668	15,990	85.5%																		
3	1	5	3	2	2	4		1		2			20	22	-	-	13,668	15,990	85.5%																		
2	1	5	3	2	2	4		1		2			20	22	-	-	13,668	15,990	85.5%																		
1													0	0	1,440	2,740	-	-	4,870	85.8%	11,350				4	0	4	4	0	4	8				26		
LL/P1																									16,975	34		34						34	28		
LL/P2																									16,975	34		34						34	28		
TOTALS	4	18	11	6	6	12	1	3	1	6	2	1	71	80	1,440	4,470	50,054	65,970	84.8%	45,300				72	0	72	4	0	4	76	1.01	0.90	2.78	82			
PERCENT	5.63%	25.35%	15.49%	8.45%	8.45%	16.90%	1.41%	4.23%	1.41%	8.45%	2.82%	1.41%	100.00%																								
	54.93%				32.39%					12.68%			100.00%																								

705 Average N.S.F. per unit
596 Average S.F. per space
909 Average G.S.F per unit
(not including commercial or parking areas)

SHARED PARKING			
TOTAL SPACES	PER UNIT	PER BR	PER 1K SF
76	1.07	0.95	

NOTES:


- GROSS AREA DOES NOT INCLUDE PARKING / SERVICE AREAS - ONLY FINISHED PROGRAM AREAS.
- FIRST FLOOR COMMON AMENITY SPACE INCLUDES LOBBY, MAIL ROOM, PACKAGE ROOM & FITNESS AREAS .
- PARKING AREAS INCLUDE THE STAIRS & ELEVATOR , MECHANICAL & SUPPORT AREAS
- PARKING FOR THE COMMERCIAL SPACES ASSUMES 1 SPACES PER 400 GSF
- GROSS UNIT AREA CALCULATED AT CENTERLINE OF DEMISING WALLS, CORRIDOR FACE OF STUD & EXTERIOR WALL FACE OF STUD PLUS BALCONIES

BICYCLE PARKING (REQUIRED)		
Required Bicycle Parking (Per Unit Type)	Required Bicycle Parking Totals	
STUDIO	1.0 per Unit	39
1 BEDROOM	1.0 per Unit	23
2 BEDROOM	1.0 per Unit	9
**Residential Sub-Total:		71
Residential Long Term - Floor (Min.)		53
Residential Long Term - Wall (25% Max.)		18
Total Long Term (Secured) Spaces:		71
RESIDENTIAL GUEST & COMMERCIAL SPACE BICYCLE PARKING		
Commercial Space	Area (SF)	TOTALS
Total Commercial Space	1440	1
Guest - Exterior (1 PER 10 Units)		7
Total Commercial/Short Term Spaces:		8
TOTAL REQUIRE SPACES:		79
** 90% LONG TERM PARKING REQUIRED:		64
** 10% SHORT TERM PARKING ACCEPTABLE:		8

BICYCLE PARKING (PROPOSED)		
BUILDING	TOTALS	
Residential Short Term - Floor (Interior - 1st)	0	
Residential Long Term - (Interior - 1st)	30	
Residential Long Term (Interior - P1)	20	
Residential Long Term - Interior - P2)	20	
Interior Residential Total Spaces:	76	
Commercial Space 1st Floor	2	
Guest/Short Term - Exterior	8	
Total Commercial/Short Term Spaces:	10	
TOTAL PROPOSED BICYCLE PARKING:	86	

ELECTRIC VEHICLE STALL INFORMATION:

TOTAL PARKING SPACES: 77
2% EV INSTALLED = 2
10% EV READY = 8

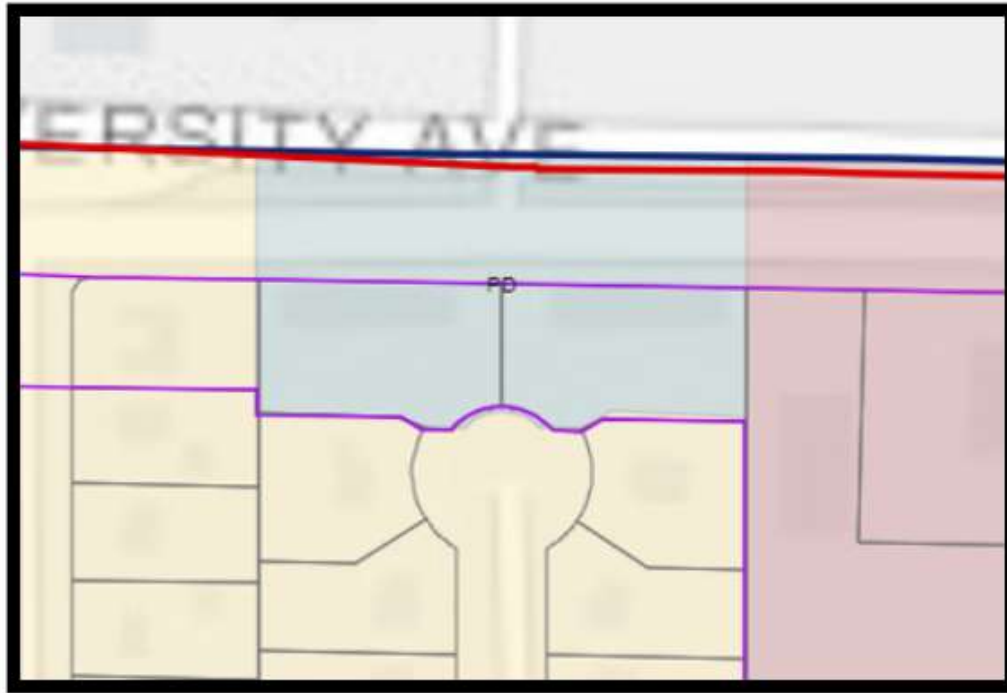

CURRENT ZONING: PD
REQUESTED ZONING: CC-T/FLEX BUILDING



PROJECT LOCATOR MAP

7/9/2024 7:26:38 PM



3575 UNIVERSITY AVENUE

SITE CONTEXT

JLA PROJECT No: W23-0222


CITY OF MADISON LAND USE AND URBAN DESIGN COMMISSION SUBMITTAL

U002

7/10/24



① EXISTING SITE PLAN
1/64" = 1'-0"



7/9/2024 7:26:38 PM



3575 UNIVERSITY AVENUE

EXISTING SITE PLAN

JLA PROJECT No: W23-0222

CITY OF MADISON LAND USE AND URBAN DESIGN COMMISSION SUBMITTAL

U003

7/10/24



EXISTING VIEW - WEST FACING



EXISTING WEST BUILDING
3553 UNIVERSITY AVENUE



WEST BUILDING PARKING
3553 UNIVERSITY AVENUE



WEST BUILDING - REAR

7/9/2024 7:26:38 PM



3575 UNIVERSITY AVENUE


WEST BUILDING - EXTERIOR PHOTOS

JLA PROJECT No: W23-0222



CITY OF MADISON LAND USE AND URBAN DESIGN COMMISSION SUBMITTAL

U005

7/10/24

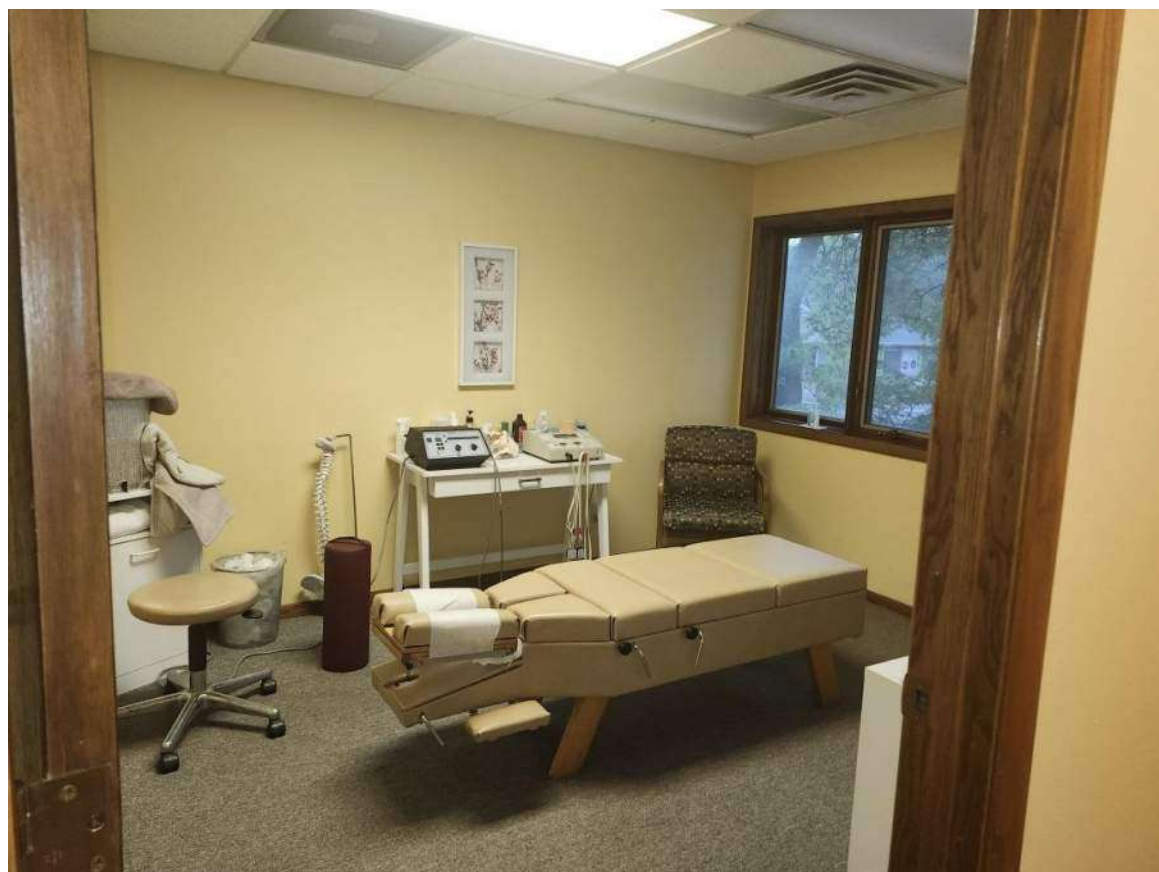

INTERIOR 3553 UNIVERSITY AVE

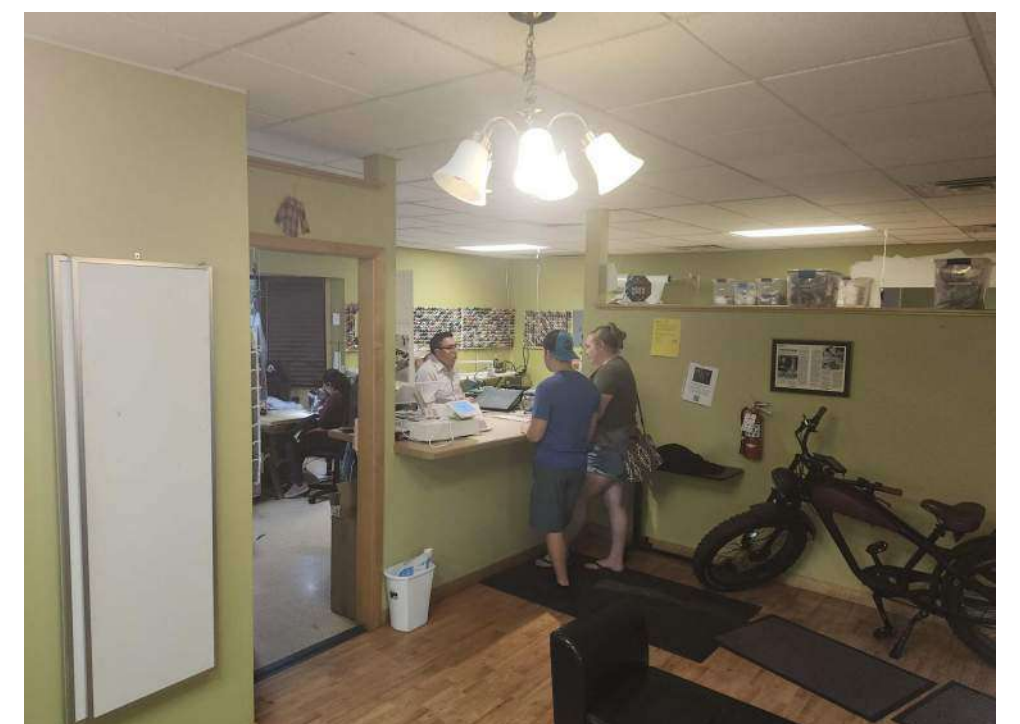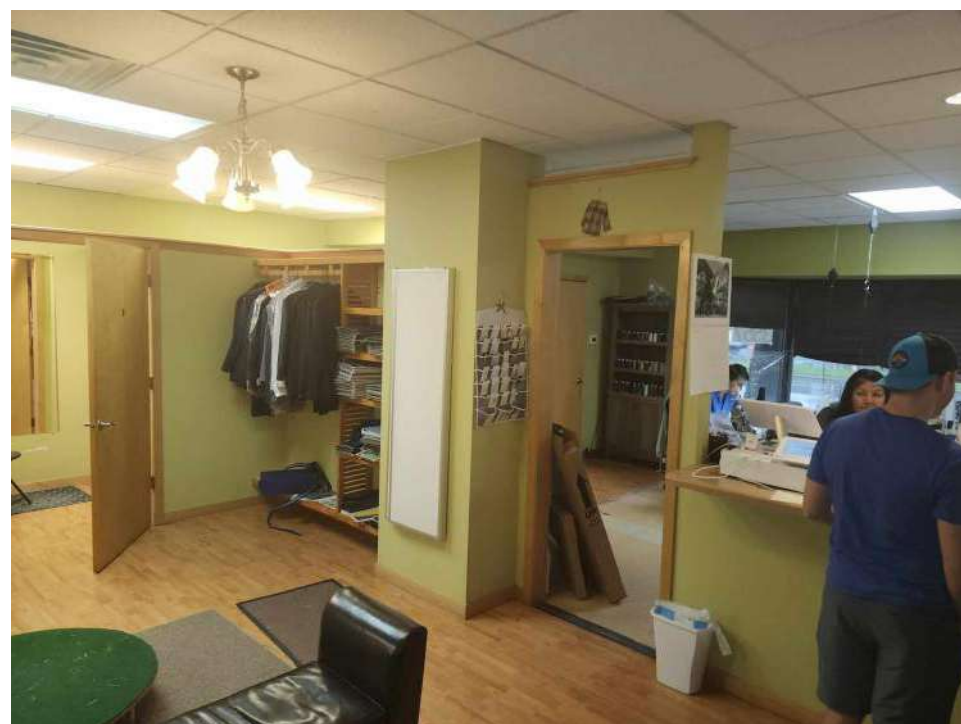

3575 UNIVERSITY AVENUE

WEST BUILDING - INTERIOR PHOTOS

CITY OF MADISON LAND USE AND URBAN DESIGN COMMISSION SUBMITTAL

U006

JLA PROJECT No: W23-0222

7/10/24

7/9/2024 7:26:39 PM





EXISTING EAST BUILDING
3535 UNIVERSITY AVENUE



EXISTING VIEW - EAST FACING

7/9/2024 7:26:39 PM



3575 UNIVERSITY AVENUE

EAST BUILDING - EXTERIOR PHOTOS

JLA PROJECT No: W23-0222


CITY OF MADISON LAND USE AND URBAN DESIGN COMMISSION SUBMITTAL

U007

7/10/24



EAST BUILDING REAR

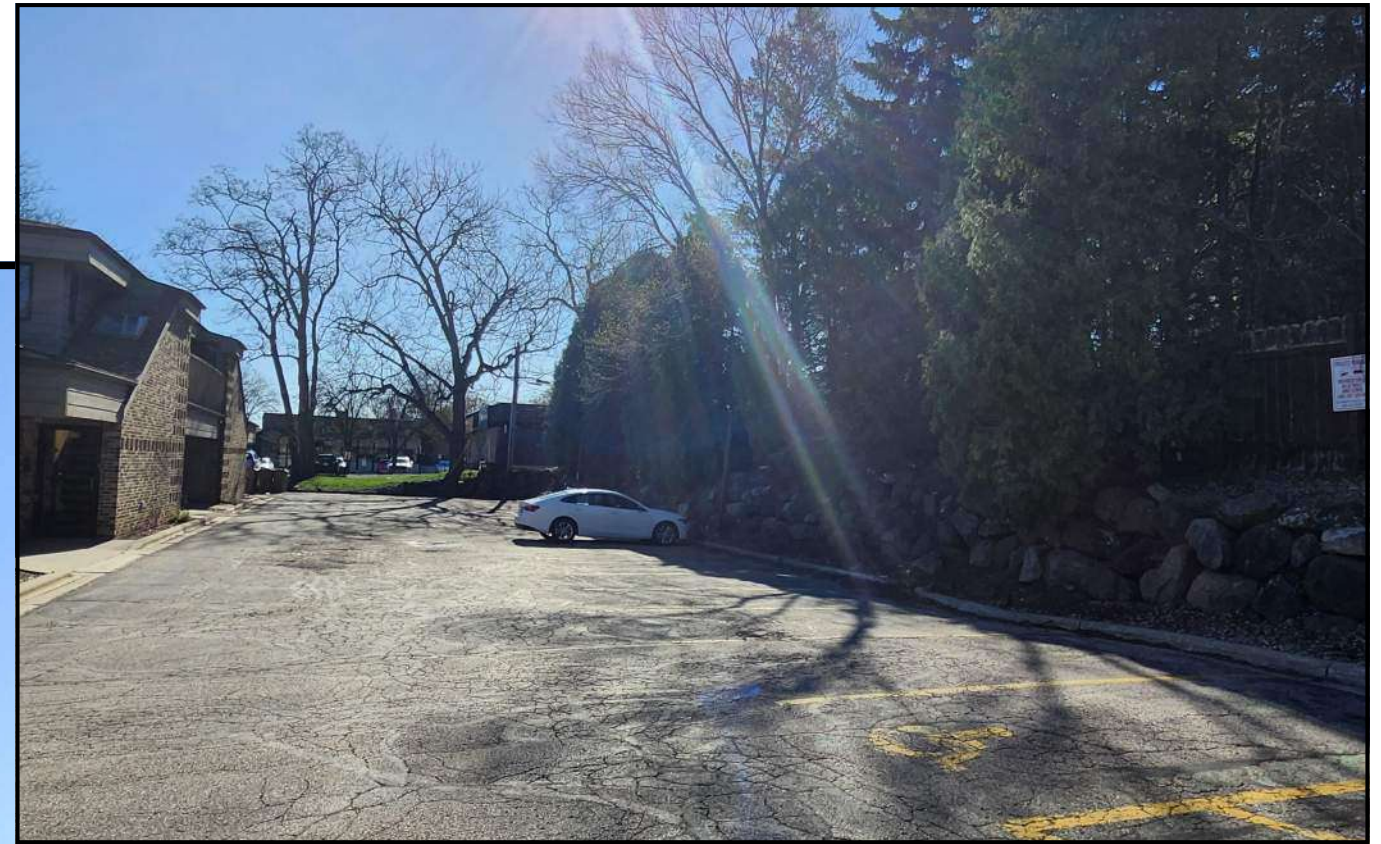

EAST BUILDING PARKING LOT
3535 UNIVERSITY AVENUE

7/9/2024 7:26:39 PM



3575 UNIVERSITY AVENUE



EAST BUILDING - EXTERIOR PHOTOS

JLA PROJECT No: W23-0222

CITY OF MADISON LAND USE AND URBAN DESIGN COMMISSION SUBMITTAL

U008

7/10/24

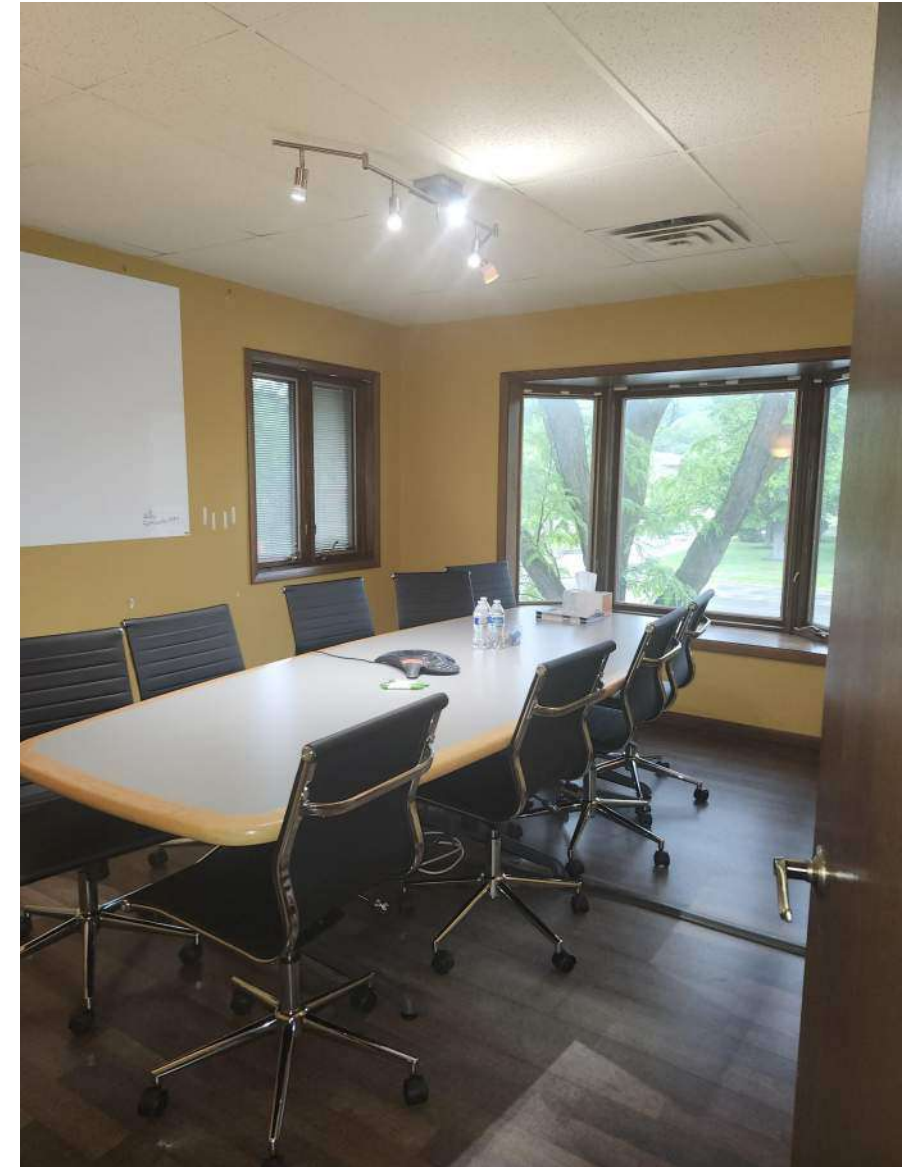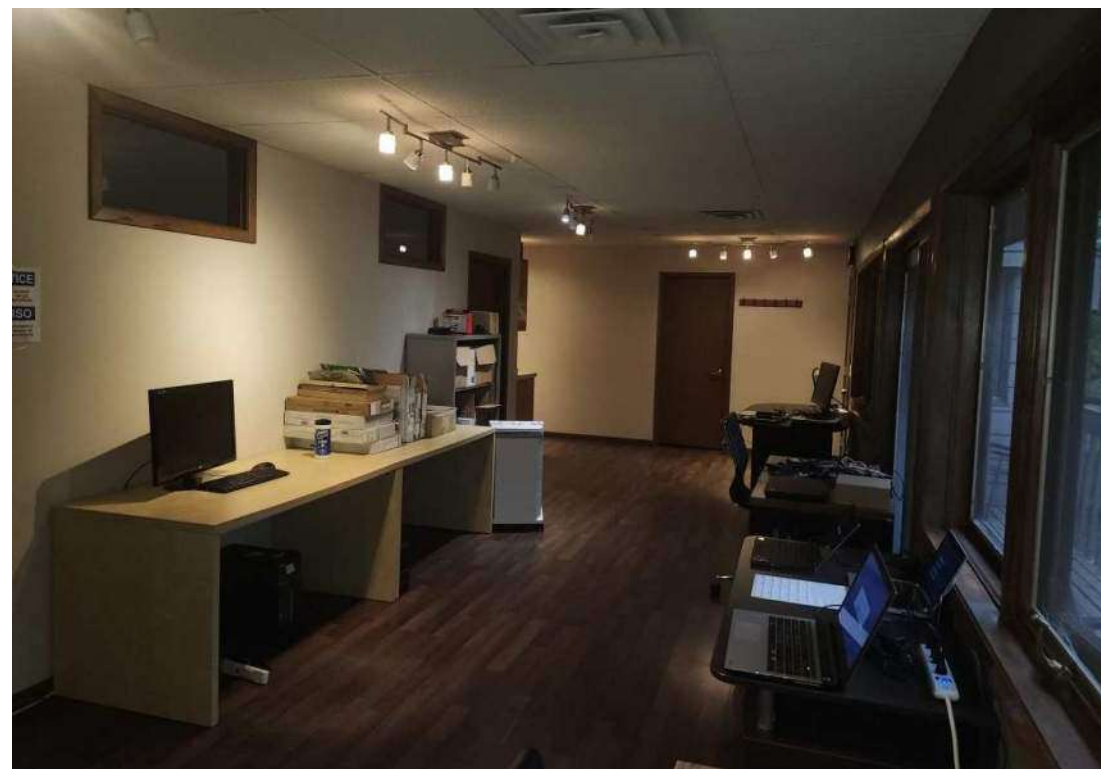

INTERIOR 3533 UNIVERSITY AVE

7/9/2024 7:26:39 PM



3575 UNIVERSITY AVENUE

EAST BUILDNG - INTERIOR PHOTOS

JLA PROJECT No: W23-0222

CITY OF MADISON LAND USE AND URBAN DESIGN COMMISSION SUBMITTAL

U009

7/10/24


USABLE OPEN AREA CHART

- DENOTES USABLE OPEN AREA ON PLAN 2,294 SF
- DENOTES USABLE OPEN AREA PRIVATE BALCONIES ON PLAN = 3,428 SF
- DENOTES USABLE OPEN AREA ROOF DECKS ON PLAN = 881 SF



REQUIRED USABLE OPEN AREA = 2,840 SF
(40 SF X 71 DWELLING UNITS)

TOTAL USABLE OPEN SPACE = 6,603 SF

UNIVERSITY AVENUE

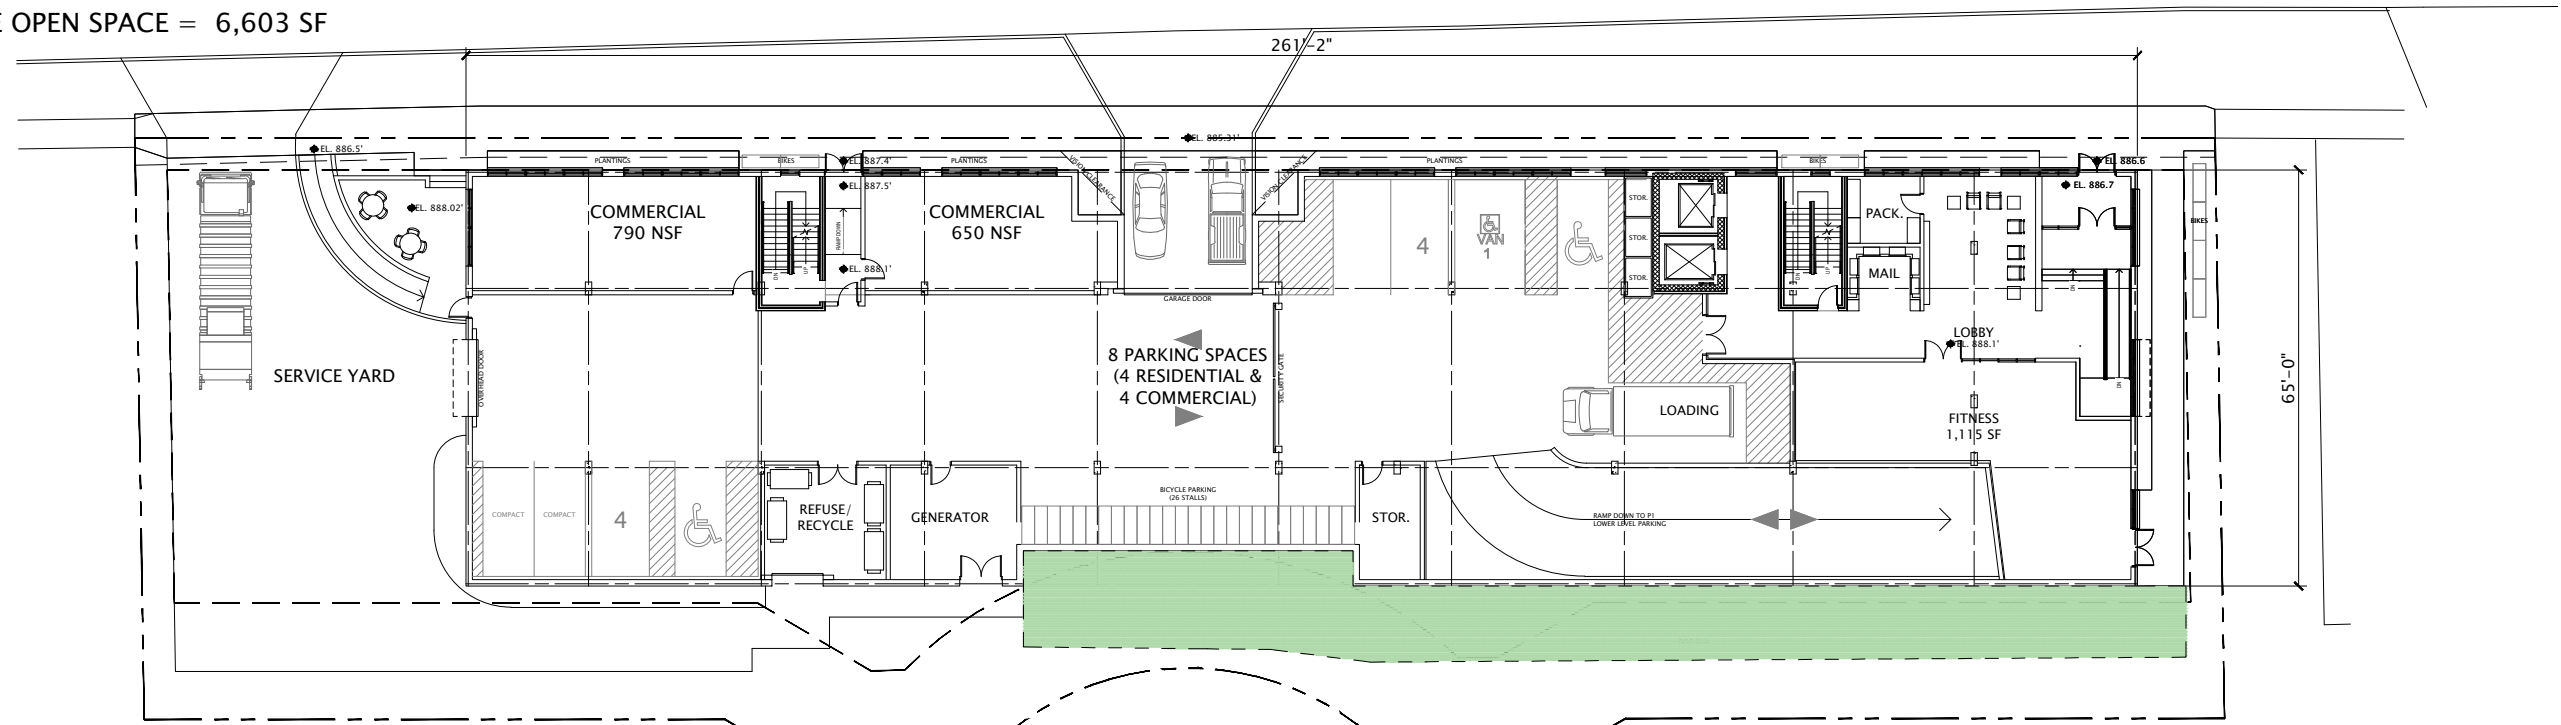

1 FIRST FLOOR PLAN
1" = 30'-0"

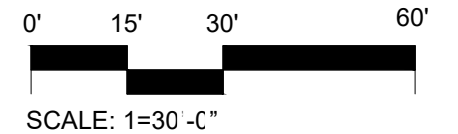

7/9/2024 7:26:39 PM



3575 UNIVERSITY AVENUE
USEABLE OPEN SPACE - FIRST FLOOR PLAN

JLA PROJECT No: W23-0222

CITY OF MADISON LAND USE AND URBAN DESIGN COMMISSION SUBMITTAL

U010



7/10/24

USABLE OPEN AREA CHART



- DENOTES USABLE OPEN AREA ON PLAN 2,294 SF
- DENOTES USABLE OPEN AREA PRIVATE BALCONIES ON PLAN = 3,428 SF
- DENOTES USABLE OPEN AREA ROOF DECKS ON PLAN = 881 SF

REQUIRED USABLE OPEN AREA = 2,840 SF
(40 SF X 71 DWELLING UNITS)

TOTAL USABLE OPEN SPACE = 6,603 SF

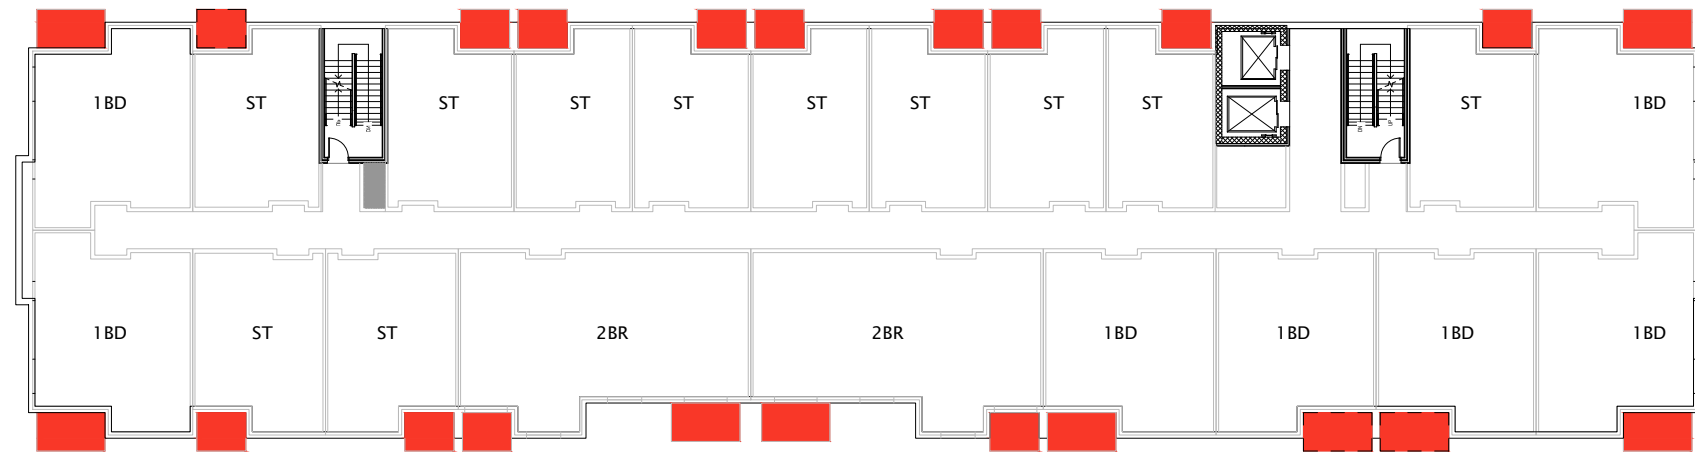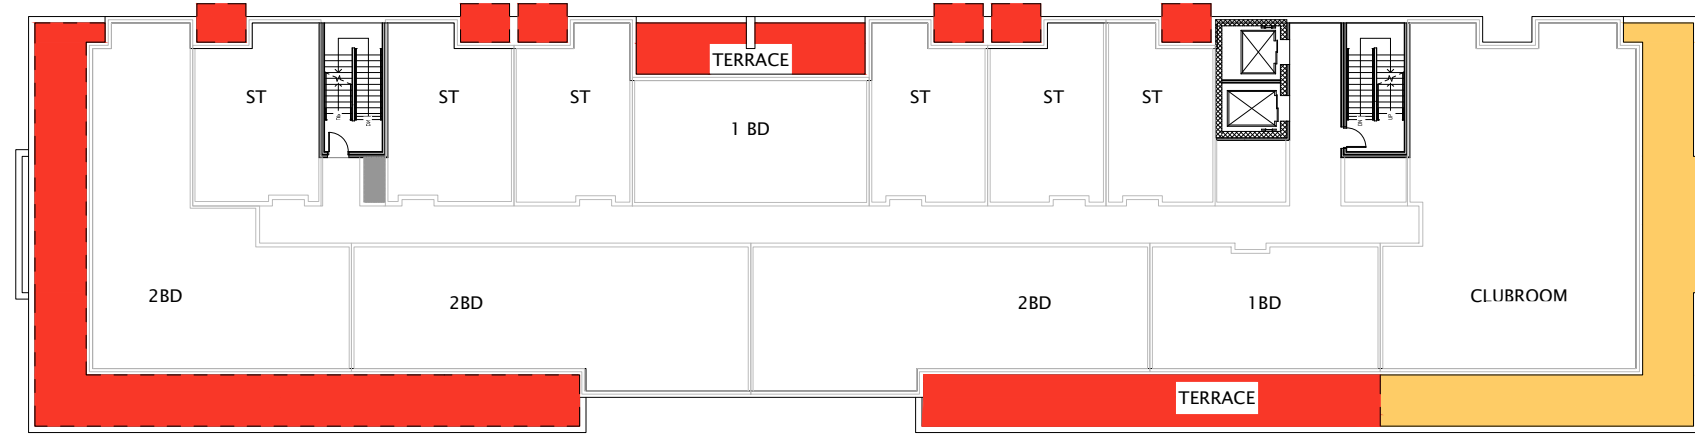

1 SECOND - FOURTH & FIFTH FLOOR PLANS
1" = 30'-0"

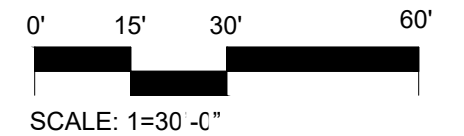

7/9/2024 7:26:39 PM



3575 UNIVERSITY AVENUE

USEABLE OPEN SPACE -2ND THRU 5TH FLOOR

JLA PROJECT No: W23-0222


CITY OF MADISON LAND USE AND URBAN DESIGN COMMISSION SUBMITTAL

U011

7/10/24

UNIVERSITY AVENUE

Z:\0 + Reference\Asset-9\floating-logo-90.png

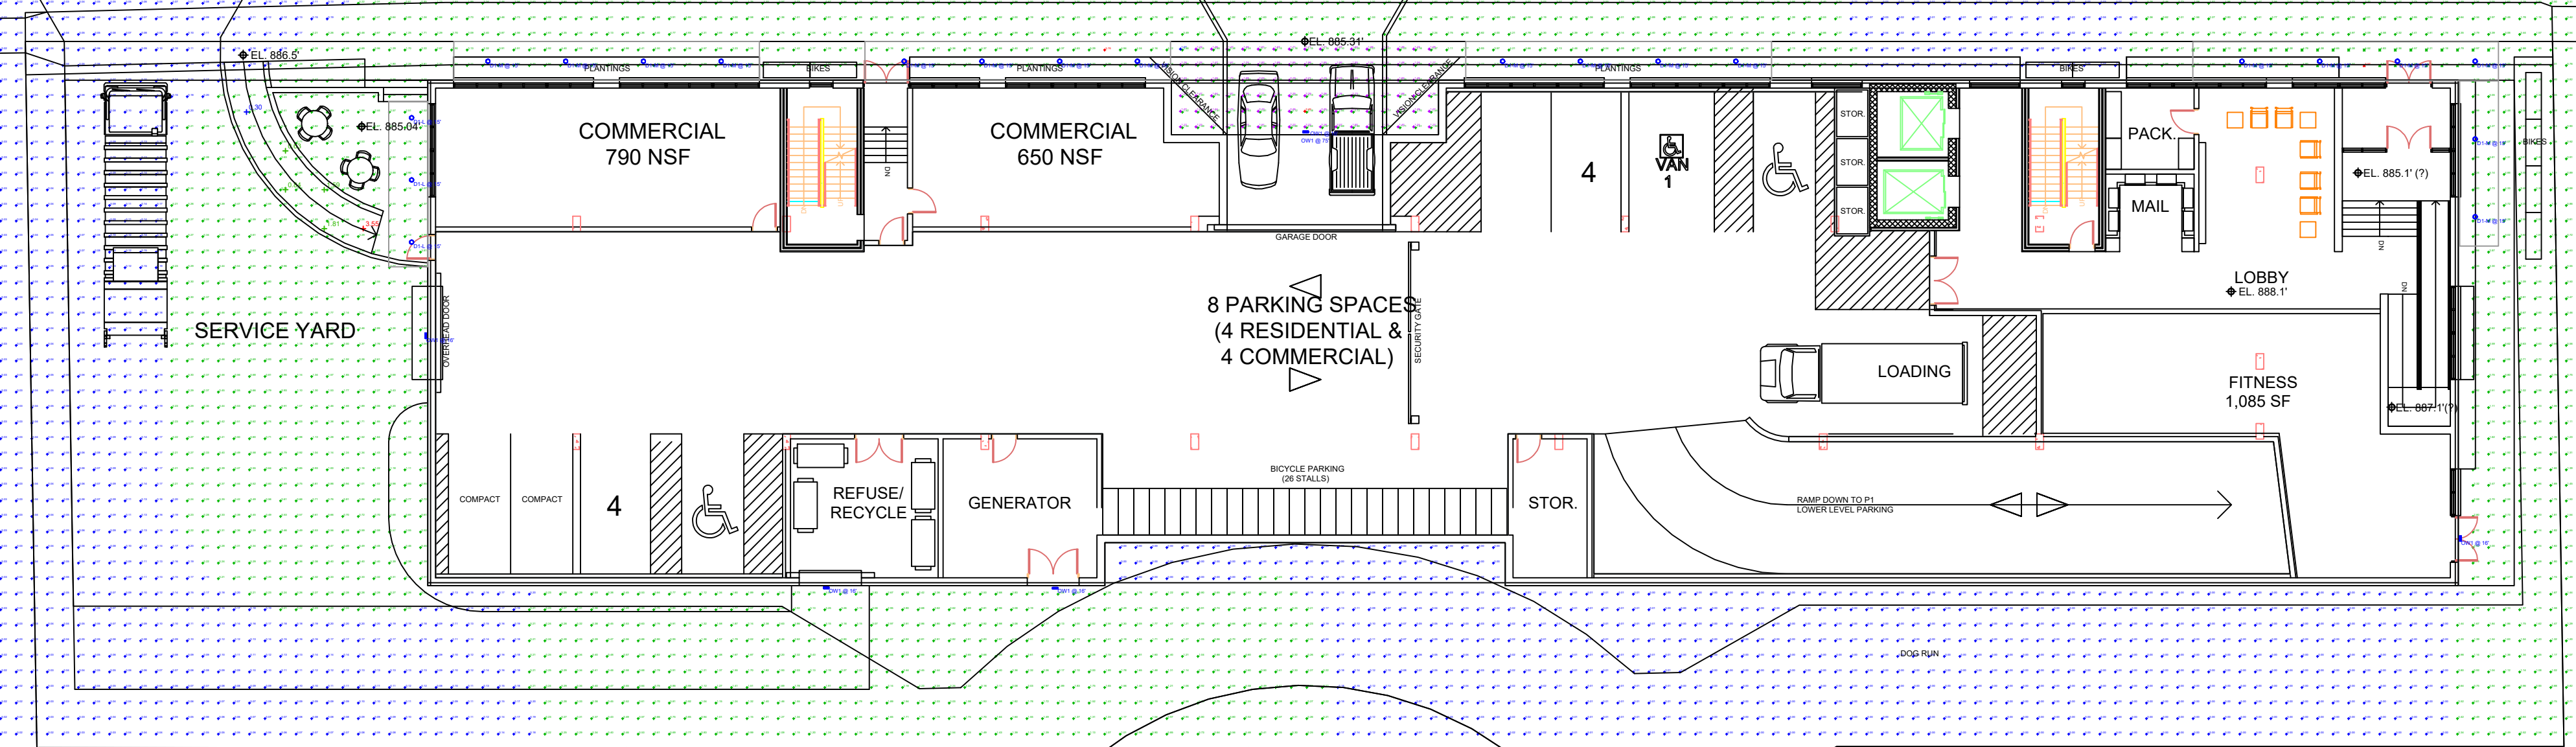

COMMENTS

DATE

#

REVISIONS

DRAWN BY : CAS

DATE : 05/23/2024

SCALE : 1/16" = 1' 0"

3575 UNIVERSITY AVE

MADISON, WI



EXTERIOR LAYOUT

Statistics						
Description	Symbol	Avg	Max	Min	Max/Min	Avg/Min
Ramp_At Grade	+	1.45 fc	3.55 fc	0.30 fc	11.8:1	4.8:1
Typical Under Canopy_At Grade	✕	4.43 fc	5.57 fc	2.37 fc	2.4:1	1.9:1
Under Pergola_At 57FT	+	1.73 fc	2.40 fc	1.07 fc	2.2:1	1.6:1
10FT From Lot Line University Dr_At 4FT Above Grade	+	0.06 fc	0.18 fc	0.00 fc	N/A	N/A

Schedule							
Label	QTY	Manufacturer	Catalog	Number Lamps	Lamp Output	LLF	Input Power
D1-L	3	Lithonia Lighting	LDN6 ALO1 (500LM) SWW1 AR LD WD 80CRI	1	514	0.9	5.76
D1-M	18	Lithonia Lighting	LDN6 ALO1 (750LM) SWW1 AR LSS WD 80CRI	1	879	0.9	9.06
OW1	6	Lithonia Lighting	WPX1 LED P2 XXX MVOLT	1	2913	0.95	24.42


EXISTING CONDITIONS SURVEY

PART OF LOTS 527, 528, 529 AND 530, AND PART OF VACATED BRUCE COURT AND VACATED PUBLIC WALKWAY LYING BETWEEN THOSE PARTS OF LOTS 528 AND 529, ALL BEING LOCATED IN THE PLAT OF SUNSET VILLAGE, SUNSET RIDGE ADDITION IN THE NE 1/4 OF SECTION 20 TOWN 7 NORTH, RANGE 9 EAST, CITY OF MADISON, DANE COUNTY, WISCONSIN

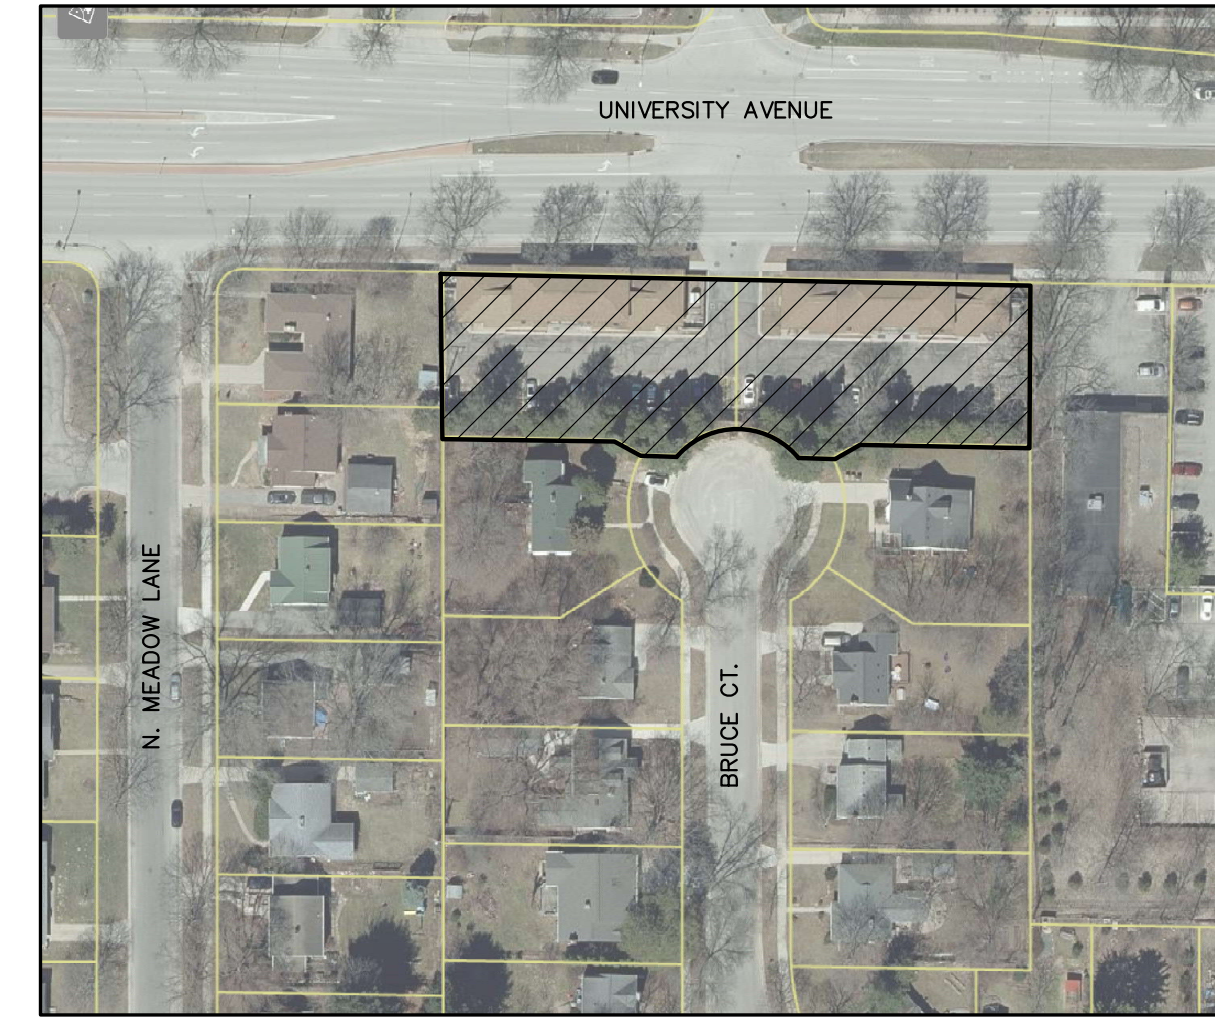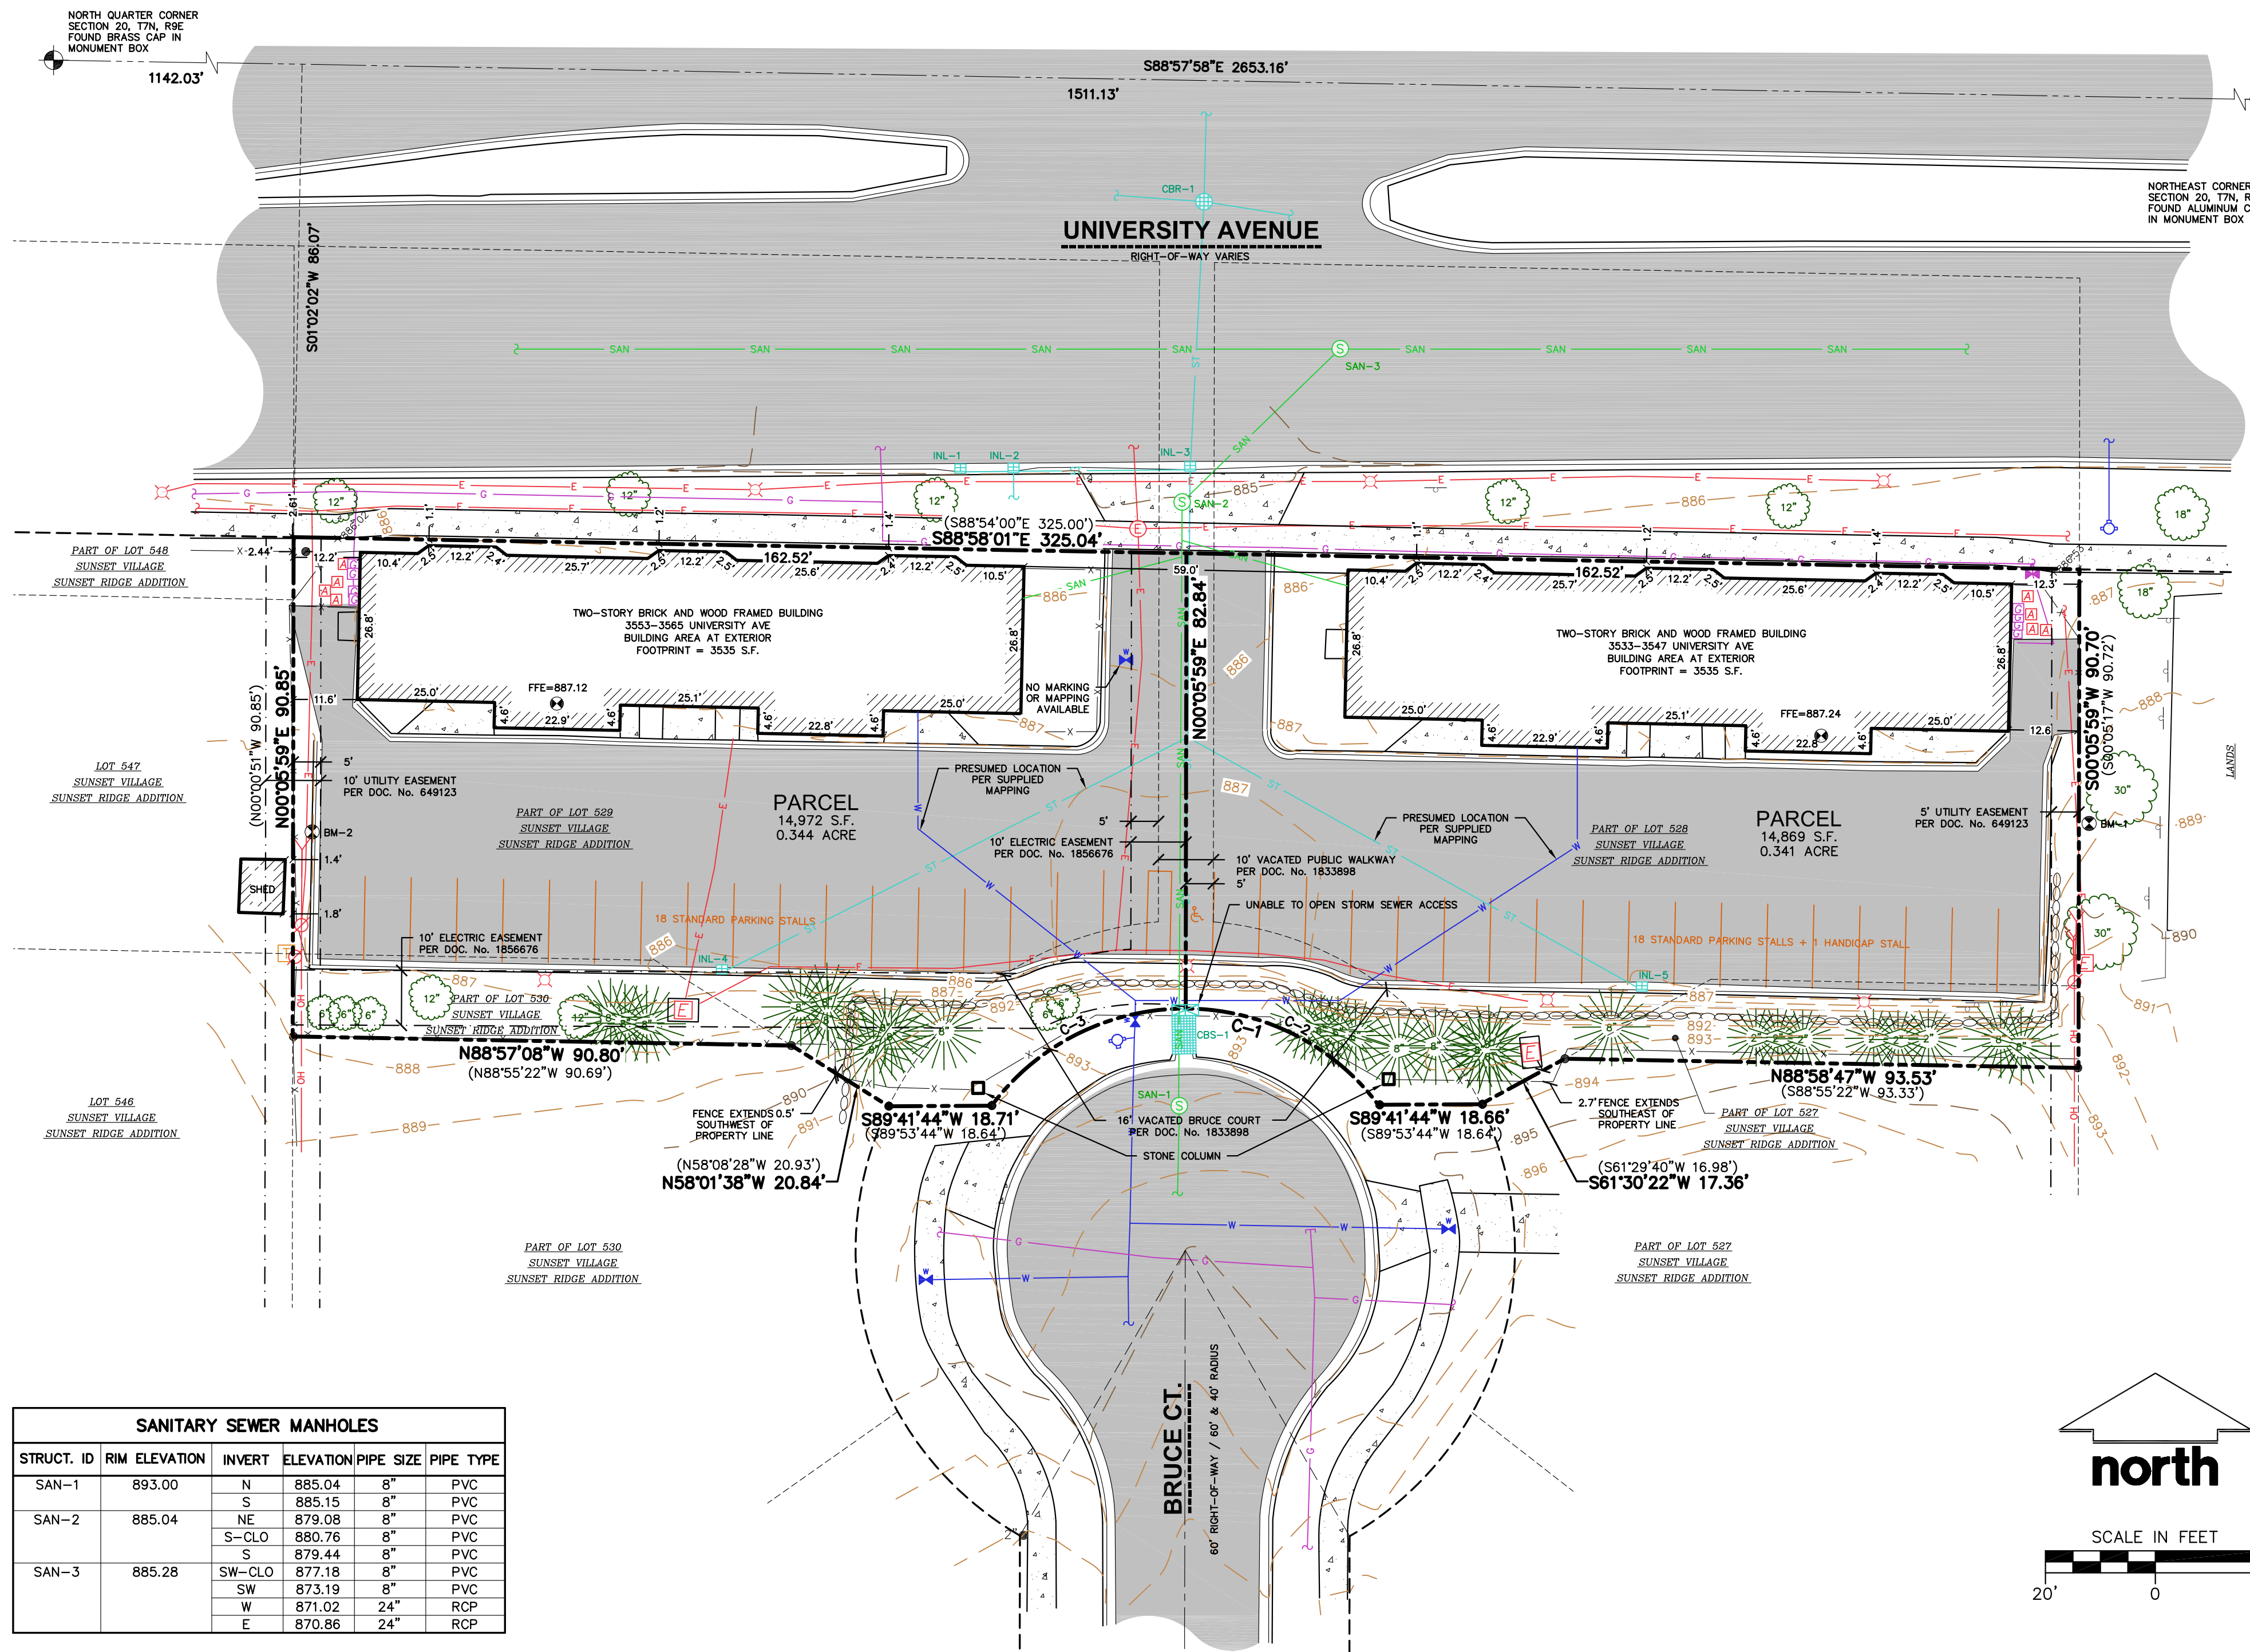

VICINITY MAP
NOT TO SCALE

- LEGEND**
- CHISELED 'X' SET
 - MAG NAIL SET
 - GOVERNMENT CORNER
 - IRON PIPE FOUND (SIZE NOTED)
 - 3/4" REBAR FOUND
 - CONTROL POINT
 - BENCHMARK
 - FINISHED FLOOR SHOT LOCATION
 - SANITARY MANHOLE
 - WATERMAIN OR GASMAIN VALVE
 - HYDRANT
 - WATER VALVE
 - STORM MANHOLE
 - SQUARE CASTED INLET
 - CURB INLET
 - STORM SEWER ACCESS
 - GAS REGULATOR/METER
 - GAS VALVE
 - ELECTRIC MANHOLE (MGE)
 - ELECTRIC MANHOLE
 - ELECTRIC TRANSFORMER
 - AIR CONDITION UNIT
 - LIGHT POLE
 - POWER POLE
 - POWER POLE W/GUY
 - TELEPHONE PEDESTAL
 - DECIDUOUS TREE
 - CONIFEROUS TREE
 - HANDICAP PARKING
 - CENTERLINE
 - RIGHT-OF-WAY LINE
 - SECTION LINE
 - PARCEL BOUNDARY
 - PROPERTY LINE
 - EASEMENT LINE
 - FENCE LINE
 - STONE WALL
 - EDGE OF PAVEMENT
 - CONCRETE CURB & GUTTER
 - EDGE OF GRAVEL
 - SANITARY SEWER
 - WATER LINE
 - STORM SEWER
 - NATURAL GAS
 - OVERHEAD LINE
 - UNDERGROUND ELECTRIC
 - FIBER OPTIC
 - BUILDING
 - WALL LINE
 - 875 INDEX CONTOUR
 - 874 INTERMEDIATE CONTOUR
 - BITUMINOUS PAVEMENT
 - RETAINING WALL
 - CONCRETE PAVEMENT
 - GRAVEL
 - EDGE OF BITUMINOUS
 - PAVEMENT STRIPING
 - () DENOTES RECORDED AS MEASUREMENTS DEPICTING THE SAME LINE ON THE GROUND AS RETRACED BY THIS SURVEY

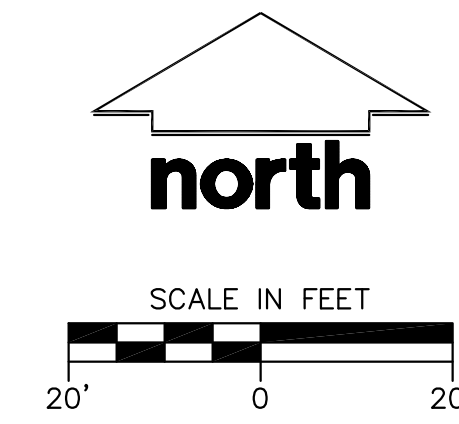

SANITARY SEWER MANHOLES					
STRUCT. ID	RIM ELEVATION	INVERT	ELEVATION	PIPE SIZE	PIPE TYPE
SAN-1	893.00	N	885.04	8"	PVC
		S	885.15	8"	PVC
SAN-2	885.04	NE	879.08	8"	PVC
		S-CLO	880.76	8"	PVC
		S	879.44	8"	PVC
SAN-3	885.28	SW-CLO	877.18	8"	PVC
		SW	873.19	8"	PVC
		W	871.02	24"	RCP
		E	870.86	24"	RCP

STORM SEWER INLETS					
STRUCT. ID	RIM ELEVATION	INVERT	ELEVATION	PIPE SIZE	PIPE TYPE
CBS-1*	893.48	N	889.48	15"	ORIFICE
INL-1	884.51	E	882.21	12"	RCP
		S	882.22	12"	PVC
INL-2	884.55	W	882.01	12"	RCP
		E	882.00	12"	RCP
		W	880.02	12"	RCP
INL-3	884.62	S	881.19	15"	RCP
		N	879.97	36"	RCP
INL-4	885.76	NE	883.76	12"	RCP
INL-5	885.88	NW	883.62	12"	RCP
CBR-1	884.89	W	879.94	12"	RCP
		S	879.94	36"	RCP
		E	879.94	12"	RCP
		N	879.94	36"	RCP

BENCHMARKS			
BENCH MARK	ELEVATION	DESCRIPTION	
BM-1	888.49	3/4" REBAR AT EAST END OF PROJECT AREA	
BM-2	887.13	MAG NAIL IN CURB AT WEST END OF PROJECT AREA	

CURVE TABLE					
CURVE	LENGTH	RADIUS	DELTA	CHORD	CHORD BEARING
C-1	40.61'	44.00'	52°52'46"	39.18'	N63°27'38"W
C-2	40.61'	44.00'	52°52'46"	39.18'	N63°27'38"W
C-3	40.97'	44.00'	53°21'00"	39.51'	S63°25'29"W

SURVEYOR'S CERTIFICATE

I, TODD J. BUHR, WISCONSIN PROFESSIONAL LAND SURVEYOR NO. S-2614, HEREBY CERTIFY THAT UNDER THE DIRECTION OF WALTER WAYNE DEVELOPMENT THIS SURVEY AND MAP HAS BEEN PREPARED AND COMPLIES WITH WISCONSIN ADMINISTRATIVE CODE A-E7 AND IS CORRECT TO THE BEST OF MY KNOWLEDGE AND BELIEF IN ACCORDANCE WITH THE INFORMATION PROVIDED.

TODD J. BUHR, S-2614
PROFESSIONAL LAND SURVEYOR

DATE _____



NOTES

- FIELD WORK PERFORMED ON JUNE 19-20, 2023.
- BEARINGS FOR THIS SURVEY AND MAP ARE REFERENCED TO THE WISCONSIN COUNTY COORDINATE SYSTEM, DANE COUNTY THE NORTHEAST LINE OF SECTION 20, T7N, R9E, RECORDED AS S88°57'58"E.
- ELEVATIONS ARE BASED ON THE NORTH AMERICAN VERTICAL DATUM OF 1988 (NAVD88). BENCHMARK IS A CITY OF MADISON MONUMENT MARKING THE NORTH 1/4 CORNER OF SECTION 20, T07N, R09E, ELEVATION = 897.697'
- CONTOUR INTERVAL IS ONE FOOT.
- SUBSURFACE UTILITIES AND FEATURES SHOWN ON THIS MAP HAVE BEEN APPROXIMATED BY LOCATING SURFICIAL FEATURES AND APPURTENANCES, LOCATING DIGGERS HOTLINE FIELD MARKINGS AND BY REFERENCE TO UTILITY RECORDS AND MAPS. DIGGER'S HOTLINE TICKET NO. 20232406744, 20232406744, 20232406778 AND 20232406828 WITH A CLEAR DATE OF 06/15/2023.
- UTILITY COMPANIES CONTACTED THRU DIGGERS HOTLINE:

CITY OF MADISON	MGE (ELECTRIC AND GAS)	AMERICAN TRANSMISSION
CHARTER COMMUNICATIONS	MADISON METRO SEWERAGE	MCI
AT&T		
- BEFORE EXCAVATION, APPROPRIATE UTILITY COMPANIES SHOULD BE CONTACTED. FOR EXACT LOCATION OF UNDERGROUND UTILITIES, CONTACT DIGGERS HOTLINE, AT 1.800.242.8511.
- THE ACCURACY OF THE BENCHMARKS SHOWN ON THIS MAP SHALL BE VERIFIED BEFORE BEING UTILIZED. JSD PROFESSIONAL SERVICES, INC. DOES NOT WARRANT THE ACCURACY OF THESE BENCHMARKS.
- ROADWAY UTILITY RECORD DRAWINGS WERE REQUESTED FROM THE CITY OF MADISON. THE UTILITIES SHOWN REPRESENT FIELD LOCATED UTILITIES IN COMBINATION WITH THE SUPPLIED CITY RECORDS.
- PER DOCUMENT NO. 649123, NOTE 9, "VEHICULAR ACCESS SHALL NOT BE PERMITTED FROM UNIVERSITY AVENUE TO LOTS 528, 529 AND 548."



CREATE THE VISION TELL THE STORY

jsdinc.com

MADISON REGIONAL OFFICE
161 HORIZON DRIVE, SUITE 101
VERONA, WISCONSIN 53593
P. 608.848.5060

CLIENT:
**WALTER WAYNE
DEVELOPMENT**

CLIENT ADDRESS:
**702 N. HIGH POINT RD. SUITE 200
MADISON, WI 53717**

PROJECT:
**UNIVERSITY AVENUE
MIXED USE DEVELOPMENT**

PROJECT LOCATION:
**3535 AND 3553 UNIVERSITY AVE
MADISON, WI 53717**

MODIFICATIONS:

#	Date	Description
1		
2		
3		
4		
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		

Prepared By: SMN 06/27/2023

SHEET TITLE:

**EXISTING
CONDITIONS
SURVEY**

SHEET NUMBER:

1 OF 1

PROJECT NO: 23-13311

File: I:\2023\23-13311\DWG\SURVEY\Sheet23-13311_Existing.dwg Layout: 22x34 User: coblen PlotDate: Jul 19, 2023 10:02am Xref's:

THESE PLANS AND DESIGNS ARE COPYRIGHT PROTECTED AND MAY NOT BE USED IN WHOLE OR IN PART WITHOUT THE WRITTEN CONSENT OF JSD PROFESSIONAL SERVICES, INC.

GENERAL NOTES

- 1. REFER TO THE EXISTING CONDITIONS SURVEY FOR EXISTING CONDITIONS NOTES AND LEGENDS.
2. ALL WORK IN THE RIGHT-OF-WAY AND/OR PUBLIC EASEMENTS SHALL BE IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS, JURISDICTIONAL SPECIFICATIONS, AND APPROVED BY THE JURISDICTION HAVING AUTHORITY.
3. EXISTING GRADE SPOT ELEVATIONS SHOWN FOR INFORMATIONAL PURPOSES. DURING CONSTRUCTION MATCH EXISTING GRADES AT CONSTRUCTION LIMITS.
...
9.6. DEPARTMENT OF SAFETY AND PROFESSIONAL SERVICES - "DSPS" OR "SPS"

DEMOLITION NOTES

- 1. THIS PLAN INDICATES ITEMS ON THE PROPERTY INTENDED FOR DEMOLITION BASED ON THE CURRENT SITE DESIGN THAT HAVE BEEN IDENTIFIED BY A REASONABLE OBSERVATION OF THE EXISTING CONDITIONS THROUGH FIELD SURVEY RECONNAISSANCE, "DIGGERS HOTLINE" LOCATION, AND GENERAL "STANDARD OF CARE". THERE MAY BE ADDITIONAL ITEMS THAT CAN NOT BE IDENTIFIED BY A REASONABLE ABOVEGROUND OBSERVATION, OF WHICH THE ENGINEER WOULD HAVE NO KNOWLEDGE OR MAY BE A PART OF ANOTHER DESIGN DISCIPLINE. IT IS THE CONTRACTOR/SBIDDER'S RESPONSIBILITY TO REVIEW THE PLANS, INSPECT THE SITE, AND PROVIDE THEIR OWN DUE DILIGENCE TO INCLUDE IN THEIR BID WHAT ADDITIONAL ITEMS, IN THEIR OPINION, MAY BE NECESSARY FOR DEMOLITION. ANY ADDITIONAL ITEMS IDENTIFIED BY THE CONTRACTOR/SBIDDER SHALL BE IDENTIFIED IN THE BID AND REPORTED TO THE ENGINEER OF RECORD. JSD TAKES NO RESPONSIBILITY FOR ITEMS ON THE PROPERTY THAT COULD NOT BE LOCATED BY A REASONABLE OBSERVATION OF THE PROPERTY OR OF WHICH THEY WOULD HAVE NO KNOWLEDGE.
2. CONTRACTOR SHALL KEEP ALL STREETS AND PRIVATE DRIVES FREE AND CLEAR OF ALL CONSTRUCTION-RELATED DIRT, DUST, AND DEBRIS.
...
17. RESTORATION OF THE EXISTING ROADWAY RIGHT-OF-WAYS ARE CONSIDERED INCIDENTAL AND SHALL BE PART OF THE COST OF THE UNDERGROUND IMPROVEMENTS, DEMOLITION, AND REMOVAL. THIS INCLUDES CURB AND GUTTER, SIDEWALK, TOPSOIL, SEEDING, AND MULCHING.

PAVING NOTES

- 1. GENERAL:
2.1. PAVING SHALL CONFORM TO STATE HIGHWAY SPECIFICATIONS, APPLICABLE JURISDICTIONAL SPECIFICATIONS, AND THE GEOTECHNICAL REPORT PREPARED BY CGC, INC, TITLED GEOGRAPHICAL EXPLORATION REPORT, ISSUE DATE 1/9/2024. ALL REFERENCES TO THE "GEOTECHNICAL REPORT" SHALL BE UNDERSTOOD AS THE AFOREMENTIONED REPORT.
2.2. ALL PAVING DIMENSIONS ARE TO FACE OF CURB UNLESS SPECIFIED OTHERWISE.
...
5.2. ALL PAVEMENT MARKINGS INCLUDING STOP BARS, CROSSWALKS, DIRECTIONAL ARROWS, PARKING STALL LINES, ADA STALL MARKINGS, NO PARKING ZONES, AND DROP-OFF/PICK-UP ZONES SHALL BE PAINTED WITH LATEX PAINT PER SPECIFICATIONS.

CONSTRUCTION SEQUENCING

- 1. INSTALL PERIMETER SILT FENCE, WATTLE, INLET PROTECTION, AND CONSTRUCTION ENTRANCE.
2. STRIP AND STOCKPILE TOPSOIL AND INSTALL SILT FENCE AROUND PERIMETER OF STOCKPILE.
3. CONDUCT ROUGH GRADING EFFORTS AND INSTALL CHECK DAMS WITHIN DRAINAGE DITCHES.
4. INSTALL UTILITY PIPING AND STRUCTURES, IMMEDIATELY INSTALL INLET PROTECTION.
5. COMPLETE FINAL GRADING, INSTALLATION OF GRAVEL BASE COURSES, PLACEMENT OF CURBS, PAVEMENTS, WALKS, ETC.
6. PLACE TOPSOIL AND IMMEDIATELY STABILIZE DISTURBED AREAS WITH EROSION CONTROL MEASURES AS INDICATED ON PLANS.
7. EROSION CONTROLS SHALL NOT BE REMOVED UNTIL SITE IS FULLY STABILIZED OR 70% CONTIGUOUS VEGETATIVE COVER IS ESTABLISHED.

CONTRACTOR MAY MODIFY SEQUENCING AFTER ITEM NO. 1 AS NEEDED TO COMPLETE CONSTRUCTION IF EROSION CONTROLS ARE MAINTAINED IN ACCORDANCE WITH THE CONSTRUCTION SITE EROSION CONTROL REQUIREMENTS.

UTILITY NOTES

- 1. ALL EXISTING UTILITIES ARE SHOWN FOR INFORMATIONAL PURPOSES ONLY AND ARE NOT GUARANTEED TO BE ACCURATE OR ALL INCLUSIVE. THE CONTRACTOR IS RESPONSIBLE FOR MAKING THEIR OWN DETERMINATION AS TO THE TYPE AND LOCATIONS OF UNDERGROUND UTILITIES AS MAY BE NECESSARY TO AVOID DAMAGE THERETO. CONTRACTOR/OWNER SHALL CALL "DIGGERS HOTLINE" PRIOR TO ANY CONSTRUCTION.
2. PRIOR TO CONSTRUCTION, THE PRIME CONTRACTOR IS RESPONSIBLE FOR:
2.1. EXAMINING ALL SITE CONDITIONS RELATIVE TO THE CONDITIONS INDICATED ON THE ENGINEERING DRAWINGS. ANY DISCREPANCIES ARE TO BE REPORTED TO THE ENGINEER AND RESOLVED PRIOR TO THE START OF CONSTRUCTION.
...
17.5. JOINT RESTRAINT:
17.5.1. WHERE SPECIFIED, DUCTILE IRON PIPE SHALL INCLUDE MECHANICAL JOINTS CONFORMING TO CHAPTER 4.4.2(b) OF THE STANDARD SPECIFICATIONS. POLYETHYLENE WRAP SHALL BE USED AROUND ALL

UTILITY NOTES, CONTINUED

- MECHANICAL CONNECTIONS.
17.6. BEDDING AND COVER MATERIAL.
17.6.1. PIPE BEDDING AND COVER MATERIAL SHALL BE SAND, CRUSHED STONE CHIPS OR CRUSHED STONE SCREENINGS CONFORMING TO CHAPTER 8.43.2 OF THE STANDARD SPECIFICATIONS.
...
19.3. BEDDING AND COVER MATERIAL.
19.3.1. MATERIAL SHALL CONFORM TO THE APPROPRIATE SECTIONS OF THE STANDARD SPECIFICATIONS WITH THE FOLLOWING MODIFICATION: "COVER MATERIAL SHALL BE THE SAME AS USED FOR BEDDING AND SHALL CONFORM TO SECTION 8.43.2 (A).
...
19.4.2. LANDSCAPED AREAS MAY BE BACKFILLED WITH EXCAVATED MATERIAL IN CONFORMANCE WITH SECTION 8.43.5 OF THE STANDARD SPECIFICATIONS.

4/17/2024 11:30:17 AM



3535 UNIVERSITY MIXED USE

REVIEW DRAWING
NOT TO BE USED FOR CONSTRUCTION
DATE OF ISSUE 07/10/2024



NOTES & LEGEND

Table with 2 columns: Field Name and Value. Includes JLA PROJECT No: W23-0222, DATE OF ISSUANCE: 07/10/24, REVISION DATE.

C100

EROSION CONTROL NOTES

- CONTRACTOR IS RESPONSIBLE TO NOTIFY ENGINEER OF RECORD AND OFFICIALS OF ANY CHANGES TO THE EROSION CONTROL AND STORMWATER MANAGEMENT PLANS.
- ALL EROSION CONTROL MEASURES SHALL BE CONSTRUCTED AND MAINTAINED BY THE CONTRACTOR IN ACCORDANCE WITH WDNR TECHNICAL STANDARDS AND JURISDICTIONAL REQUIREMENTS. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO OBTAIN A COPY OF THESE STANDARDS. CONTRACTOR SHALL BE RESPONSIBLE FOR ANY ADDITIONAL EROSION CONTROL MEASURES WHICH MAY BE NECESSARY TO MEET UNFORESEEN FIELD CONDITIONS.
- INSTALL PERIMETER EROSION CONTROL MEASURES (SUCH AS CONSTRUCTION ENTRANCES, SILT FENCE, AND EXISTING INLET PROTECTION) PRIOR TO ANY GRADING OR DISTURBANCE OF EXISTING SURFACE COVER. MODIFICATIONS TO THE APPROVED EROSION CONTROL DESIGN IN ORDER TO MEET UNFORESEEN FIELD CONDITIONS IS ALLOWED IF MODIFICATIONS CONFORM TO WDNR TECHNICAL STANDARDS AND JURISDICTIONAL REQUIREMENTS. ALL DESIGN MODIFICATIONS MUST BE APPROVED BY THE JURISDICTIONAL AUTHORITIES PRIOR TO DEVIATION OF THE APPROVED PLAN.
- ADDITIONAL EROSION CONTROL MEASURES, AS REQUESTED BY JURISDICTIONS HAVING AUTHORITY AND/OR ENGINEER OF RECORD SHALL BE INSTALLED WITHIN 24 HOURS OF REQUEST.
- INSPECTIONS AND MAINTENANCE OF ALL EROSION CONTROL MEASURES SHALL BE ROUTINE (ONCE PER WEEK MINIMUM) TO ENSURE PROPER FUNCTION OF EROSION CONTROLS AT ALL TIMES. EROSION CONTROL MEASURES ARE TO BE IN WORKING ORDER AT THE END OF EACH WORK DAY.
- ALL EROSION AND SEDIMENT CONTROL ITEMS SHALL BE INSPECTED WITHIN 24 HOURS OF ALL RAIN EVENTS EXCEEDING 0.5". ANY DAMAGED EROSION CONTROL MEASURES SHALL BE REPAIRED OR REPLACED IMMEDIATELY UPON INSPECTION.
- CONSTRUCTION ENTRANCES SHALL BE INSTALLED AT ALL LOCATIONS OF VEHICLE INGRESS/EGRESS POINTS. ADDITIONAL LOCATIONS OTHER THAN AS SHOWN ON THE PLANS MUST BE PRE-APPROVED BY THE JURISDICTION. CONSTRUCTION ENTRANCES SHALL BE 50' LONG AND NO LESS THAN 12" THICK BY USE OF 3" SELECTED CRUSHED. CONSTRUCTION ENTRANCES SHALL BE MAINTAINED BY THE CONTRACTOR IN A CONDITION WHICH WILL PREVENT THE TRACKING OF MUD OR DRY SEDIMENT OFF-SITE AFTER EACH WORKING DAY OR MORE FREQUENTLY AS REQUIRED.
- PAVED SURFACES ADJACENT TO CONSTRUCTION SITE VEHICLE ACCESS SHALL BE SWEEP AND/OR SCRAPPED TO REMOVE ACCUMULATED SOIL, DIRT, AND/OR DUST AFTER THE END OF EACH WORK DAY AND AS REQUESTED BY THE JURISDICTIONAL AUTHORITIES.
- INLET PROTECTION SHALL BE IMMEDIATELY FITTED AT THE INLETS OF ALL INSTALLED STORM SEWER. STONE DITCH CHECKS/FENCE SHALL BE IMMEDIATELY FITTED AT ALL INSTALLED CULVERT INLETS TO PREVENT SEDIMENT DEPOSITION WITHIN STORM SEWER SYSTEMS.
- INSTALL EROSION CONTROLS ON THE DOWNSTREAM SIDE OF STOCKPILES. IF STOCKPILE REMAINS UNDISTURBED FOR MORE THAN SEVEN (7) DAYS, TEMPORARY SEEDING AND STABILIZATION IN ACCORDANCE WITH BEST MANAGEMENT PRACTICES IS REQUIRED. IF DISTURBANCE OCCURS BETWEEN NOVEMBER 15TH AND MAY 15TH, THE MULCHING SHALL BE PERFORMED BY HYDRO-MULCHING WITH A "TACKIFIER."
- DITCH CHECKS AND APPLICABLE EROSION NETTING/MATTING SHALL BE INSTALLED IMMEDIATELY AFTER COMPLETION OF GRADING EFFORTS WITHIN DITCHES/SWALES TO PREVENT SOIL TRANSPORTATION.
- EROSION CONTROL FOR UTILITY CONSTRUCTION (STORM SEWER, SANITARY SEWER, WATER MAIN, ETC.):
 - PLACE EXCAVATED TRENCH MATERIAL ON THE HIGH SIDE OF THE TRENCH.
 - BACKFILL, COMPACT, AND STABILIZE THE TRENCH IMMEDIATELY AFTER PIPE CONSTRUCTION.
 - DISCHARGE TRENCH WATER INTO A SEDIMENTATION BASIN OR FILTERING TANK IN ACCORDANCE WITH THE WDNR DEWATERING TECHNICAL STANDARD NO. 1061 PRIOR TO RELEASE INTO THE STORM SEWER, RECEIVING STREAM, OR DRAINAGE DITCH.
- ALL SLOPES 4:1 OR GREATER SHALL BE STABILIZED WITH CLASS I, TYPE B EROSION MATTING PER STATE HIGHWAY SPECIFICATIONS OR APPLICATION OF A WISDOT APPROVED POLYMER SOIL STABILIZATION TREATMENT OR A COMBINATION THEREOF, AS REQUIRED WITHIN SEVEN (7) DAYS OF REACHING FINAL GRADE. DRAINAGE SWALES SHALL BE STABILIZED WITH CLASS II, TYPE B EROSION MATTING PER STATE HIGHWAY SPECIFICATIONS. EROSION MATTING AND/OR NETTING USED ON-SITE SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S GUIDELINES AND WDNR TECHNICAL STANDARDS 1052 AND 1053.
- CONTRACTOR SHALL TAKE ALL NECESSARY STEPS TO CONTROL DUST ARISING FROM CONSTRUCTION OPERATIONS. REFER TO WDNR TECHNICAL STANDARD 1068.
- A CONCRETE WASHOUT AREA SHALL BE DESIGNATED ON-SITE. CONTRACTOR SHALL USE PRE-MANUFACTURED ABOVE GROUND WASHOUT TOTE OR EQUIVALENT CONTAINMENT AREA FOR ALL CONCRETE WASTE. CONCRETE WASTE SHALL ONLY BE CONTAINED IN ABOVE GROUND PRE-FABRICATED CONTAINERS OR CONSTRUCTED CONTAINMENT AREA AND IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO FREQUENTLY DISPOSE OF OFF-SITE IN ACCORDANCE WITH LOCAL, STATE AND FEDERAL REQUIREMENTS TO MAINTAIN THE SYSTEMS EFFECTIVENESS.
- STABILIZATION MEASURES SHALL BE INITIATED AS SOON AS PRACTICABLE IN PORTIONS OF THE SITE WHERE CONSTRUCTION ACTIVITIES HAVE TEMPORARILY OR PERMANENTLY CEASED. NO MORE THAN SEVEN (7) DAYS SHALL PASS AFTER THE CONSTRUCTION ACTIVITY IN THAT PORTION OF THE SITE HAS CEASED UNLESS:
 - THE INITIATION STABILIZATION MEASURES BY THE SEVENTH (7) DAY AFTER CONSTRUCTION ACTIVITY HAS CEASED OR IS PRECLUDED BY SNOW COVER. IN THAT EVENT, STABILIZATION SHALL BE INITIATED AS SOON AS PRACTICABLE.
 - CONSTRUCTION ACTIVITY WILL RESUME ON A PORTION OF THE SITE WITHIN FOURTEEN (14) DAYS FROM WHEN ACTIVITY CEASED (I.E., THE TOTAL TIME PERIOD THAT THE CONSTRUCTION ACTIVITY IS TEMPORARILY CEASED IS LESS THAN FOURTEEN (14) DAYS). IN THAT EVENT, STABILIZATION MEASURES DO NOT HAVE TO BE INITIATED ON THAT PORTION OF THE SITE BY THE SEVENTH (7) DAY AFTER CONSTRUCTION ACTIVITY HAS TEMPORARILY CEASED.
 - STABILIZATION MEASURES SHALL BE DETERMINED BASED ON-SITE CONDITIONS WHEN CONSTRUCTION ACTIVITY HAS CEASED INCLUDING, BUT NOT LIMITED TO, WEATHER CONDITIONS AND LENGTH OF TIME THE MEASURE MUST BE EFFECTIVE. THE FOLLOWING ARE ACCEPTABLE STABILIZATION MEASURES:
 - PERMANENT SEEDING; IN ACCORDANCE WITH APPROVED CONSTRUCTION SPECIFICATION
 - TEMPORARY SEEDING; MAY CONSIST OF SPRING OATS(100LBS/ACRE) IN SPRING/SUMMER OR WHEAT OR CEREAL RYE (150LBS/ACRE) IN FALL
 - HYDRO-MULCHING WITH A TACKIFIER
 - WOVEN AND NON-WOVEN GEOTEXTILES
 - EROSION MATTING
 - SODDING
 - OTHER MEASURES AS APPROVED BY THE ENGINEER
- EROSION CONTROL MEASURES SHALL NOT BE REMOVED UNTIL ALL LAND DISTURBING CONSTRUCTION ACTIVITY AT THE SITE HAS BEEN COMPLETED AND THAT A UNIFORM PERENNIAL VEGETATIVE COVER HAS BEEN ESTABLISHED WITH A CONTIGUOUS DENSITY OF AT LEAST 70% FOR UNPAVED AREAS AND AREAS NOT COVERED BY PERMANENT STRUCTURES OR THAT EMPLOY EQUIVALENT PERMANENT STABILIZATION MEASURES.
- CONTRACTOR/OWNER SHALL FILE A NOTICE OF TERMINATION UPON COMPLETION OF THE PROJECT IN ACCORDANCE WITH WDNR REQUIREMENTS AND/OR REQUEST FOR PERMIT CLOSURE IN ACCORDANCE WITH JURISDICTION PERMIT AND SPECIFICATION REQUIREMENTS.

GRADING AND EARTHWORK NOTES

- ALL SITE PREP AND EARTHWORK SHALL CONFORM TO THE GEOTECHNICAL REPORT PREPARED BY CGC, INC, TITLED "GEOGRAPHICAL EXPLORATION REPORT", ISSUE DATE 1/19/2024. ALL REFERENCES TO THE "GEOTECHNICAL REPORT" SHALL BE UNDERSTOOD AS THE AFOREMENTIONED REPORT.
- ALL PROPOSED GRADES SHOWN ARE FINISHED GRADES. CONTRACTOR SHALL VERIFY ALL GRADES, MAKE SURE ALL AREAS DRAIN PROPERLY, AND REPORT ANY DISCREPANCIES TO THE ENGINEER PRIOR TO CONSTRUCTION.
- CONTRACTOR SHALL ASSUME SOLE RESPONSIBILITY FOR COMPUTATIONS OF ALL GRADING QUANTITIES. WHILE JSD PROFESSIONAL SERVICES, INC. ATTEMPTS TO PROVIDE A COST-EFFECTIVE APPROACH TO BALANCE EARTHWORK, GRADING DESIGN IS BASED ON MANY FACTORS, INCLUDING SAFETY, AESTHETICS, AND COMMON ENGINEERING STANDARDS OF CARE. THEREFORE, NO GUARANTEE CAN BE MADE FOR A BALANCED SITE.
- ALL EXCAVATIONS AND FILLS SHALL BE TO THE ELEVATIONS SHOWN ON THE DRAWINGS AND SHALL INCLUDE SUFFICIENT DEPTHS FOR PLACEMENT OF FILL MATERIALS, BASE COURSES, PAVEMENTS, TOPSOIL, AND OTHER MATERIALS TO THE SPECIFIED DEPTHS.
- CONTRACTOR SHALL NOT EXCAVATE BELOW ELEVATIONS OR DESIGN GRADES SHOWN ON THE DRAWINGS WITHOUT PRIOR AUTHORIZATION FROM ENGINEER AND OWNER.
- PRIOR TO ALL EXCAVATION OR FILLING OPERATIONS, CONTRACTOR IS RESPONSIBLE FOR REMOVING ALL TOPSOIL FROM PROPOSED LOCATIONS OF BUILDINGS, STRUCTURES, ROADS, WALKS, OTHER PAVED AREAS, STORM WATER FACILITIES OR WITHIN THE GRADING EXTENTS WHERE EXISTING GRADES ARE ALTERED BY MORE THAN 3". REMOVED OR STRIPPED TOPSOIL SHALL BE SEGREGATED AND STOCKPILED ON-SITE IN AN APPROPRIATE LOCATION TO BE RESPREAD AS SPECIFIED ON THE DRAWINGS.
- CONTRACTOR SHALL NOT PLACE ANY FILL OR OTHER MATERIALS ON AREAS THAT HAVE NOT HAD TOPSOIL REMOVED, ARE FROZEN, SATURATED, OR YIELDING. CONTRACTOR SHALL NOTIFY OWNER OR ENGINEER IF SUBGRADE CONDITIONS ARE NOT SUITABLE FOR SUPPORTING FILL AND A FURTHER DETERMINATION SHALL BE PROVIDED BY OWNER OR ENGINEER.
- CONTRACTOR SHALL PLACE THE FILLS IN ACCORDANCE WITH THE RECOMMENDATIONS OF THE GEOTECHNICAL REPORT INCLUDING LIFT DEPTHS AND COMPACTION EFFORTS.
- PRIOR TO PLACEMENT OF BASE COURSE MATERIALS IN PAVEMENT OR HARD SURFACE AREAS OR CONDUCTING EXCAVATION BELOW SUBGRADE (EBS) ELEVATIONS, CONTRACTOR SHALL NOTIFY OWNER AND ENGINEER TO CONDUCT AN INSPECTION OF THE PREPARED SUBGRADE AND PROOF-ROLLING. PROOF-ROLLING SHALL BE CONDUCTED BY THE CONTRACTOR IN WITNESS OF THE OWNER AND ENGINEER. OWNER AND ENGINEER SHALL DETERMINE IF AREAS OF EBS ARE REQUIRED. EBS SHALL BE COMPLETED BY THE CONTRACTOR PER THE DIRECTION OF THE OWNER AND ENGINEER.
- SOIL MATERIAL SPECIFICATIONS:
 - FILL AND BACKFILL MATERIALS
 - MATERIAL SHALL BE SATISFACTORY. MATERIALS EXCAVATED FROM THE SITE, PER THE GEOTECHNICAL REPORT. IF SATISFACTORY MATERIALS ARE NOT AVAILABLE ON-SITE OR ADDITIONAL MATERIALS ARE REQUIRED, REFER TO IMPORTED FILL MATERIAL SPECIFICATIONS.
 - IMPORTED FILL MATERIAL
 - MATERIAL SHALL BE PROVIDED BY THE CONTRACTOR FROM OFFSITE BORROW AREAS WHEN SUFFICIENT, SATISFACTORY MATERIALS ARE NOT AVAILABLE ON-SITE. IMPORTED FILL MATERIAL SHALL BE IN ACCORDANCE WITH THE GEOTECHNICAL REPORT AND CONSIST OF CLEAN MATERIAL OF INORGANIC SOILS OR A MIXTURE OF INORGANIC SOIL AND ROCK, STONE, OR GRAVEL. THE MATERIAL SHALL BE FREE OF TOPSOIL, VEGETATION, PAVEMENT RUBBLE, DEBRIS, OR OTHER DELETERIOUS MATERIALS. THE MAXIMUM NOMINAL DIMENSION OF MATERIALS CONSISTING OF ROCK, STONE, OR GRAVEL SHALL BE 6".
 - GRANULAR FILL
 - MATERIAL SHALL CONSIST OF CLEAN MATERIAL MEETING THE REQUIREMENTS OF "GRADE 1" OR "GRADE 2" GRANULAR BACKFILL AS DEFINED IN SECTION 209.2.1 OF THE STATE HIGHWAY SPECIFICATIONS.
 - BUILDING STRUCTURAL FILL
 - CLEAN MATERIAL MEETING THE REQUIREMENTS OF TYPE A "STRUCTURE BACKFILL" AS DEFINED IN SECTIONS 210.2.1 AND 210.2.2 OF THE STATE HIGHWAY SPECIFICATIONS AND GEOTECHNICAL REPORT.

SEEDING AND RESTORATION NOTES

- CONTRACTOR SHALL PROVIDE NOTICE TO THE JURISDICTIONAL AUTHORITIES IN ADVANCE OF ANY SOIL DISTURBING ACTIVITIES, IN ACCORDANCE WITH MUNICIPAL REQUIREMENTS.
- ALL DISTURBED AREAS SHALL BE SODDED AND/OR SEEDED AND MULCHED IMMEDIATELY FOLLOWING GRADING ACTIVITIES. SOD/SEED MIX TO BE IN ACCORDANCE WITH LANDSCAPE PLAN.
- CONTRACTOR SHALL WATER ALL NEWLY SODDED/SEEDED AREAS DURING THE SUMMER MONTHS WHENEVER THERE IS A 7-DAY LAPSE WITH NO SIGNIFICANT RAINFALL.
- ALL SLOPES 20% OR GREATER SHALL BE TEMPORARILY SEEDED, MULCHED, OR OTHER MEANS OF COVER PLACED ON THEM WITHIN 2 WEEKS OF DISTURBANCE. REFER TO STABILIZATION PRACTICES IN THE EROSION CONTROL NOTES FOR FURTHER SPECIFICATIONS.
- CONTRACTOR SHALL CHISEL-PLOW OR DEEP TILL WITH DOUBLE TIMES ALL STORMWATER MANAGEMENT FACILITIES JUST PRIOR TO SODDING AND/OR SEEDING AND MULCHING TO PROMOTE INFILTRATION.
- SEEDING SPECIFICATIONS:
 - TURF LAWN SEED MIXTURE: WISDOT SEED MIX NO. 40 AT RATES SPECIFIED IN SECTION 630 OF THE STATE HIGHWAY SPECIFICATIONS
 - LOW MAINTENANCE AREA SEED MIXTURE: WISDOT SEED MIX NO. 10 OR 20 APPLIED AT RATES AS SPECIFIED IN SECTION 630 OF THE STATE HIGHWAY SPECIFICATIONS.
 - NO-MOW AREA SEED MIXTURE: NO-MOW LAWN SEED MIX, AS PROVIDED BY PRAIRIE NURSERY, P.O. BOX 306, WESTFIELD, WISCONSIN, 53964. TEL: 608-296-3679 (OR APPROVED EQUIVALENT). SEEDING RATE SHALL BE PER MANUFACTURER'S RECOMMENDATIONS.
- SEED PREPARATION SPECIFICATIONS:
 - SCARIFY SUBSOILS TO A DEPTH OF 3" WHERE TOPSOIL SHALL BE PLACED TO REDUCE COMPACTION.
 - PLACE TOPSOIL AT A MINIMUM DEPTH OF 6" UNLESS OTHERWISE NOTED ON THE PLANS.
 - APPLY FERTILIZER IN ACCORDANCE WITH SEED MIX MANUFACTURER'S RECOMMENDATIONS.
 - SOW SEED AT RATES SPECIFIED USING METHOD "A" OR METHOD "B" AS SPECIFIED IN SECTION 630 OF THE STATE HIGHWAY SPECIFICATIONS.
- SEED MULCHING/EROSION MATTING SPECIFICATIONS:
 - ALL SEEDED AREAS WITH SLOPES FLATTER THAN 4:1, UNLESS OTHERWISE NOTED ON THE PLANS, SHALL BE STABILIZED WITH WEED-FREE WHEAT STRAW MULCH WITH METHODS AND RATES IN ACCORDANCE WITH SECTION 627 OF THE STATE HIGHWAY SPECIFICATIONS.
 - ALL SEEDED AREAS WITH SLOPES EQUAL TO OR STEEPER THAN 4:1, UNLESS OTHERWISE NOTED ON THE PLANS, SHALL BE STABILIZED WITH EROSION MATTING MATERIALS AS SPECIFIED ON THE PLANS. EROSION MATTING SHALL BE IN ACCORDANCE WITH SECTION 628 OF THE STATE HIGHWAY SPECIFICATIONS.

LEGEND

	PROPERTY LINE
	RIGHT-OF-WAY
	EASEMENT LINE
	BUILDING OUTLINE
	BUILDING OVERHANG
	BUILDING SETBACK LINE
	PAVEMENT SETBACK LINE
	EDGE OF PAVEMENT
	STANDARD CURB AND GUTTER
	REJECT CURB AND GUTTER
	MOUNTABLE CURB AND GUTTER
	8" CONCRETE RIBBON CURB
	ASPHALT PAVEMENT
	HEAVY DUTY ASPHALT PAVEMENT
	CONCRETE PAVEMENT
	HEAVY DUTY CONCRETE PAVEMENT
	PROPOSED 1 FOOT CONTOUR
	PROPOSED 5 FOOT CONTOUR
	EXISTING 1 FOOT CONTOUR
	EXISTING 5 FOOT CONTOUR
	DRAINAGE DIRECTION
	GRADE BREAK
	STORMWATER MANAGEMENT AREA
	RETAINING WALL
	BOULDER WALL
	RAILING
	FENCE
	LIGHT POLE (REFER TO PHOTOMETRIC PLAN)
	ADA PARKING SIGN
	FLAG POLE
	BOLLARD
	BOLLARD WITH ADA PARKING SIGN
	BIKE RACK
	TREE REMOVAL
	SHRUB REMOVAL
	SAWCUT EXISTING PAVEMENT
	SANITARY SEWER
	WATERMAIN
	STORM SEWER
	8'x4'x4" INSULATION (PLAN VIEW)
	8'x4'x4" INSULATION (PROFILE VIEW)
	SILT FENCE
	RIP-RAP
	CONSTRUCTION ENTRANCE
	EROSION MATTING
	TURF REINFORCEMENT MATTING
	SPOT ELEVATION
	EP - EDGE OF PAVEMENT
	FG - FINISH GRADE
	EC - EDGE OF CONCRETE
	BOC - BACK OF CURB
	MATCH - MATCH EXISTING GRADE
	HP - HIGH POINT
	SW - SIDEWALK
	DITCH CHECK
	INLET PROTECTION
	PROPERTY LINE
	RIGHT-OF-WAY
	EASEMENT LINE
	DEMOLITION - REMOVAL OF ONSITE CURB SURFACES AND BASE COURSE
	DEMOLITION - PAVEMENT MILL AND OVERLAY
	DEMOLITION - REMOVAL OF RETAINING WALL
	DEMOLITION - REMOVAL OF ASPHALT SURFACES
	DEMOLITION - REMOVAL OF CONCRETE SURFACES
	DEMOLITION - REMOVAL OF BUILDINGS/STRUCTURES
	DEMOLITION - REMOVAL OF UTILITIES
	DEMOLITION - REMOVAL OF LANDSCAPE BEDDING
	TREE REMOVAL
	SHRUB REMOVAL
	PROTECT EXISTING TREE

4/17/2024 11:30:17 AM



3535 UNIVERSITY MIXED USE


REVIEW DRAWING
NOT TO BE USED FOR CONSTRUCTION
DATE OF ISSUE: 07/10/2024



NOTES & LEGEND

JLA PROJECT No:	W23-0222
DATE OF ISSUANCE:	07/10/24
REVISION DATE:	

C101

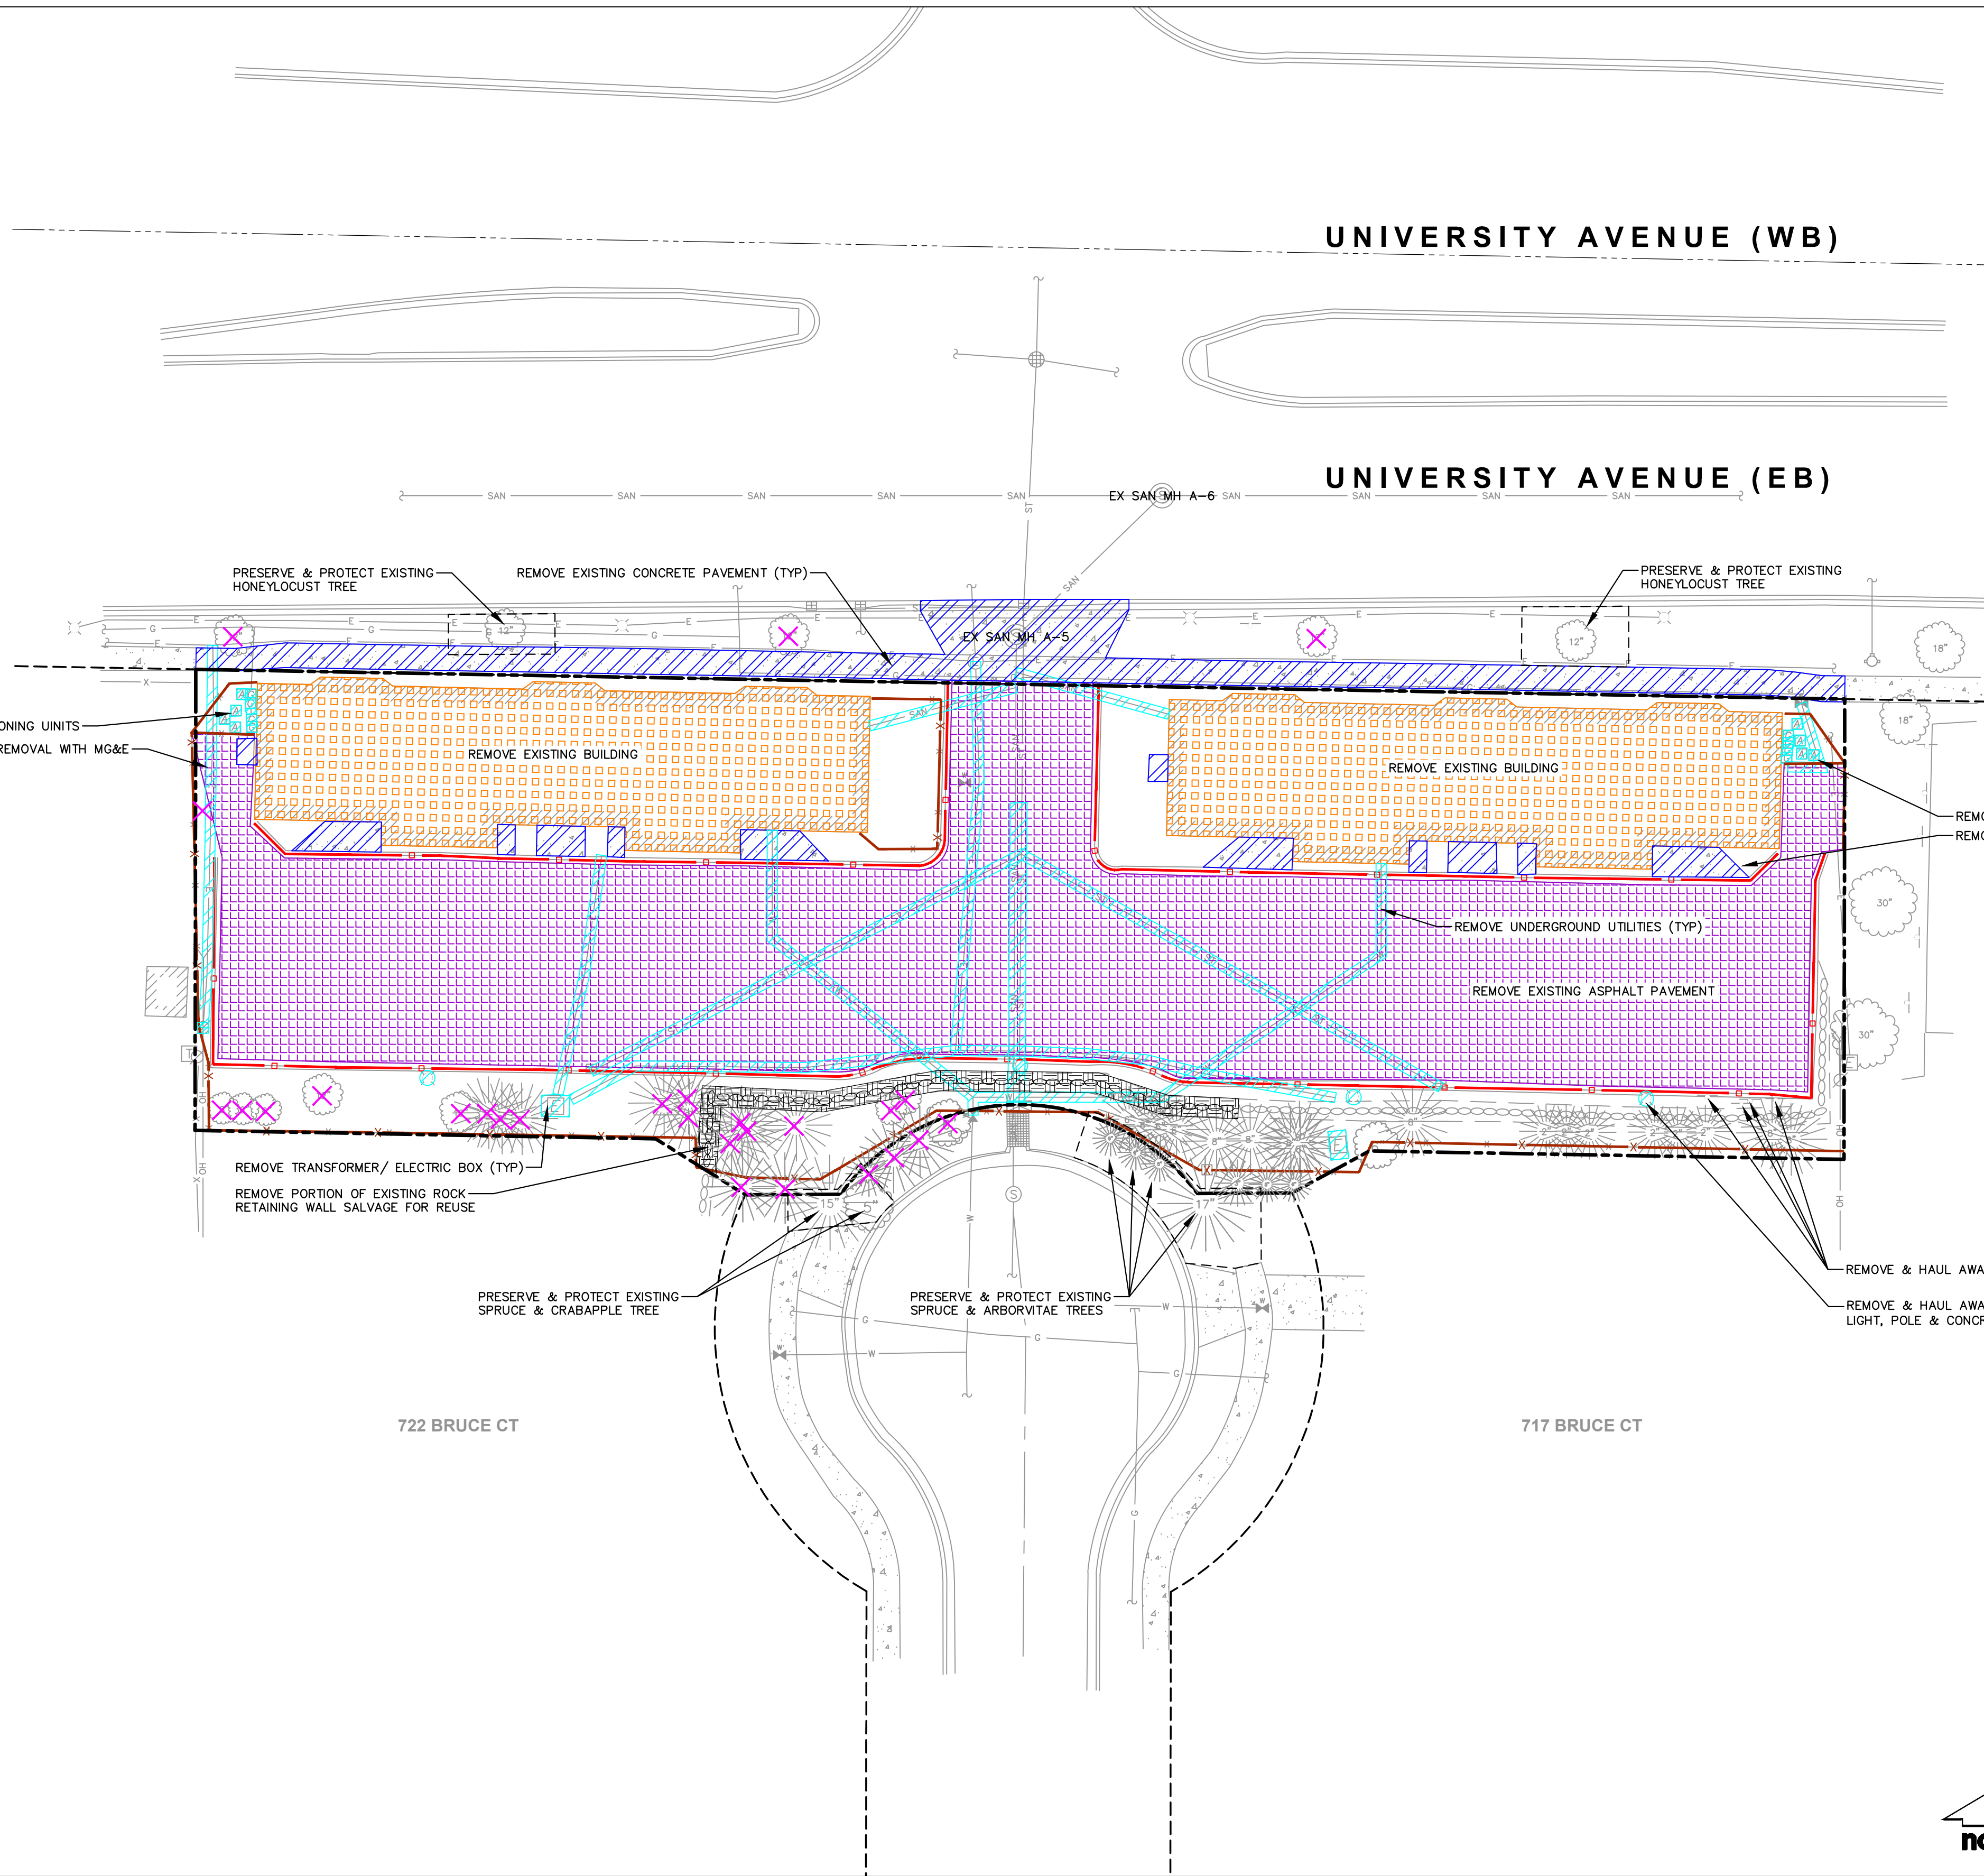

LEGEND

- — — — — PROPERTY LINE
- - - - - RIGHT-OF-WAY
- - - - - EASEMENT LINE
- — — — — DEMOLITION - REMOVAL OF ONSITE CURB SURFACES AND BASE COURSE
- ▨ DEMOLITION - REMOVAL OF RETAINING WALL
- ▨ DEMOLITION - REMOVAL OF ASPHALT SURFACES
- ▨ DEMOLITION - REMOVAL OF CONCRETE SURFACES
- ▨ DEMOLITION - REMOVAL OF BUILDINGS/STRUCTURES
- ▨ DEMOLITION - REMOVAL OF UTILITIES
- ▨ DEMOLITION - REMOVAL OF FENCE
- ✕ TREE REMOVAL
- PROTECT EXISTING TREE

CURVE TABLE

CURVE	LENGTH	RADIUS	TANGENT	DELTA	CHORD	CHORD BEARING
C-10	81.58'	44.00'	58.63	106°13'46"	70.39'	S89°51'52"W
C-11	81.58'	44.00'	58.63	106°13'46"	70.39'	S89°51'52"W
C-12	81.58'	44.00'	58.63	106°13'46"	70.39'	S89°51'52"W

CONTRACTOR SHALL CONTACT CITY FORESTRY AT 266-4816 TO ISSUE A STREET TREE REMOVAL PERMIT FOR (X) TREE(S) (DBH) DIAMETER (VARIETY) TREE DUE TO (REASON) AT (LOCATION).

PRESERVE & PROTECT EXISTING HONEYLOCUST TREE

REMOVE EXISTING CONCRETE PAVEMENT (TYP)

EX SAN MH A-6

PRESERVE & PROTECT EXISTING HONEYLOCUST TREE

EX SAN MH A-5

REMOVE EXISTING AIR CONDITIONING UNITS

COORDINATE ALL ELECTRICAL REMOVAL WITH MG&E

REMOVE EXISTING BUILDING

REMOVE EXISTING BUILDING

REMOVE EXISTING AIR CONDITIONING UNITS

REMOVE & HAUL AWAY BIKE RACK

REMOVE UNDERGROUND UTILITIES (TYP)

REMOVE EXISTING ASPHALT PAVEMENT

REMOVE TRANSFORMER/ ELECTRIC BOX (TYP)

REMOVE PORTION OF EXISTING ROCK RETAINING WALL SALVAGE FOR REUSE

PRESERVE & PROTECT EXISTING SPRUCE & CRABAPPLE TREE

PRESERVE & PROTECT EXISTING SPRUCE & ARBORVITAE TREES

REMOVE & HAUL AWAY SIGN & POST

REMOVE & HAUL AWAY LIGHT, POLE & CONCRETE BASE (TYP)

722 BRUCE CT

717 BRUCE CT



4/17/2024 11:30:17 AM



3535 UNIVERSITY MIXED USE

REVIEW DRAWING
 NOT TO BE USED FOR CONSTRUCTION
 DATE OF ISSUE 07/10/2024




DEMOLITION PLAN

JLA PROJECT No: W23-0222
 DATE OF ISSUANCE: 07/10/24
 REVISION DATE:

C200

SITE INFORMATION BLOCK	
SITE ADDRESS	3535 UNIVERSITY AVE
PROPERTY ACREAGE	0.69 ACRES ACRES
NUMBER OF BUILDING STORIES	5
TOTAL BUILDING SQUARE FOOTAGE	16,360 SF
GREEN ROOF SQUARE FOOTAGE	4,200 SF
NUMBER OF PARKING STALLS	
UNDERGROUND	
LARGE	56
COMPACT	18
ACCESSIBLE	3
TOTAL UNDERGROUND	77
NUMBER OF SURFACE BICYCLE STALLS:	8
NUMBER OF UNDERGROUND BICYCLE STALLS:	31
EXISTING VS. PROPOSED SITE COVERAGE	
EXISTING IMPERVIOUS SURFACE AREA	22,845 SF
EXISTING PERVIOUS SURFACE AREA	6,996 SF
EXISTING IMPERVIOUS SURFACE AREA RATIO	0.77
PROPOSED IMPERVIOUS SURFACE AREA	23,373 SF
PROPOSED PERVIOUS SURFACE AREA	6,468 SF
PROPOSED IMPERVIOUS SURFACE AREA RATIO	0.78

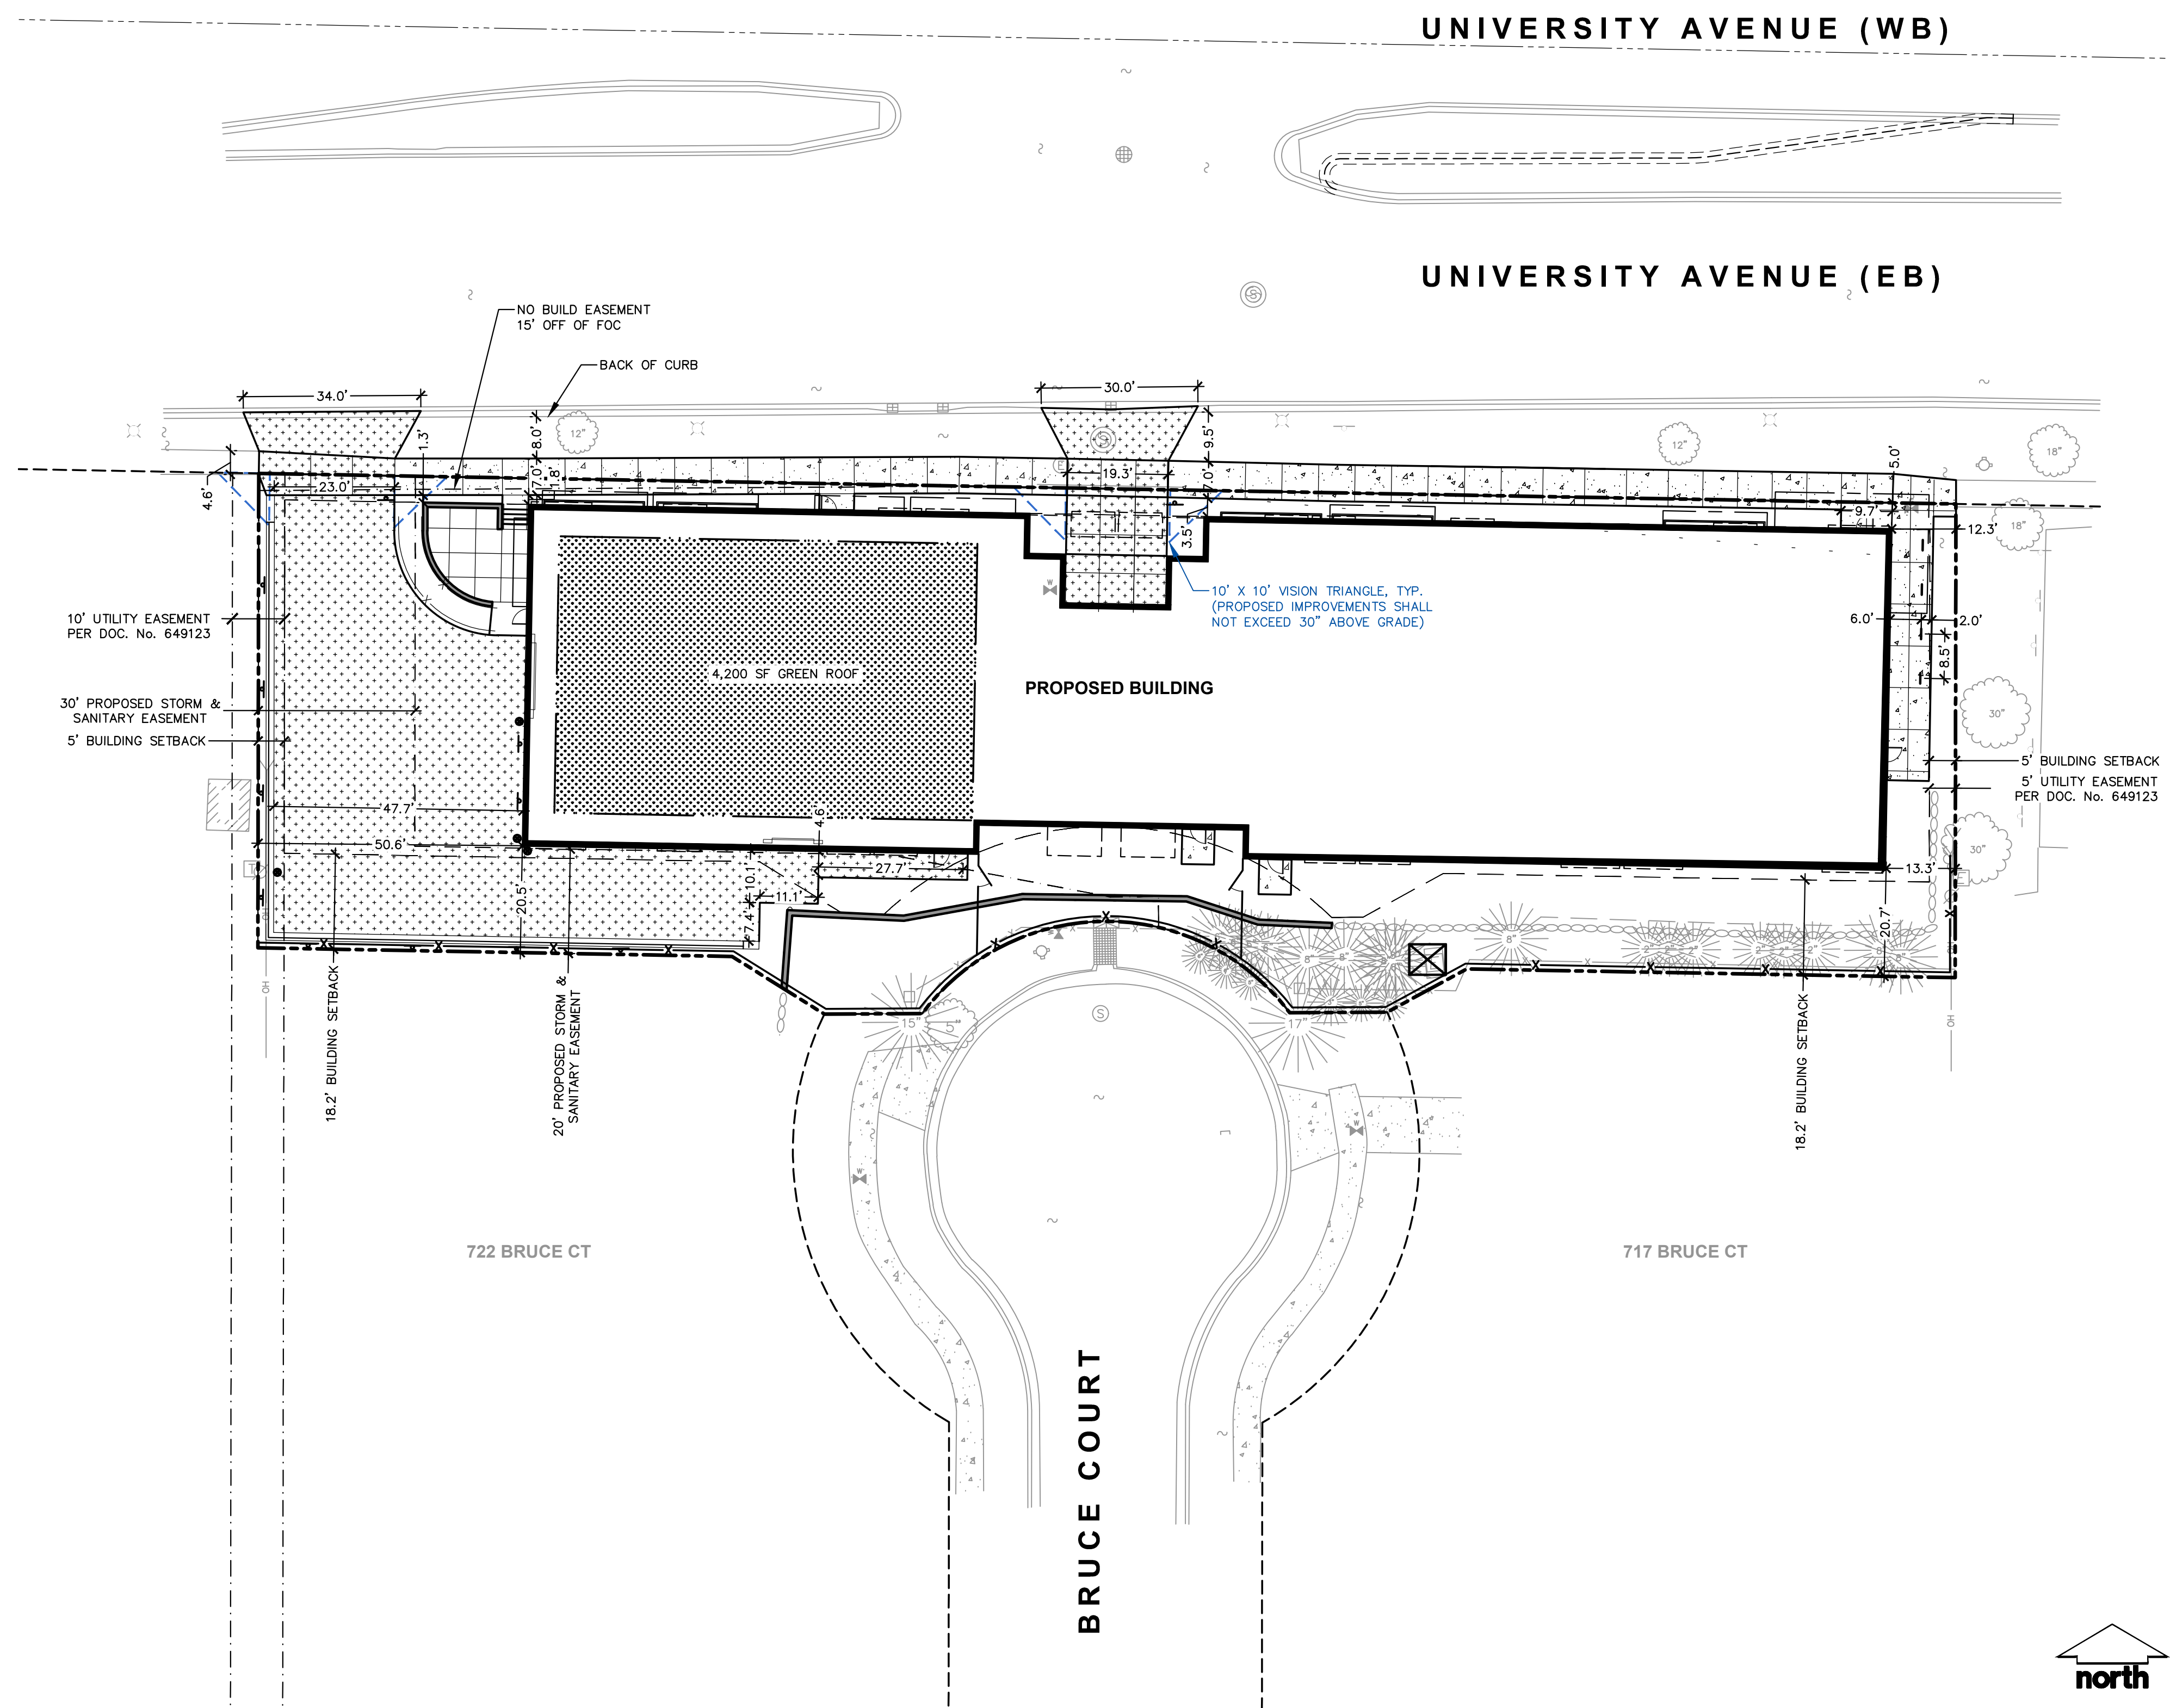

4/17/2024 11:30:17 AM



3535 UNIVERSITY MIXED USE


REVIEW DRAWING
 NOT TO BE USED FOR CONSTRUCTION
 DATE OF ISSUE 07/10/2024




DIMENSIONED SITE PLAN

JLA PROJECT No:	W23-0222
DATE OF ISSUANCE:	07/10/24
REVISION DATE:	

C300

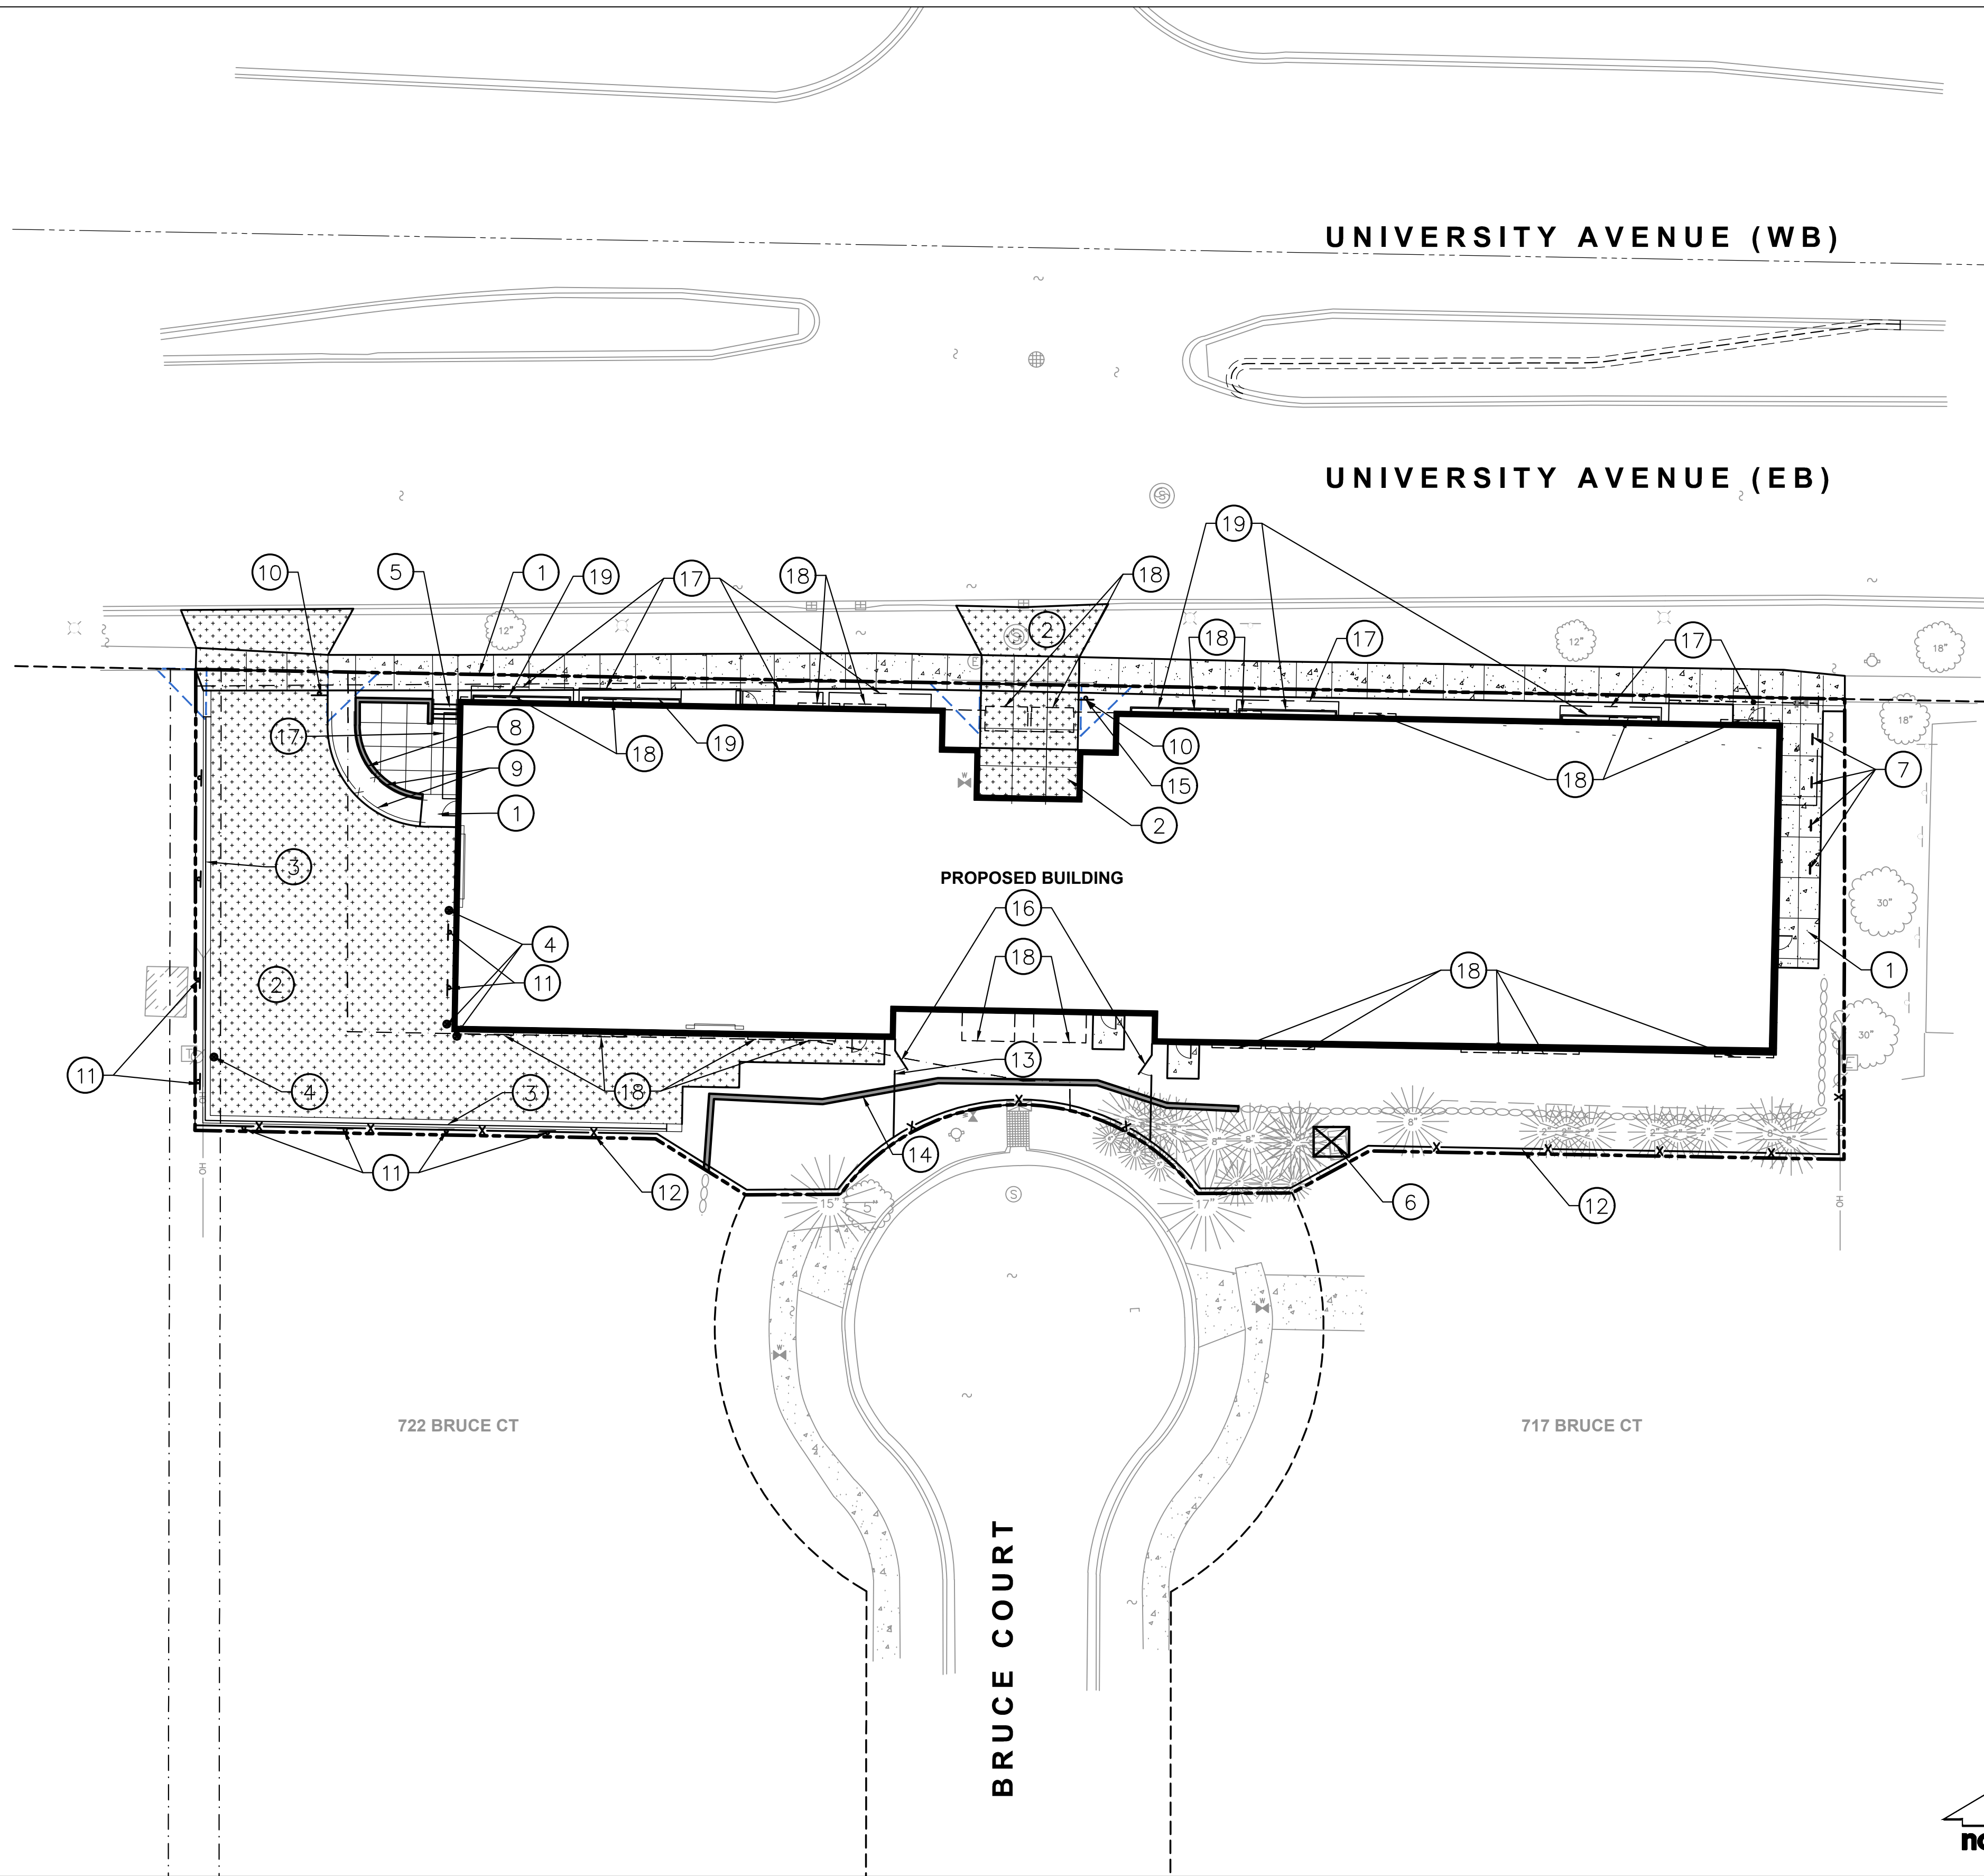

- KEYNOTES**
1. CONCRETE SIDEWALK (REFER TO DETAIL)
 2. HEAVY DUTY CONCRETE PAVEMENT (REFER TO DETAIL)
 3. 18" STANDARD CURB & GUTTER (REFER TO DETAIL)
 4. BOLLARD (REFER TO DETAILS)
 5. STEPS WITH RAILING (REFER TO DETAIL)
 6. TRANSFORMER PAD
 7. BIKE RACK
 8. SEAT WALL
 9. RAILING
 10. R1-1 STOP SIGN
 11. R8-3 NO PARKING SIGN MOUNTED TO WALL FENCE OR POST
 12. 6' OPAQUE CEDAR FENCE
 13. 4' VINYL COATED CHAIN LINK FENCE
 14. RETAINING WALL - REUSE EXISTING WALL STONE
 15. R3-2 "NO LEFT TURN 7-9 AM, 4-6 PM" SIGN
 16. 4' FENCE W/ GATE BELOW RETAINING WALL
 17. BUILDING AWNING
 18. BALCONY
 19. PLANTER BOX

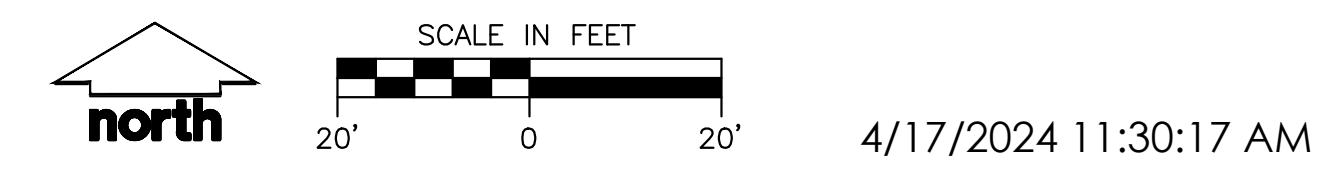

3535 UNIVERSITY MIXED USE

REVIEW DRAWING
 NOT TO BE USED FOR CONSTRUCTION
 DATE OF ISSUE 07/10/2024




ANNOTATED SITE PLAN

JLA PROJECT No:	W23-0222
DATE OF ISSUANCE:	07/10/24
REVISION DATE:	

C301

UNIVERSITY AVENUE (EB)

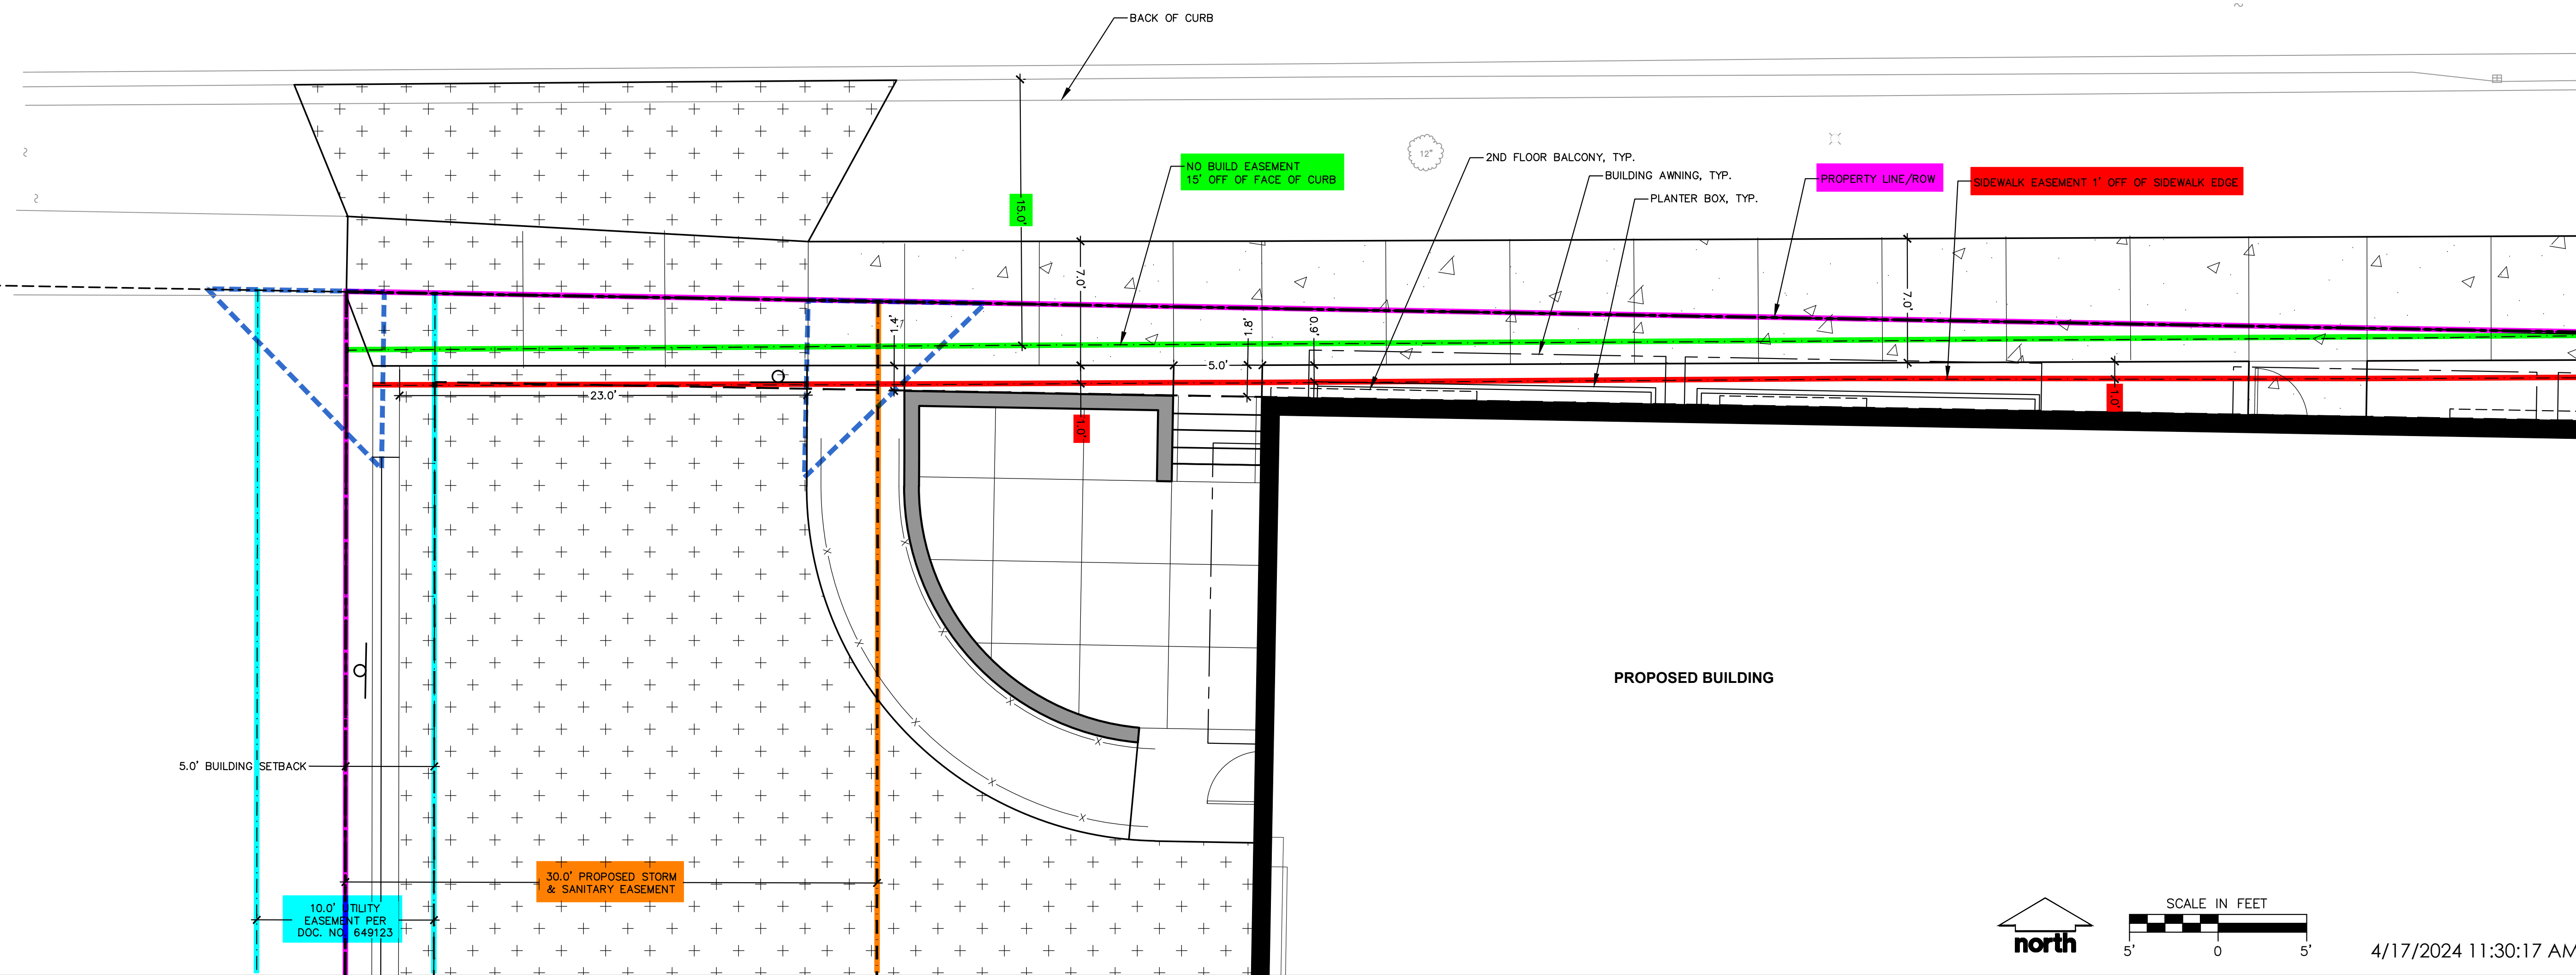

4/17/2024 11:30:17 AM



3535 UNIVERSITY MIXED USE

REVIEW DRAWING
 NOT TO BE USED FOR CONSTRUCTION
 DATE OF ISSUE 07/10/2024





SITE PLAN, NW EASEMENT EXHIBIT

JLA PROJECT No:	W23-0222
DATE OF ISSUANCE:	07/10/24
REVISION DATE:	

C302

NOTES

1. FLOOD PLAIN ELEVATION IS 887.6 AND MINIMUM OPENING ELEVATION IS 888.10

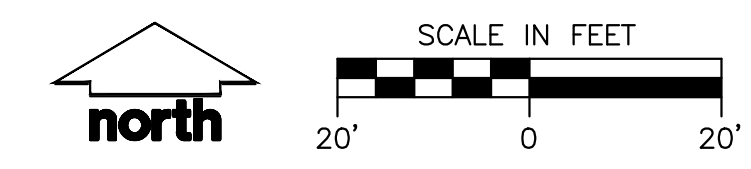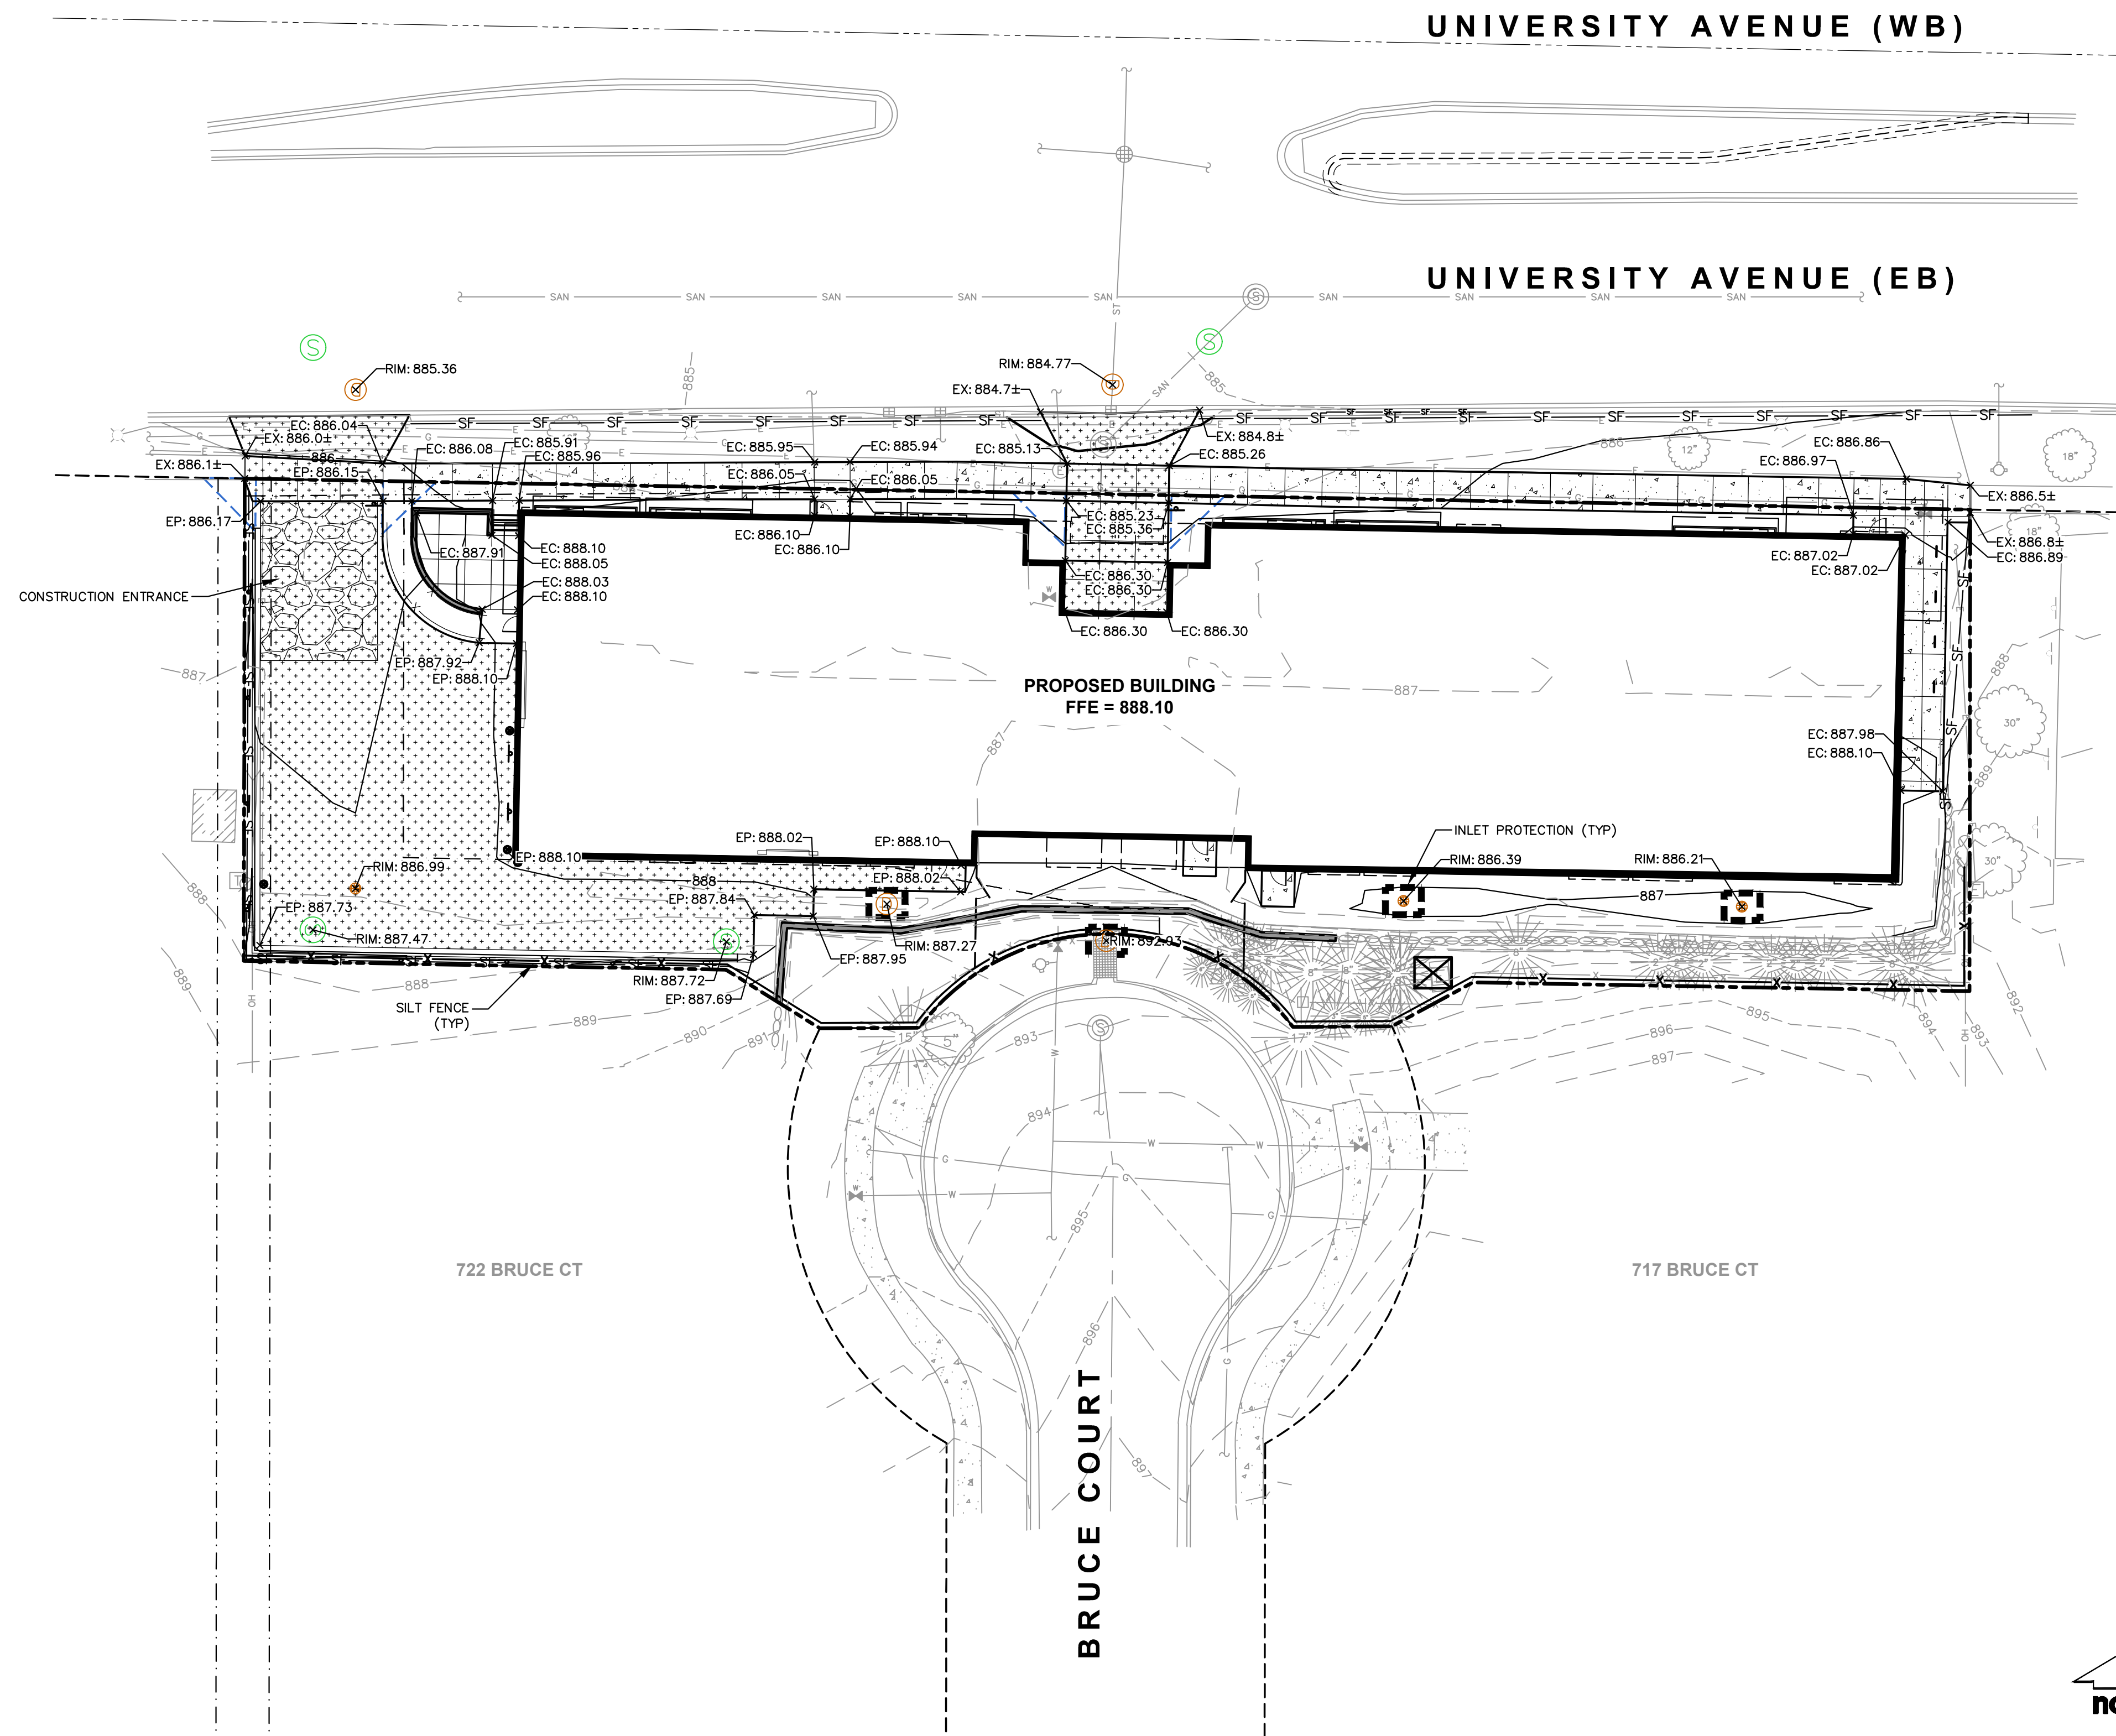

4/17/2024 11:30:17 AM



3535 UNIVERSITY MIXED USE


REVIEW DRAWING
 NOT TO BE USED FOR CONSTRUCTION
 DATE OF ISSUE 07/10/2024



GRADING & EROSION CONTROL PLAN

JLA PROJECT No:	W23-0222
DATE OF ISSUANCE:	07/10/24
REVISION DATE:	

C400

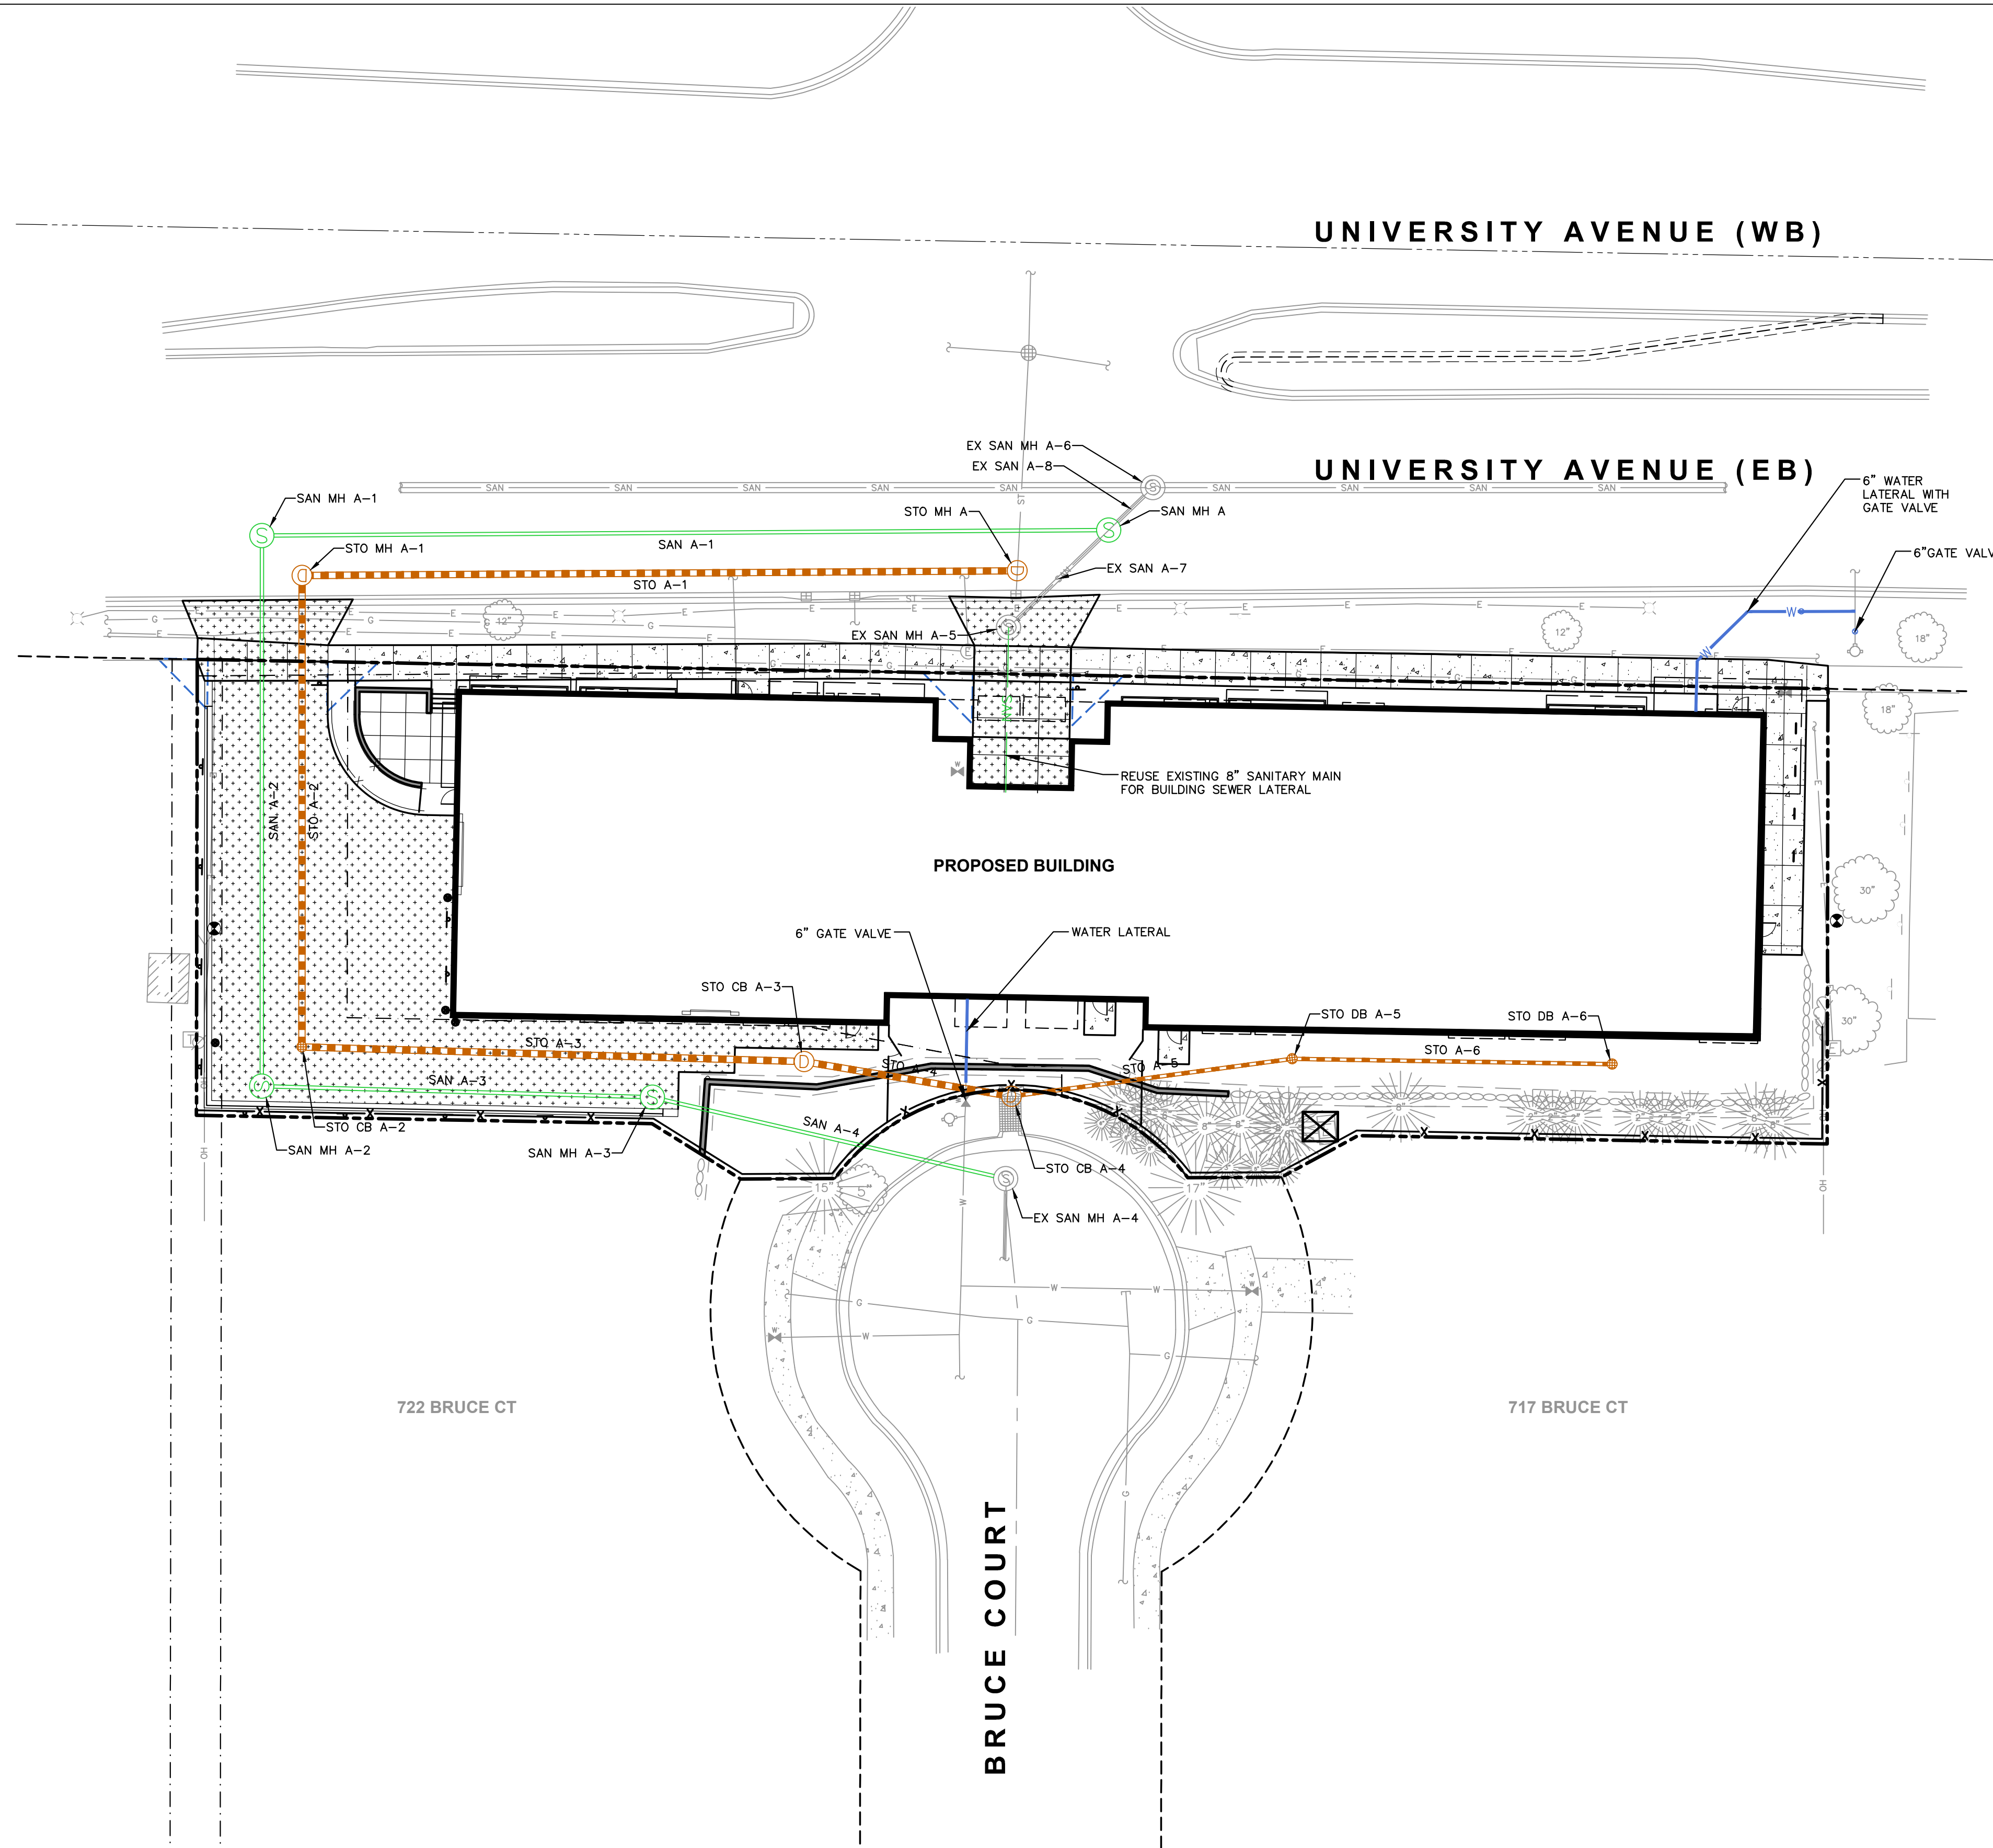


PROPOSED STORM SEWER STRUCTURE TABLE					
LABEL	RIM EL. (FT)	INVERT EL. (FT)	DEPTH (FT)	STRUCTURE DESC.	FRAME & GRATE
STO CB A-2	886.99	N INV: 881.61 (15") E INV: 881.71 (15")	5.4	36 IN MH (FLAT)	R-2050 TYPE D
STO CB A-3	887.27	W INV: 882.36 (15") E INV: 882.46 (15")	4.9	48 IN MH (FLAT)	R-1550 SOLID LID
STO CB A-4	893.48	W INV: 882.73 (15") E INV: 883.31 (8")	10.7	48 IN MH (FLAT)	R-1550 SOLID LID
STO DB A-5	886.39	W INV: 883.68 (8") E INV: 883.78 (8")	2.7	24 IN DB	ADA DRAIN WITH BEEHIVE GRATE
STO DB A-6	886.21	W INV: 884.19 (8")	2.0	24 IN DB	ADA DRAIN WITH BEEHIVE GRATE
STO MH A	884.77	W INV: 879.97 (15")	4.8	48 IN MH (FLAT)	R-1550 SOLID LID
STO MH A-1	885.36	E INV: 880.90 (15") S INV: 881.00 (15")	4.5	48 IN MH (FLAT)	R-1550 SOLID LID

PROPOSED STORM SEWER PIPE TABLE							
LABEL	FROM	TO	LENGTH	INVERT EL. (FT)	DISCHARGE EL. (FT)	SLOPE	SIZE & MATERIAL
STO A-1	STO MH A-1	STO MH A	143'	880.90	879.97	0.65%	15 IN RCP
STO A-2	STO CB A-2	STO MH A-1	94'	881.61	881.00	0.65%	15 IN RCP
STO A-3	STO CB A-3	STO CB A-2	100'	882.36	881.71	0.65%	15 IN RCP
STO A-4	STO CB A-4	STO CB A-3	42'	882.73	882.46	0.65%	15 IN RCP
STO A-5	STO DB A-5	STO CB A-4	56'	883.68	883.31	0.65%	8 IN HDPE
STO A-6	STO DB A-6	STO DB A-5	64'	884.19	883.78	0.65%	8 IN HDPE

PROPOSED SANITARY SEWER STRUCTURE TABLE					
LABEL	RIM EL. (FT)	INVERT EL. (FT)	DEPTH (FT)	STRUCTURE DESC.	FRAME & GRATE
EX SAN MH A-4	892.99	W INV: 885.04 (8") S INV: 885.15 (6") N INV: 885.04 (8")	8.0	48 IN MH	R-1550 SOLID LID
EX SAN MH A-5	8.99	S INV: 879.44 (8") NE INV: 879.08 (8")	9.7	48 IN MH	R-1550 SOLID LID
EX SAN MH A-6	877.79	SW INV: 873.19 (8") W INV: 871.02 (24") E INV: 870.86 (24")	6.9	48 IN MH	R-1550 SOLID LID
SAN MH A	889.77	SW INV: 874.99 (8") W INV: 874.99 (8") NE INV: 874.98 (8")	14.8	48 IN MH	R-1550 SOLID LID
SAN MH A-1	885.41	E INV: 875.80 (8") S INV: 875.90 (8")	9.6	48 IN MH	R-1550 SOLID LID
SAN MH A-2	887.47	N INV: 877.00 (8") E INV: 877.10 (8")	10.5	48 IN MH	R-1550 SOLID LID
SAN MH A-3	887.72	W INV: 880.99 (8") E INV: 881.09 (8")	6.7	48 IN MH	R-1550 SOLID LID

PROPOSED SANITARY SEWER PIPE TABLE							
LABEL	FROM	TO	LENGTH	INVERT EL. (FT)	DISCHARGE EL. (FT)	SLOPE	SIZE & MATERIAL
EX SAN A-7	SAN MH A	EX SAN MH A-5	28'	874.99	879.08	14.70%	8 IN PVC
EX SAN A-8	EX SAN MH A-6	SAN MH A	12'	873.19	874.98	14.70%	8 IN PVC
SAN A-1	SAN MH A-1	SAN MH A	169'	875.80	874.99	0.48%	8 IN PVC
SAN A-2	SAN MH A-2	SAN MH A-1	110'	877.00	875.90	1.00%	8 IN PVC
SAN A-3	SAN MH A-3	SAN MH A-2	78'	880.99	877.10	5.00%	8 IN PVC
SAN A-4	EX SAN MH A-4	SAN MH A-3	72'	885.04	881.09	5.47%	8 IN PVC

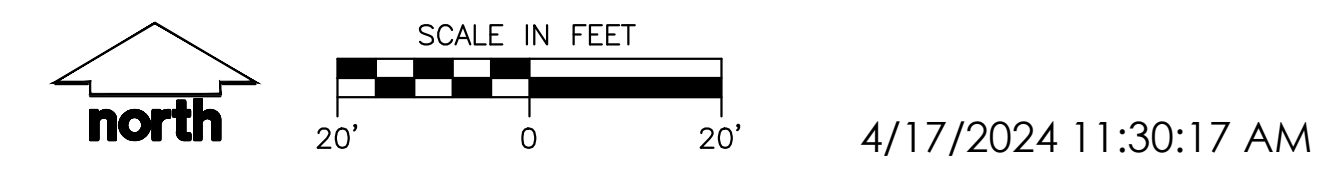

3535 UNIVERSITY MIXED USE




REVIEW DRAWING
NOT TO BE USED FOR CONSTRUCTION
DATE OF ISSUE: 07/10/2024





UTILITY PLAN

JLA PROJECT No: W23-0222
DATE OF ISSUANCE: 07/10/24
REVISION DATE:






C500

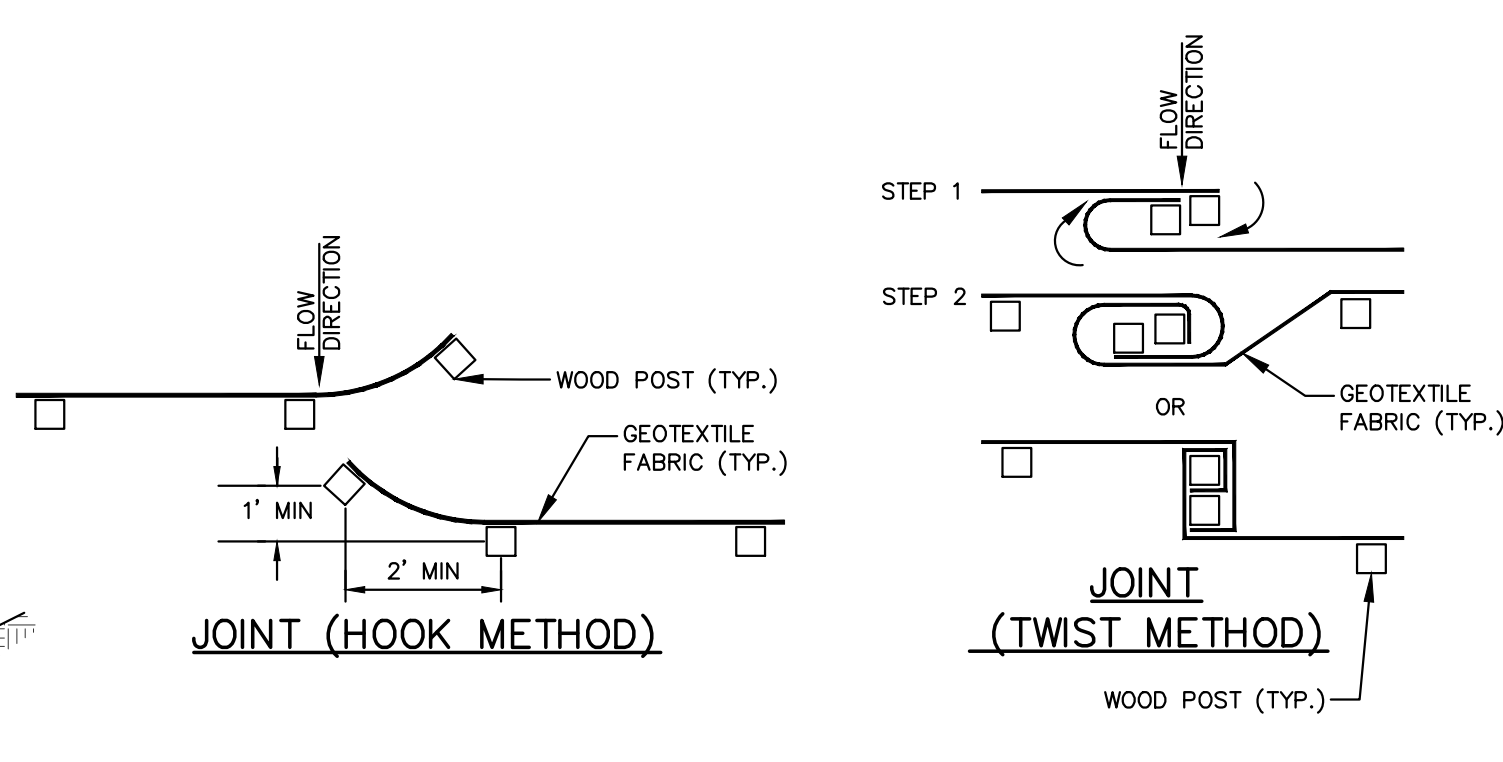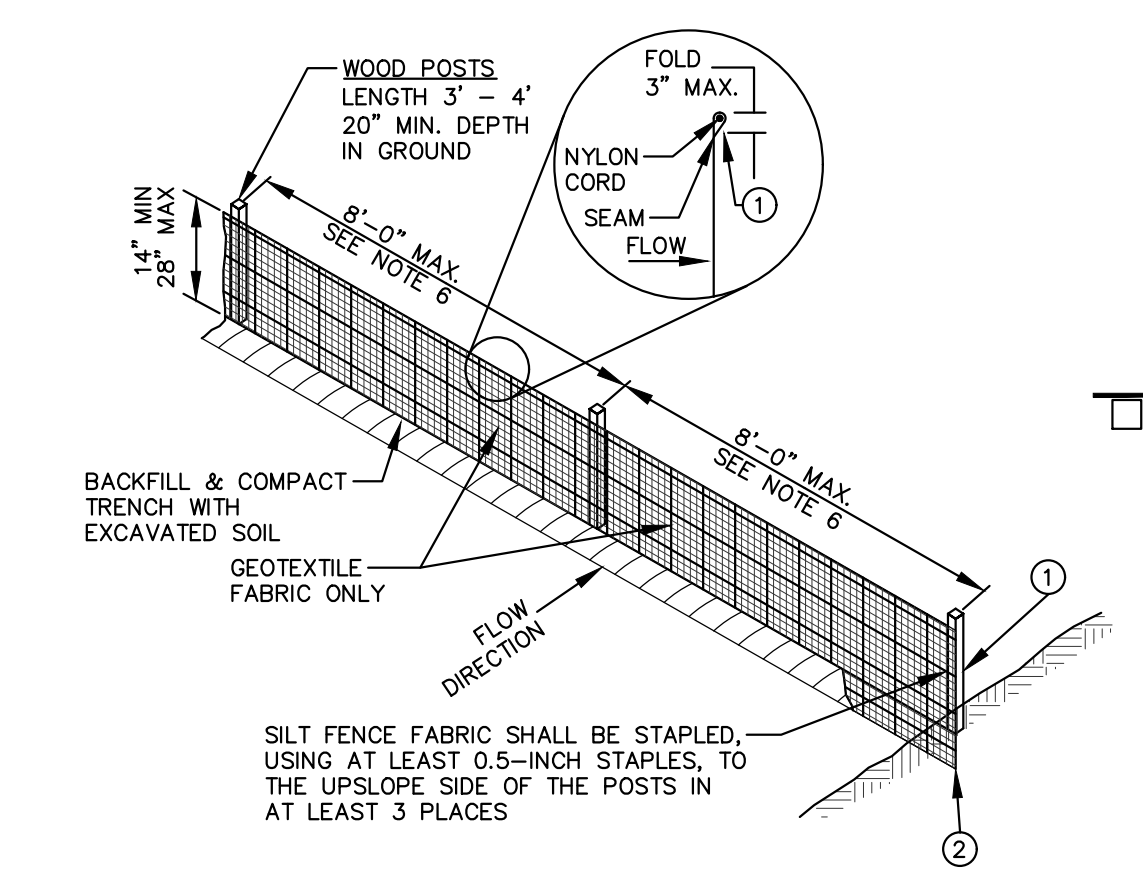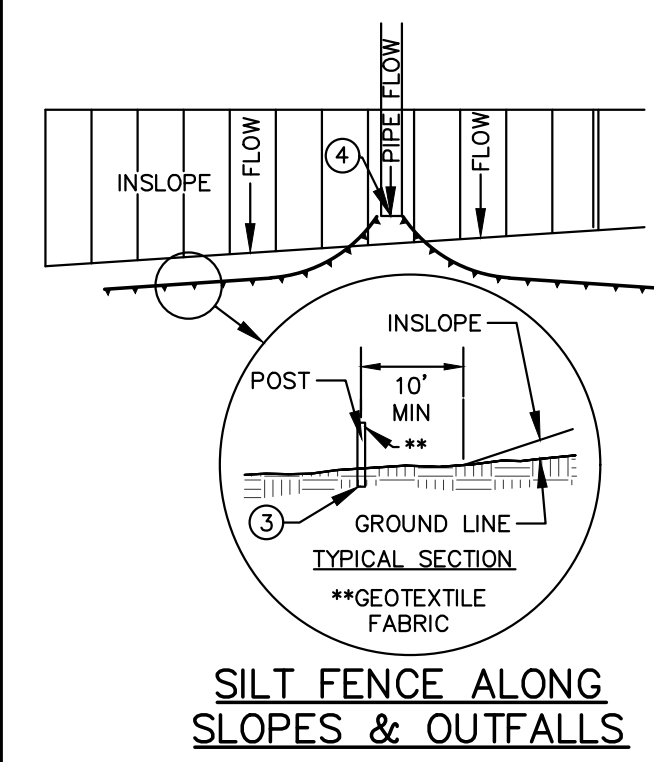


- GENERAL NOTES:**
- SILT FENCE SHALL BE ANCHORED BY SPREADING AT LEAST 8-INCHES OF FABRIC IN A 4-INCH WIDE AND 6-INCH DEEP TRENCH OR 6-INCH DEEP V-TRENCH ON THE UPSLOPE SIDE OF THE FENCE. TRENCHES SHALL NOT BE EXCAVATED WIDER OR DEEPER THAN NECESSARY FOR PROPER INSTALLATION.
 - FOLD MATERIAL TO FIT TRENCH AND BACKFILL AND COMPACT TRENCH WITH EXCAVATED SOIL.
 - WOOD POSTS SHALL BE A MINIMUM SIZE OF 1.125-INCHES x 1.125-INCHES OF DRIED OAK OR HICKORY.
 - SILT FENCE TO EXTEND ABOVE THE TOP OF PIPE.
 - SILT FENCE CONSTRUCTION AND GEOTEXTILE FABRIC SHALL CONFORM TO WDMR TECHNICAL STANDARD 1056.
 - POST SPACING SHALL BE SELECTED BASED ON GEOTEXTILE FABRIC (8-FEET FOR WOVEN & 3-FEET FOR NON-WOVEN)

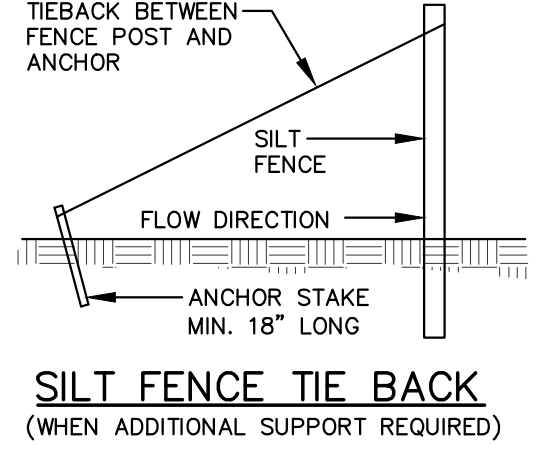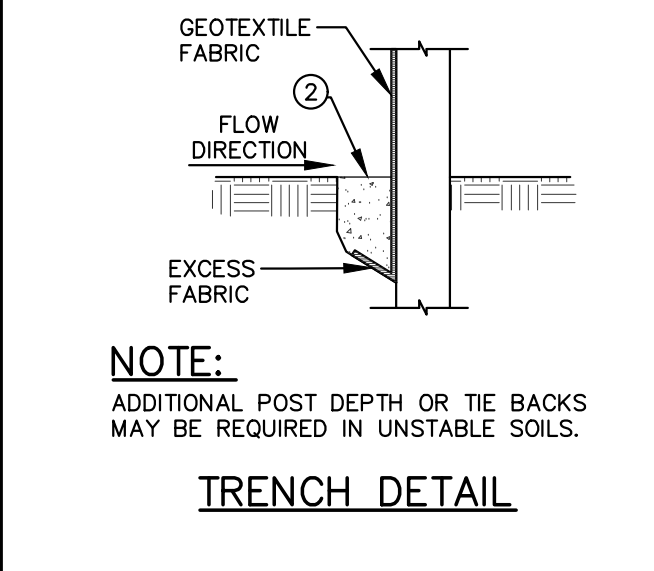

SILT FENCE
N.T.S.

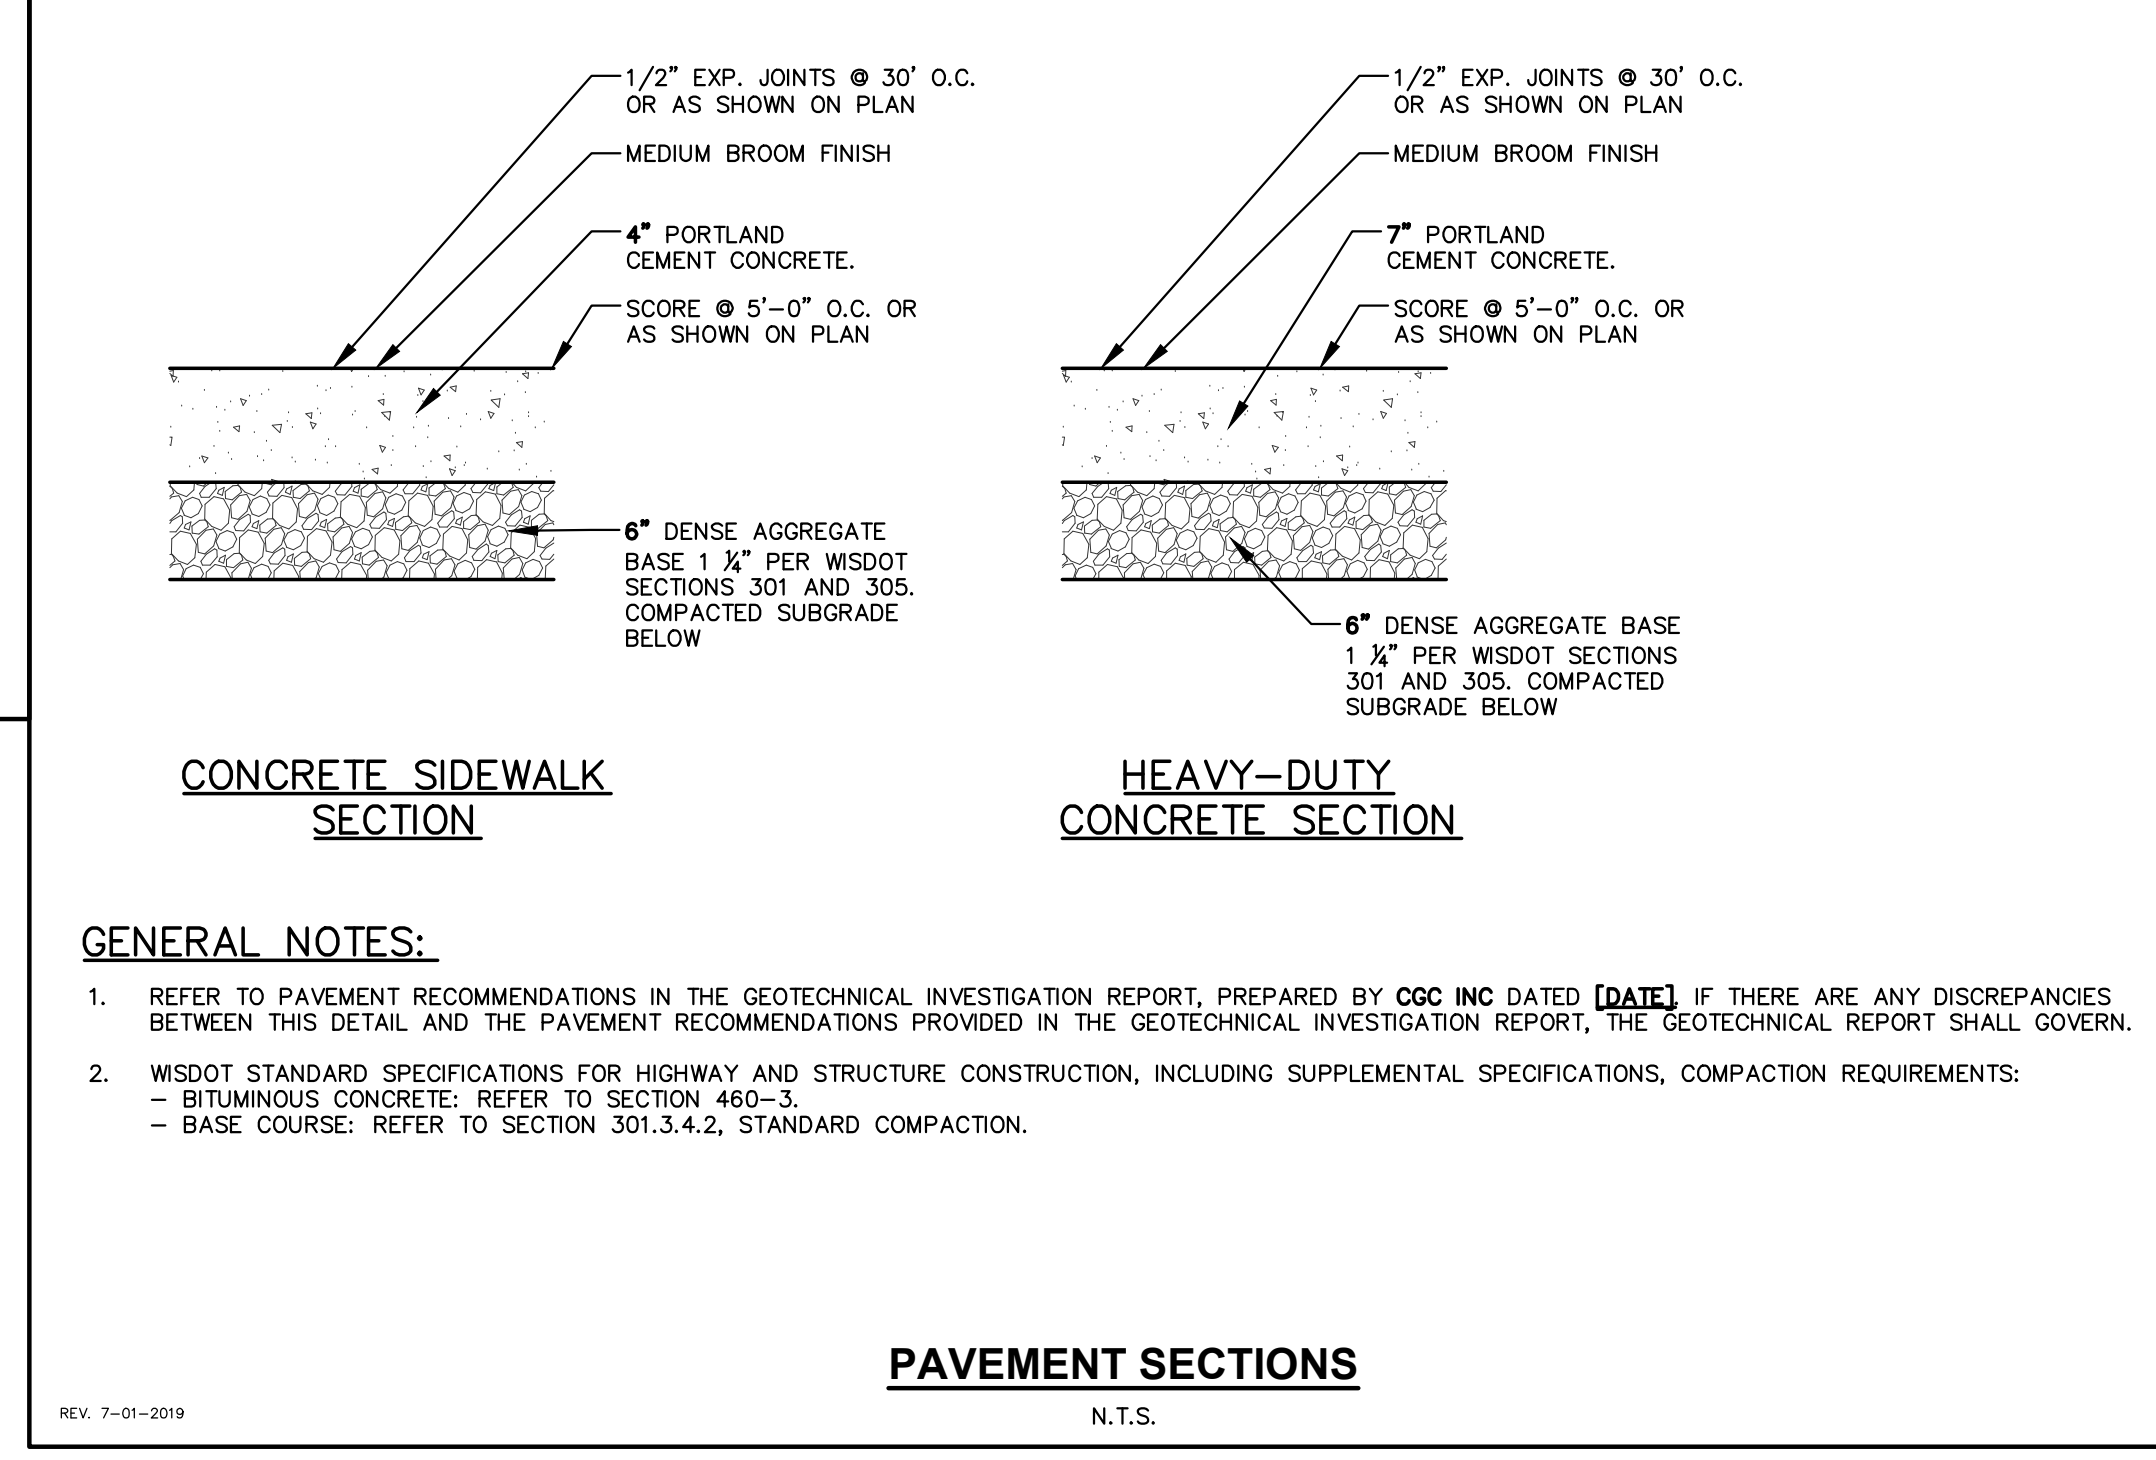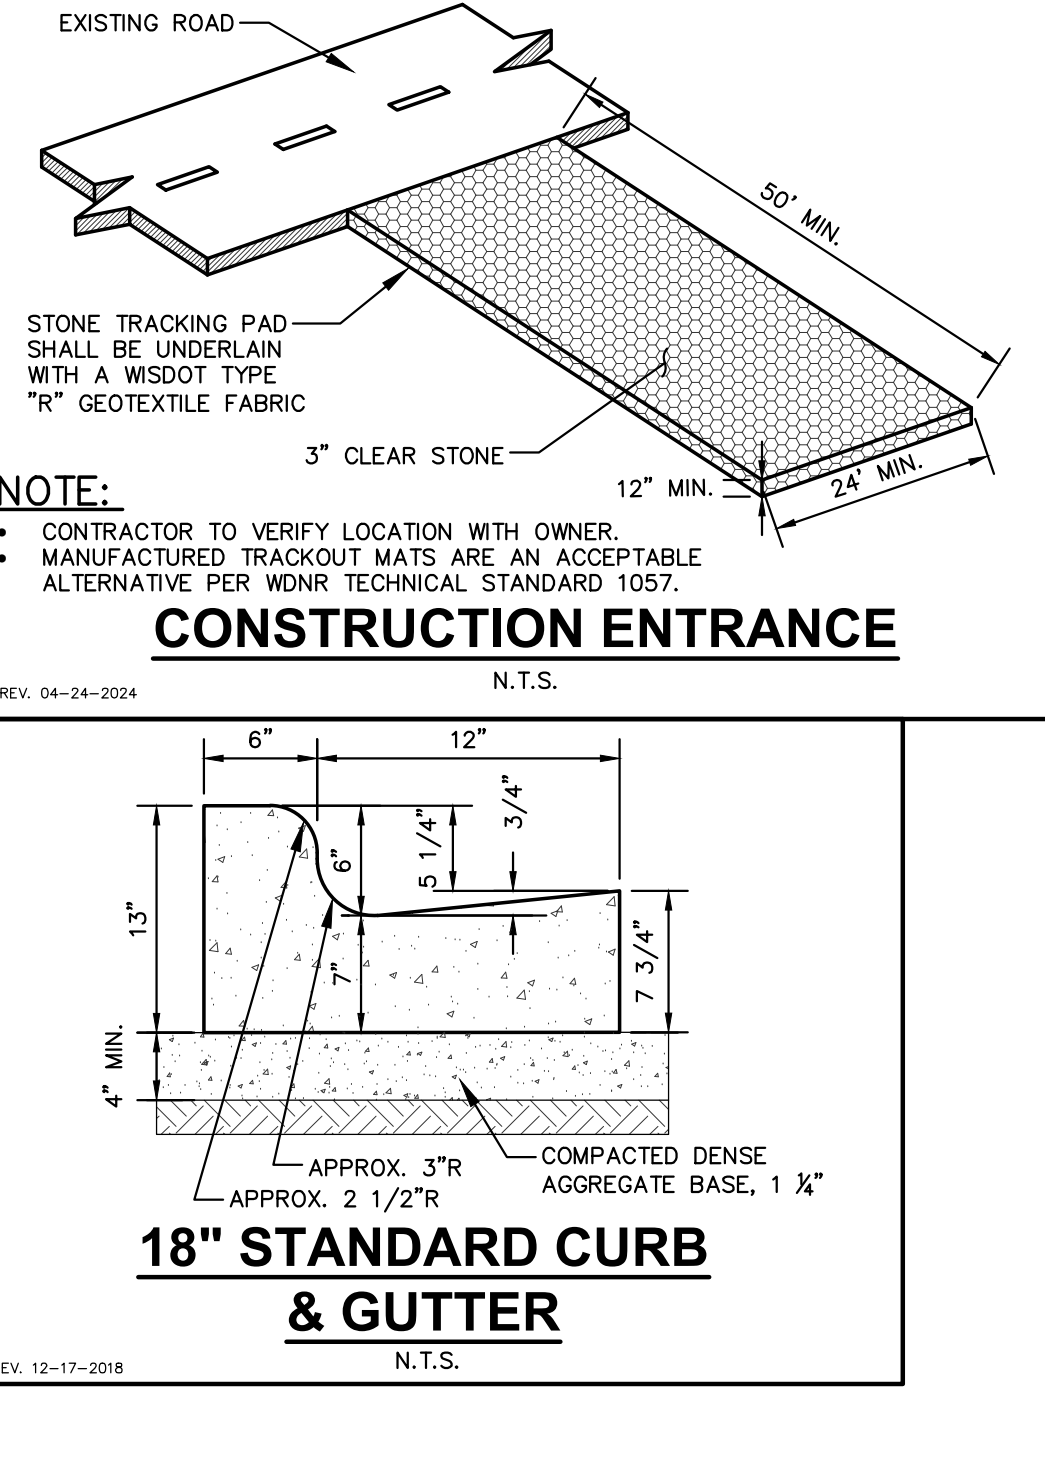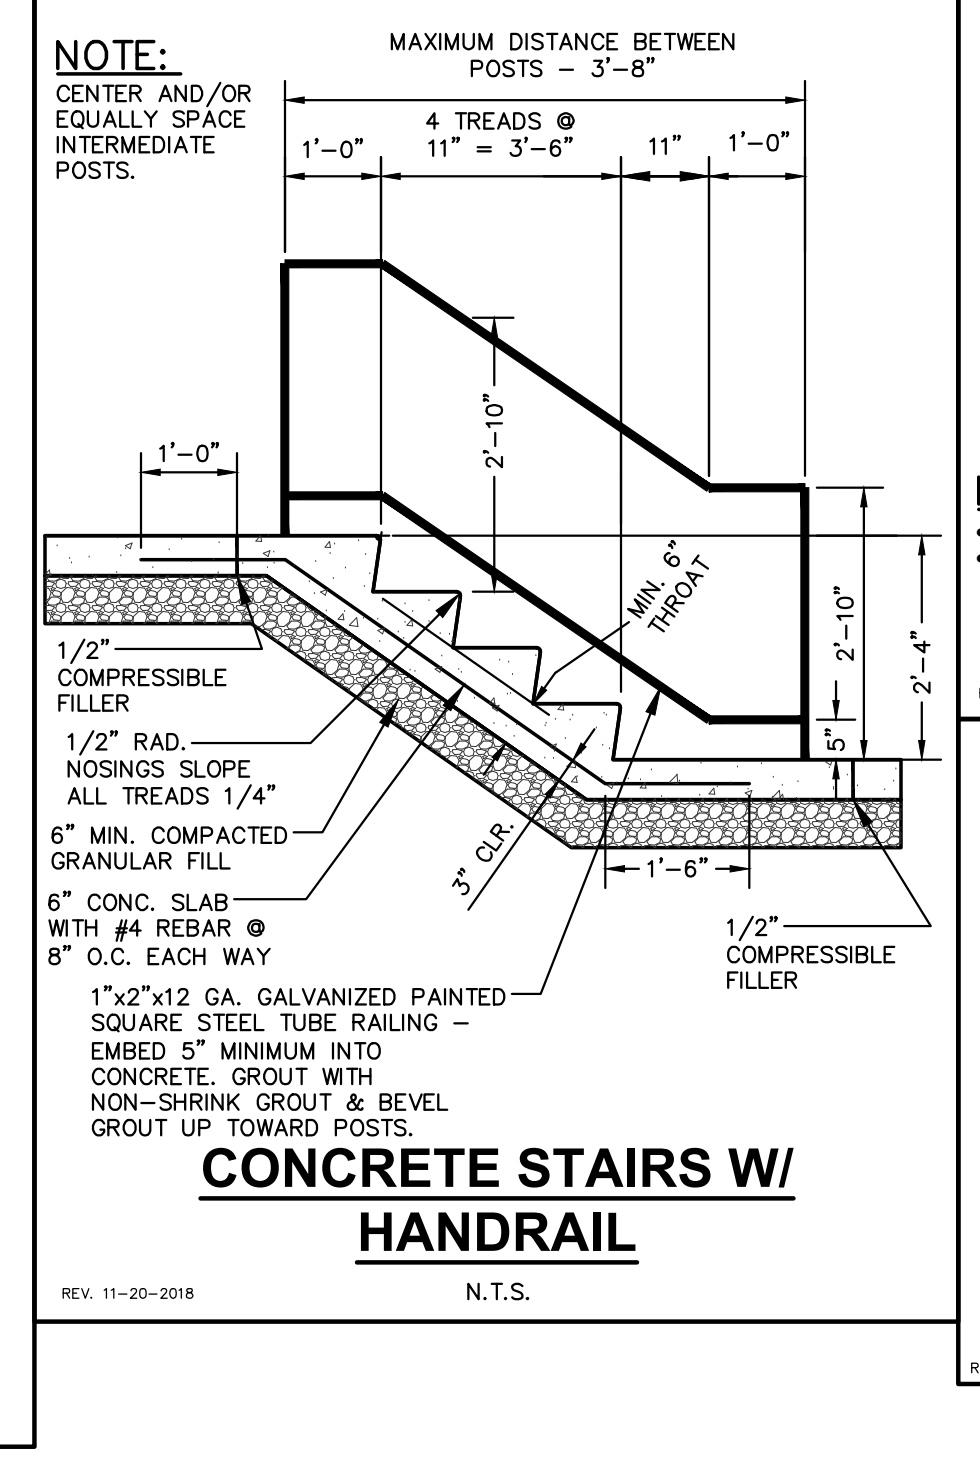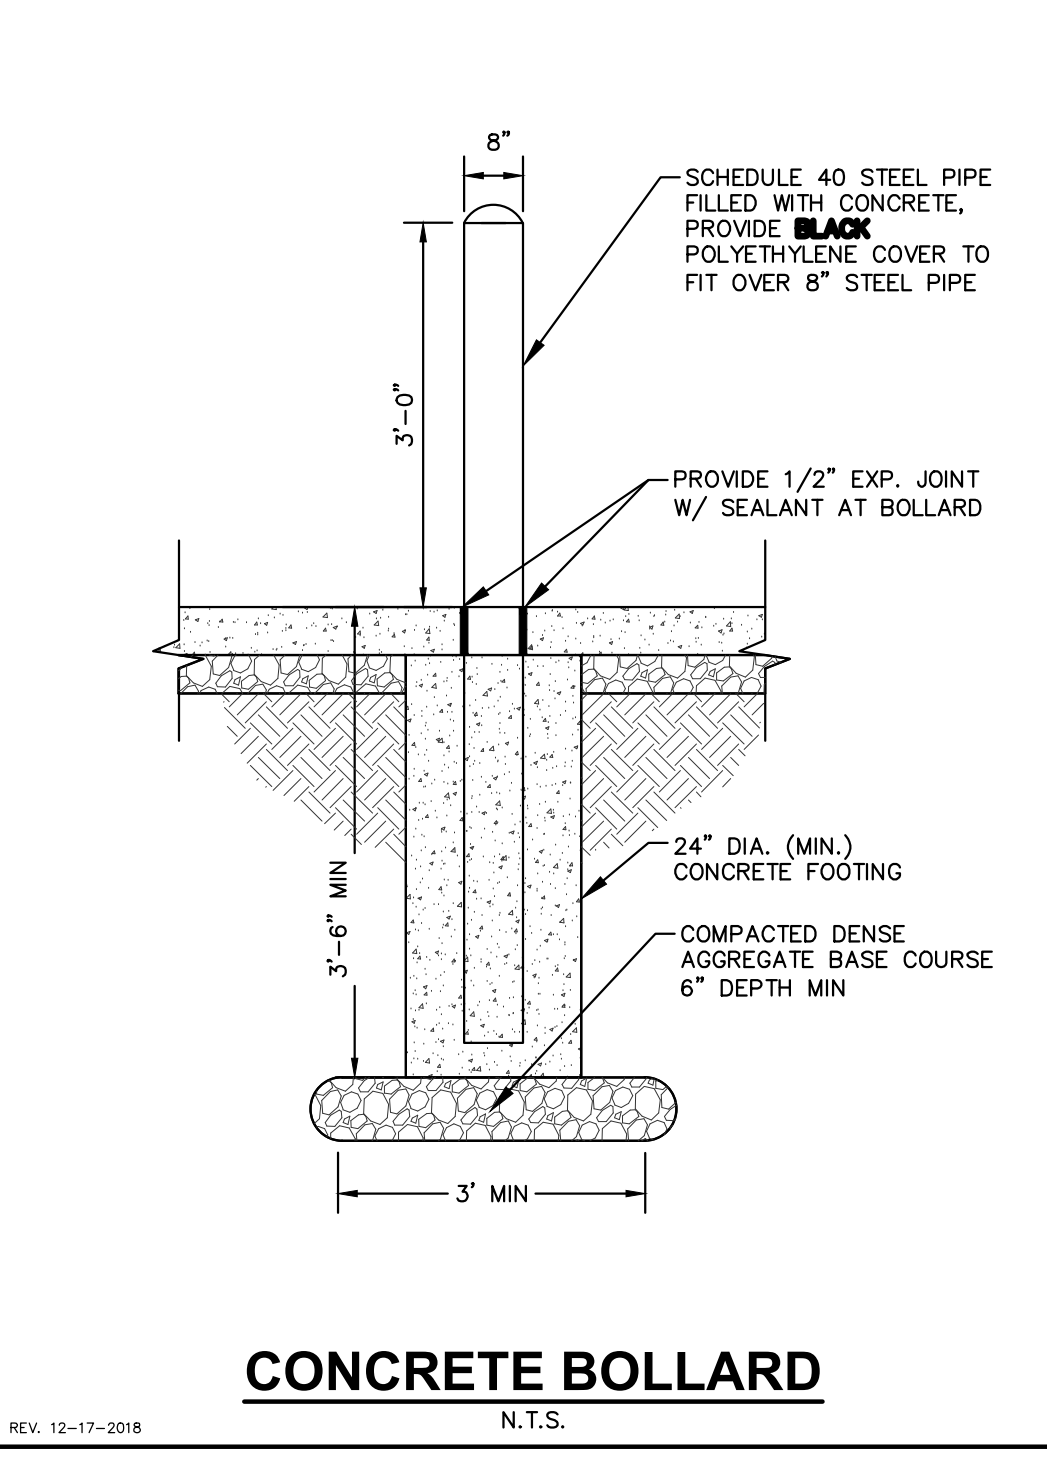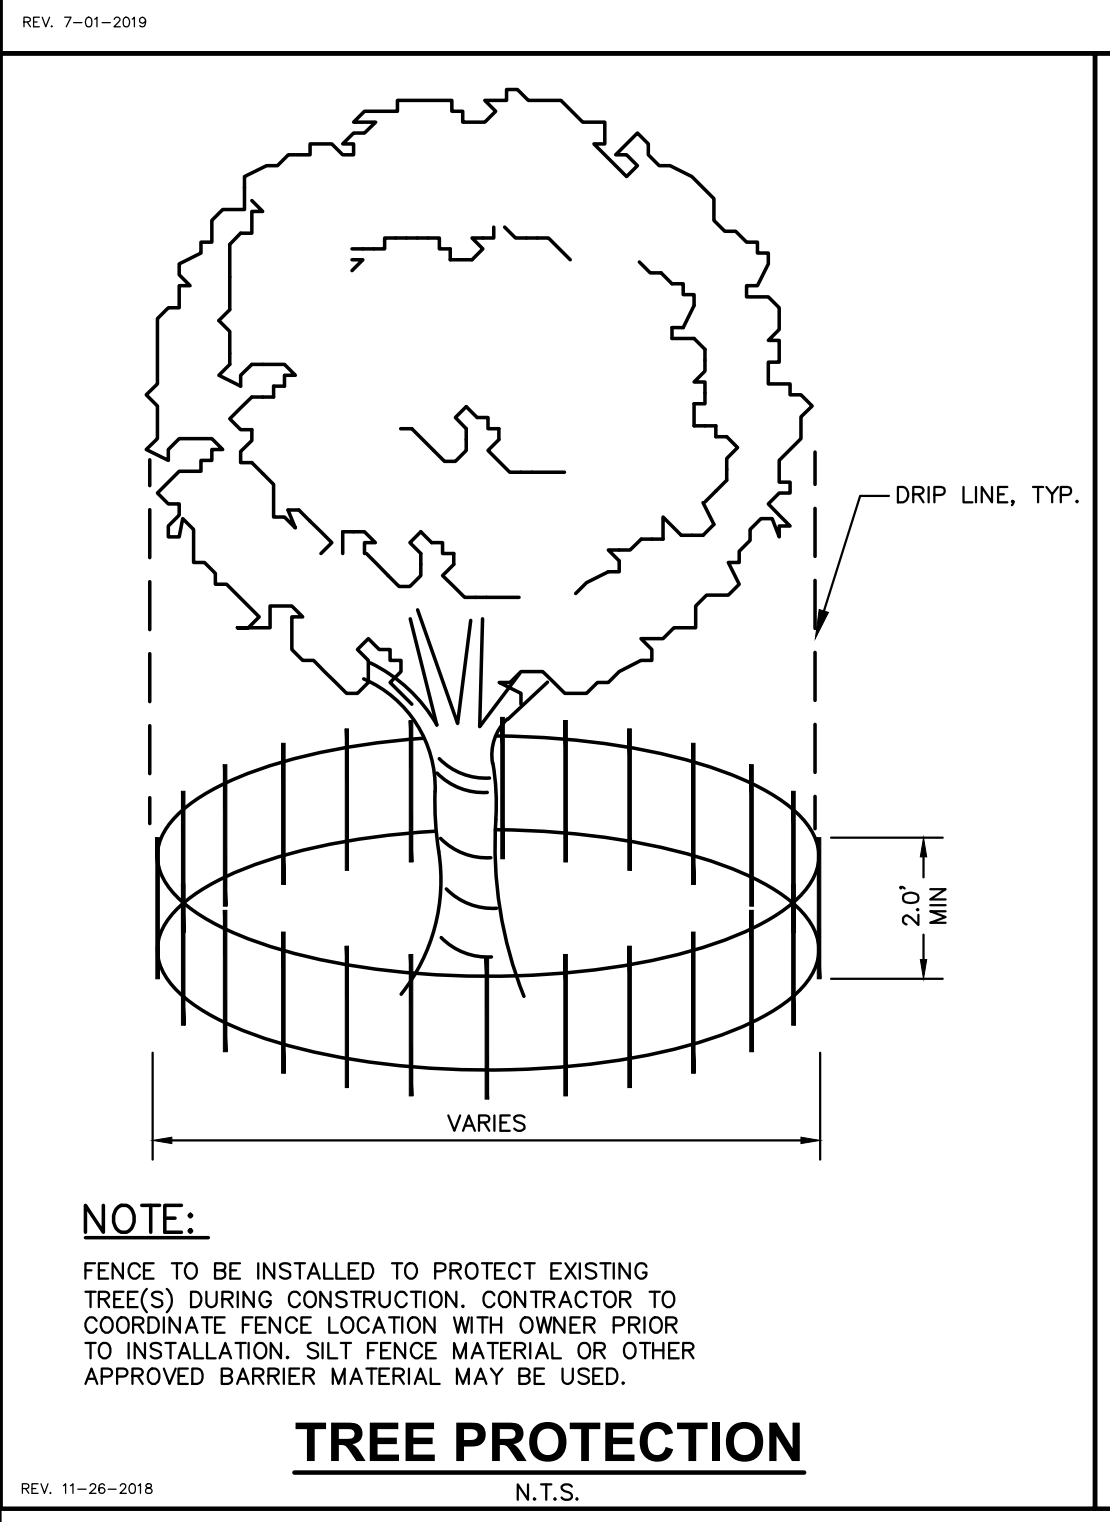

FLEXSTORM INLET FILTERS TO MEET DANE COUNTY EROSION CONTROL STANDARDS

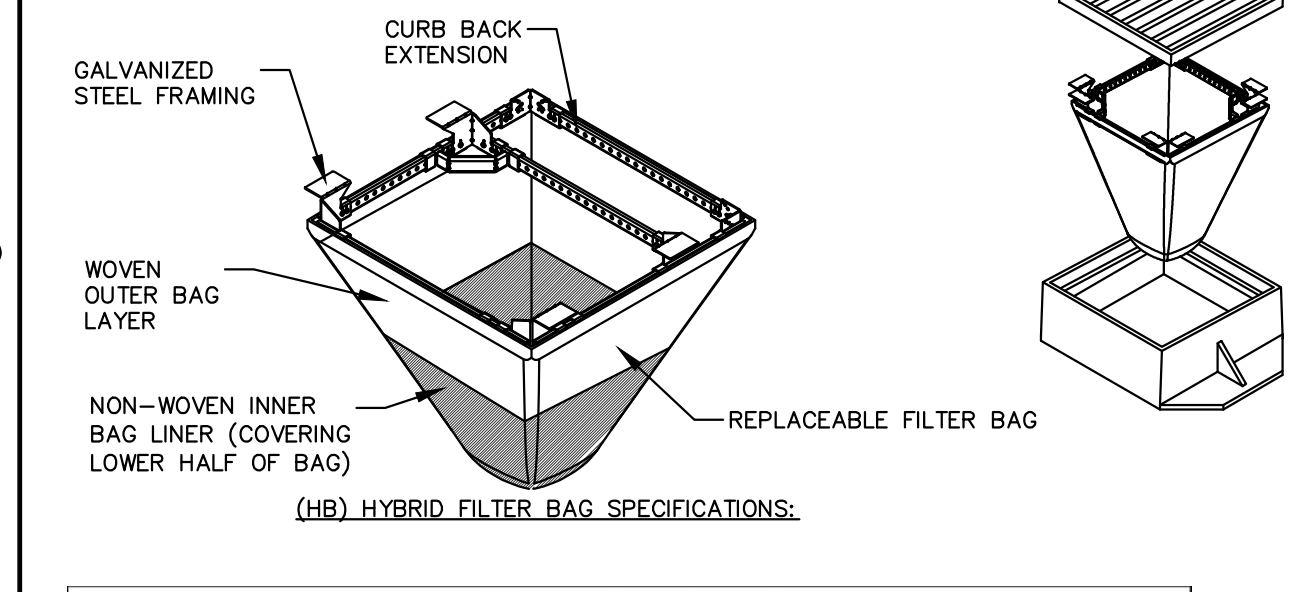

CATCH-IT INLET FILTER (Temporary Inlet Protection)

Neenah Casting	Inlet Type	Grate Size	Opening Size	Bag Cap (ft)	Flow Ratings (CFS)		ADS P/N
					HB (Hybrid Bag)	Bypass	
3067	Curb Box	35.25 x 17.75	33.0 x 15.0	4.4	2.0	5.8	62LCBETHB
3246A	Curb Box	35.75 x 23.875	33.5 x 21.0	4.2	1.1	3.3	62LCB924HB
3030	Square/Rect (SQ)	23 x 16	20.5 x 13.5	1.6	0.7	2.2	62MCR2316HB
3067-C	Square/Rect (SQ)	35.25 x 17.75	33 x 15	3.2	1.0	5.2	62LSQ3618HB
R-2501	Round (RD)	-28	-24	2.3	0.8	5.2	62MRQ28HB
R-1772/2560	Round (RD)	22.25-23.5	20.5-21	1.5	0.6	4.6	62MRD22HB

- INSTALLATION INSTRUCTIONS:**
- REMOVE GRATE FROM THE DRAINAGE STRUCTURE
 - CLEAN STONE AND DIRT FROM LEDGE (LIP) OF DRAINAGE STRUCTURE
 - DROP THE INLET FILTER THROUGH THE CLEAR OPENING SUCH THAT THE HANGERS REST FIRMLY ON THE LIP OF THE STRUCTURE
 - REPLACE THE GRATE AND CONFIRM IT IS NOT ELEVATED MORE THAN 1/8"

- MAINTENANCE GUIDELINES:**
- EMPTY THE SEDIMENT BAG IF MORE THAN HALF FILLED WITH SEDIMENT AND DEBRIS
 - REMOVE THE GRATE, ENGAGE THE LIFTING POINTS, AND LIFT FILTER FROM THE DRAINAGE STRUCTURE.
 - DISPOSE OF SEDIMENT AND DEBRIS BY THE ENGINEERING OR MAINTENANCE CONTRACT 4. ALTERNATIVELY, AN INDUSTRIAL VACUUM CAN BE USED TO COLLECT SEDIMENT FROM THE FILTER BAG

Woven and Non-Woven Geotextile Filter Bag Properties (Minimum Average Roll Values)

PROPERTY	TEST METHOD	WOVEN (OUTER)	NON-WOVEN (INNER)
TENSILE STRENGTH	ASTM D4832	320 x 223 lbs	100 lbs
ELONGATION	ASTM D4832	20% x 15%	50%
CBR PUNCTURE	ASTM D6241	3000 lbs	60 lbs
TRAPEZOIDAL TEAR	ASTM D4838	110 x 75 lbs	45 lbs
UV RESISTANCE	ASTM D4855	90%	70%
OPENING SIZE (AOS)	ASTM D4751	20 US STD SIEVE	40 US STD SIEVE
PERMEABILITY	ASTM D4401	1.5 Sec ⁻¹	3.0 Sec ⁻¹
WATER FLOW RATE	ASTM D4401	200 gal/min/ft ²	145 gal/min/ft ²
MINIMUM FILTER BAG VOLUME		2 CUBIC FT	

FRAMED INLET PROTECTION
N.T.S.



3535 UNIVERSITY MIXED USE











REVIEW DRAWING
NOT TO BE USED FOR CONSTRUCTION
DATE OF ISSUE 07/10/2024



DETAILS

JLA PROJECT No:	W23-0222
DATE OF ISSUANCE:	07/10/24
REVISION DATE:	

C600

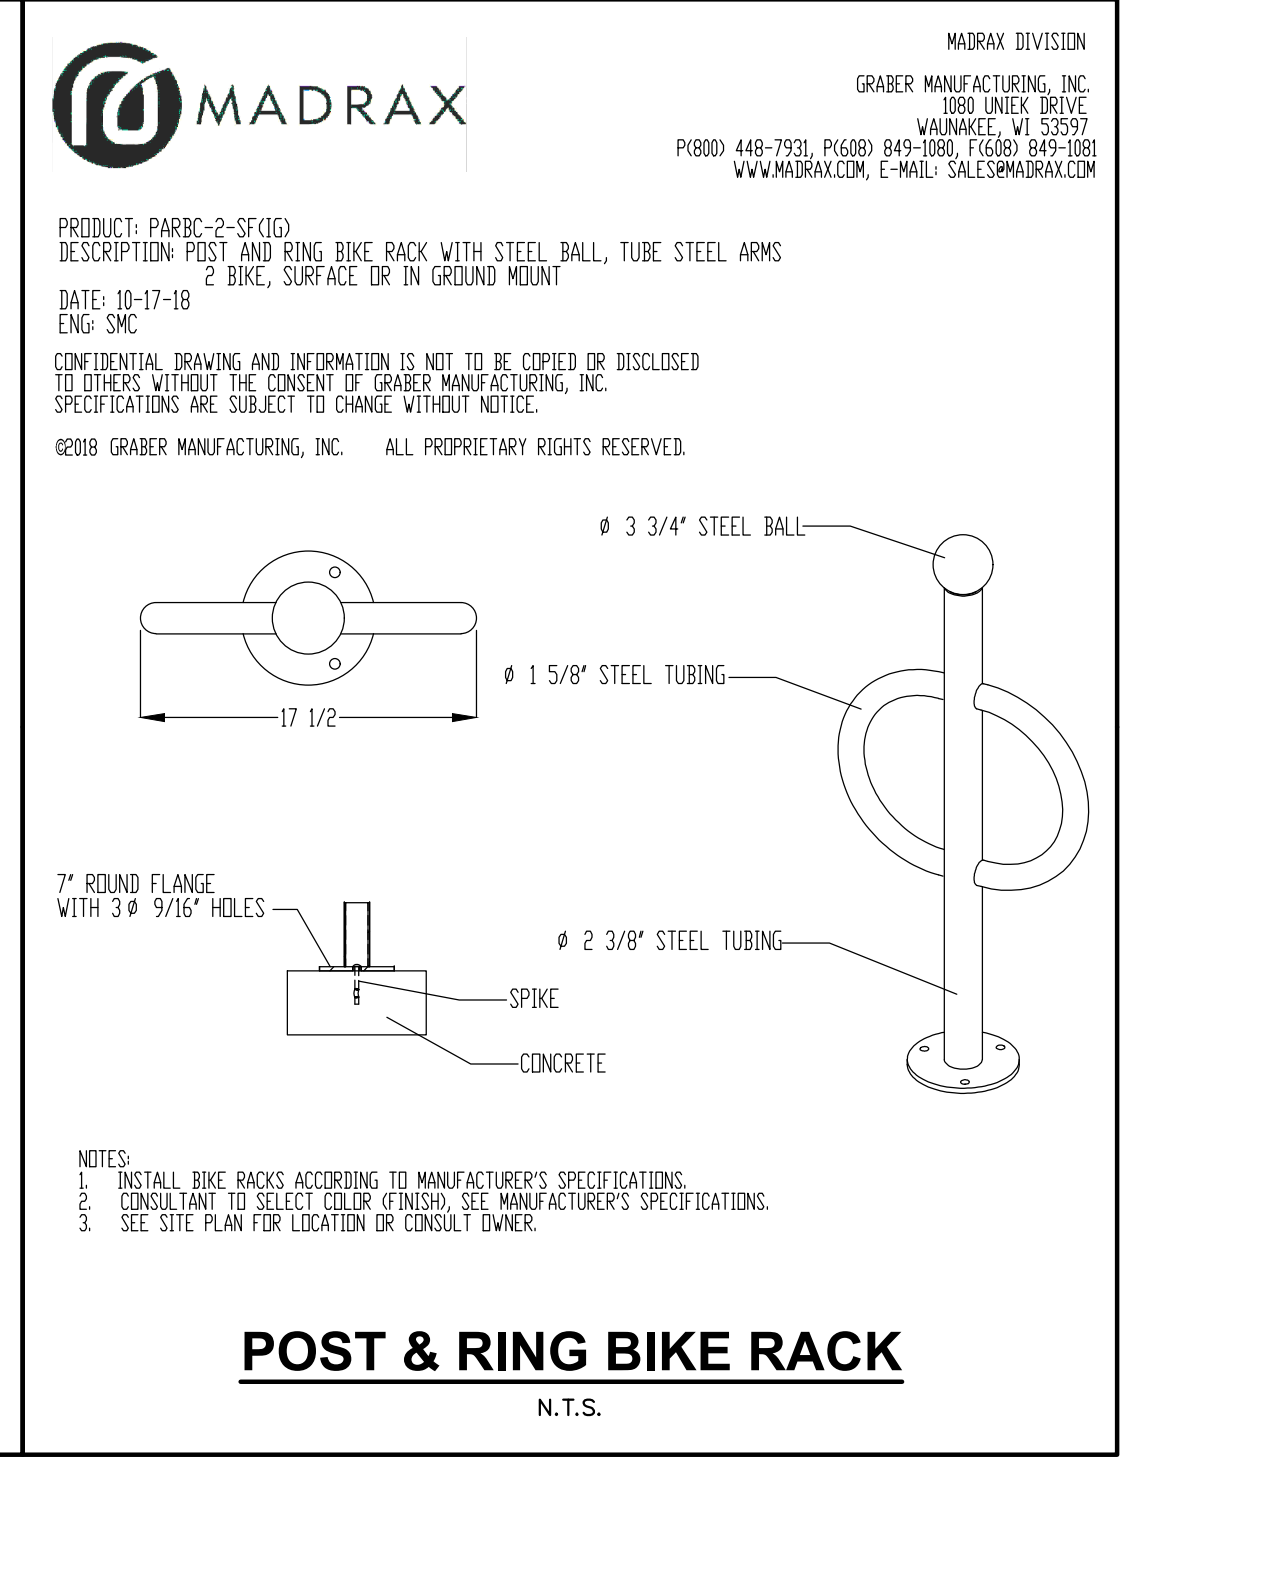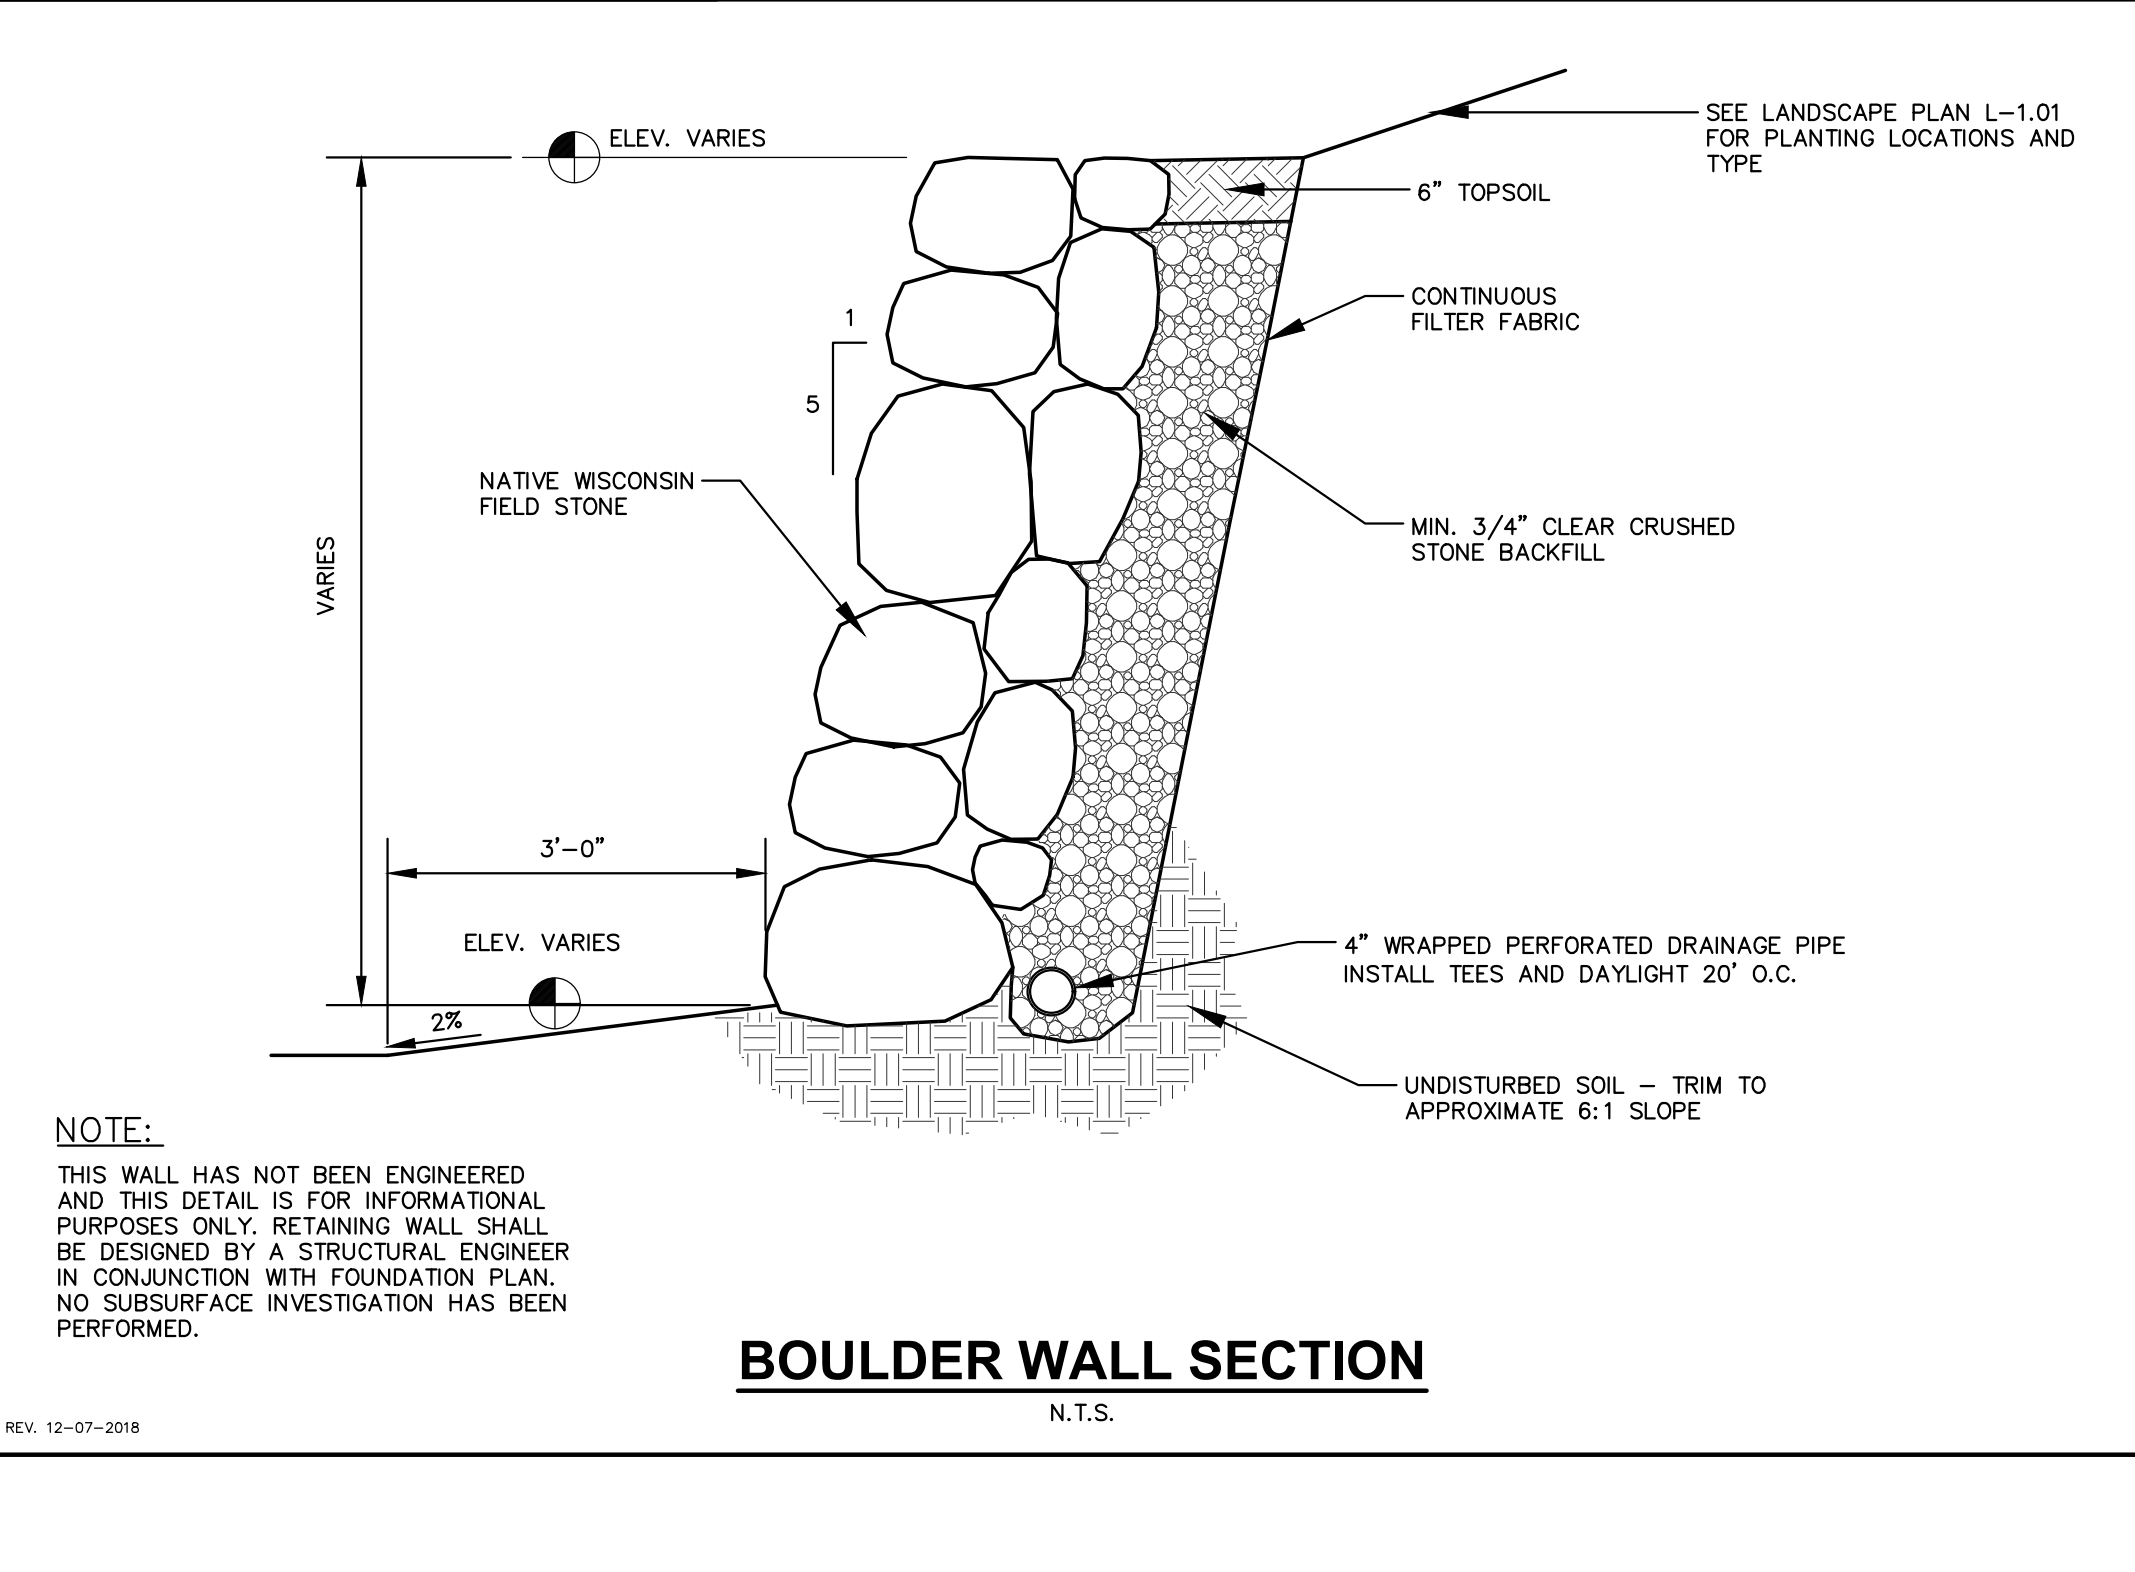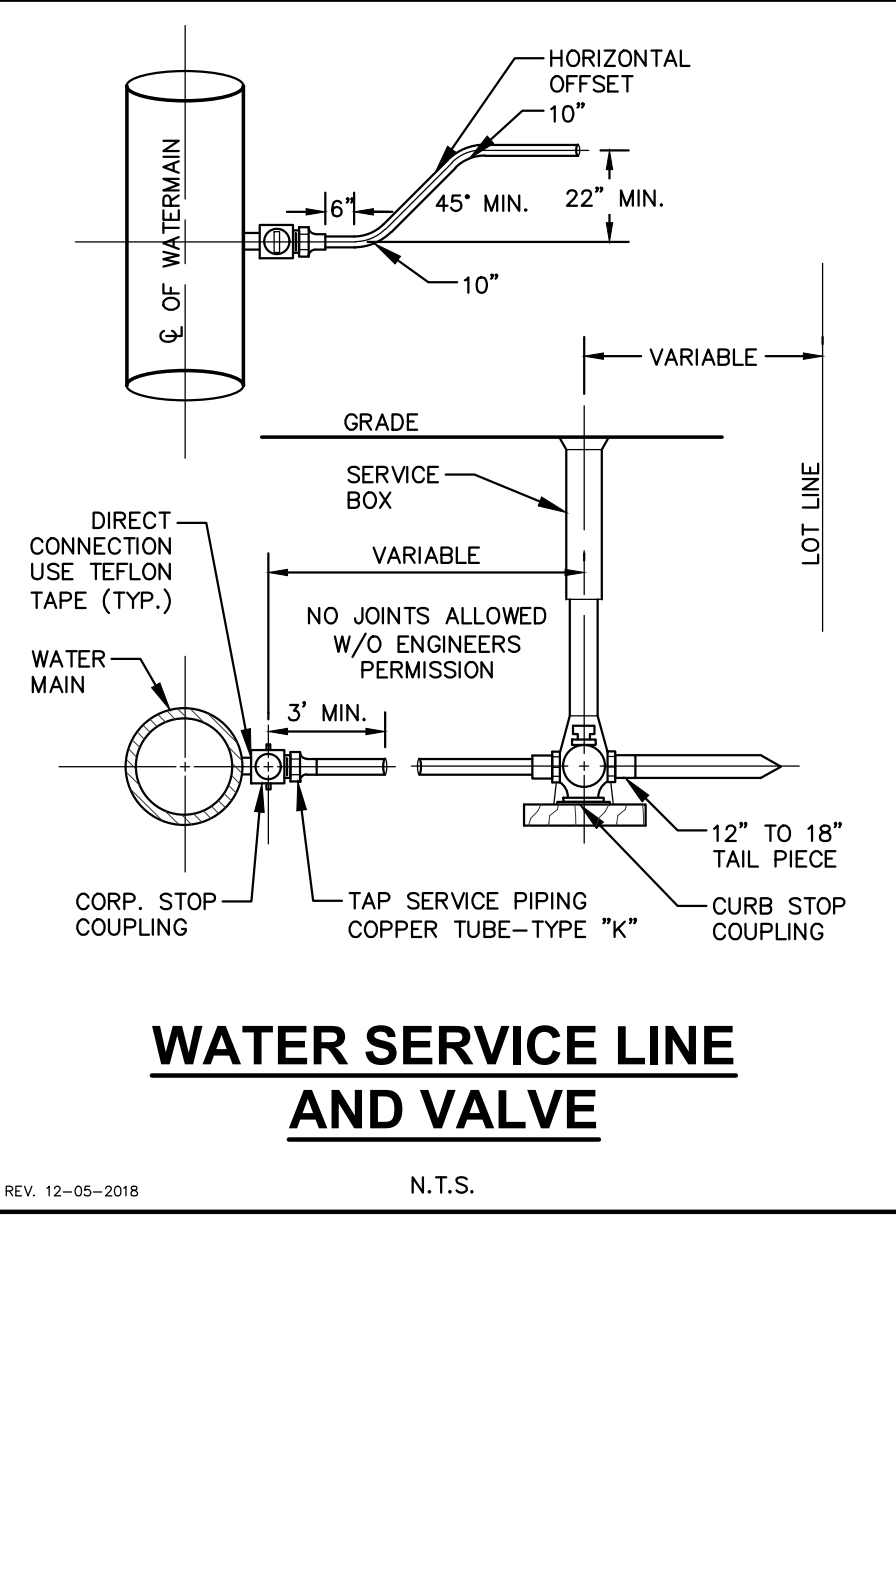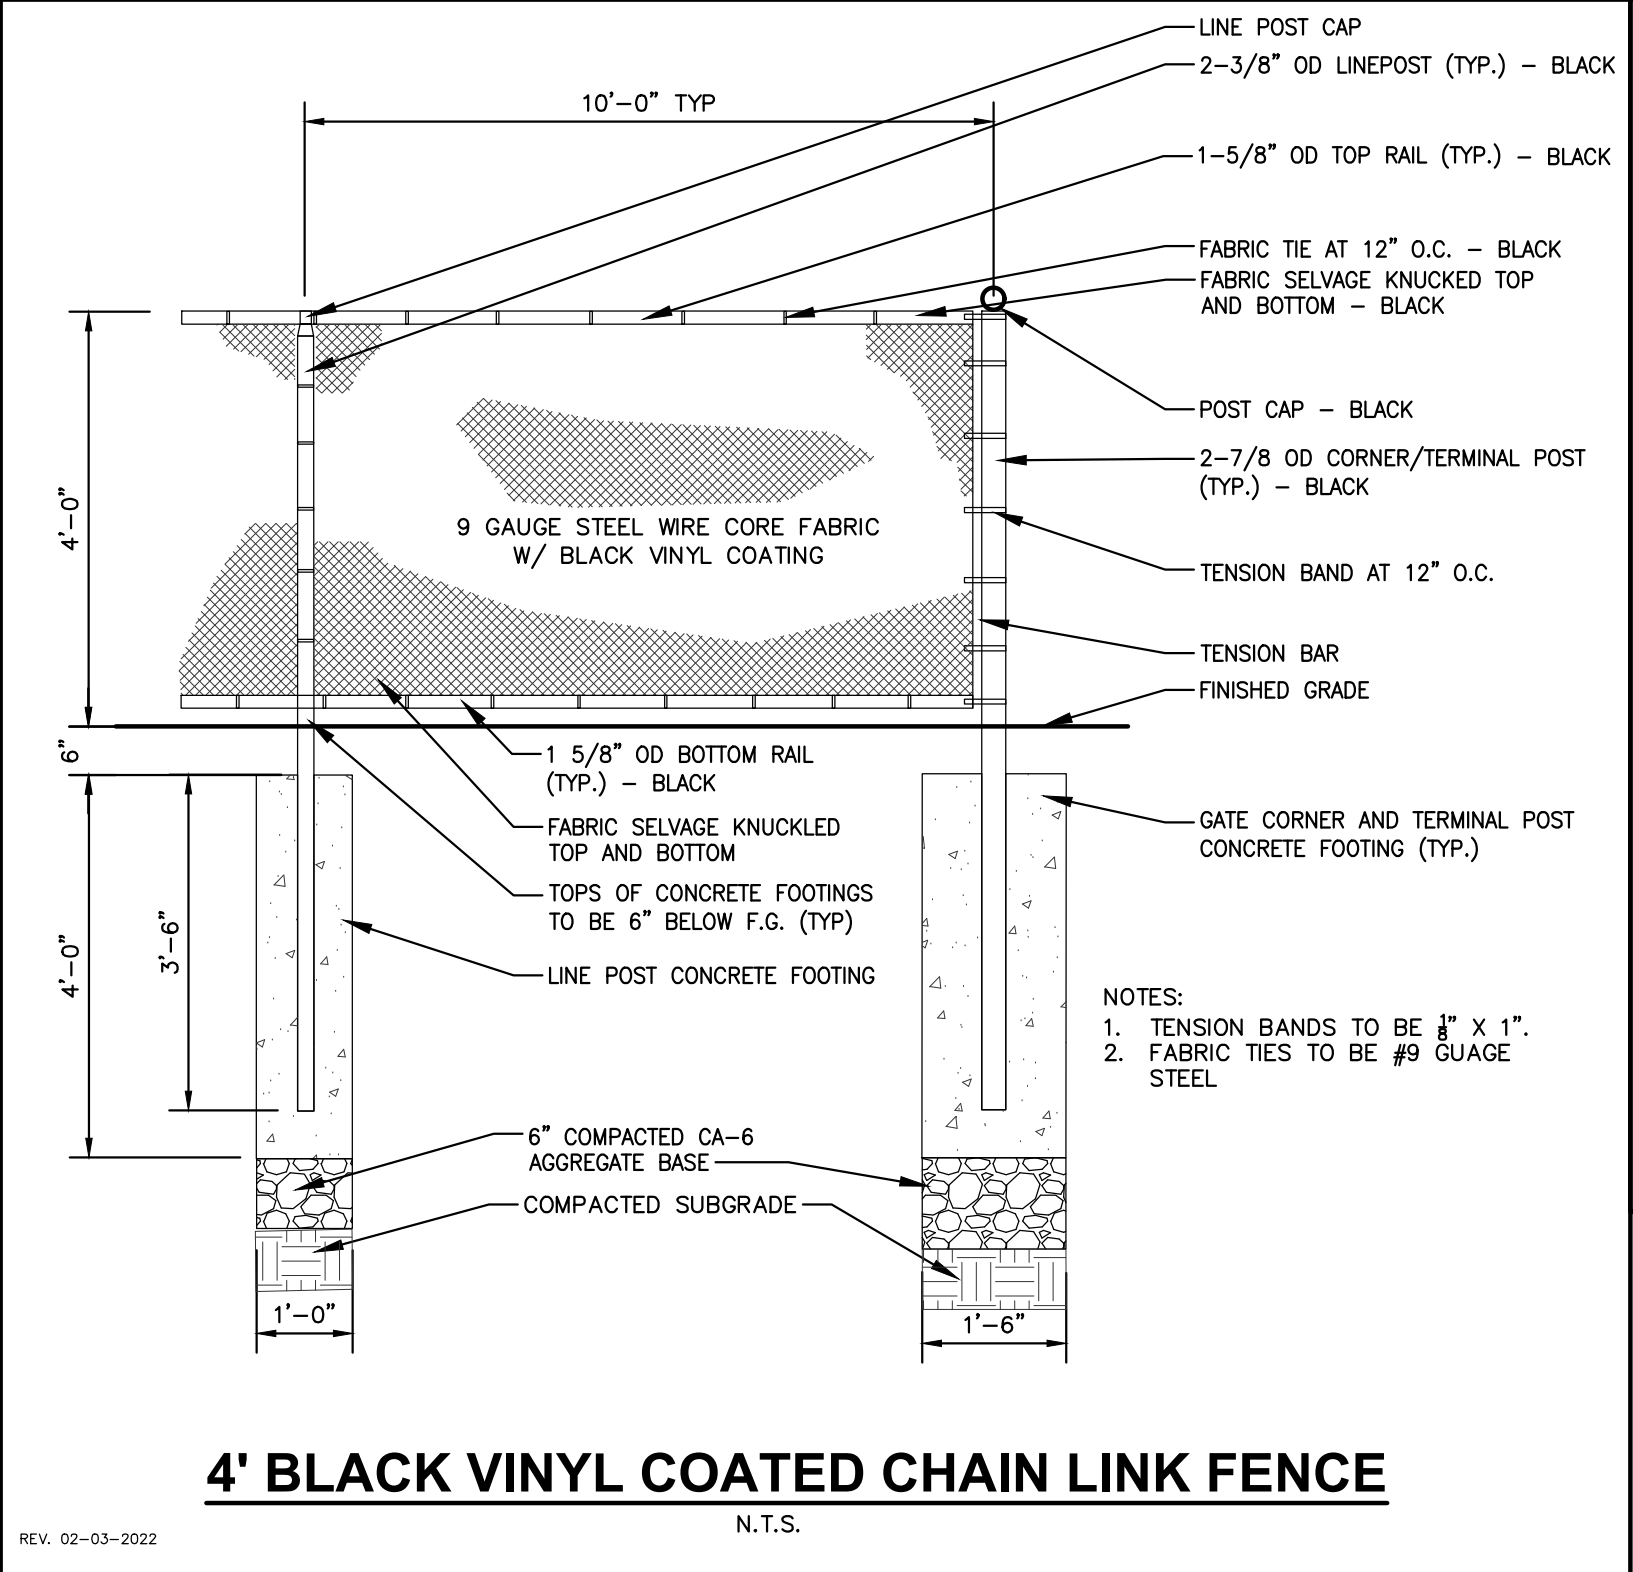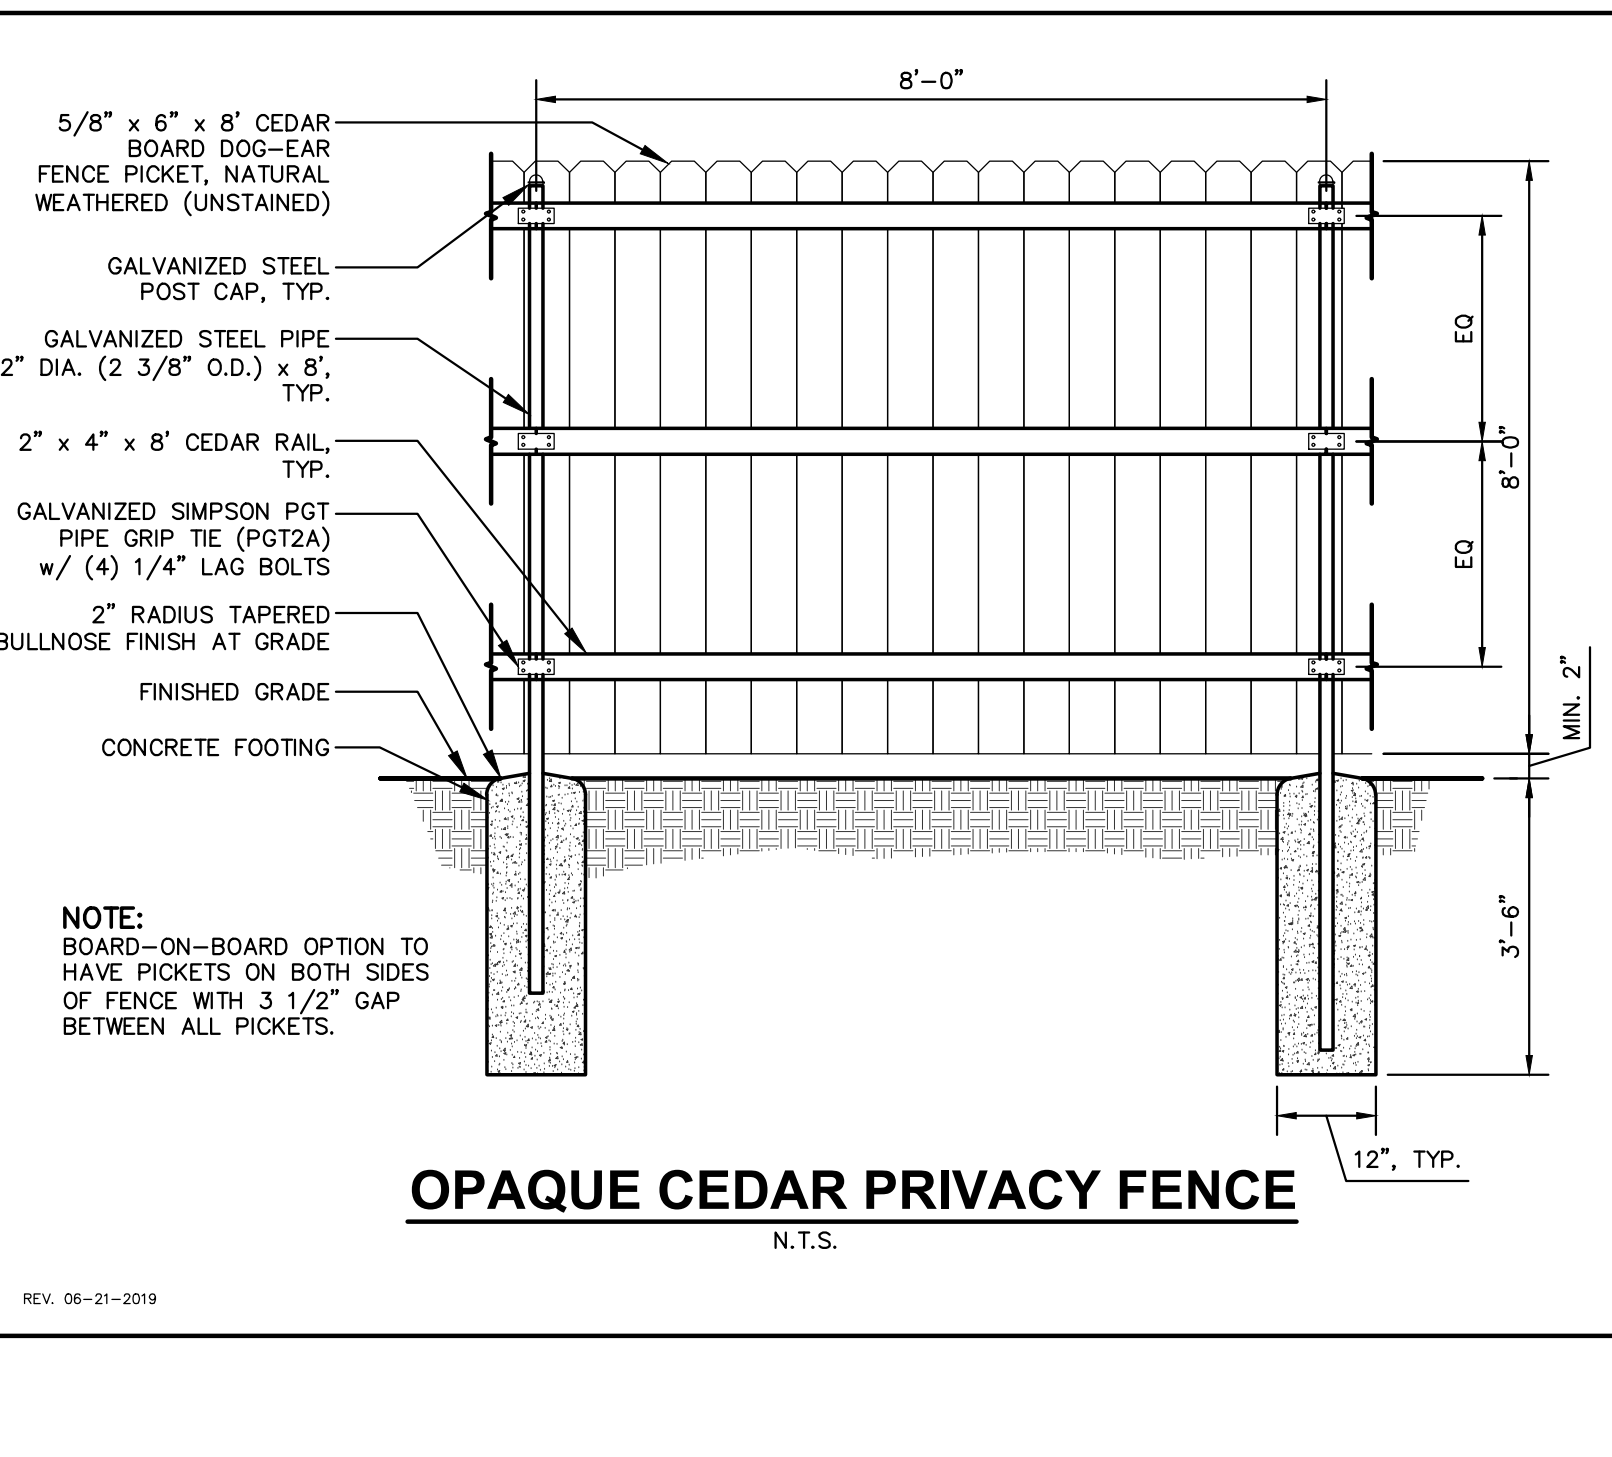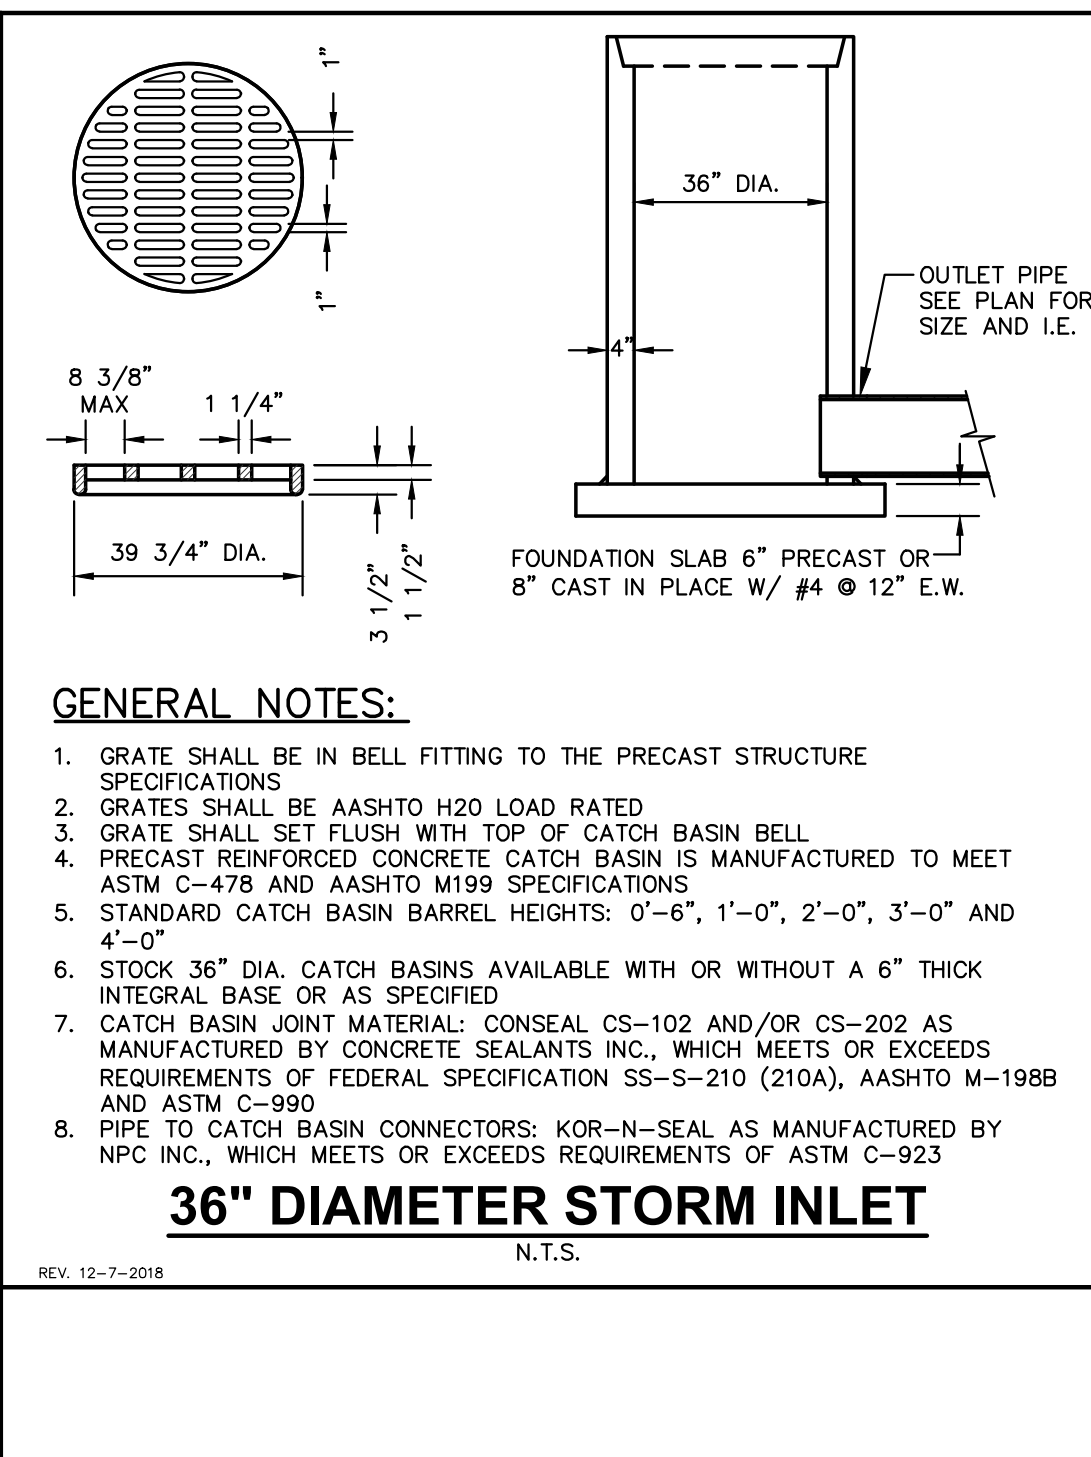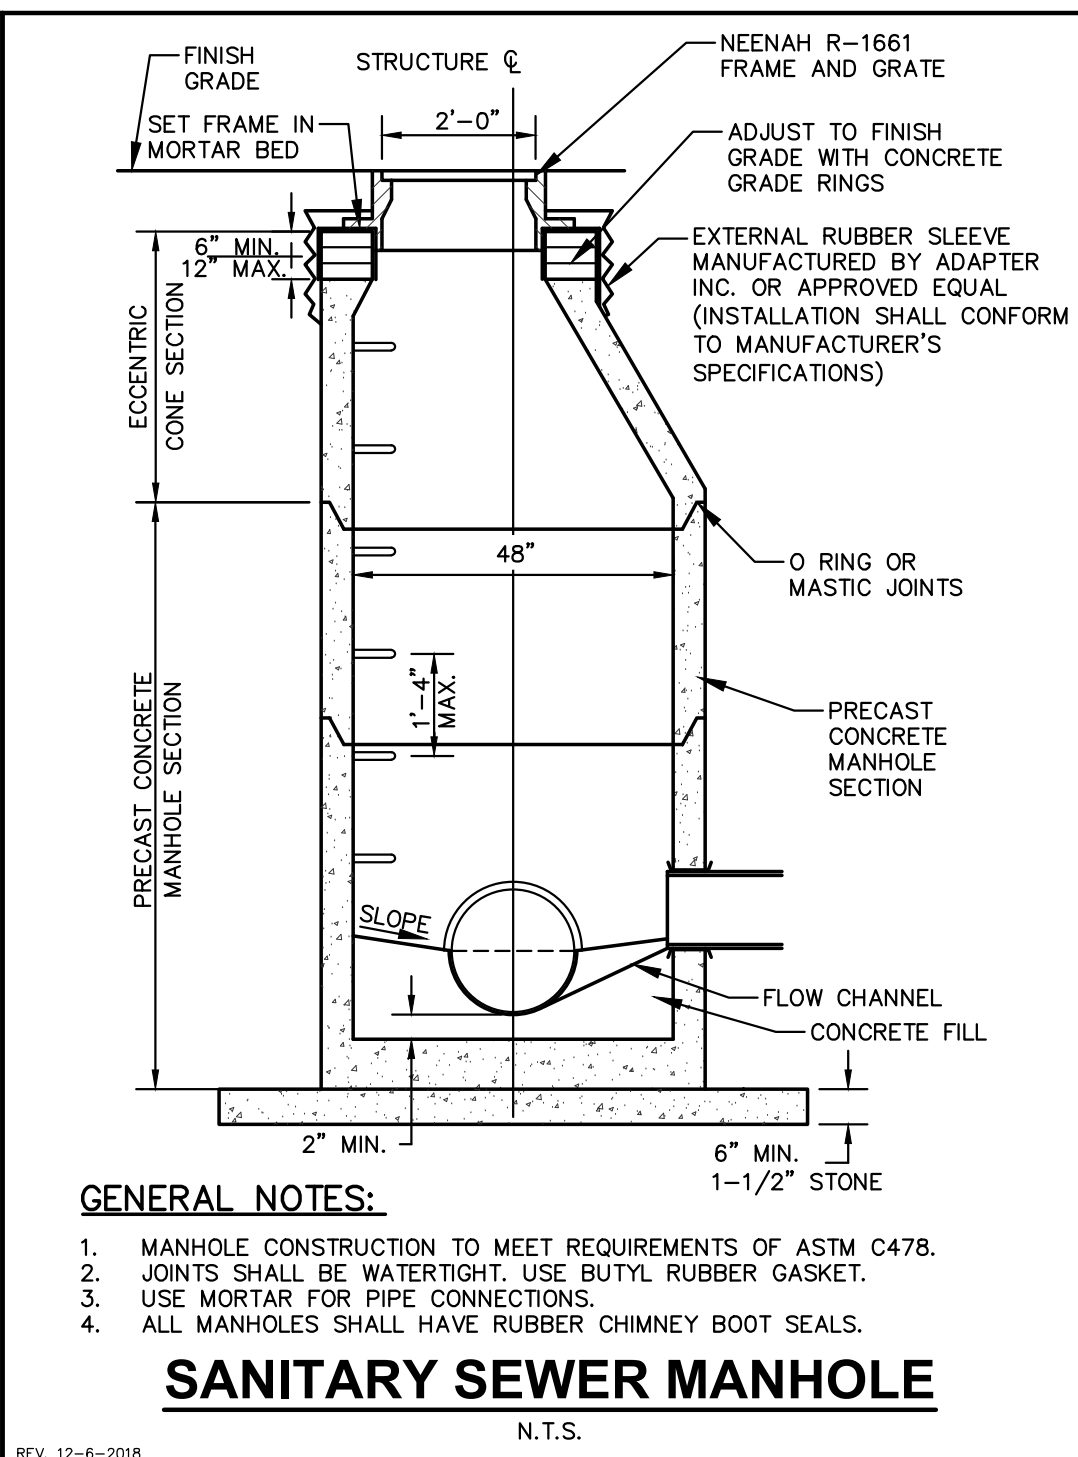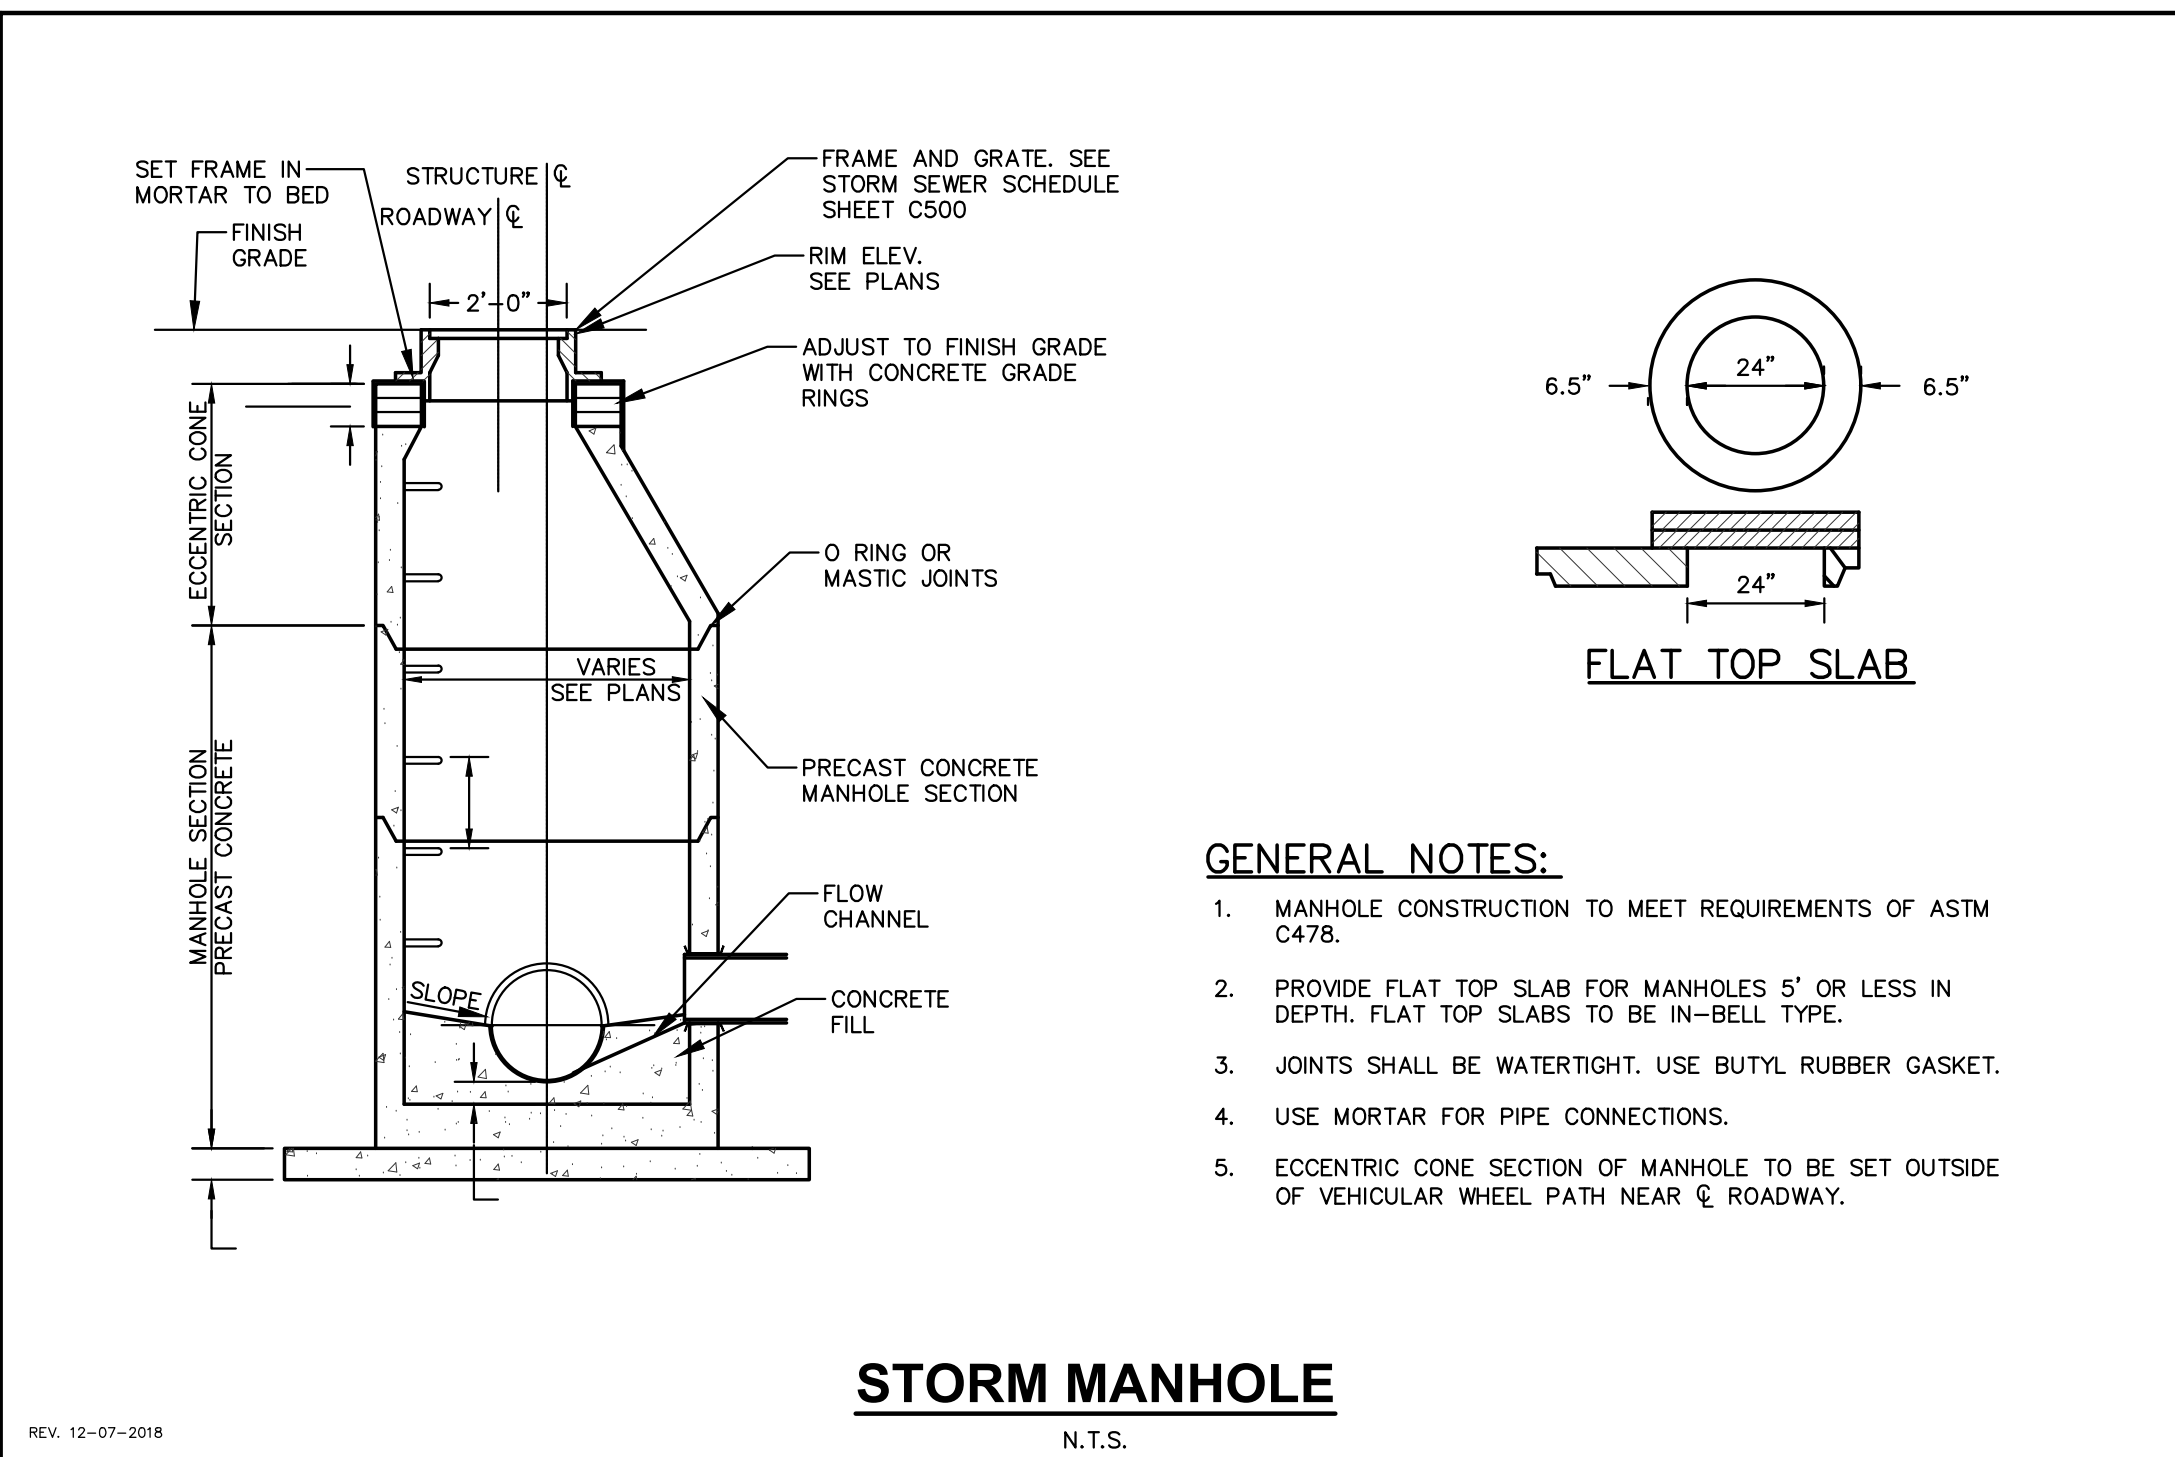






3535 UNIVERSITY MIXED USE

REVIEW DRAWING
NOT TO BE USED FOR CONSTRUCTION
DATE OF ISSUE 07/10/2024



UTILITY DETAILS	
JLA PROJECT No:	W23-0222
DATE OF ISSUANCE:	07/10/24
REVISION DATE:	

C601

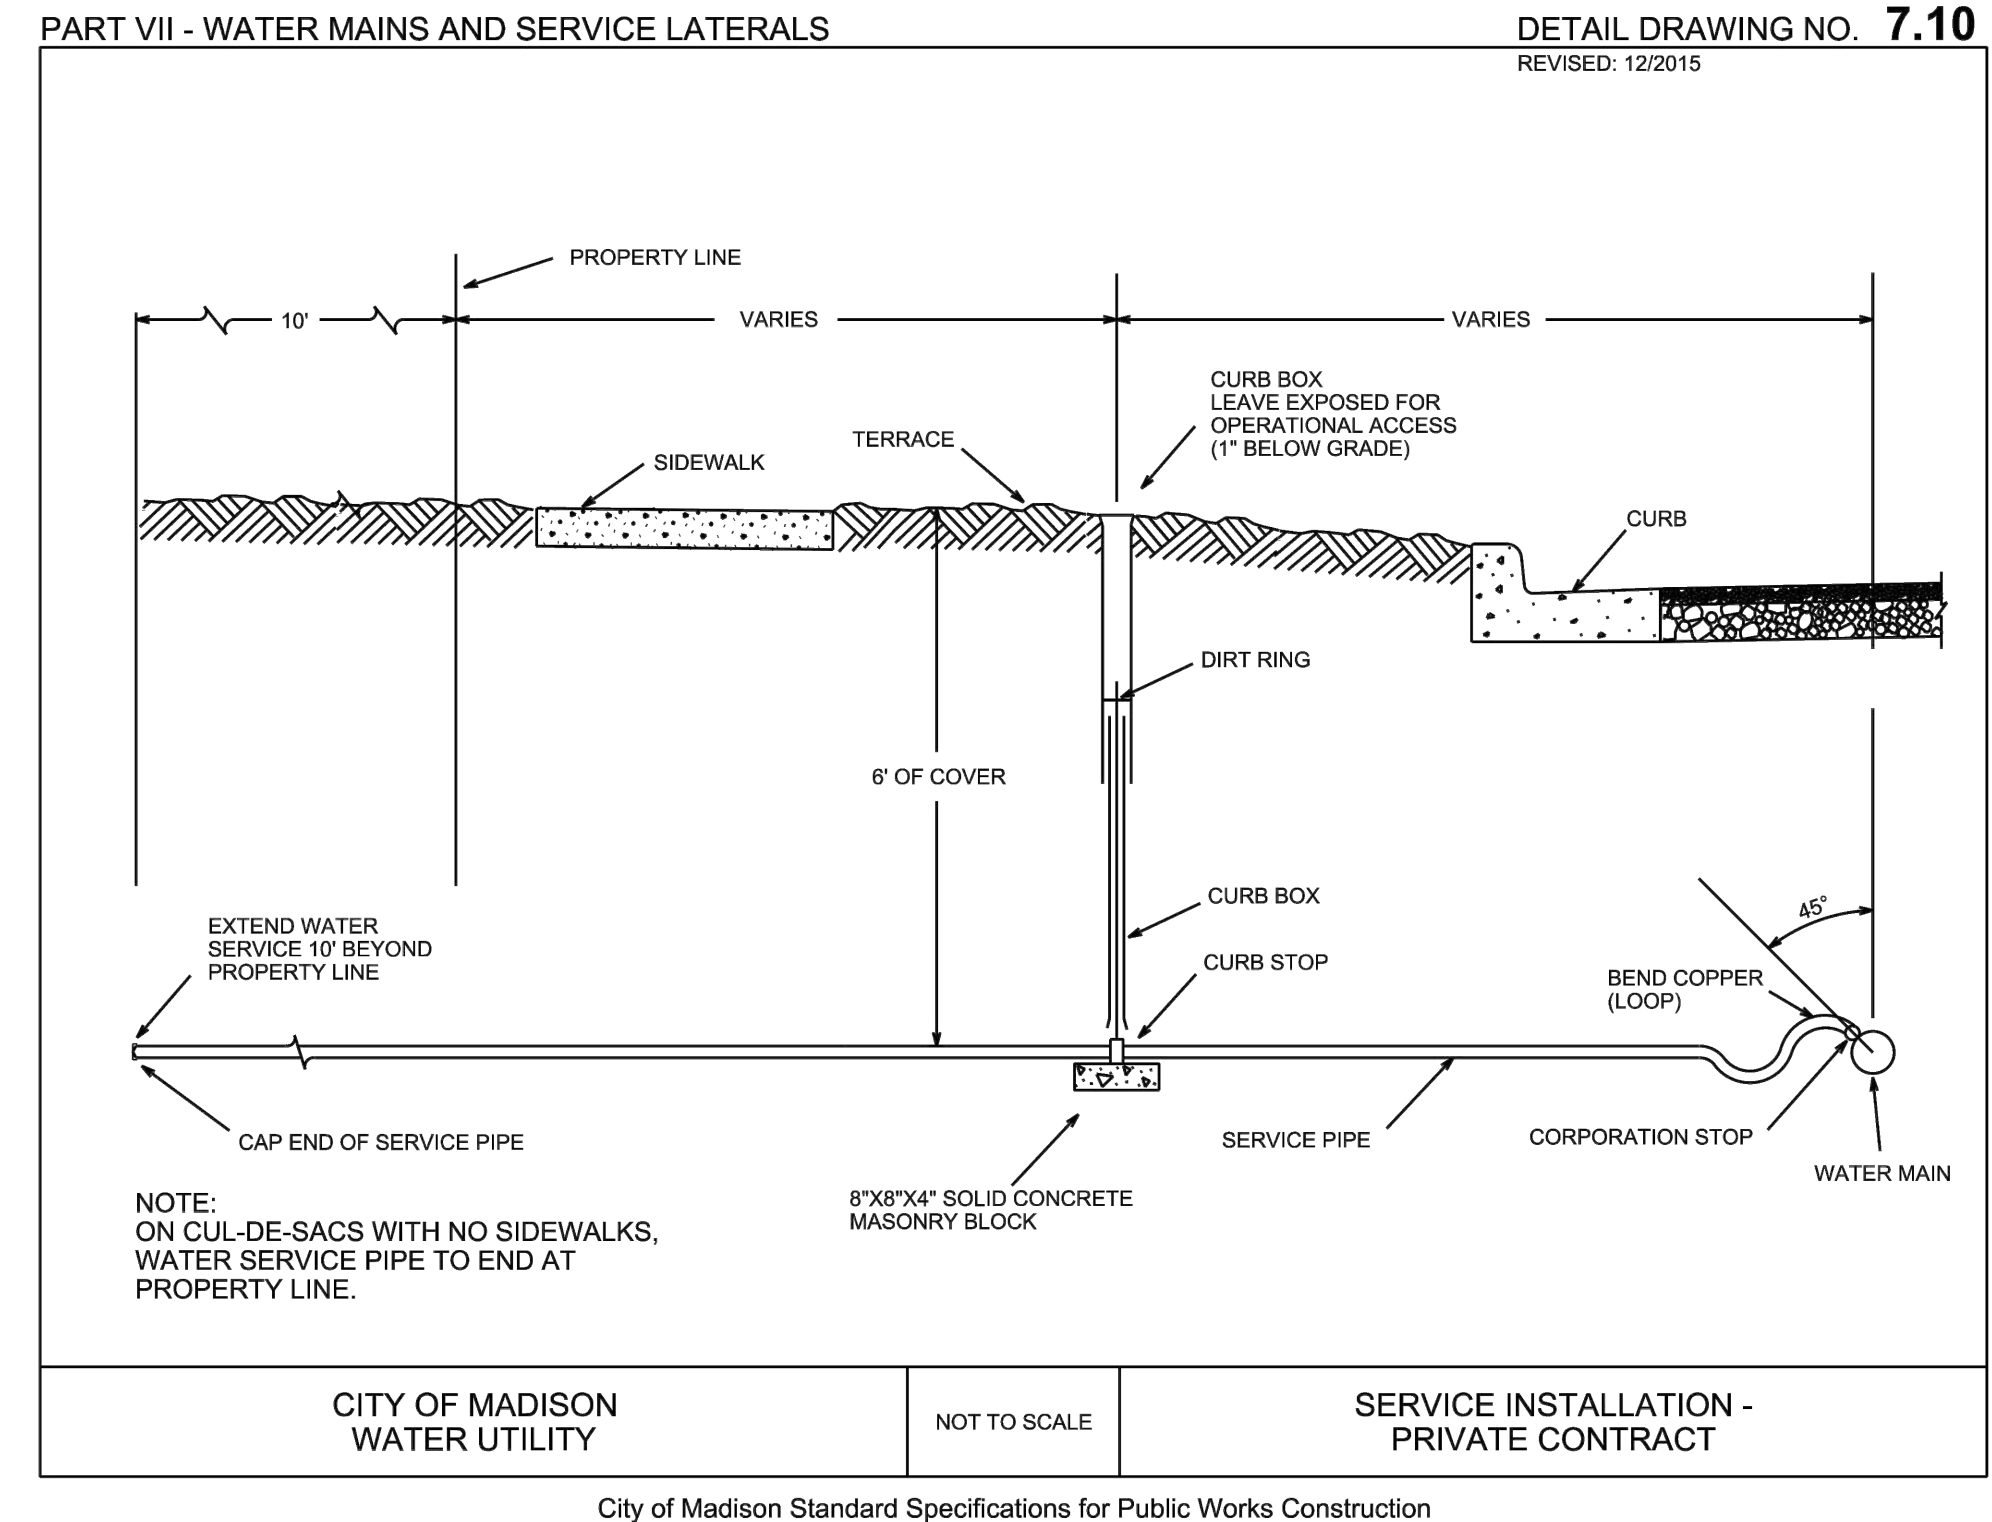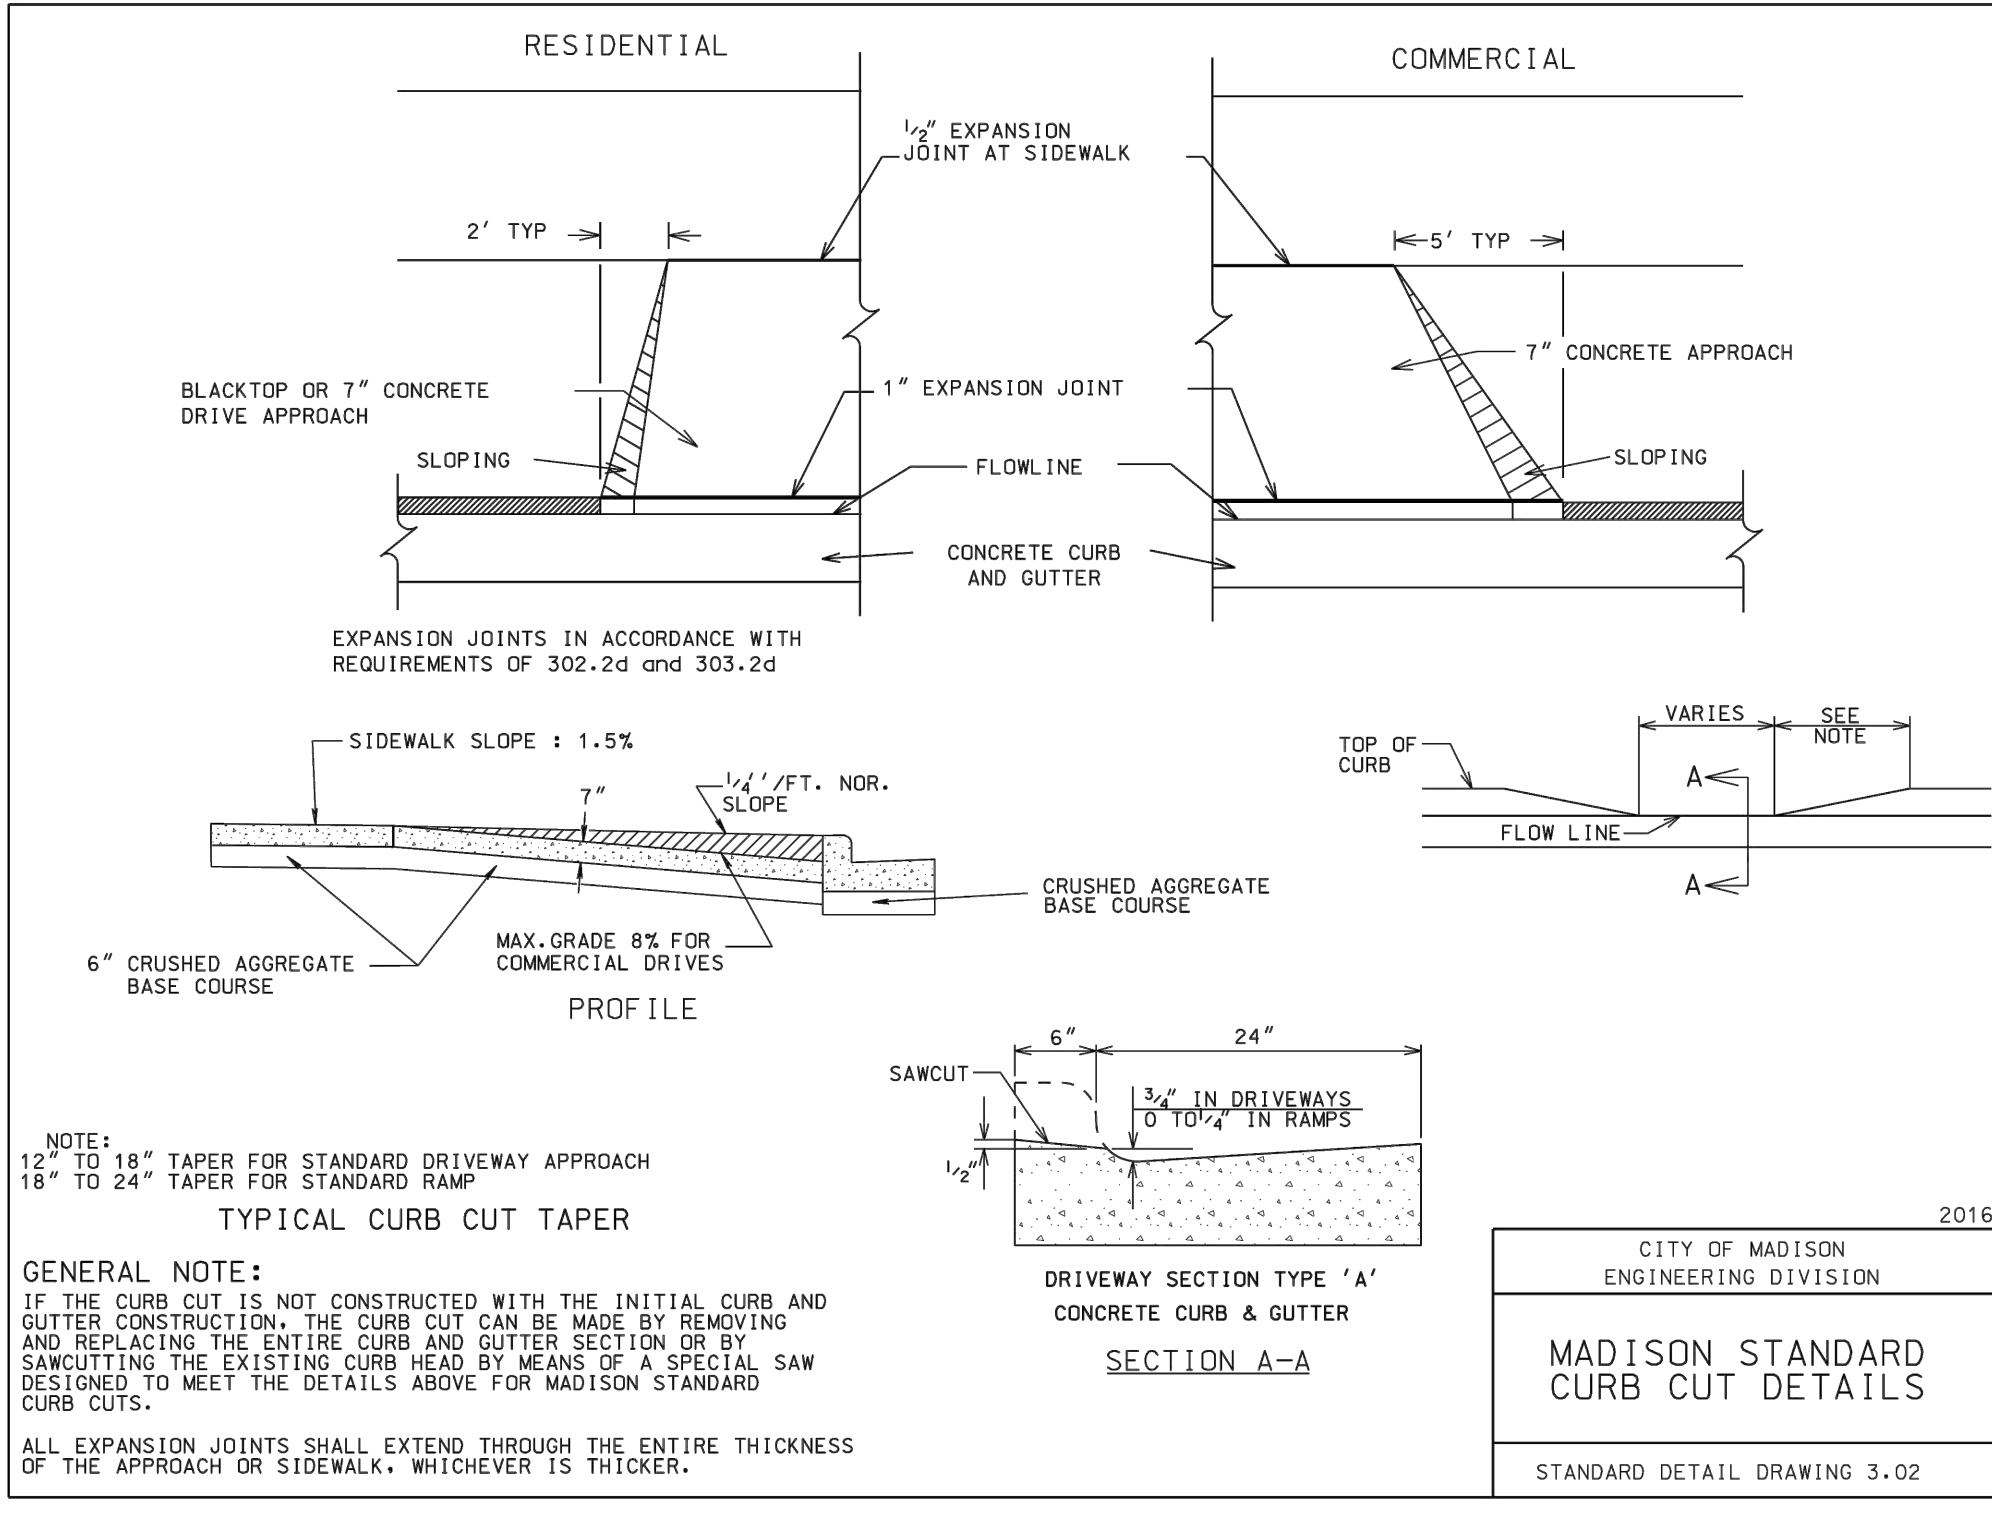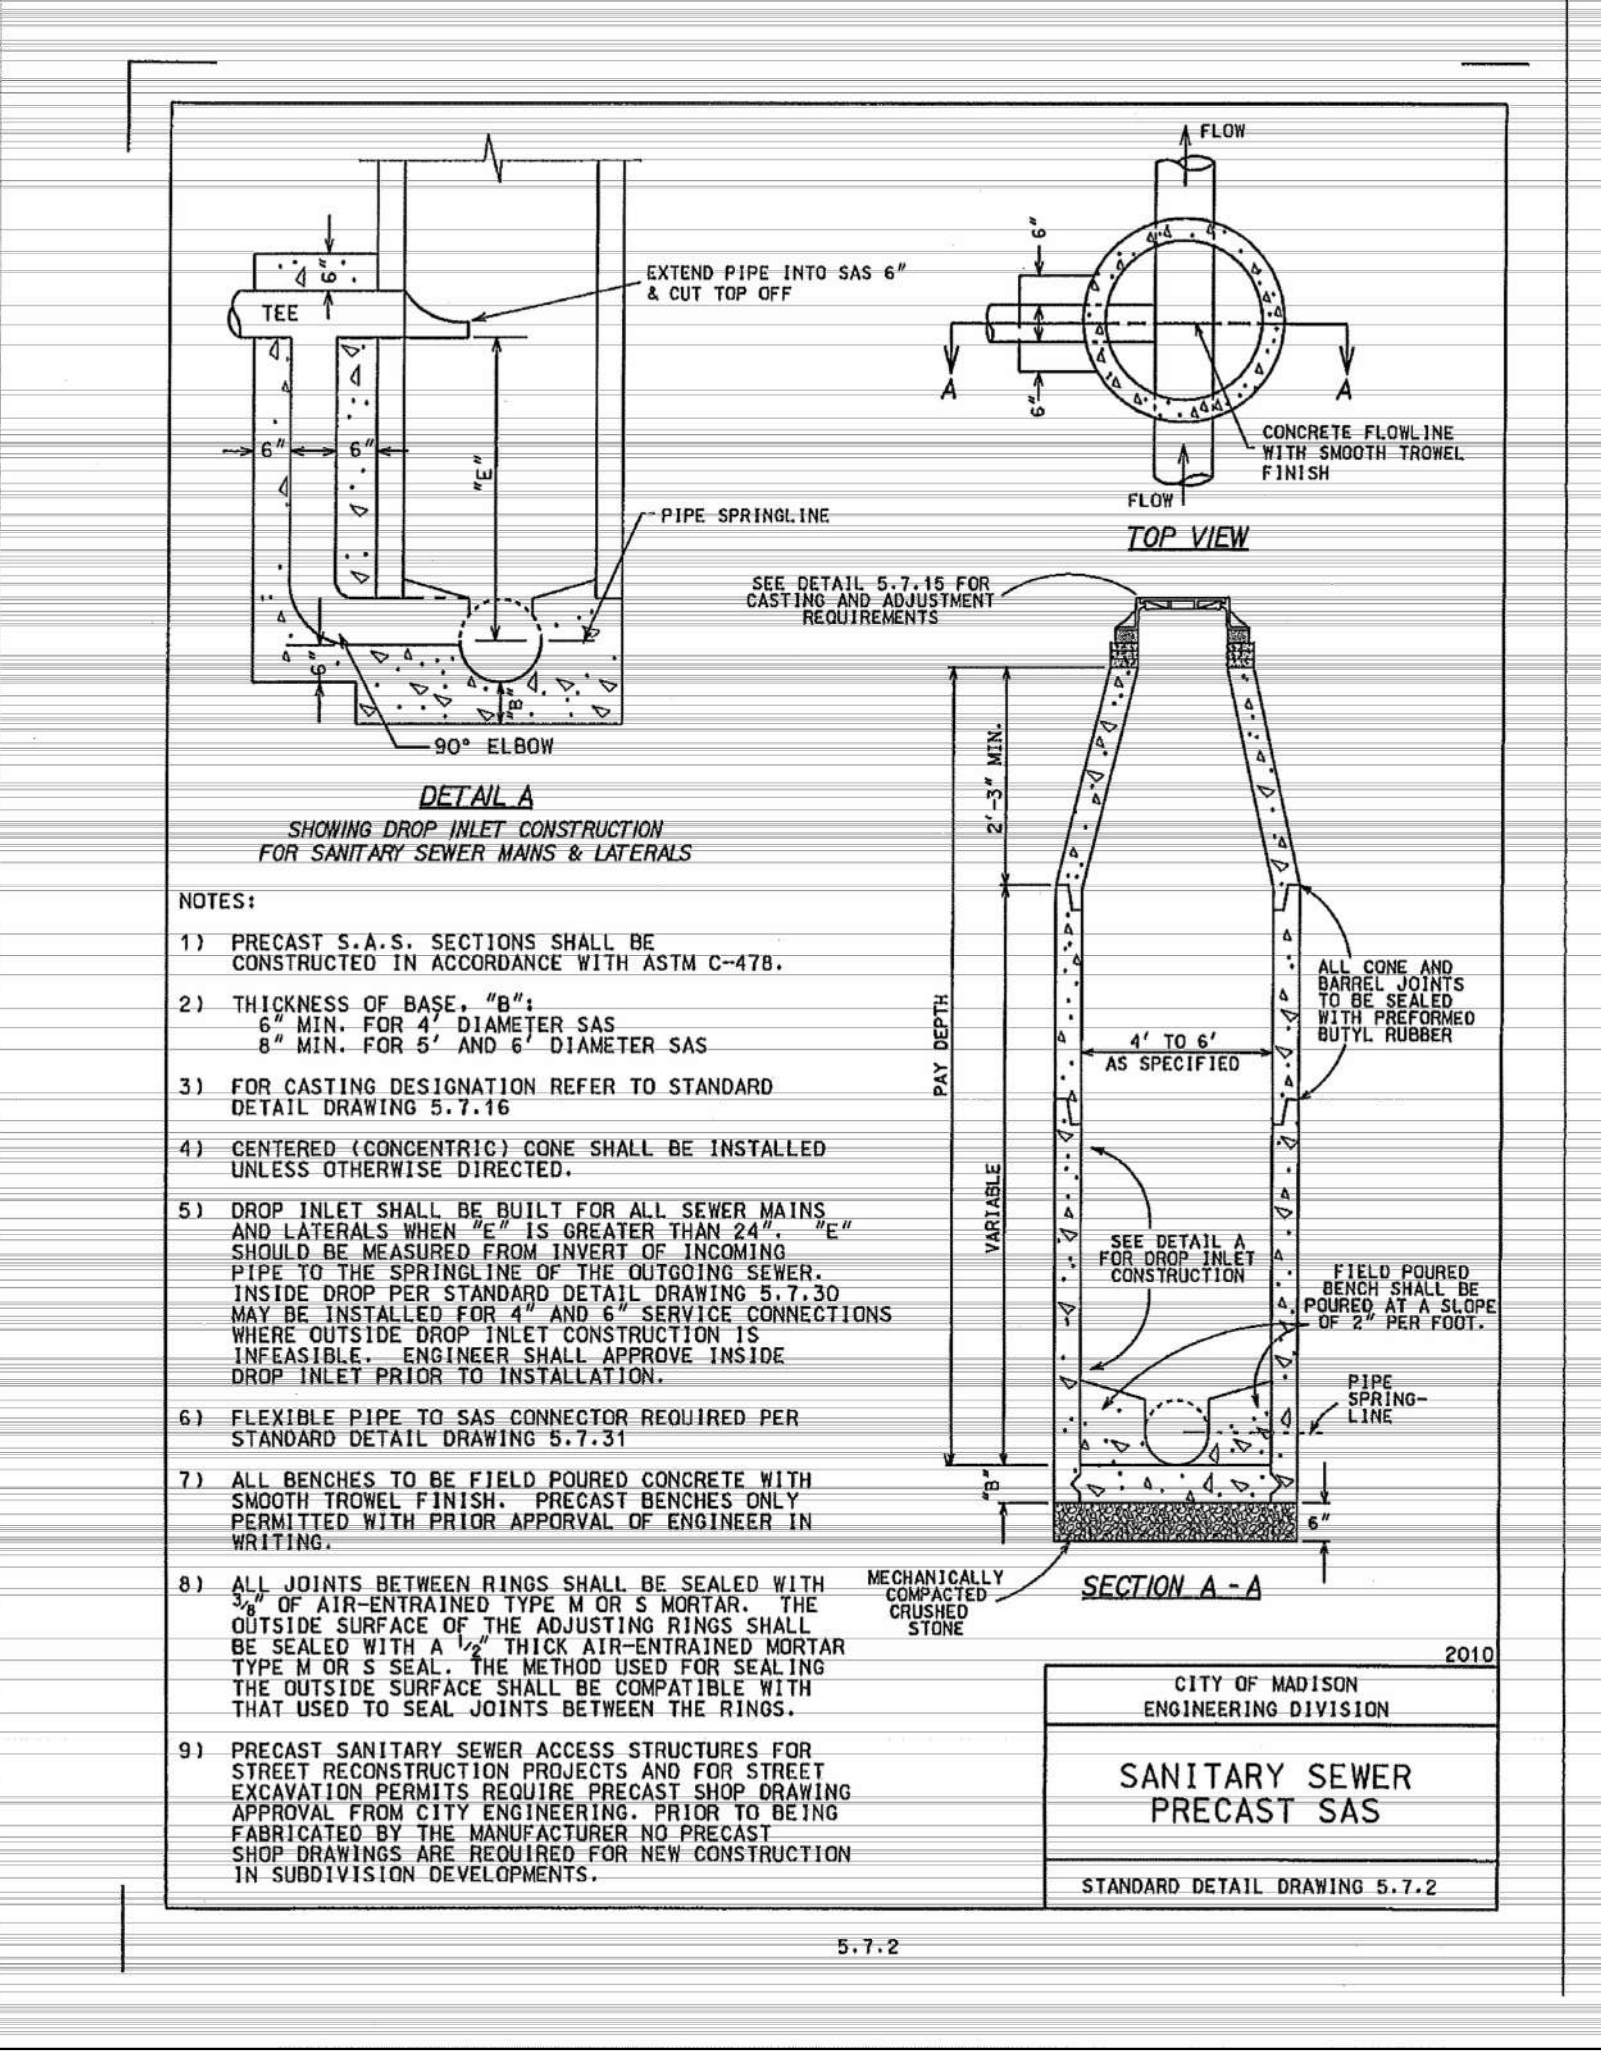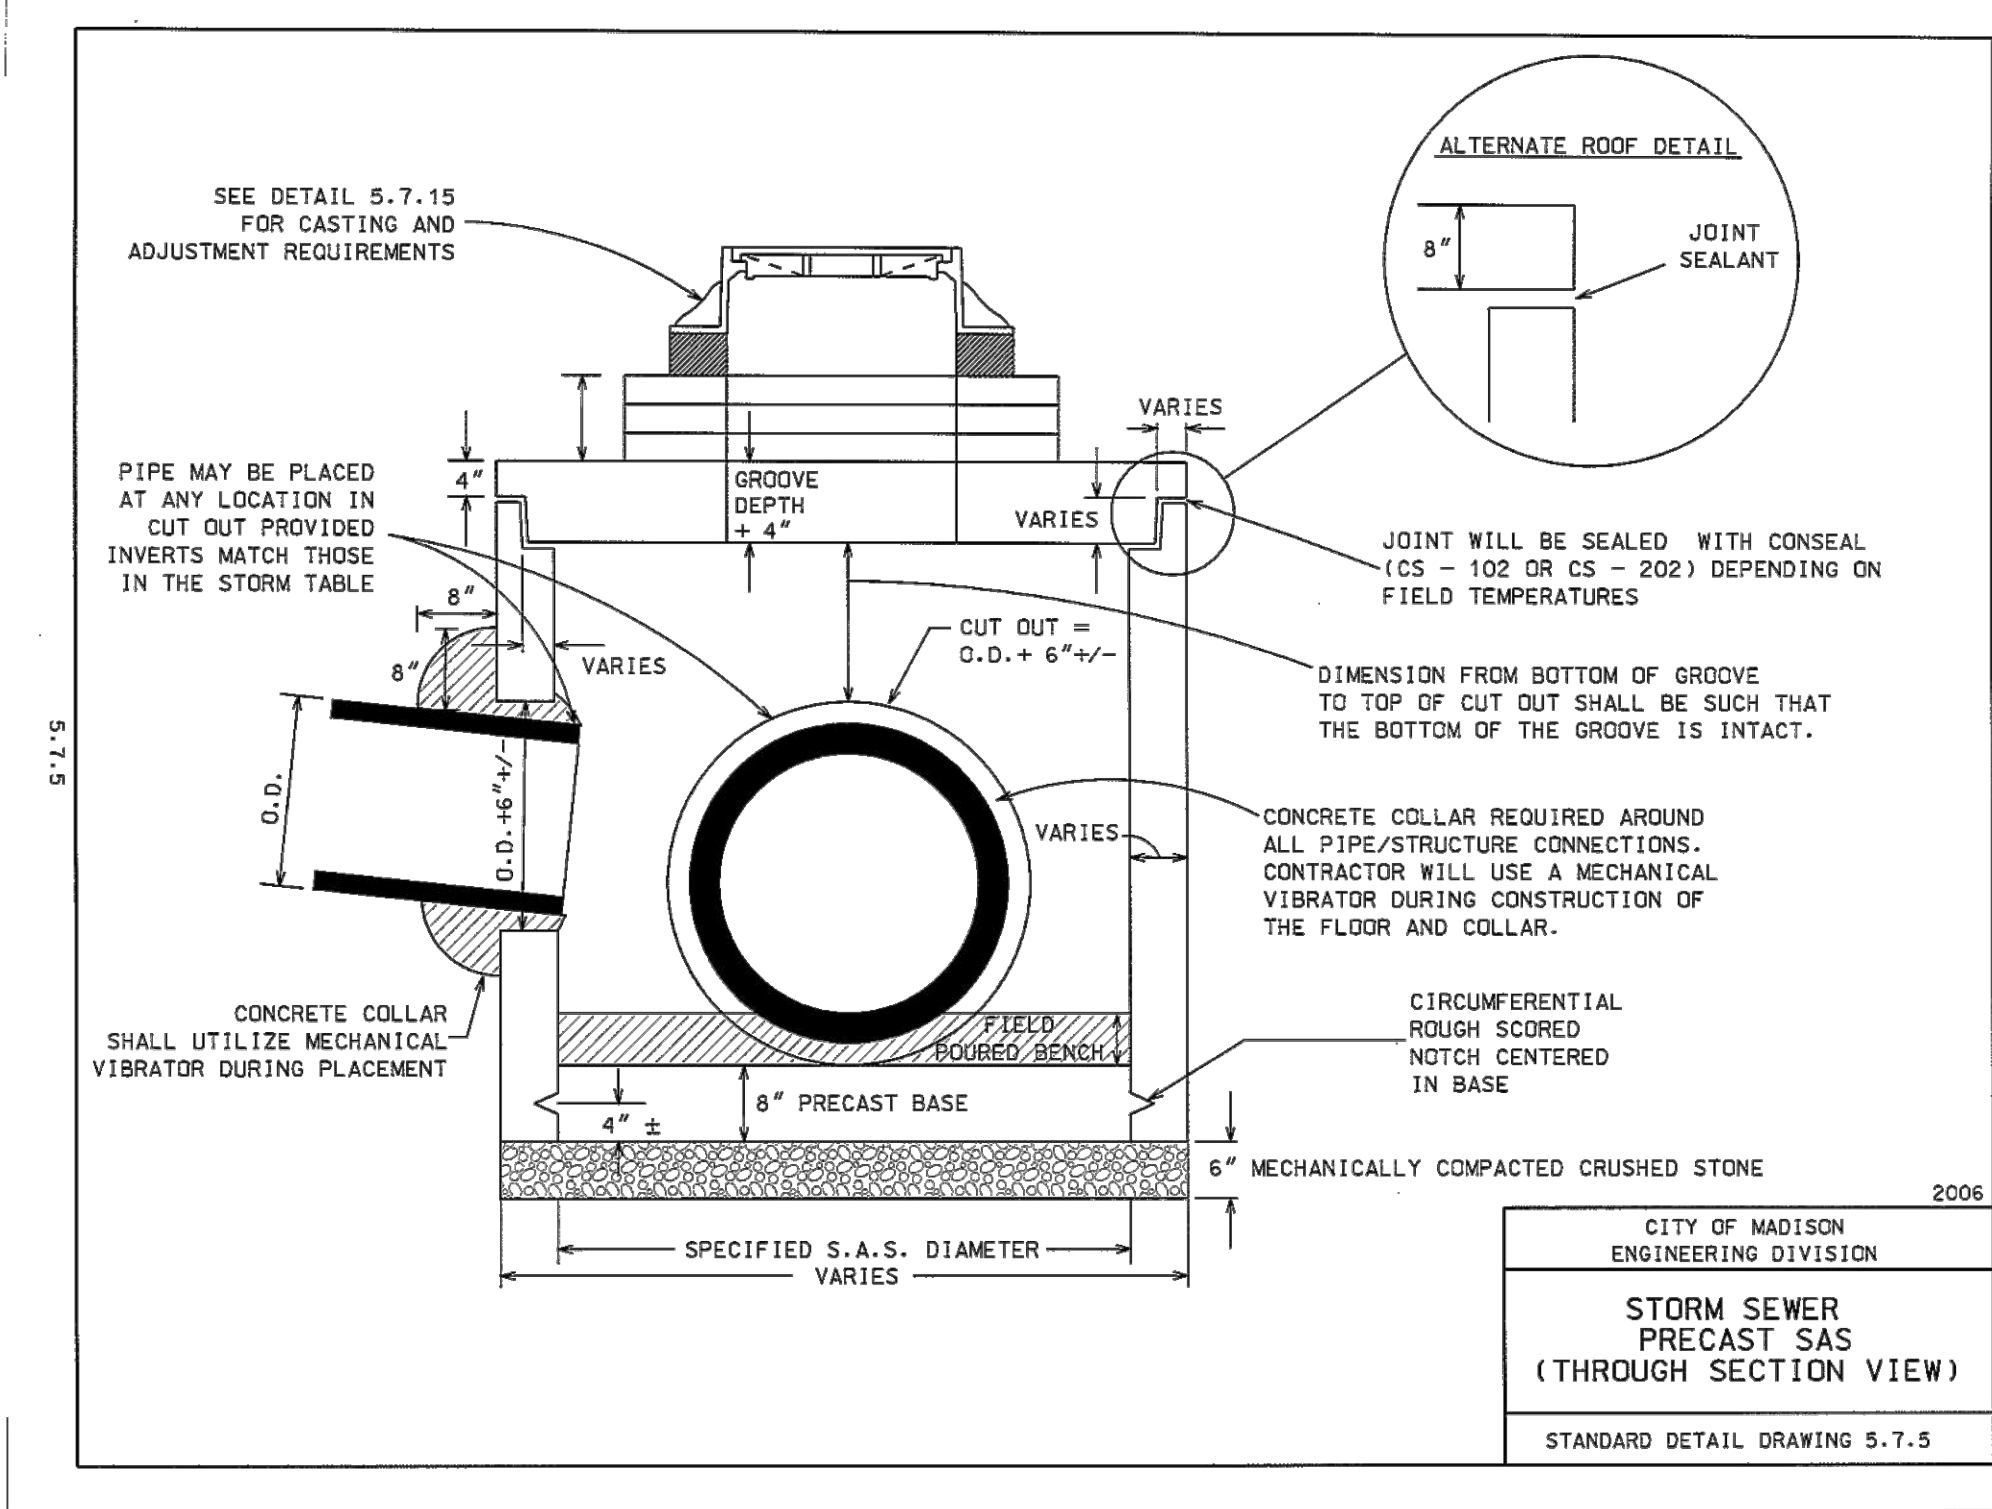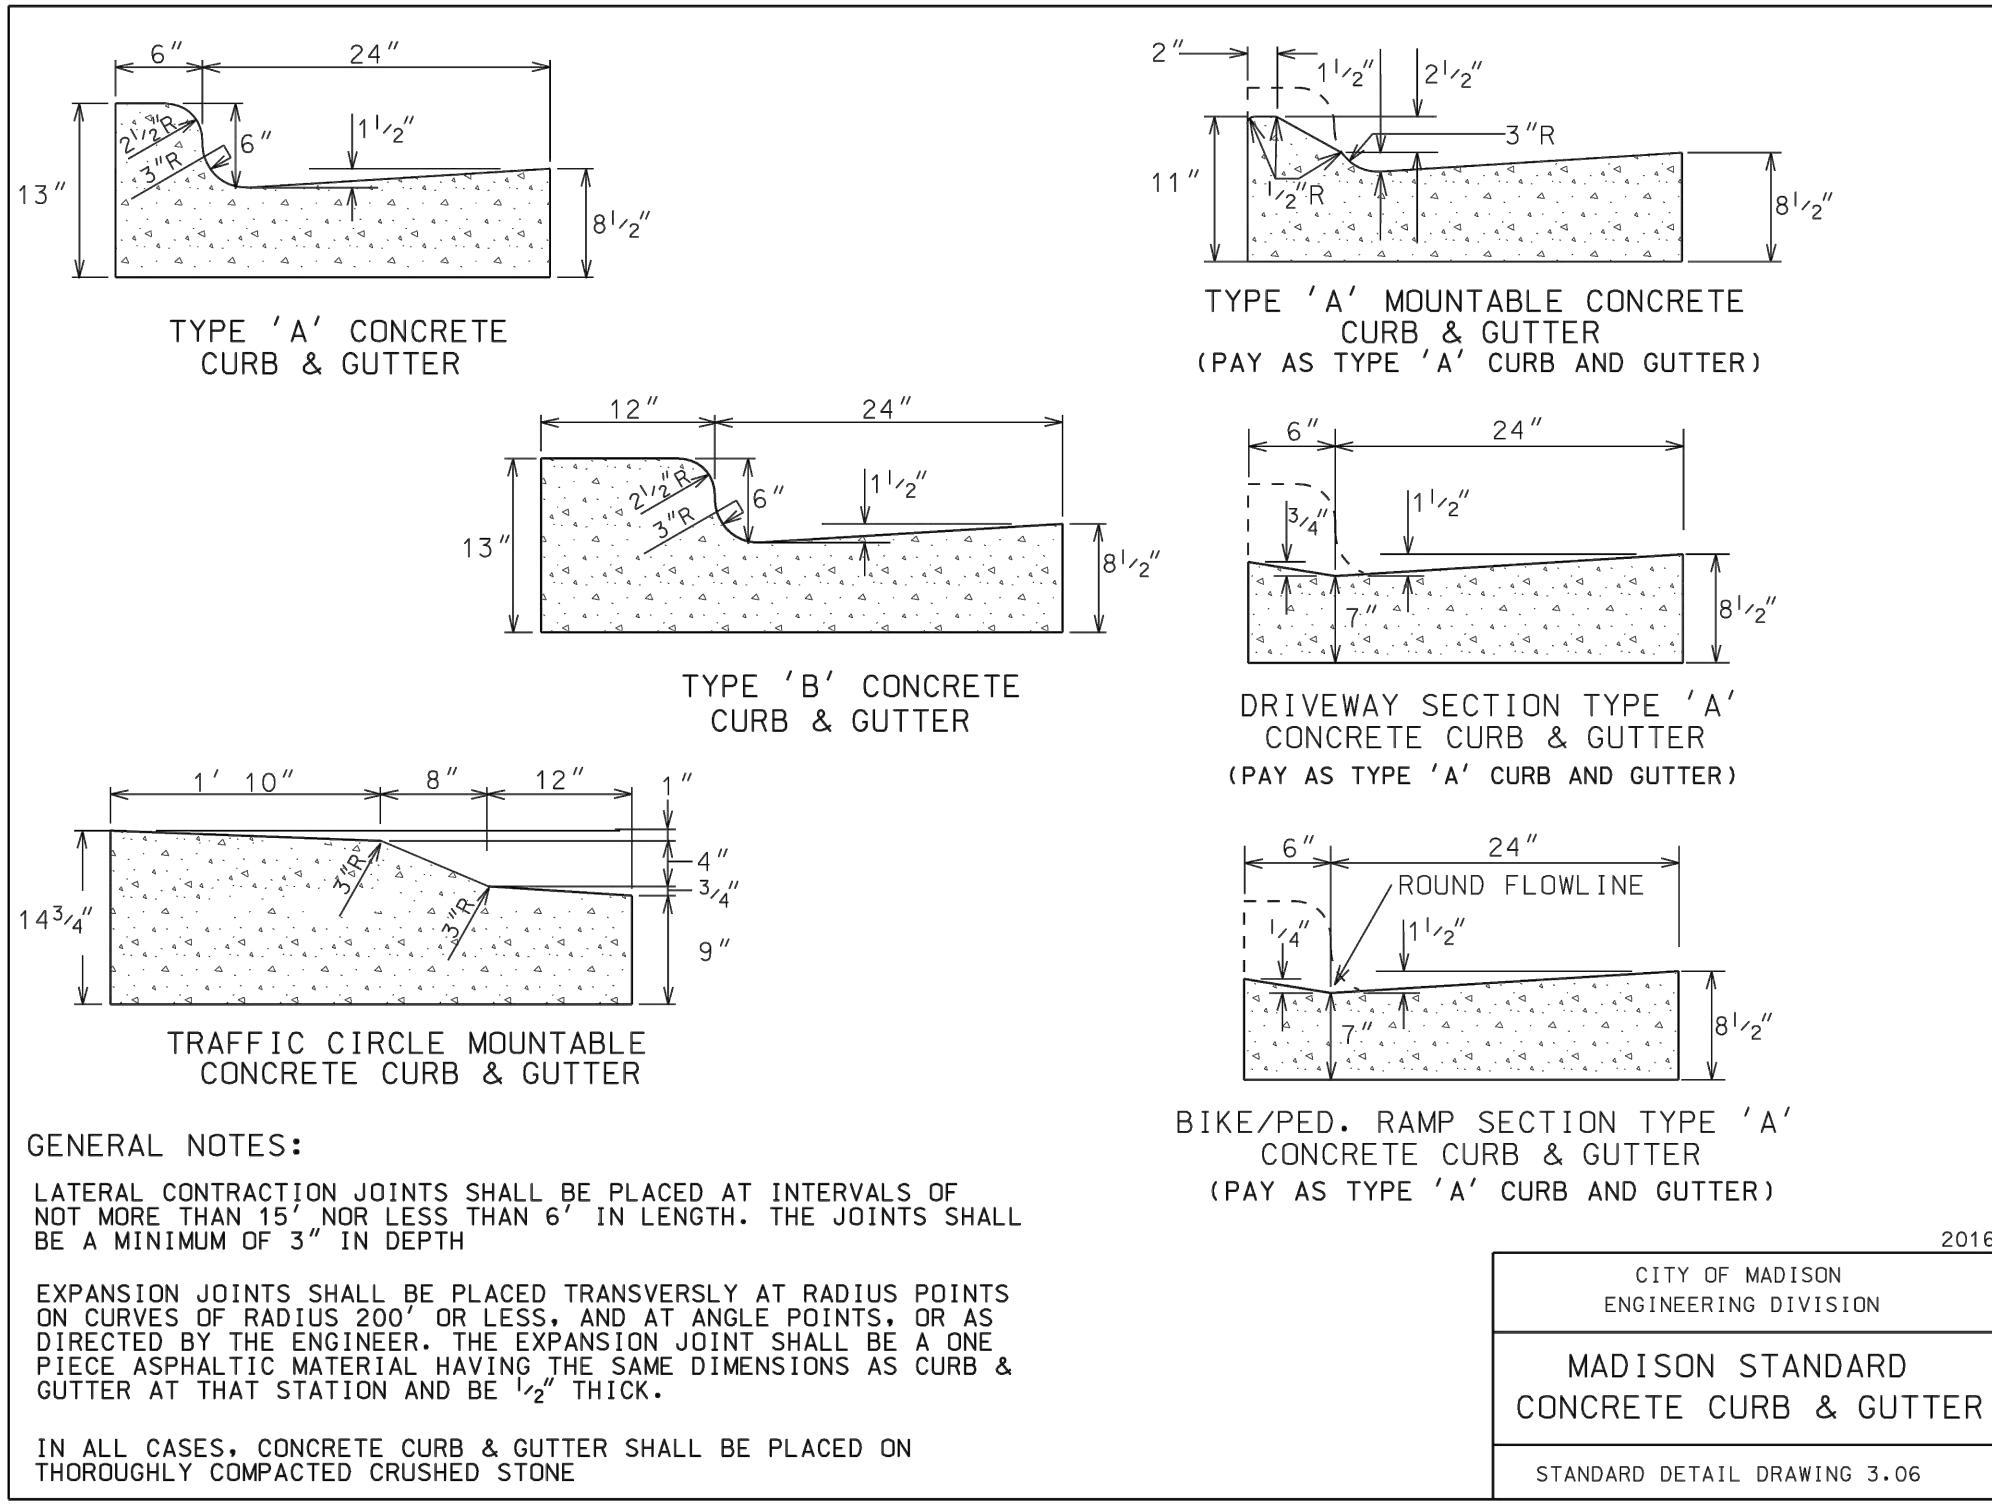

4/17/2024 11:30:17 AM



3535 UNIVERSITY MIXED USE

REVIEW DRAWING
 NOT TO BE USED FOR CONSTRUCTION
 DATE OF ISSUE 07/10/2024



CITY OF MADISON DETAILS

JLA PROJECT No: W23-0222
 DATE OF ISSUANCE: 07/10/24
 REVISION DATE:

C602

LANDSCAPE CALCULATIONS AND DISTRIBUTIONS

Required landscaped areas shall be calculated based upon the total developed area of the property. Developed area is defined as that area within a single contiguous boundary which is made up of structures, parking, driveways and docking/loading facilities, but excluding the area of any building footprint at grade, land designated for open space uses such as athletic fields, and undeveloped land area on the same zoning lot. There are three methods for calculating landscape points depending on the size of the lot and Zoning District.

(A) For all lots except those described in (B) and (C) below, five (5) landscape points shall be provided for each three hundred (300) square feet of developed area.

Total square footage of developed area: **7,155 Square Feet**
 Total landscape points required: **120 Points**

(B) For lots larger than five (5) acres, points shall be provided at five (5) points per three hundred (300) square feet for the first five (5) developed acres, and one (1) point per one hundred (100) square feet for all additional acres:


Total square footage of developed area: _____
 Five (5) acres: _____
 First five (5) developed acres: _____
 Remainder of developed area: _____
 Total landscape points required: _____

(C) For the Industrial - Limited (IL) and Industrial - General (IG) districts, one (1) point shall be provided per one hundred (100) square feet of developed area:

Total square footage of developed area: _____
 Total landscape points required: _____

TABULATION OF LANDSCAPE CREDITS AND POINTS

PLANT TYPE/ELEMENT	MINIMUM INSTALLATION SIZE	POINTS	CREDITS / EXISTING LANDSCAPING		NEW / PROPOSED LANDSCAPING	
			QUANTITY	POINTS ACHIEVED	QUANTITY	POINTS ACHIEVED
OVERSTORY DECIDUOUS TREE	2.5" CAL MIN.	35	0	0	0	0
TALL EVERGREEN TREE	5-6' TALL MIN.	35	0	0	0	0
ORNAMENTAL TREE	1.5" CAL MIN.	15	0	0	0	0
UPRIGHT EVERGREEN SHRUB	3-4' TALL, MIN.	10	18	180	0	0
SHRUB, DECIDUOUS	#3 CONT., MIN. 12"-24"	3	0	0	21	63
SHRUB, EVERGREEN	#3 CONT., MIN. 12"-24"	4	0	0	16	64
ORNAMENTAL GRASS & PERENNIAL	#1 CONT., MIN. 8"-18"	2	0	0	0	0
ORNAMENTAL / DECORATIVE FENCING OR WALL	4 POINTS / 10 LF	4	0	0	0	0
EXISTING SIGNIFICANT SPECIMAN TREE	14 POINTS / CAL. (MAXIMUM 200 POINTS PER TREE)	14	0	0	0	0
LANDSCAPE FURNITURE	5 POINTS PER SEAT (WITHIN PUBLICALLY ACCESSIBLE DEVELOPED AREA. CANNOT COMPOSE MORE THAN 5% OF TOTAL REQUIRED POINTS)	5	0	0	0	0
SUBTOTAL				180		127
TOTAL NUMBER OF POINTS PROVIDED				307		

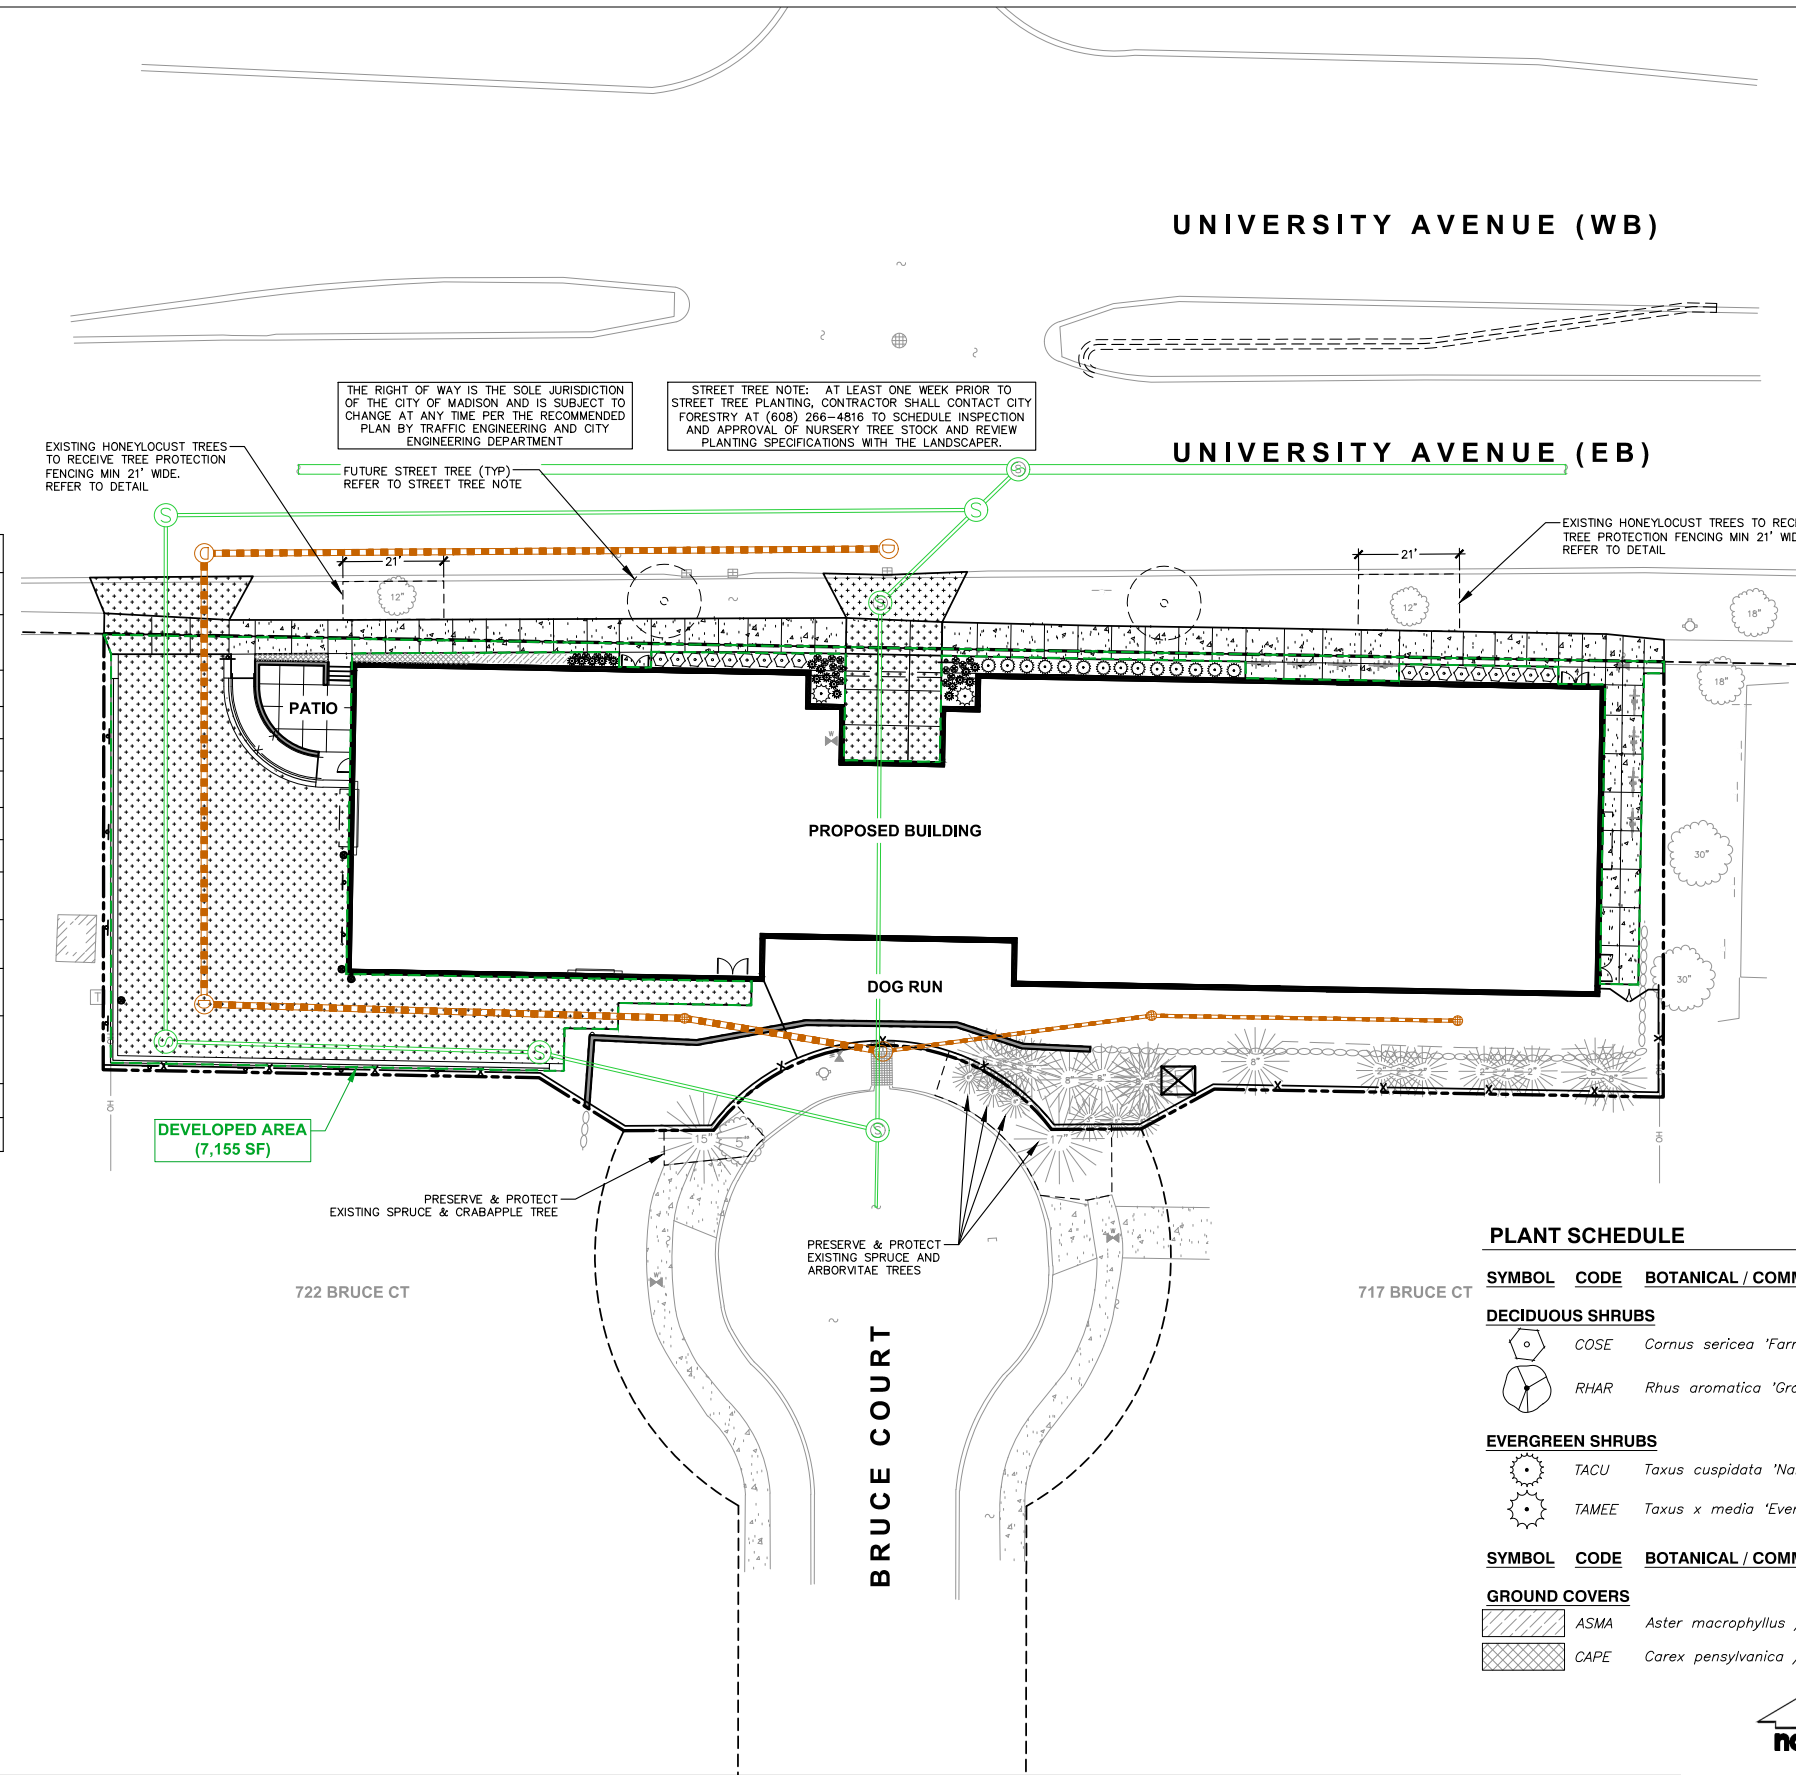

GENERAL NOTES


- REFER TO THE EXISTING CONDITIONS SURVEY FOR EXISTING CONDITIONS NOTES AND LEGEND.
- ALL WORK IN THE ROW SHALL BE IN ACCORDANCE WITH THE MUNICIPAL STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION.
- JSD SHALL BE HELD HARMLESS AND DOES NOT WARRANT ANY DEVIATIONS BY THE OWNER/CONTRACTOR FROM THE APPROVED CONSTRUCTION PLANS THAT MAY RESULT IN DISCIPLINARY ACTIONS BY ANY OR ALL REGULATORY AGENCIES.
- DRAWING FOR REVIEW - NOT FOR CONSTRUCTION UNLESS OTHERWISE NOTED IN THE TITLE BLOCK.
- THE LANDSCAPE CONTRACTOR SHALL COORDINATE ALL FINE GRADING AND TOPSOILING WITH GENERAL CONTRACTOR
- REFER TO "LANDSCAPE DETAILS AND NOTES" SHEET FOR ADDITIONAL DETAILS, NOTES AND SPECIFICATION INFORMATION INCLUDING MATERIALS, GUARANTEE AND EXECUTION RELATED TO LANDSCAPE PLAN
- CONTRACTOR SHALL REVIEW SITE CONDITIONS FOR UTILITY CONFLICTS, DRAINAGE ISSUES, SUBSURFACE ROCK, AND PLANT PLACEMENT CONFLICTS PRIOR TO PLANT INSTALLATION. REPORT ANY CONDITIONS THAT MAY HAVE ADVERSE IMPACT ON PLANTING OPERATIONS TO LANDSCAPE ARCHITECT
- DO NOT COMMENCE PLANTING OPERATIONS UNTIL ALL ADJACENT SITE IMPROVEMENTS, IRRIGATION INSTALLATION (IF APPLICABLE), AND FINISH GRADING ARE COMPLETE

CONTRACTOR NOTES

- REFERENCE SHEET C1.0 FOR LEGEND.
- ALL PROPOSED STREET TREE REMOVALS WITHIN THE RIGHT OF WAY SHALL BE REVIEWED BY CITY FORESTRY BEFORE THE PLAN COMMISSION MEETING. STREET TREE REMOVALS REQUIRE APPROVAL AND A TREE REMOVAL PERMIT ISSUED BY CITY FORESTRY. ANY STREET TREE REMOVALS REQUESTED AFTER THE DEVELOPMENT PLAN IS APPROVED BY THE PLAN COMMISSION OR THE BOARD OF PUBLIC WORKS AND CITY FORESTRY WILL REQUIRE A MINIMUM OF A 72-HOUR REVIEW PERIOD WHICH SHALL INCLUDE THE NOTIFICATION OF THE ALDERPERSON WITHIN WHO'S DISTRICT IS AFFECTED BY THE STREET TREE REMOVAL(S) PRIOR TO A TREE REMOVAL PERMIT BEING ISSUED.
- AS DEFINED BY THE SECTION 107.13 OF CITY OF MADISON STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION: NO EXCAVATION IS PERMITTED WITHIN 5-FEET OF THE TRUNK OF THE STREET TREE OR WHEN CUTTING ROOTS OVER 3 INCHES IN DIAMETER. IF EXCAVATION IS NECESSARY, THE CONTRACTOR SHALL CONTACT MADISON CITY FORESTRY (266-4816) PRIOR TO EXCAVATION. CITY OF MADISON FORESTRY PERSONNEL SHALL ASSESS THE IMPACT TO THE TREE AND TO ITS ROOT SYSTEM PRIOR TO WORK COMMENCING. TREE PROTECTION SPECIFICATIONS CAN BE FOUND ON THE FOLLOWING WEBSITE: [HTTPS://WWW.CITYOFMADISON.COM/BUSINESS/PW/SPECS.CFM](https://www.cityofmadison.com/BUSINESS/PW/SPECS.CFM)
- CONTRACTOR SHALL TAKE PRECAUTIONS DURING CONSTRUCTION TO NOT DISFIGURE, SCAR, OR IMPAIR THE HEALTH OF ANY STREET TREE. CONTRACTOR SHALL OPERATE EQUIPMENT IN A MANNER AS TO NOT DAMAGE THE BRANCHES OF THE STREET TREE(S). THIS MAY REQUIRE USING SMALLER EQUIPMENT AND LOADING AND UNLOADING MATERIALS IN A DESIGNATED SPACE AWAY FROM TREES ON THE CONSTRUCTION SITE. ANY DAMAGE OR INJURY TO EXISTING STREET TREES (EITHER ABOVE OR BELOW GROUND) SHALL BE REPORTED IMMEDIATELY TO CITY FORESTRY AT 266-4816. PENALTIES AND REMEDIATION SHALL BE REQUIRED.
- SECTION 107.13(G) OF CITY OF MADISON STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION ADDRESSES SOIL COMPACTION NEAR STREET TREES AND SHALL BE FOLLOWED BY CONTRACTOR. THE STORAGE OF PARKED VEHICLES, CONSTRUCTION EQUIPMENT, BUILDING MATERIALS, REFUSE, EXCAVATED SPOILS OR DUMPING OF POISONOUS MATERIALS ON OR AROUND TREES AND ROOTS WITHIN FIVE (5) FEET OF THE TREE OR WITHIN THE PROTECTION ZONE IS PROHIBITED.
- STREET TREE PRUNING SHALL BE COORDINATED WITH MADISON FORESTRY AT A MINIMUM OF TWO WEEKS PRIOR TO THE START OF CONSTRUCTION FOR THIS PROJECT. ALL PRUNING SHALL FOLLOW THE AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI) A300 - PART 1 STANDARDS FOR PRUNING.
- ALL LANDSCAPE AREAS TO RECEIVE SHREDDED HARDWOOD BARK MULCH UNLESS OTHERWISE SPECIFIED.

PLANT SCHEDULE

SYMBOL	CODE	BOTANICAL / COMMON NAME	CONT	SIZE	QTY
DECIDUOUS SHRUBS					
	COSE	Cornus sericea 'Farrow' / Arctic Fire® Red Twig Dogwood	B & B	Min. 12"-24"	18
	RHAR	Rhus aromatica 'Gro-Low' / Gro-Low Fragrant Sumac	* #3	Min. 12"-24"	3
EVERGREEN SHRUBS					
	TACU	Taxus cuspidata 'Nana' / Dwarf Japanese Yew	B & B	Min. 24" Ht.	14
	TAMEE	Taxus x media 'Everlow' / Everlow Yew	#3	Min. 12" Wide	2
GROUND COVERS					
	ASMA	Aster macrophyllus / Bigleaf Aster			
	CAPE	Carex pensylvanica / Pennsylvania Sedge			



3535 UNIVERSITY MIXED USE


REVIEW DRAWING
 NOT TO BE USED FOR CONSTRUCTION
 DATE OF ISSUE 5/28/2024



OVERALL LANDSCAPE PLAN


JLA PROJECT No:	W23-0222
DATE OF ISSUANCE:	5/28/24
REVISION DATE:	

L100

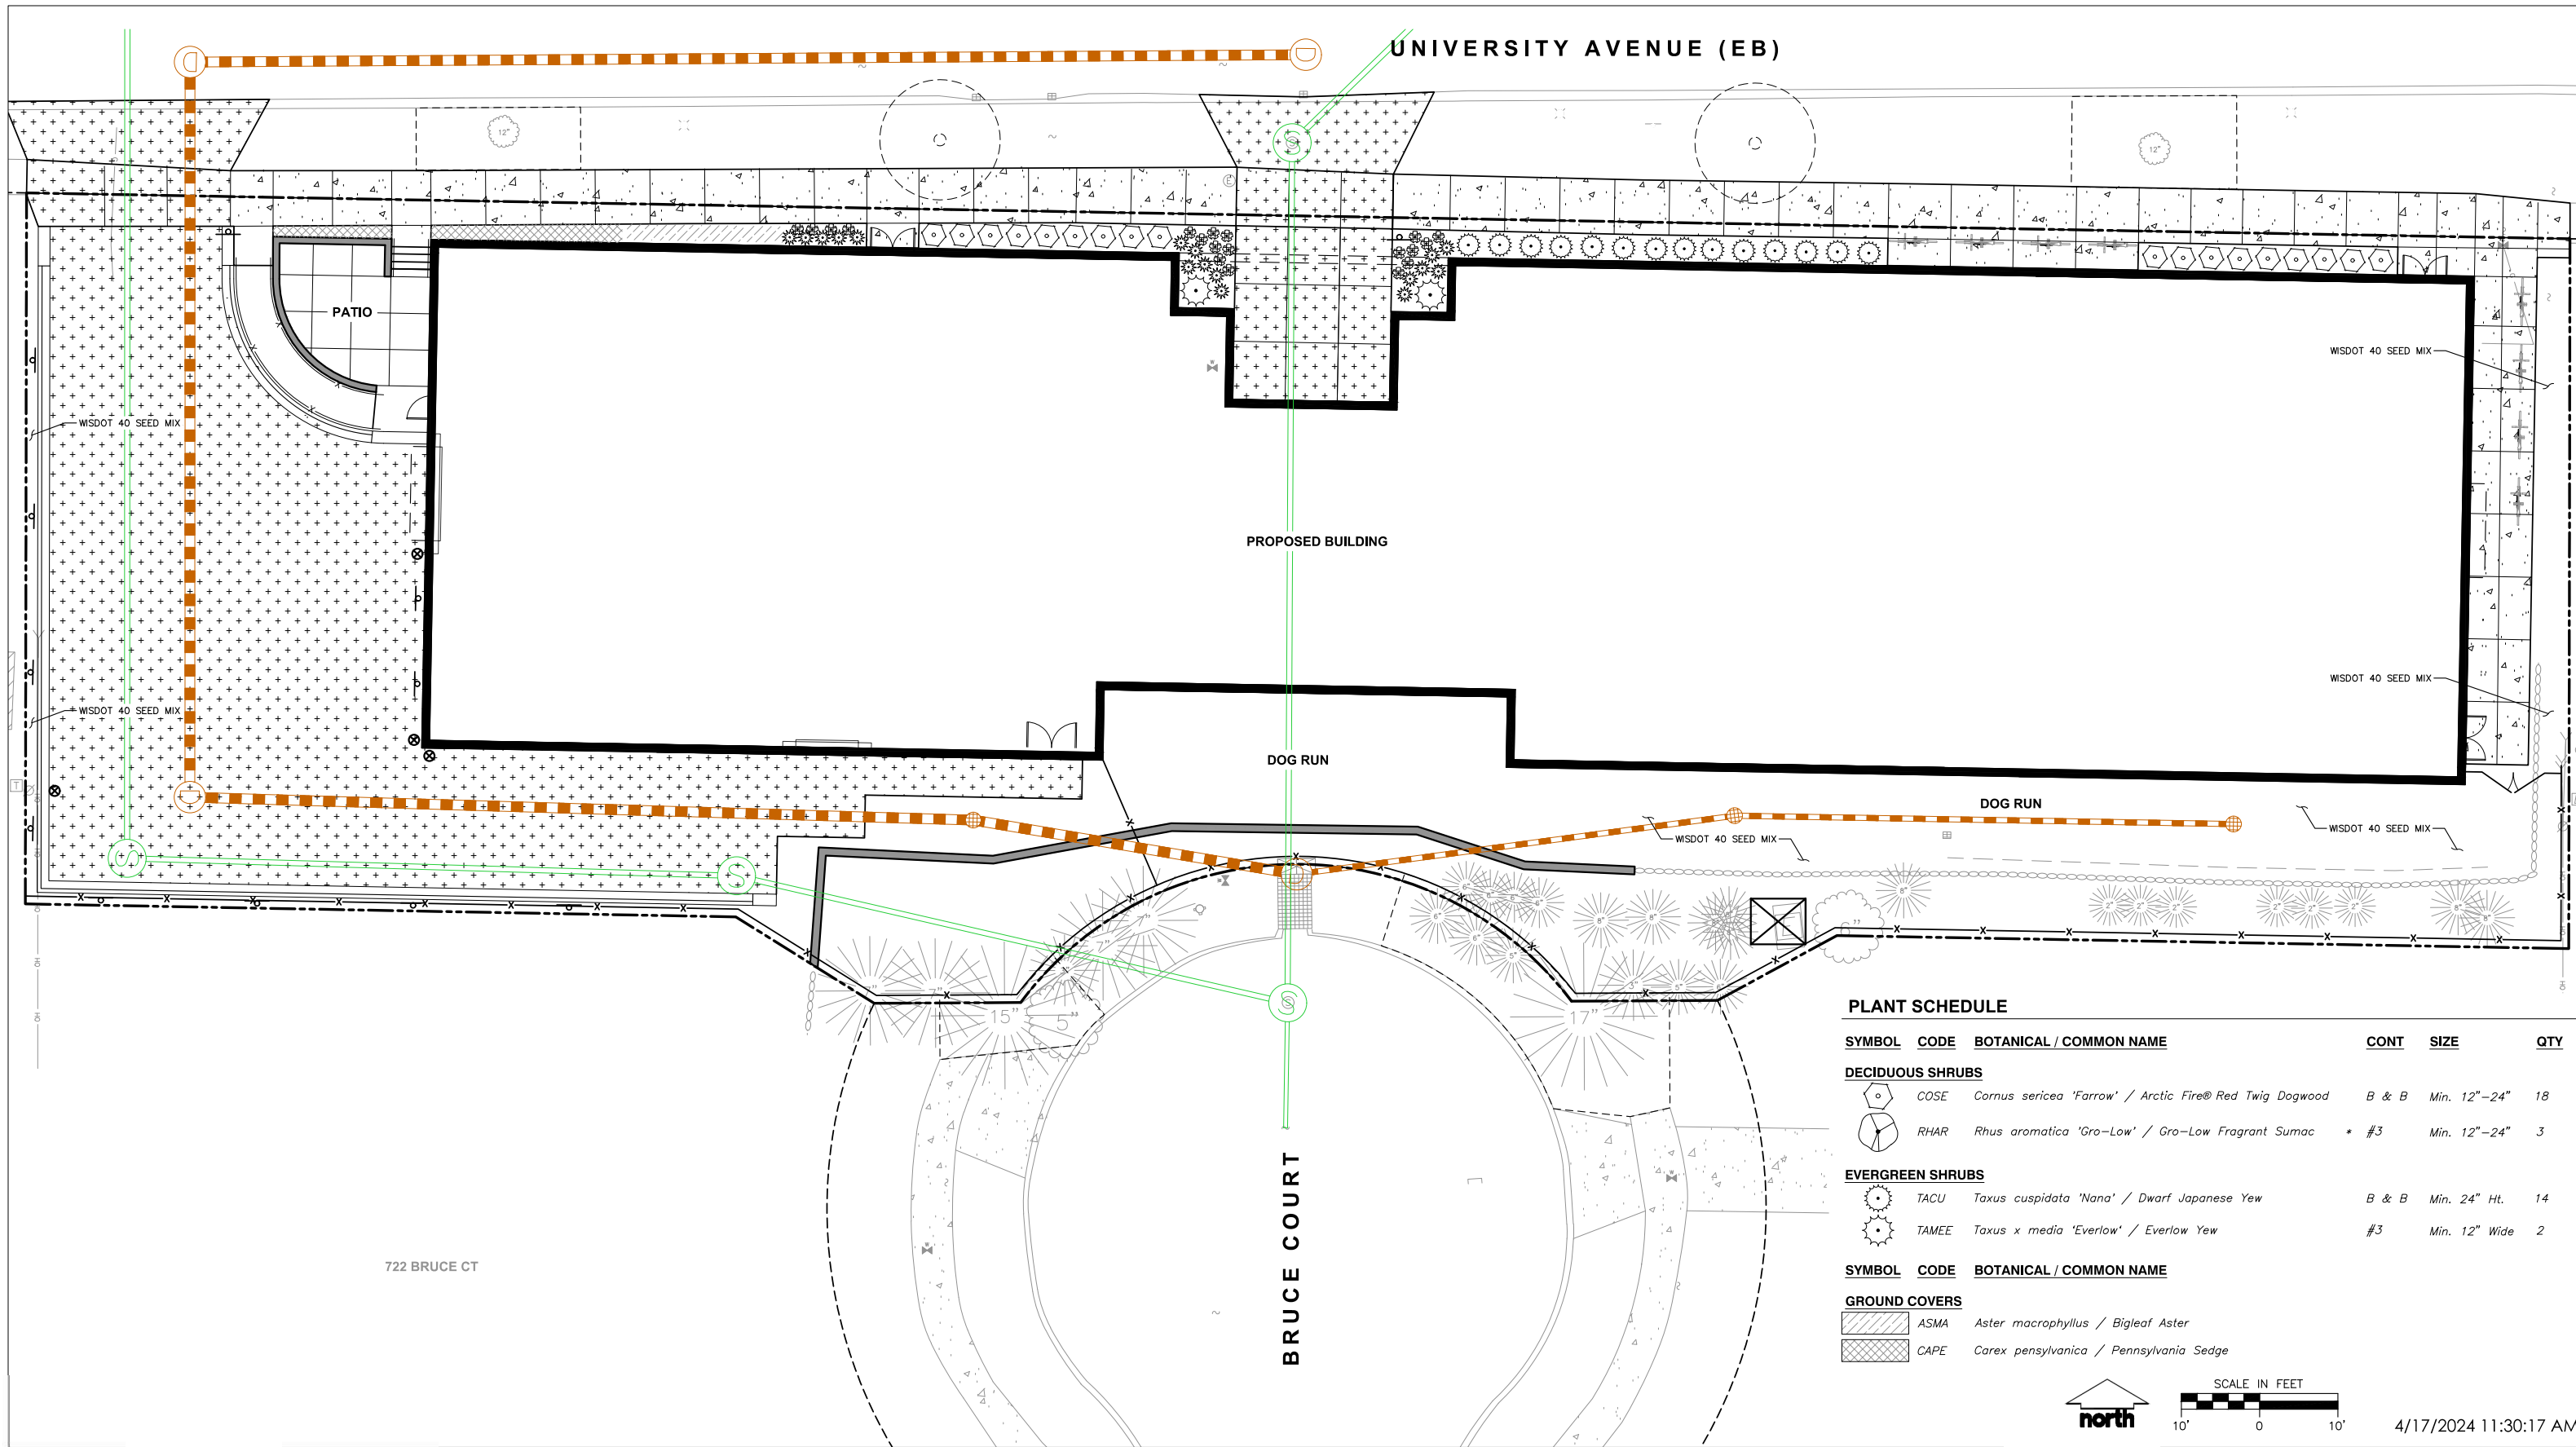

PLANT SCHEDULE

SYMBOL	CODE	BOTANICAL / COMMON NAME	CONT	SIZE	QTY
DECIDUOUS SHRUBS					
	COSE	Cornus sericea 'Farrow' / Arctic Fire® Red Twig Dogwood	B & B	Min. 12"-24"	18
	RHAR	Rhus aromatica 'Gro-Low' / Gro-Low Fragrant Sumac	* #3	Min. 12"-24"	3
EVERGREEN SHRUBS					
	TACU	Taxus cuspidata 'Nana' / Dwarf Japanese Yew	B & B	Min. 24" Ht.	14
	TAMEE	Taxus x media 'Everlow' / Everlow Yew	#3	Min. 12" Wide	2
GROUND COVERS					
	ASMA	Aster macrophyllus / Bigleaf Aster			
	CAPE	Carex pennsylvanica / Pennsylvania Sedge			



3535 UNIVERSITY MIXED USE






REVIEW DRAWING
 NOT TO BE USED FOR CONSTRUCTION
 DATE OF ISSUE 5/28/2024



DETAILED LANDSCAPE PLAN

JLA PROJECT No:	W23-0222
DATE OF ISSUANCE:	5/28/24
REVISION DATE:	

L101

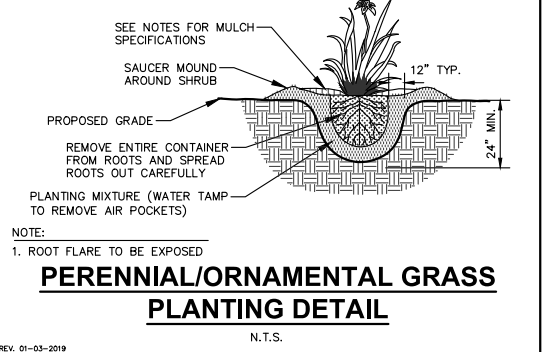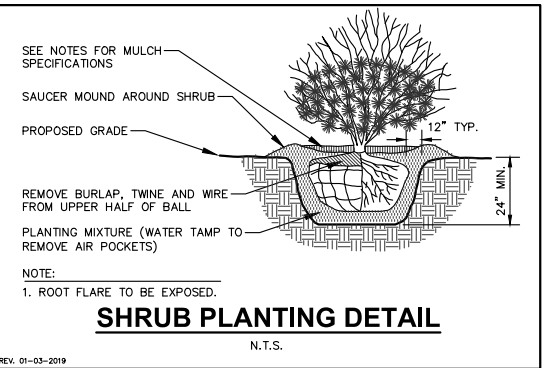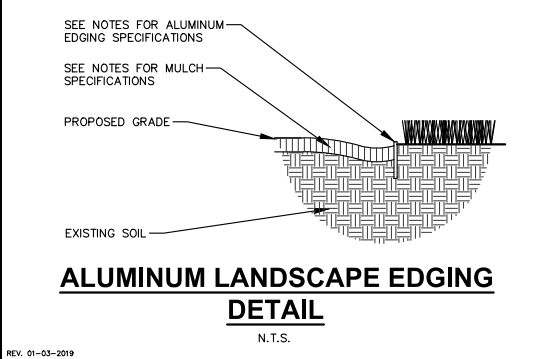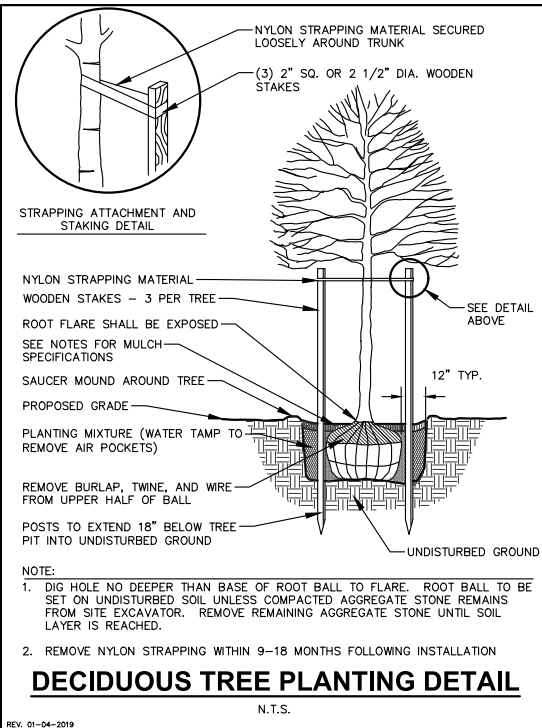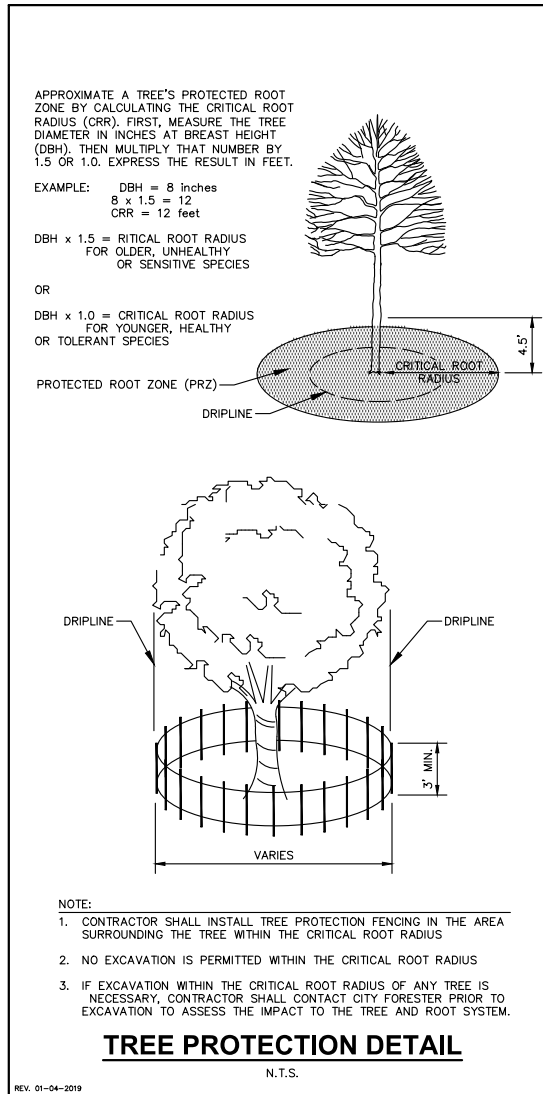

GENERAL NOTES

- GENERAL: ALL WORK IN THE R-O-W AND PUBLIC EASEMENTS SHALL BE IN ACCORDANCE WITH LOCAL MUNICIPAL REQUIREMENTS. JSD SHALL BE HELD HARMLESS AND DOES NOT WARRANT ANY DEVIATIONS BY THE OWNER/CONTRACTOR FROM THE APPROVED CONSTRUCTION PLANS THAT MAY RESULT IN DISCIPLINARY ACTIONS BY ANY OR ALL REGULATORY AGENCIES. LOCATE ALL UTILITIES PRIOR TO CONSTRUCTION. THE CONTRACTOR IS RESPONSIBLE FOR ANY DAMAGE DONE TO UTILITIES. CONTRACTOR MUST CALL 1-800-242-8511 FOR UTILITY LOCATIONS AT LEAST THREE DAYS PRIOR TO DIGGING. HAND DIG AND INSTALL ALL PLANTS THAT ARE NEAR EXISTING UTILITIES. PROTECT PREVIOUSLY INSTALLED WORK OF OTHER TRADES. CONTRACTOR IS RESPONSIBLE FOR STAKING THE PLANT MATERIALS FOR REVIEW BY OWNER PRIOR TO DIGGING AND PLACEMENT AND SHALL COORDINATE ALL FINE GRADING AND RESTORATION WITH THE GRADING CONTRACTOR.
- DELIVERY AND HANDLING: DO NOT DELIVER MORE PLANT MATERIALS THAN CAN BE PLANTED IN ONE DAY, UNLESS ADEQUATE, APPROPRIATE AND SECURE STORAGE IS PROVIDED AND APPROVED BY OWNER'S REPRESENTATIVE. AT ALL TIMES, PROTECT ALL PLANT MATERIALS FROM WIND AND DIRECT SUN. DELIVER PLANTS WITH LEGIBLE IDENTIFICATION LABELS. PROTECT PLANTS DURING DELIVERY AND DO NOT PRUNE PRIOR TO DELIVERY. ALL TREES AND SHRUBS SHALL BE PLANTED ON THE DAY OF DELIVERY; IF THIS IS NOT POSSIBLE, PROTECT THE PLANT MATERIALS NOT PLANTED BY STORING THEM IN A SHADED, SECURE AREA, PROTECTING THE ROOT MASS WITH WET SOIL, MULCH, HAY OR OTHER SUITABLE MEDIUM. CONTRACTOR TO KEEP ALL PLANT MATERIALS ADEQUATELY WATERED TO PREVENT ROOT DESICCATION. DO NOT REMOVE CONTAINER GROWN STOCK FROM CONTAINERS BEFORE TIME OF PLANTING. DO NOT PICK UP CONTAINER OR BALLED PLANTS BY STEM OR ROOTS. ALL PLANTS SHALL BE LIFTED AND HANDLED FROM THE BOTTOM OF THE CONTAINER OR BALL. PERFORM ACTUAL PLANTING ONLY WHEN WEATHER AND SOIL CONDITIONS ARE SUITABLE IN ACCORDANCE WITH LOCALLY ACCEPTED BEST HORTICULTURAL PRACTICES.
- MATERIALS - PLANTS: ALL PLANTS SHALL CONFORM TO THE LATEST VERSION OF THE AMERICAN STANDARD FOR NURSERY STOCK ANSI Z60.1. PLANTS SHALL BE TRUE TO SPECIES AND VARIETY SPECIFIED AND NURSERY GROWN IN ACCORDANCE WITH GOOD HORTICULTURAL PRACTICES UNDER CLIMATIC CONDITIONS SIMILAR TO THOSE IN THE LOCALITY OF THE PROJECT FOR AT LEAST 2 YEARS. PLANTS SHALL BE FRESHLY DUG (DURING THE MOST RECENT FAVORABLE HARVEST SEASON). PLANTS SHALL BE SO TRAINED IN DEVELOPMENT AND APPEARANCE AS TO BE UNQUESTIONABLY SUPERIOR IN FORM, COMPACTNESS, AND SYMMETRY. PLANTS SHALL BE SOUND, HEALTHY, VIGOROUS, WELL-BRANCHED AND DENSELY FOLIATED WHEN IN LEAF, AND FREE OF DISEASE AND INSECTS (ADULT EGGS, PUPAE OR LARVAE). THEY SHALL HAVE HEALTHY, WELL-DEVELOPED ROOT SYSTEMS AND SHALL BE FREE FROM PHYSICAL DAMAGE OR OTHER CONDITIONS THAT WOULD PREVENT THRIVING GROWTH OR PREMATURE MORTALITY. PLANTS SHALL BE OF THE HIGHEST QUALITY, POSSESS TYPICAL GROWTH HABITS AND FORM FOR THEIR SPECIES AND BE FREE OF INJURY. PARKWAY TREES AND PARKING LOT TREES SHALL HAVE A MINIMUM BRANCHING HEIGHT OF SIX (6) FEET ABOVE THE GROUND TO ALLOW ADEQUATE VISUAL AND PHYSICAL CLEARANCE.
- PRUNING: THE CONTRACTOR SHALL PRUNE ALL TREES AND REPAIR ANY INJURIES THAT OCCURRED DURING THE PLANTING PROCESS. DOUBLE LEADERS, DEAD BRANCHES, AND LIMBS DAMAGED OR BROKEN DURING THE PLANTING PROCESS, SHALL BE PRUNED. THIS SHALL BE THE ONLY PRUNING ALLOWED AT PLANTING. PRUNING SHALL CONFORM TO THE LATEST VERSION OF THE AMERICAN STANDARD FOR TREE CARE OPERATIONS, ANSI A300. PRUNE TREES IN ACCORDANCE WITH NAA GUIDELINES. DO NOT TOP TREES. PRUNE SHRUBS ACCORDING TO STANDARD HORTICULTURAL PRACTICES. ON CUTS OVER 3/4" IN DIAMETER AND BRUISES OR SCARS ON BARK, TRACE THE INJURED CAMBIAL LAYER BACK TO LIVING TISSUE AND REMOVE. SMOOTH AND SHAPE WOUNDS SO AS NOT TO RETAIN WATER. TREAT THE AREA WITH AN APPROVED INCONSPICUOUS LATEX BASED ANTISEPTIC TREE PAINT, IF PRUNING OCCURS "IN SEASON". DO NOT PRUNE ANY OAK TREES DURING THE MONTHS FROM APRIL TO OCTOBER.
- CLEANUP: THE WORK AREA SHALL BE KEPT SAFE AND NEAT AT ALL TIMES. DISPOSED OF EXCESS SOIL, REMOVE ALL CUTTINGS AND WASTE MATERIALS. SOIL AND BRANCHES, BIND AND WRAP THESE MATERIALS, ANY REJECTED PLANTS, AND ANY OTHER DEBRIS RESULTING FROM ALL PLANTING TASKS AND PROMPTLY CLEAN UP AND REMOVE FROM THE PROJECT SITE. UNDER NO CIRCUMSTANCES SHALL THE ACCUMULATION OF SOIL, BRANCHES OR OTHER DEBRIS BE ALLOWED UPON A PUBLIC PROPERTY IN SUCH A MANNER AS TO RESULT IN A PUBLIC SAFETY HAZARD OR DAMAGE. LIKEWISE, UNDER NO CIRCUMSTANCES SHALL ANY DEBRIS OR INCIDENTAL MATERIALS BE ALLOWED UPON ADJACENT PRIVATE PROPERTY.
- ANY SUBSTITUTIONS IN PLANT TYPE, LOCATION, OR SIZE SHALL BE APPROVED BY LANDSCAPE ARCHITECT PRIOR TO INSTALLATION.
- CONTRACTOR TO VERIFY PLANT MATERIAL QUANTITIES AND SQUARE FOOTAGES. QUANTITIES SHOWN ON PLAN TAKE PRECEDENCE OVER THOSE ON SCHEDULE.

LANDSCAPE MATERIAL NOTES

- MATERIALS - PLANTING MIXTURE: ALL HOLES EXCAVATED FOR TREES, SHRUBS, PERENNIALS AND ORNAMENTAL GRASSES SHALL BE BACKFILLED WITH TWO (2) PARTS TOPSOIL, ONE (1) PART SAND AND ONE (1) PART COMPOST. SOIL MIXTURE SHALL BE WELL BLENDED PRIOR TO INSTALLATION.
- MATERIALS - TOPSOIL: TOPSOIL TO BE CLEAN, FRIABLE LOAM FROM A LOCAL SOURCE, FREE FROM STONES OR DEBRIS OVER 3/4" IN DIAMETER, AND FREE FROM TOXINS OR OTHER DELETERIOUS MATERIALS. TOPSOIL SHALL HAVE A pH VALUE BETWEEN 6 AND 7. TOPSOIL AND PLANTING SOIL SHALL BE TESTED TO ENSURE CONFORMANCE WITH THESE SPECIFICATIONS AND SHALL BE AMENDED TO MEET THESE SPECIFICATIONS. PROVIDE TEST RESULTS TO OWNER'S REPRESENTATIVE PRIOR TO PLACEMENT. DO NOT PLACE FROZEN OR MUDDY TOPSOIL. APPLY SOIL AMENDMENTS TO ALL LANDSCAPE AREAS PER SOIL TEST.
- MATERIALS - SHREDDED HARDWOOD BARK MULCH: ALL PLANTING AREAS LABELED ON PLAN SHALL RECEIVE CERTIFIED WEED FREE, SHREDDED HARDWOOD BARK MULCH INSTALLED TO A MINIMUM AND CONSISTENT DEPTH OF 3-INCHES. SHREDDED HARDWOOD BARK MULCH SIZE & COLOR TO BE APPROVED BY OWNER'S REPRESENTATIVE PRIOR TO INSTALLATION. FERTILIZER SHALL BE IN ACCORDANCE WITH APPLICABLE LOCAL, COUNTY AND STATE REQUIREMENTS. SHREDDED HARDWOOD BARK MULCH AREAS SHALL NOT RECEIVE WOVEN WEED BARRIER FABRIC.
- MATERIALS - WISDOT #40 SEED MIX: DISTURBED LAWN AREAS LABELED ON PLAN AS SUCH, SHALL RECEIVE 6" OF TOPSOIL AND WISDOT #40 SEED MIX, OR APPROVED EQUAL, INSTALLED PER MANUFACTURER'S RECOMMENDATIONS. IN ADDITION TO TURFGRASS SEED, ANNUAL RYE SHALL BE APPLIED TO ALL DISTURBED AREAS AT A RATE OF 1 1/2 LBS PER 1000 SQUARE FEET. FERTILIZE AND MULCH PER MANUFACTURER'S RECOMMENDATIONS. MULCH SHALL BE CERTIFIED NOXIOUS WEED SEED-FREE.
- MATERIALS - TREE & SHRUB RINGS: ALL TREES AND/OR SHRUBS PLANTED IN SEEDED LAWN AREAS TO BE INSTALLED WITH A MINIMUM 4' DIAMETER SHREDDED HARDWOOD BARK MULCH TREE RING SPREAD TO A CONSISTENT DEPTH OF 3-INCHES. ALL TREE RINGS SHOULD BE INSTALLED WITH A 5" DEPTH SHOVEL CUT EDGE, ANGLED 45 DEGREES INTO SOIL AT A 5' DIAMETER ABOUT THE CENTER OF THE TREE PLANTING. A PRE-EMERGENT GRANULAR HERBICIDE WEED-PREVENTER SHOULD BE MIXED WITH MULCH USED TO INSTALL TREE RING AS WELL AS TOPICALLY APPLIED TO COMPLETED INSTALLATION OF TREE RING.
- MATERIALS - TREE PROTECTION: ALL TREES TO BE INSTALLED WITH LDPE TREE GUARDS AS MANUFACTURED BY A.M. LEONARD HORTICULTURAL TOOL & SUPPLY CO., OR APPROVED EQUAL.
- MATERIALS - (ALTERNATE 1): TREE WATERING BAGS: ALL TREES TO BE INSTALLED WITH ONE (1) WATER BAG. PRODUCT TO BE "TREE GATOR ORIGINAL SLOW RELEASE WATERING BAG," PRODUCT NO. 98183-R OR APPROVED EQUAL. INSTALL IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.

CONTRACTOR AND OWNER RESPONSIBILITY NOTES

- GUARANTEE: THE CONTRACTOR SHALL GUARANTEE ALL PLANTS THROUGH ONE (1) YEAR AFTER ACCEPTANCE BY THE OWNER'S REPRESENTATIVE. PLANTS SHALL BE ALIVE AND IN HEALTHY AND FLOURISHING CONDITION AT THE END OF THE GUARANTEE PERIOD. THE CONTRACTOR SHALL REPLACE (AT NO COST TO OWNER) ANY PLANTS THAT ARE DEAD OR NOT IN A VIGOROUS THRIVING CONDITION. REPLACEMENT PLANTS SHALL BE OF THE SAME KIND AND SIZE AS ORIGINALLY SPECIFIED UNLESS OTHERWISE DIRECTED BY OWNER'S REPRESENTATIVE. RESTORE BEDS AS NECESSARY FOLLOWING PLANT REPLACEMENT, INCLUDING BUT NOT LIMITED TO BEDDING, EDGING, MULCH, ETC. REPLACE PLANTS DAMAGED AT TIME OF PLANTING. REPAIR AREAS DISTURBED IN ANY WAY DURING PLANT REPLACEMENT AT NO COST TO OWNER. CONTRACTOR SHALL PROVIDE A ONE (1)-YEAR STRAIGHTENING GUARANTEE FOR ALL TREES.
- CONTRACTOR IS RESPONSIBLE FOR STAKING THE PLANT MATERIALS FOR REVIEW BY OWNER'S REPRESENTATIVE PRIOR TO DIGGING AND PLACEMENT AND SHALL COORDINATE ALL FINE GRADING AND RESTORATION WITH THE GRADING CONTRACTOR.
- MAINTENANCE: (CONTRACTOR) FOR ALL PLANTINGS, SEEDED AND/OR SODDED LAWN AREAS: THE CONTRACTOR SHALL MAINTAIN ALL PLANTINGS AND LAWN AREAS FOR A MINIMUM TIME PERIOD OF 60 DAYS, UNTIL FINAL ACCEPTANCE BY OWNER'S REPRESENTATIVE. THE CONTRACTOR IS RESPONSIBLE FOR ADEQUATELY WATERING PLANTS AND LAWN/TURFGRASS DURING THIS 60 DAY ESTABLISHMENT PERIOD. CONTRACTOR IS RESPONSIBLE FOR THE ESTABLISHMENT OF HEALTHY VIGOROUS PLANT MATERIALS AND LAWN/TURFGRASS GROWTH. CONTRACTOR IS ALSO RESPONSIBLE FOR ANY PRUNING OF PLANT MATERIALS, AND SHAPING AND/OR REPLACEMENT OR SUPPLEMENT OF DEFICIENT SHREDDED HARDWOOD BARK MULCH DURING THIS PERIOD. LONG TERM PLANT MATERIALS AND LAWN/TURFGRASS MAINTENANCE AND ANY PROGRAM FOR SUCH IS THE RESPONSIBILITY OF THE OWNER. ALL PLANTINGS AND LAWN/TURFGRASS AREAS SHALL BE MAINTAINED IN A MANICURED CONDITION UNTIL THE TIME WHEN THE OWNER'S ACCEPTANCE IS GIVEN.
- MAINTENANCE: (OWNER) THE OWNER IS RESPONSIBLE FOR THE CONTINUED MAINTENANCE, REPAIR AND REPLACEMENT OF ALL LANDSCAPING MATERIALS AND WEED BARRIER FABRIC AS NECESSARY FOLLOWING THE ONE (1) YEAR CONTRACTOR GUARANTEE PERIOD.

LANDSCAPING

LANDSCAPING TO BE INSTALLED AFTER COMPLETION OF THE BUILDING

INSTALLATION OF LANDSCAPING NOT TO AFFECT OPERATIONS OF THE BUILDING

TREE WATERING PROGRAM:

BASE BID - WATERING OF ALL TREES ON A REGULAR WEEKLY BASIS. CONTRACTOR TO KEEP A LOG OR JOURNAL OF A RECORD OF DATES AND QUANTITIES OF SUPPLEMENTAL WATERING EFFORTS

ALTERNATE BID #1 - INSTALLATION OF ONE (1) WATERING BAG PER TREE. DOCUMENTATION OF WEEKLY WATERING PROGRAM REQUIRED

ALTERNATE BID #2 - INSTALLATION OF TWO (2) AERATION WATERING TUBES PER TREE. DOCUMENTATION OF WEEKLY WATERING PROGRAM REQUIRED

*SEE LANDSCAPE MATERIALS NOTES FOR PRODUCTS



3535 UNIVERSITY MIXED USE


REVIEW DRAWING
 NOT TO BE USED FOR CONSTRUCTION
 DATE OF ISSUE 5/28/2024



LANDSCAPE DETAILS & NOTES

JLA PROJECT No: W23-0222
 DATE OF ISSUANCE: 5/28/24
 REVISION DATE:

L200

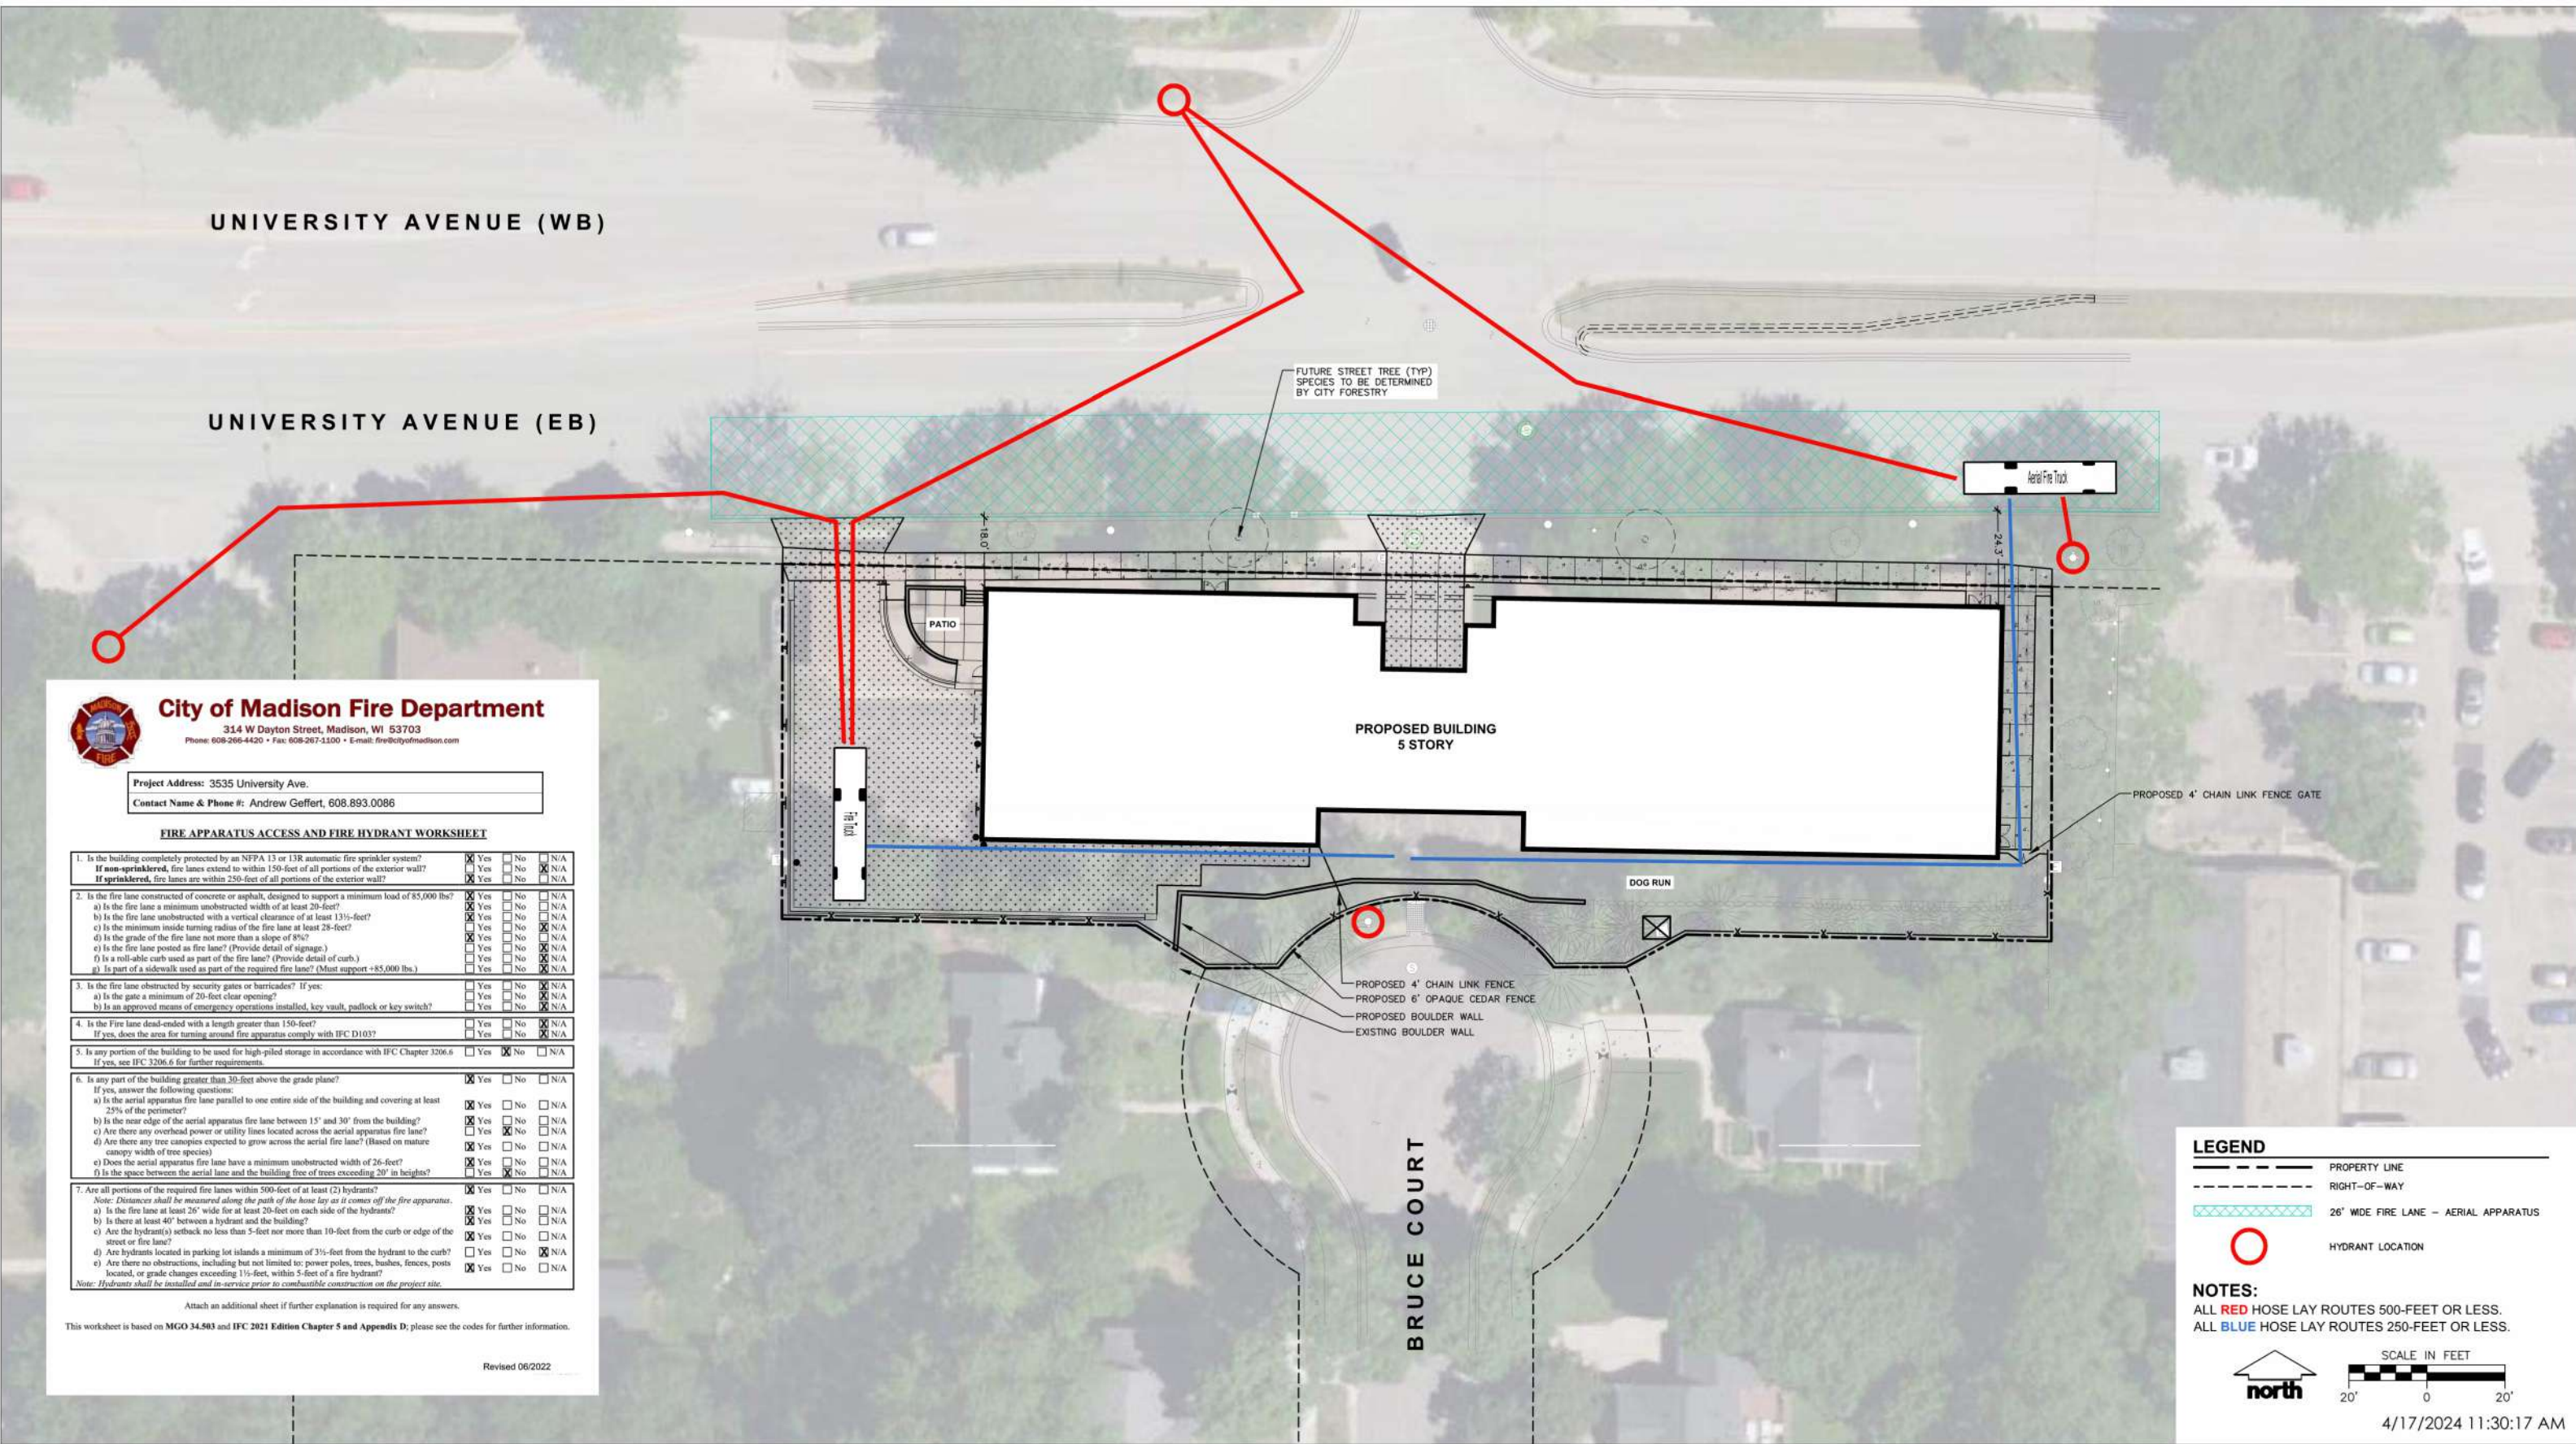

City of Madison Fire Department
 314 W Dayton Street, Madison, WI 53703
 Phone: 608-266-4420 • Fax: 608-267-1100 • E-mail: fire@cityofmadison.com

Project Address: 3535 University Ave.
 Contact Name & Phone #: Andrew Geffert, 608.893.0086

FIRE APPARATUS ACCESS AND FIRE HYDRANT WORKSHEET

1. Is the building completely protected by an NFPA 13 or 13R automatic fire sprinkler system? If non-sprinklered, fire lanes extend to within 150-feet of all portions of the exterior wall? If sprinklered, fire lanes are within 250-feet of all portions of the exterior wall?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A
2. Is the fire lane constructed of concrete or asphalt, designed to support a minimum load of 85,000 lbs? a) Is the fire lane a minimum unobstructed width of at least 20-feet? b) Is the fire lane unobstructed with a vertical clearance of at least 13½-feet? c) Is the minimum inside turning radius of the fire lane at least 28-feet? d) Is the grade of the fire lane not more than a slope of 8%? e) Is the fire lane posted as fire lane? (Provide detail of signage.) f) Is a roll-able curb used as part of the fire lane? (Provide detail of curb.) g) Is part of a sidewalk used as part of the required fire lane? (Must support +85,000 lbs.)	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A
3. Is the fire lane obstructed by security gates or barricades? If yes: a) Is the gate a minimum of 20-foot clear opening? b) Is an approved means of emergency operations installed, key vault, padlock or key switch?	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A
4. Is the Fire lane dead-ended with a length greater than 150-feet? If yes, does the area for turning around fire apparatus comply with IFC D103?	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A
5. Is any portion of the building to be used for high-piled storage in accordance with IFC Chapter 3206.6 If yes, see IFC 3206.6 for further requirements.	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A
6. Is any part of the building greater than 30-feet above the grade plane? If yes, answer the following questions: a) Is the aerial apparatus fire lane parallel to one entire side of the building and covering at least 25% of the perimeter? b) Is the near edge of the aerial apparatus fire lane between 15' and 30' from the building? c) Are there any overhead power or utility lines located across the aerial apparatus fire lane? d) Are there any tree canopies expected to grow across the aerial fire lane? (Based on mature canopy width of tree species) e) Does the aerial apparatus fire lane have a minimum unobstructed width of 26-feet? f) Is the space between the aerial lane and the building free of trees exceeding 20' in heights?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A
7. Are all portions of the required fire lanes within 500-feet of at least (2) hydrants? Note: Distances shall be measured along the path of the hose lay as it comes off the fire apparatus. a) Is the fire lane at least 26' wide for at least 20-feet on each side of the hydrants? b) Is there at least 40' between a hydrant and the building? c) Are the hydrant(s) setback no less than 5-feet nor more than 10-feet from the curb or edge of the street or fire lane? d) Are hydrants located in parking lot islands a minimum of 3½-feet from the hydrant to the curb? e) Are there no obstructions, including but not limited to power poles, trees, bushes, fences, posts located, or grade changes exceeding 1½-feet, within 5-feet of a fire hydrant? Note: Hydrants shall be installed and in-service prior to combustible construction on the project site.	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A

Attach an additional sheet if further explanation is required for any answers.
 This worksheet is based on MGO 34.503 and IFC 2021 Edition Chapter 5 and Appendix D; please see the codes for further information.

Revised 06/2022

LEGEND

- PROPERTY LINE
- RIGHT-OF-WAY
- 26' WIDE FIRE LANE - AERIAL APPARATUS
- HYDRANT LOCATION

NOTES:
 ALL RED HOSE LAY ROUTES 500-FEET OR LESS.
 ALL BLUE HOSE LAY ROUTES 250-FEET OR LESS.

SCALE IN FEET
 20' 0 20'

4/17/2024 11:30:17 AM





3535 UNIVERSITY MIXED USE

REVIEW DRAWING
 NOT TO BE USED FOR CONSTRUCTION
 DATE OF ISSUE 5/28/2024



FIRE ACCESS	JLA PROJECT No:	W23-0222	EX.1
	DATE OF ISSUANCE:	5/28/24	
	REVISION DATE:		

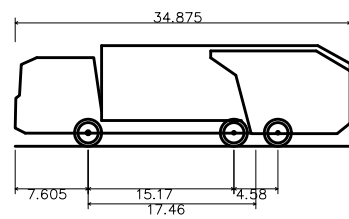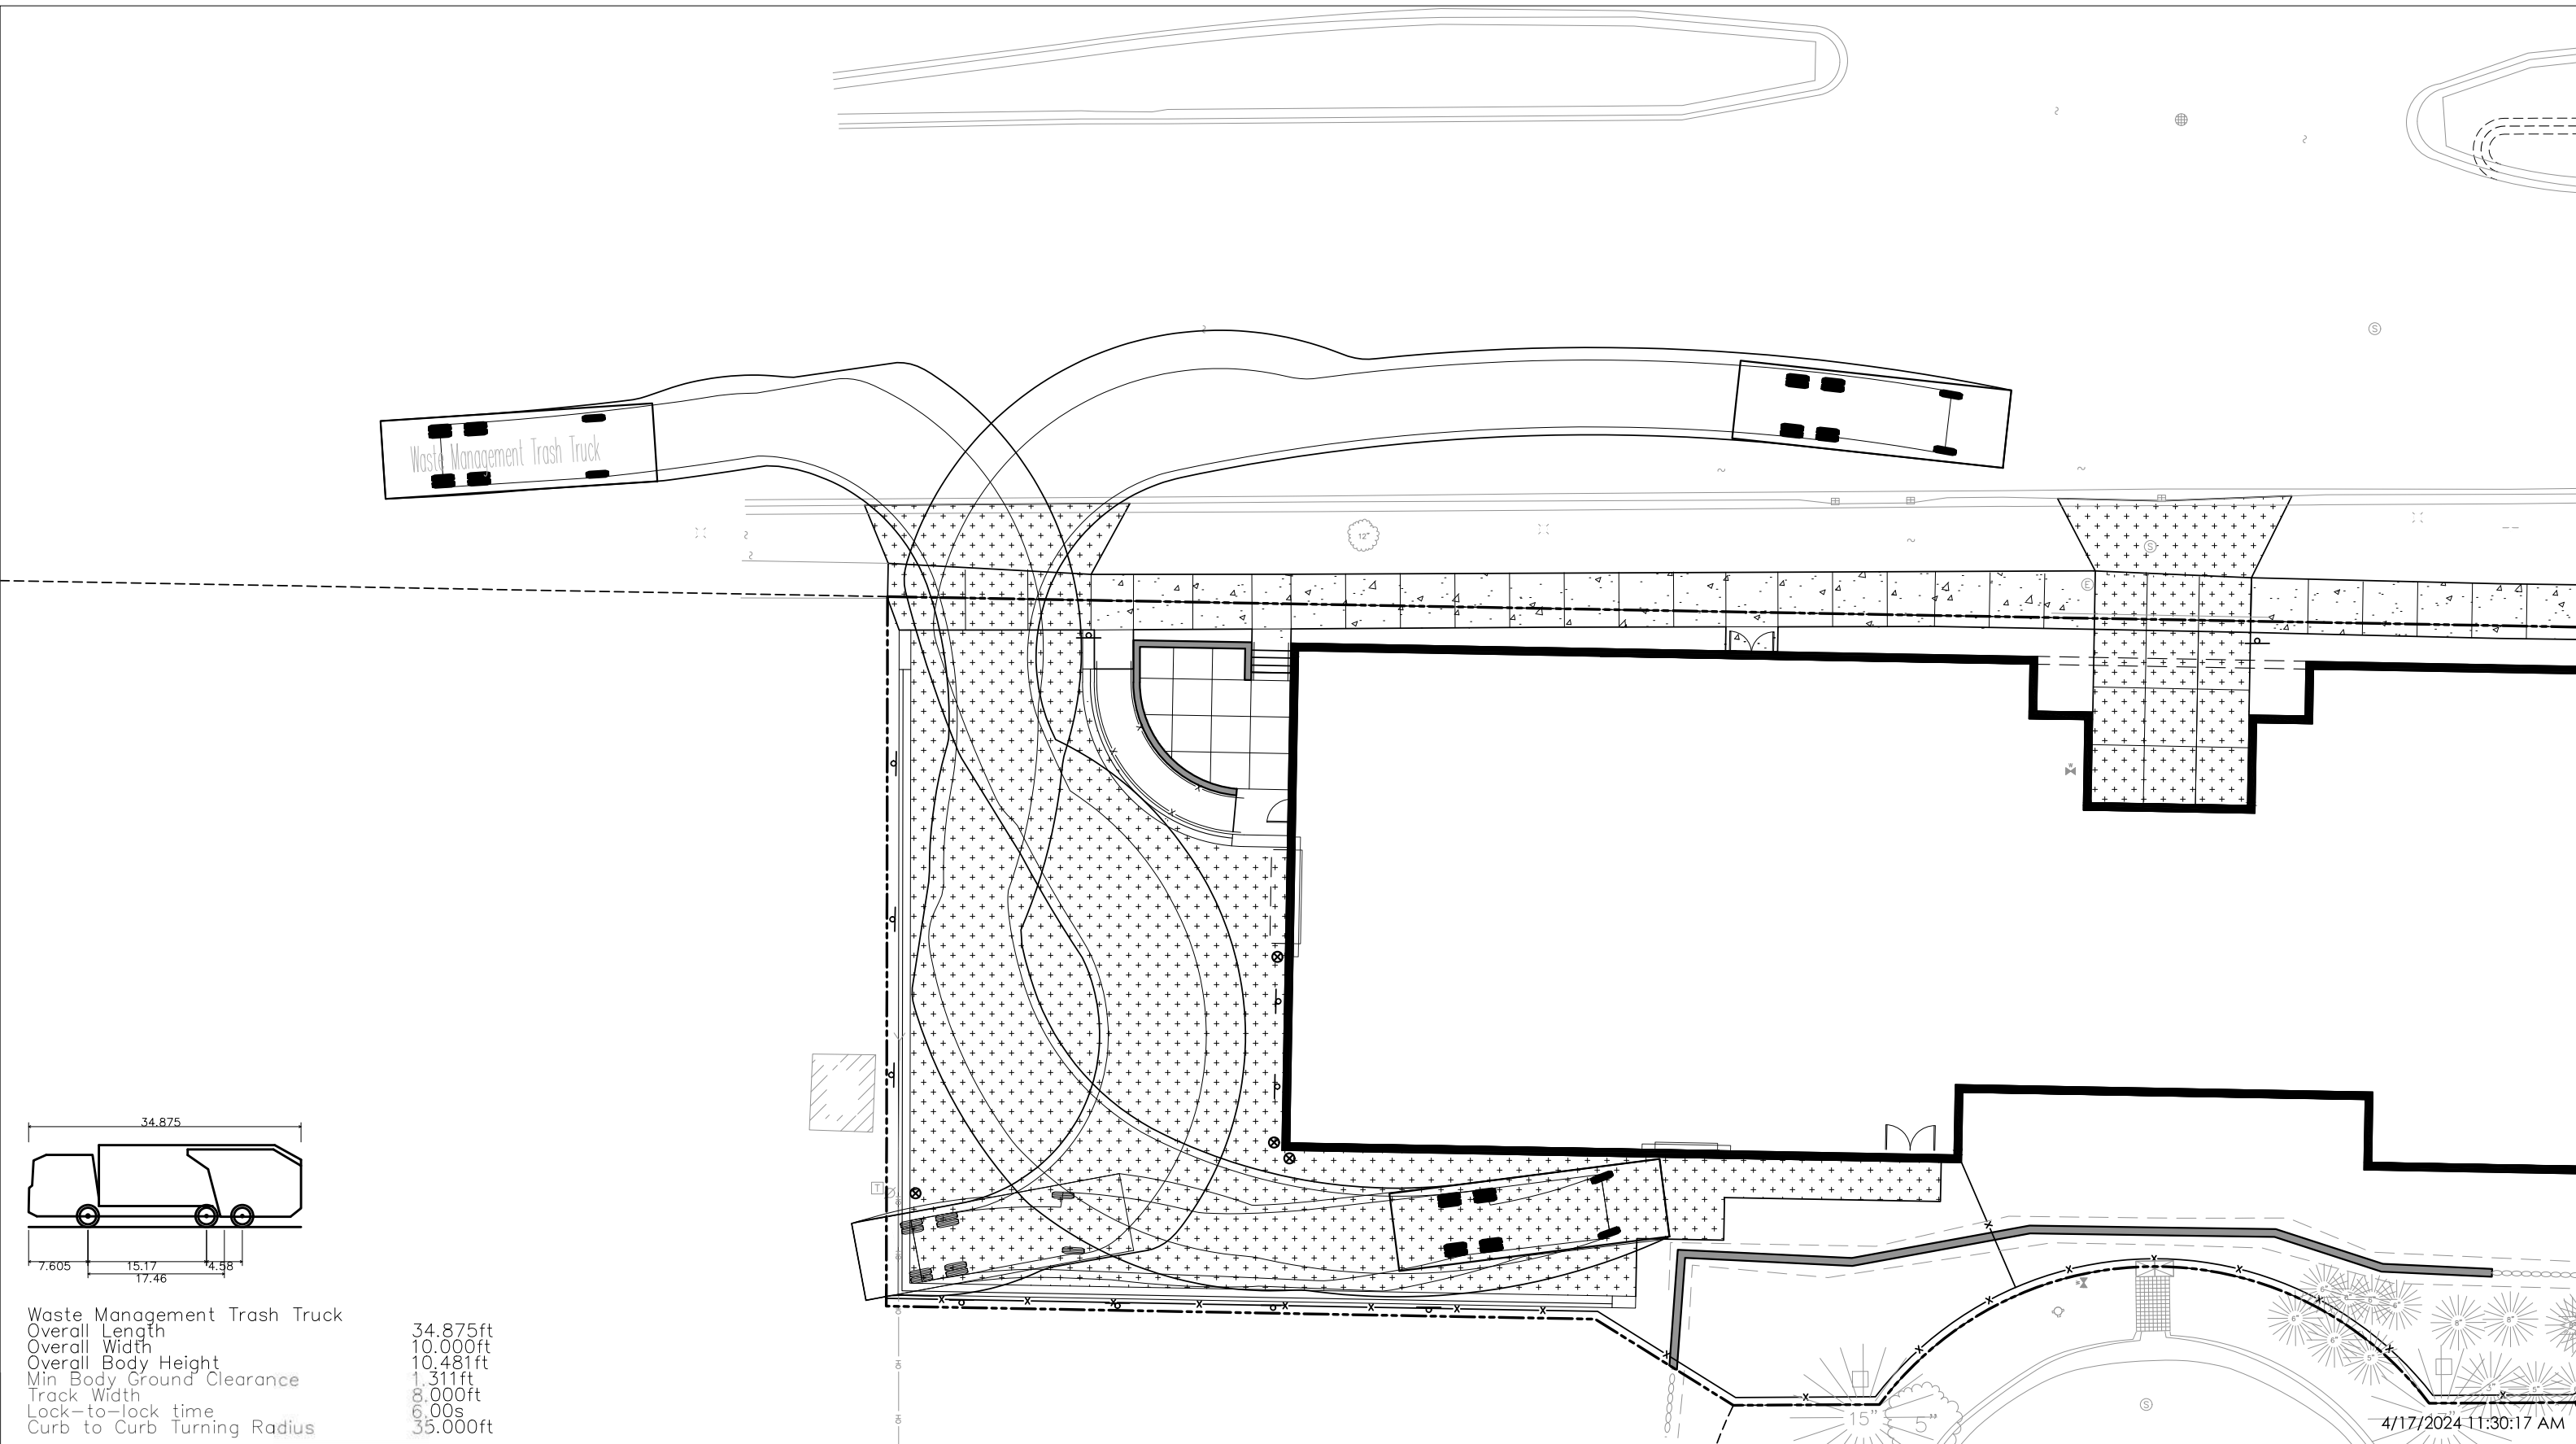


Waste Management Trash Truck
 Overall Length 34.875ft
 Overall Width 10.000ft
 Overall Body Height 10.481ft
 Min Body Ground Clearance 1.311ft
 Track Width 8.000ft
 Lock-to-lock time 6.00s
 Curb to Curb Turning Radius 35.000ft

4/17/2024 11:30:17 AM



3535 UNIVERSITY MIXED USE





REVIEW DRAWING
 NOT TO BE USED FOR CONSTRUCTION
 DATE OF ISSUE 5/28/2024



TRASH TRUCK TURN MOVEMENT

JLA PROJECT No:	W23-0222
DATE OF ISSUANCE:	5/28/24
REVISION DATE:	

EX.2

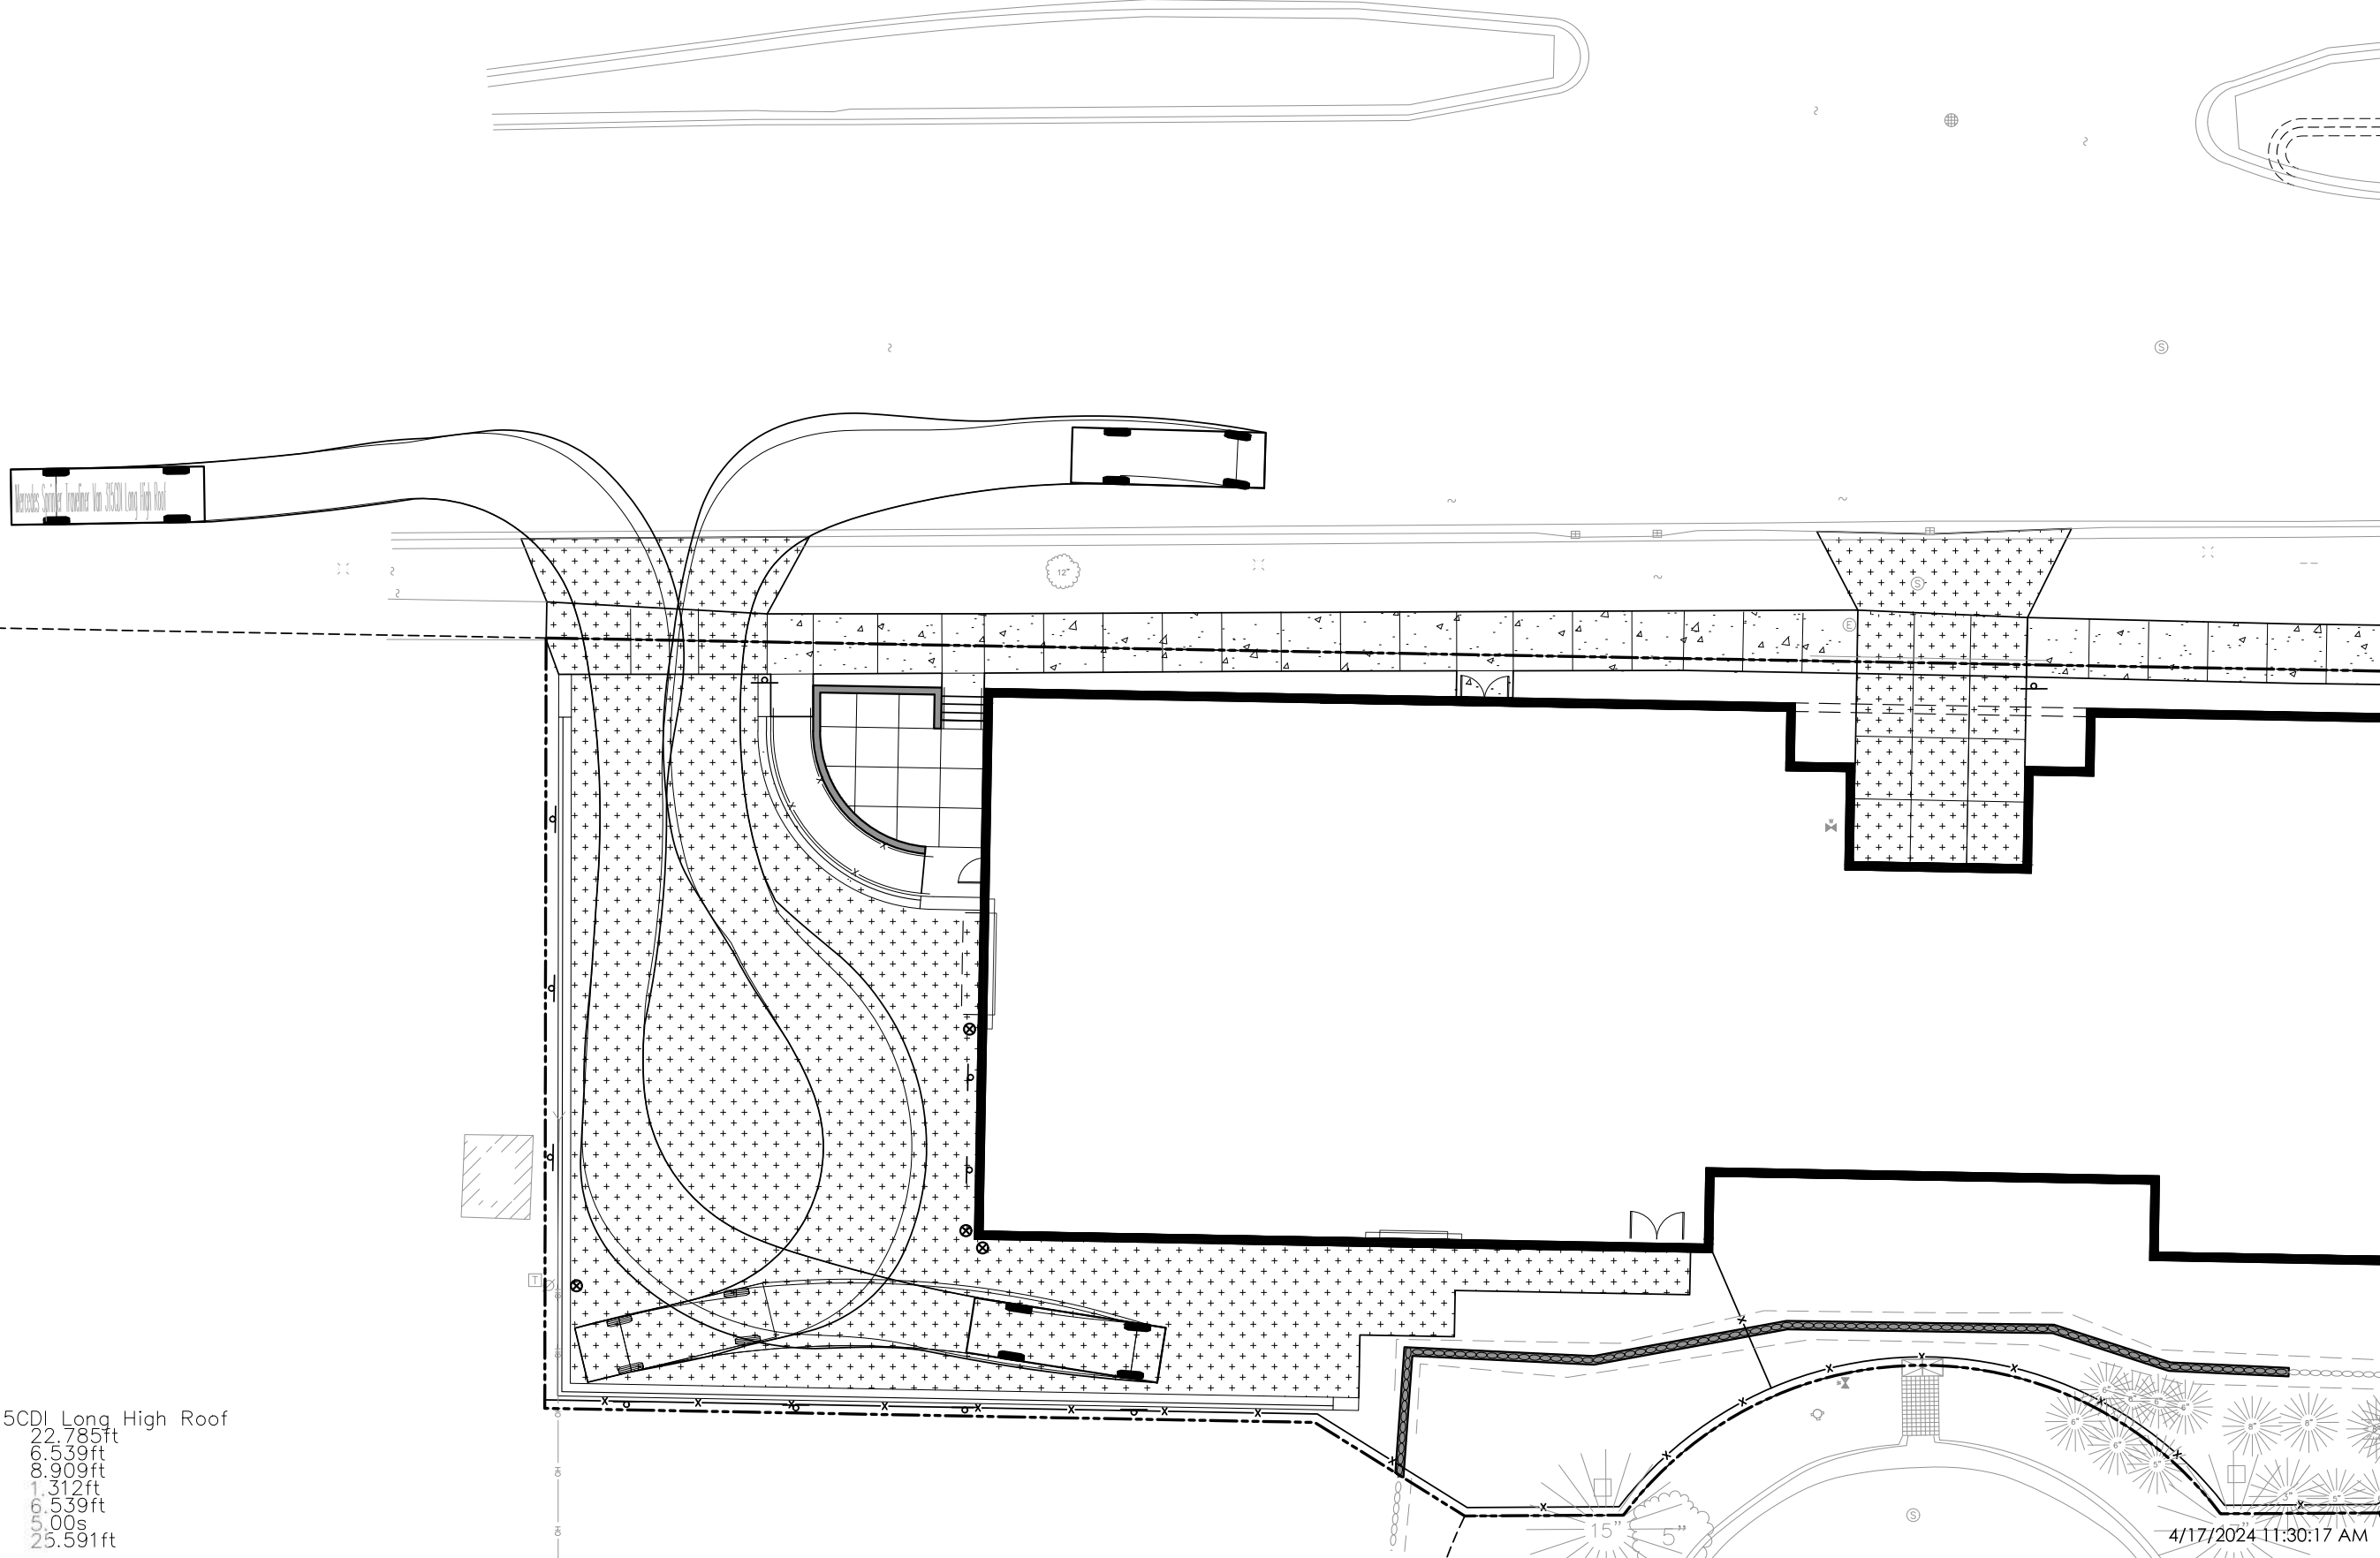

Mercedes Sprinter Traveliner Van 315CDI Long High Roof
 Overall Length 22.785ft
 Overall Width 6.539ft
 Overall Body Height 8.909ft
 Min Body Ground Clearance 1.312ft
 Track Width 6.539ft
 Lock-to-lock time 5.00s
 Wall to Wall Turning Radius 25.591ft

4/17/2024 11:30:17 AM



3535 UNIVERSITY MIXED USE




REVIEW DRAWING
 NOT TO BE USED FOR CONSTRUCTION
 DATE OF ISSUE 5/28/2024





DELIVERY TRUCK TURN MOVEMENT

JLA PROJECT No:	W23-0222
DATE OF ISSUANCE:	5/28/24
REVISION DATE:	



EX.3

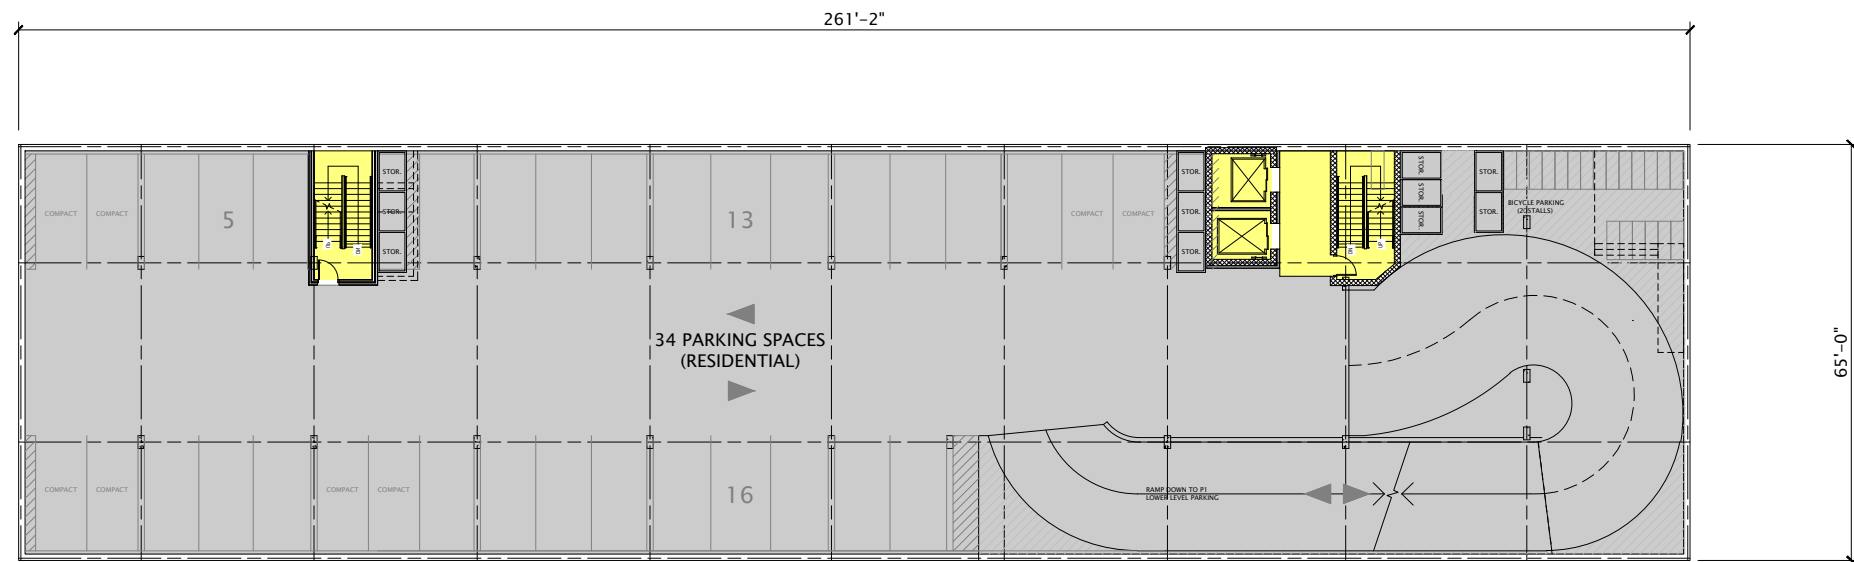

1 LOWER LEVEL (P1) FLOOR PLANS
1" = 30'-0"

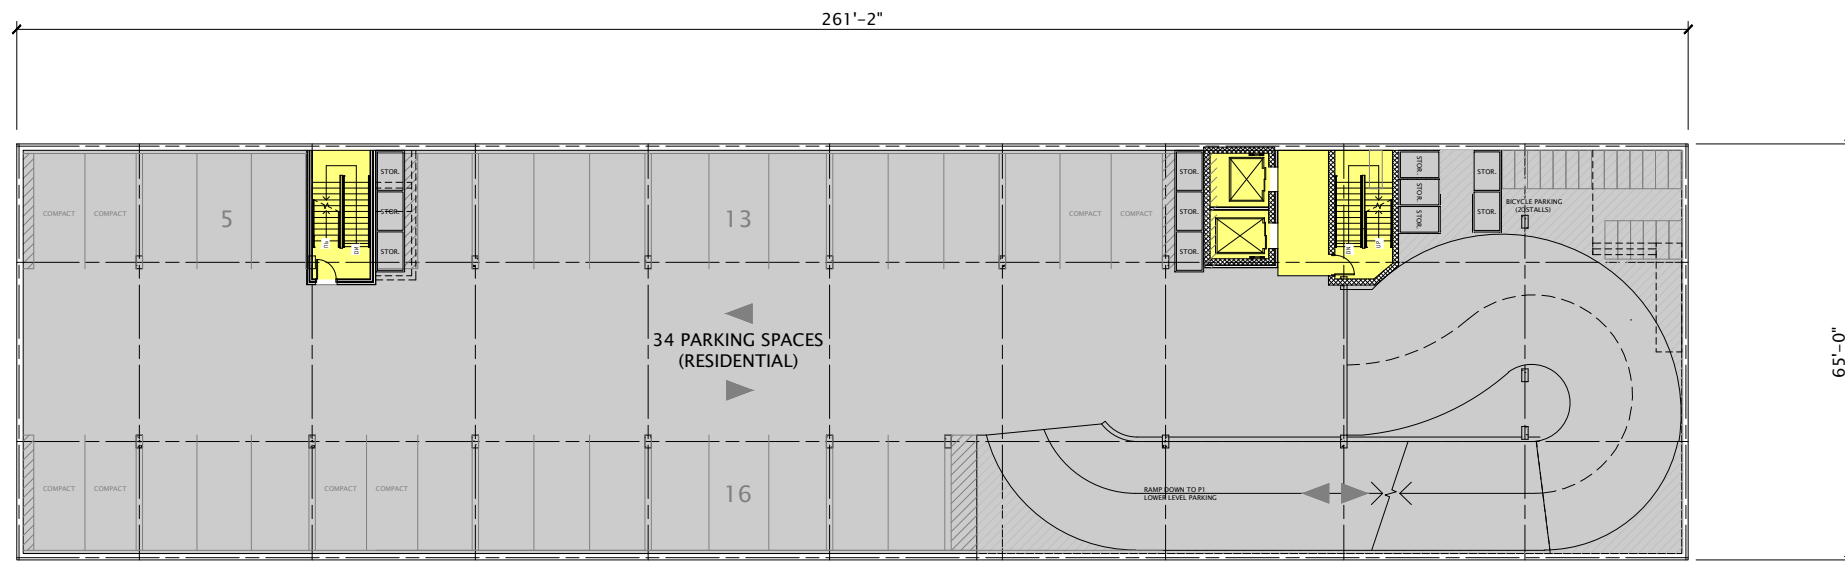

2 LOWER LEVEL (P2) FLOOR PLANS
1" = 30'-0"

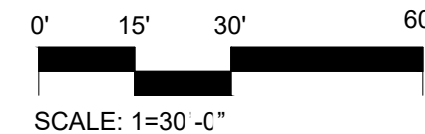

7/9/2024 7:26:39 PM




3575 UNIVERSITY AVENUE
TYPICAL BELOW GRADE PARKING LAYOUT

JLA PROJECT No: W23-0222

CITY OF MADISON LAND USE AND URBAN DESIGN COMMISSION SUBMITTAL


U100

7/10/24

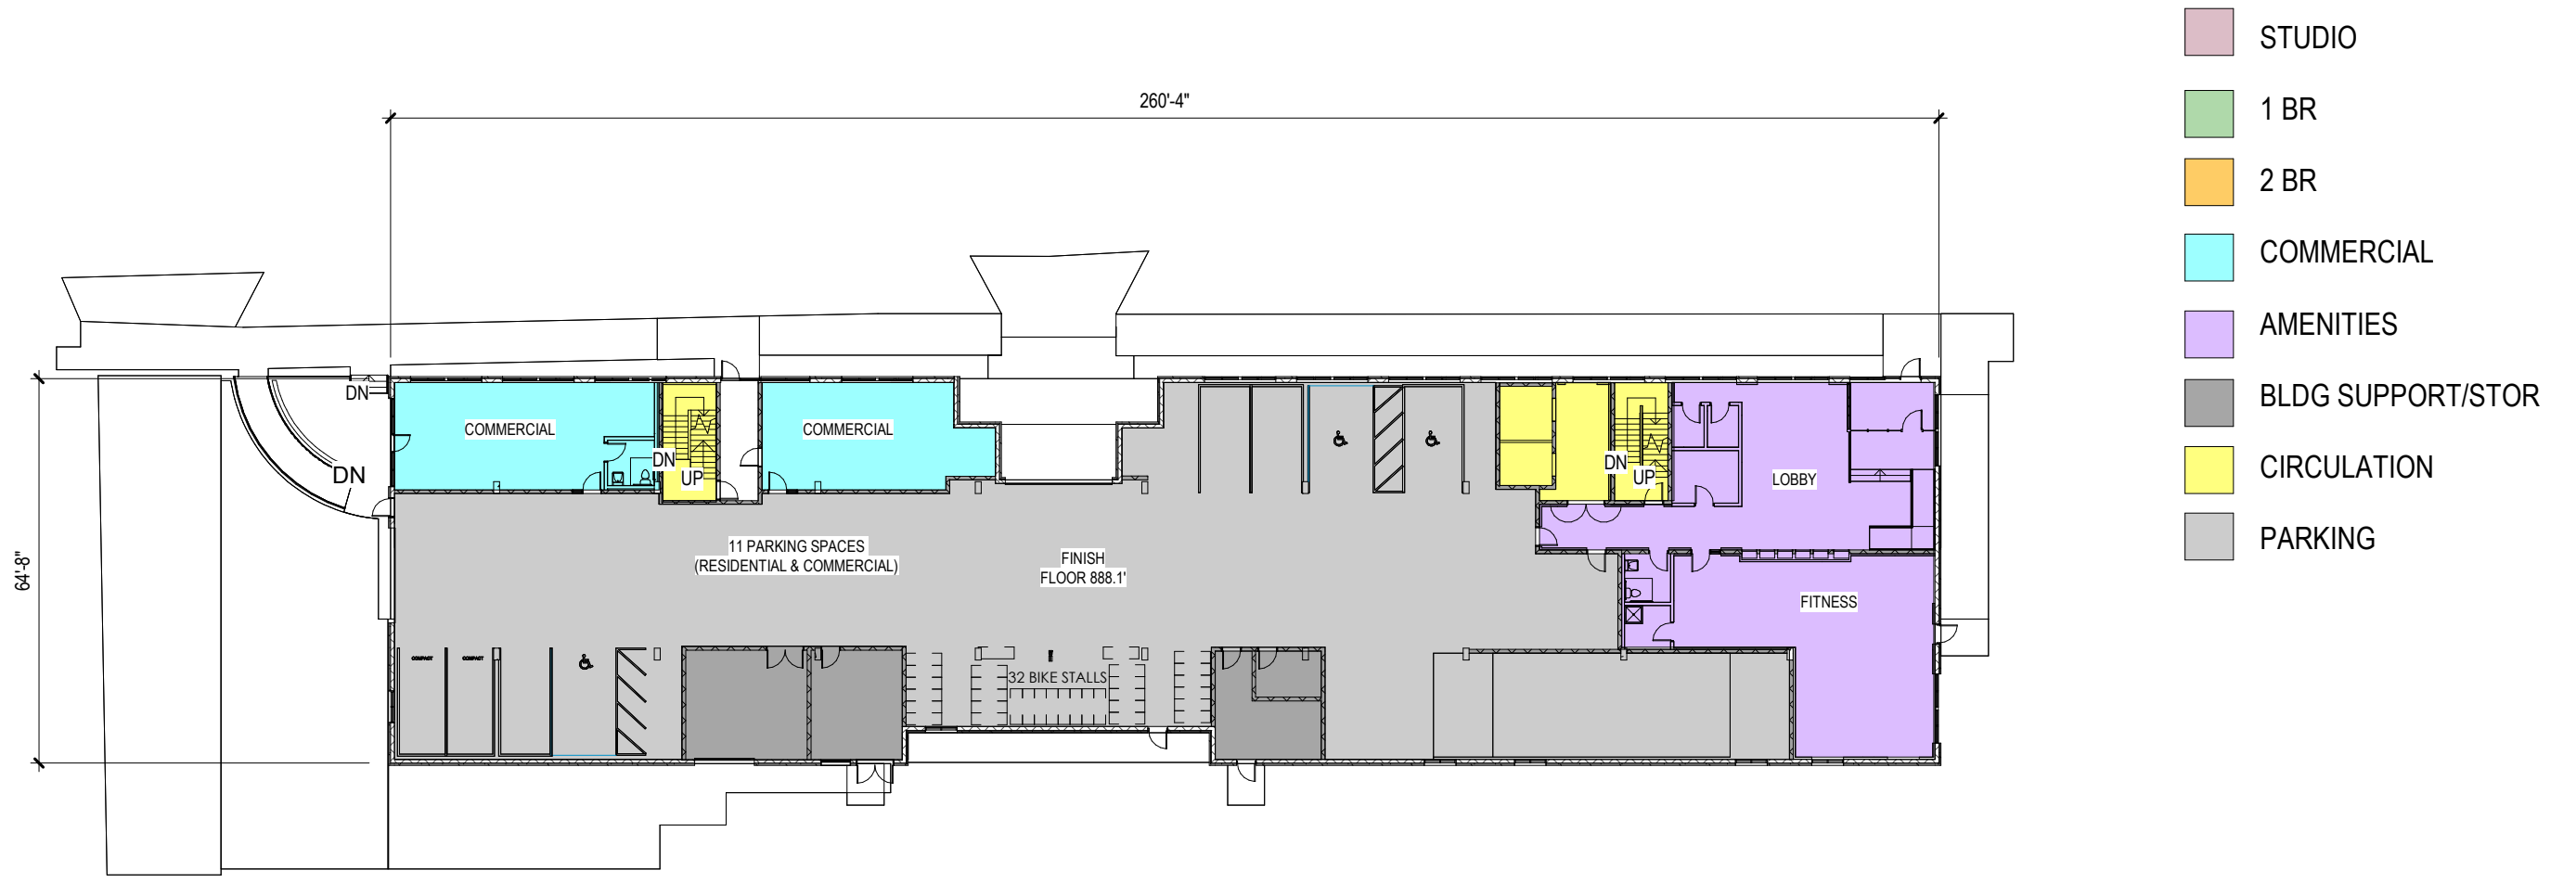

- STUDIO
- 1 BR
- 2 BR
- COMMERCIAL
- AMENITIES
- BLDG SUPPORT/STOR
- CIRCULATION
- PARKING

1 FIRST FLOOR PLAN
 1" = 30'-0"
 0' 15' 30' 60'
 SCALE: 1=30'-0"



7/10/2024 9:30:24 AM




3575 UNIVERSITY AVENUE
 FIRST FLOOR PLAN

CITY OF MADISON LAND USE AND URBAN DESIGN COMMISSION SUBMITTAL



U101

JLA PROJECT No: W23-0222

7/10/24

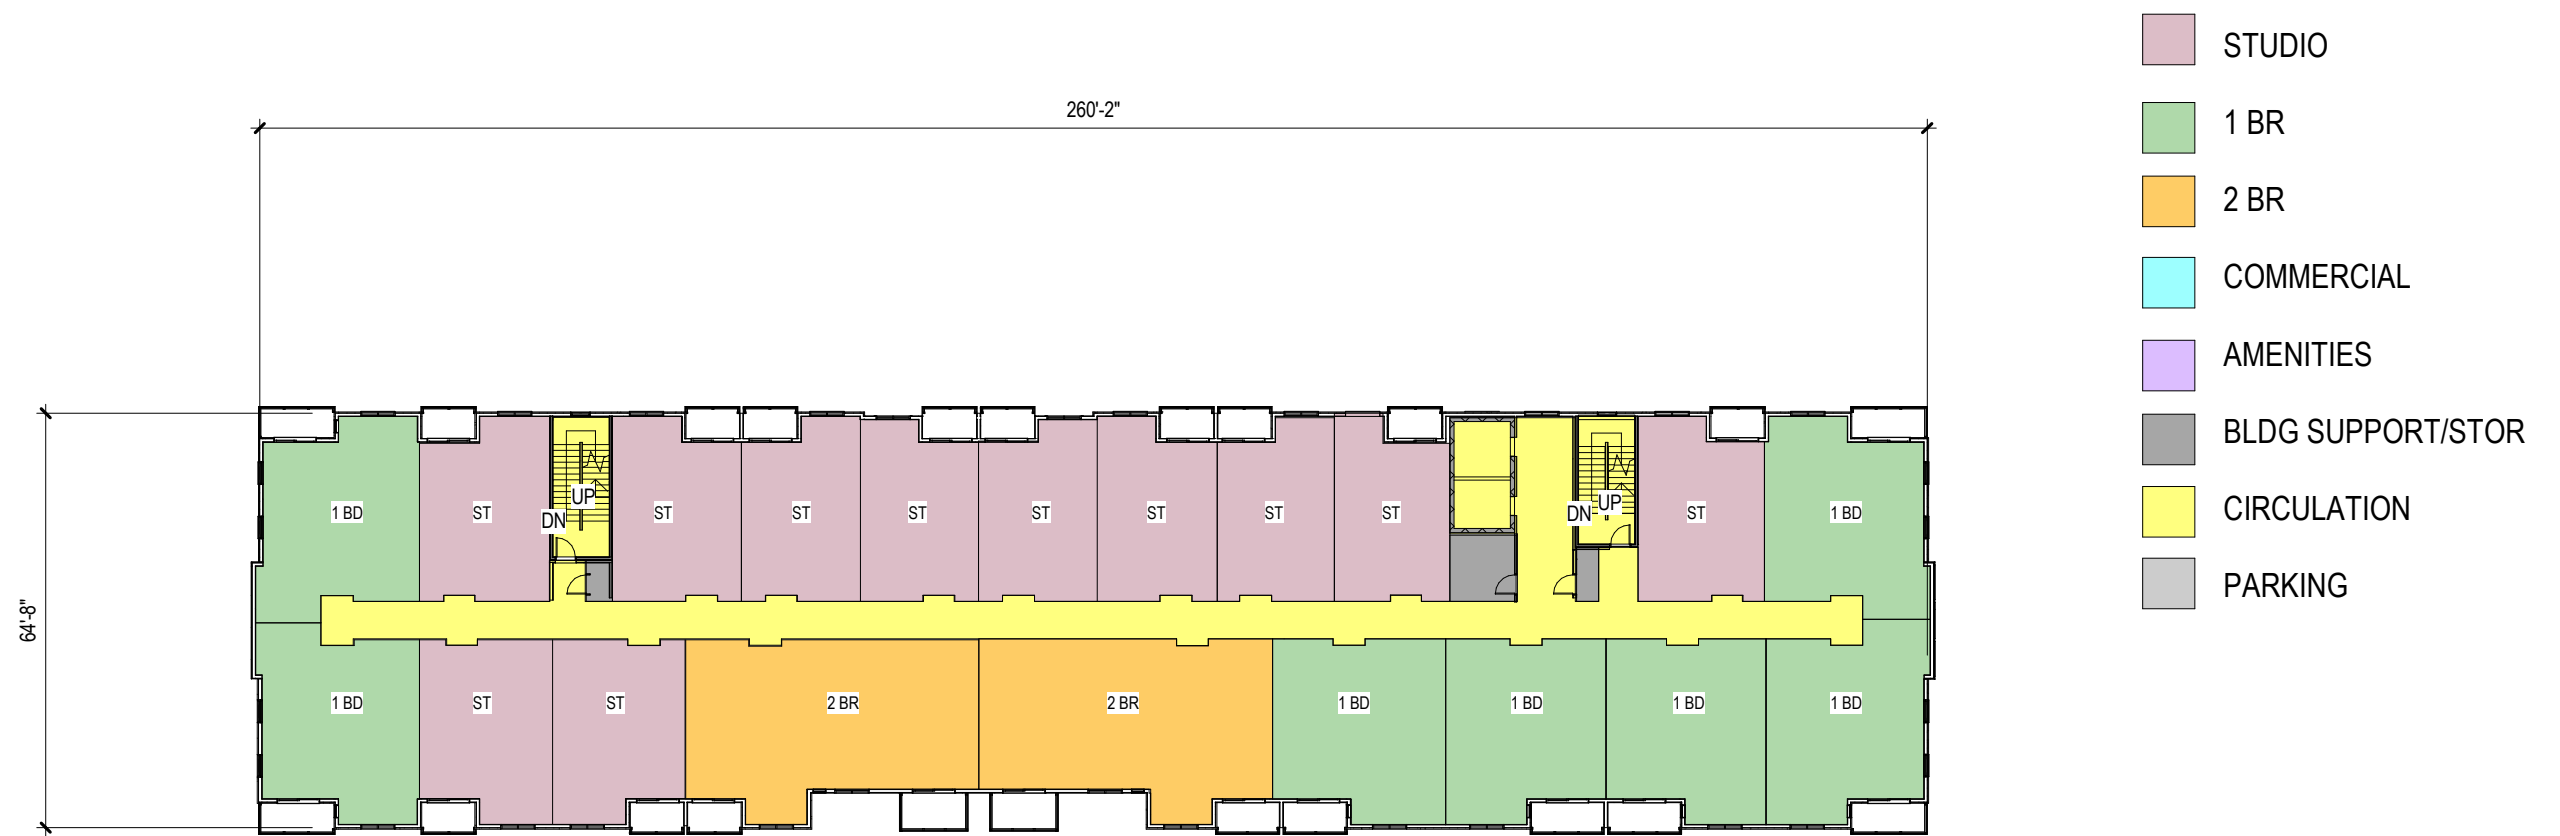

1 SECOND FLOOR PLAN
1" = 30'-0"

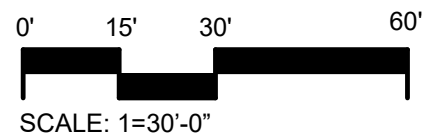

7/9/2024 7:26:41 PM



3575 UNIVERSITY AVENUE


SECOND FLOOR PLAN

JLA PROJECT No: W23-0222



CITY OF MADISON LAND USE AND URBAN DESIGN COMMISSION SUBMITTAL


U102

7/10/24


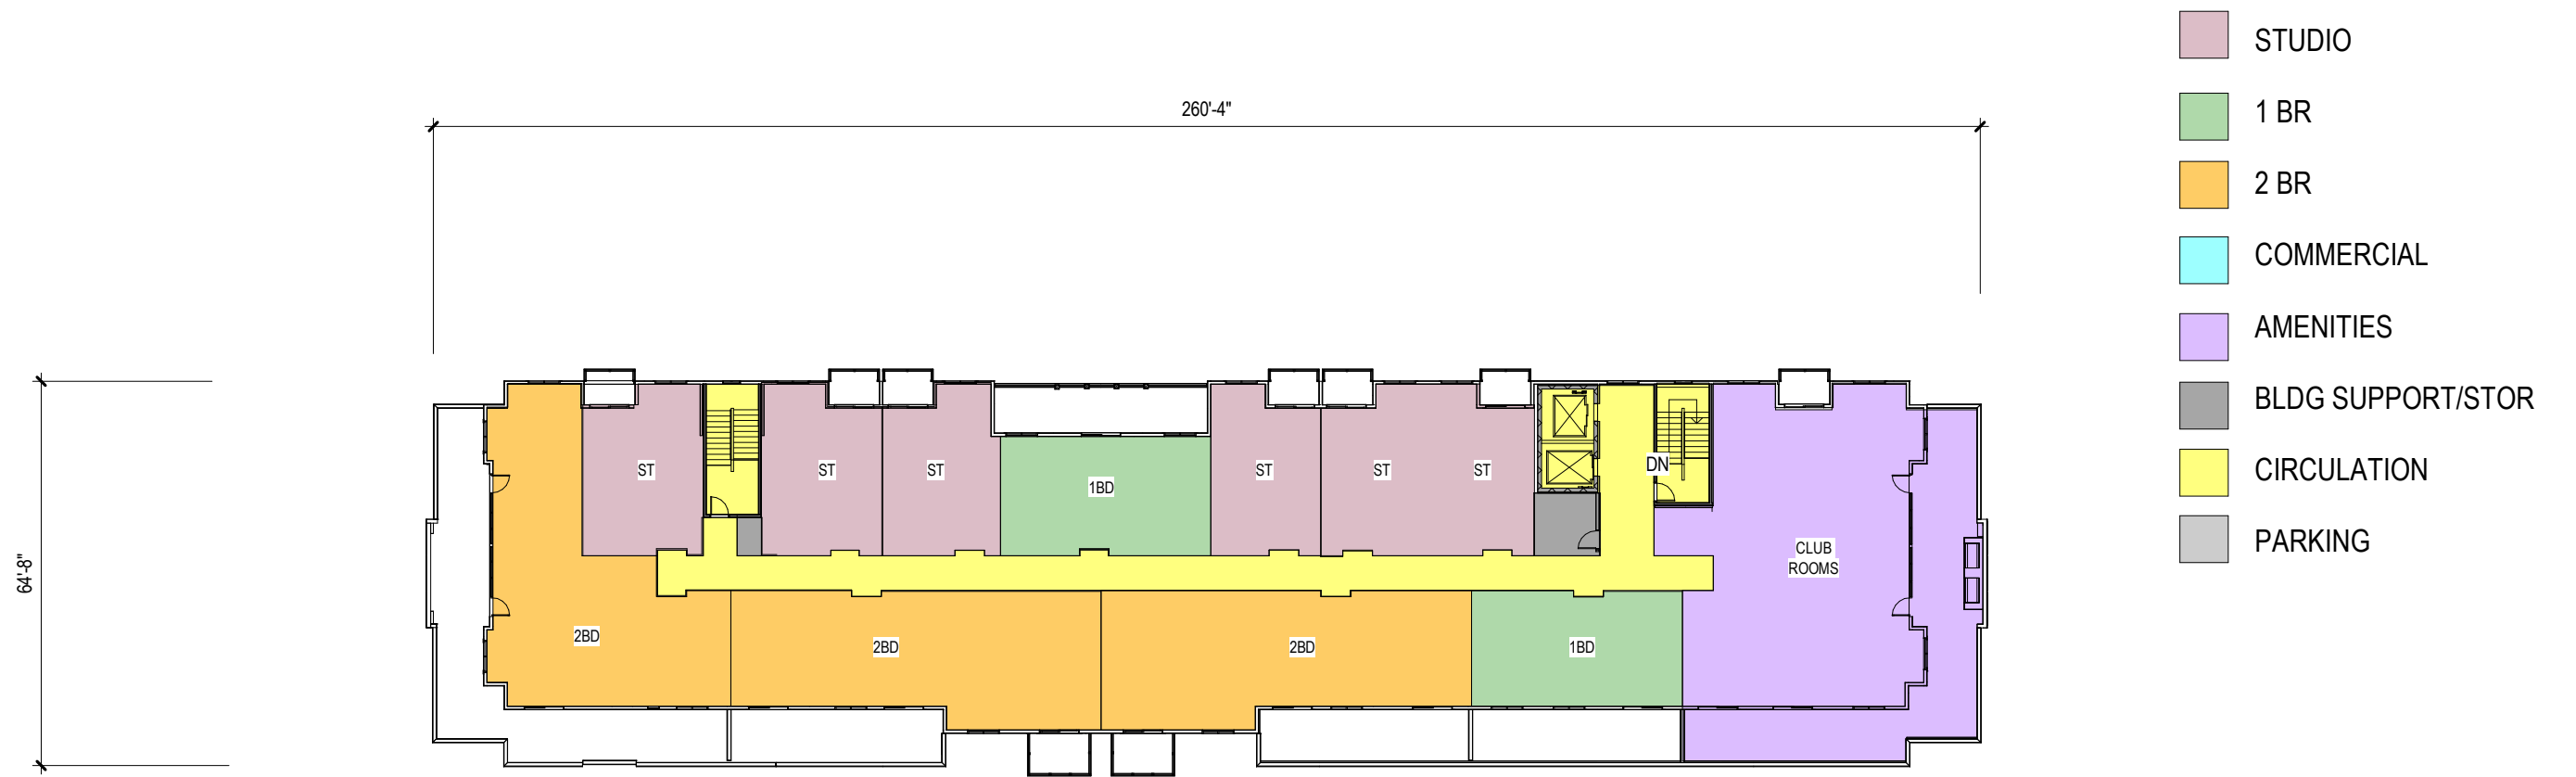



16 FIFTH FLOOR PLAN
1" = 30'-0"

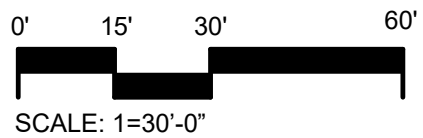

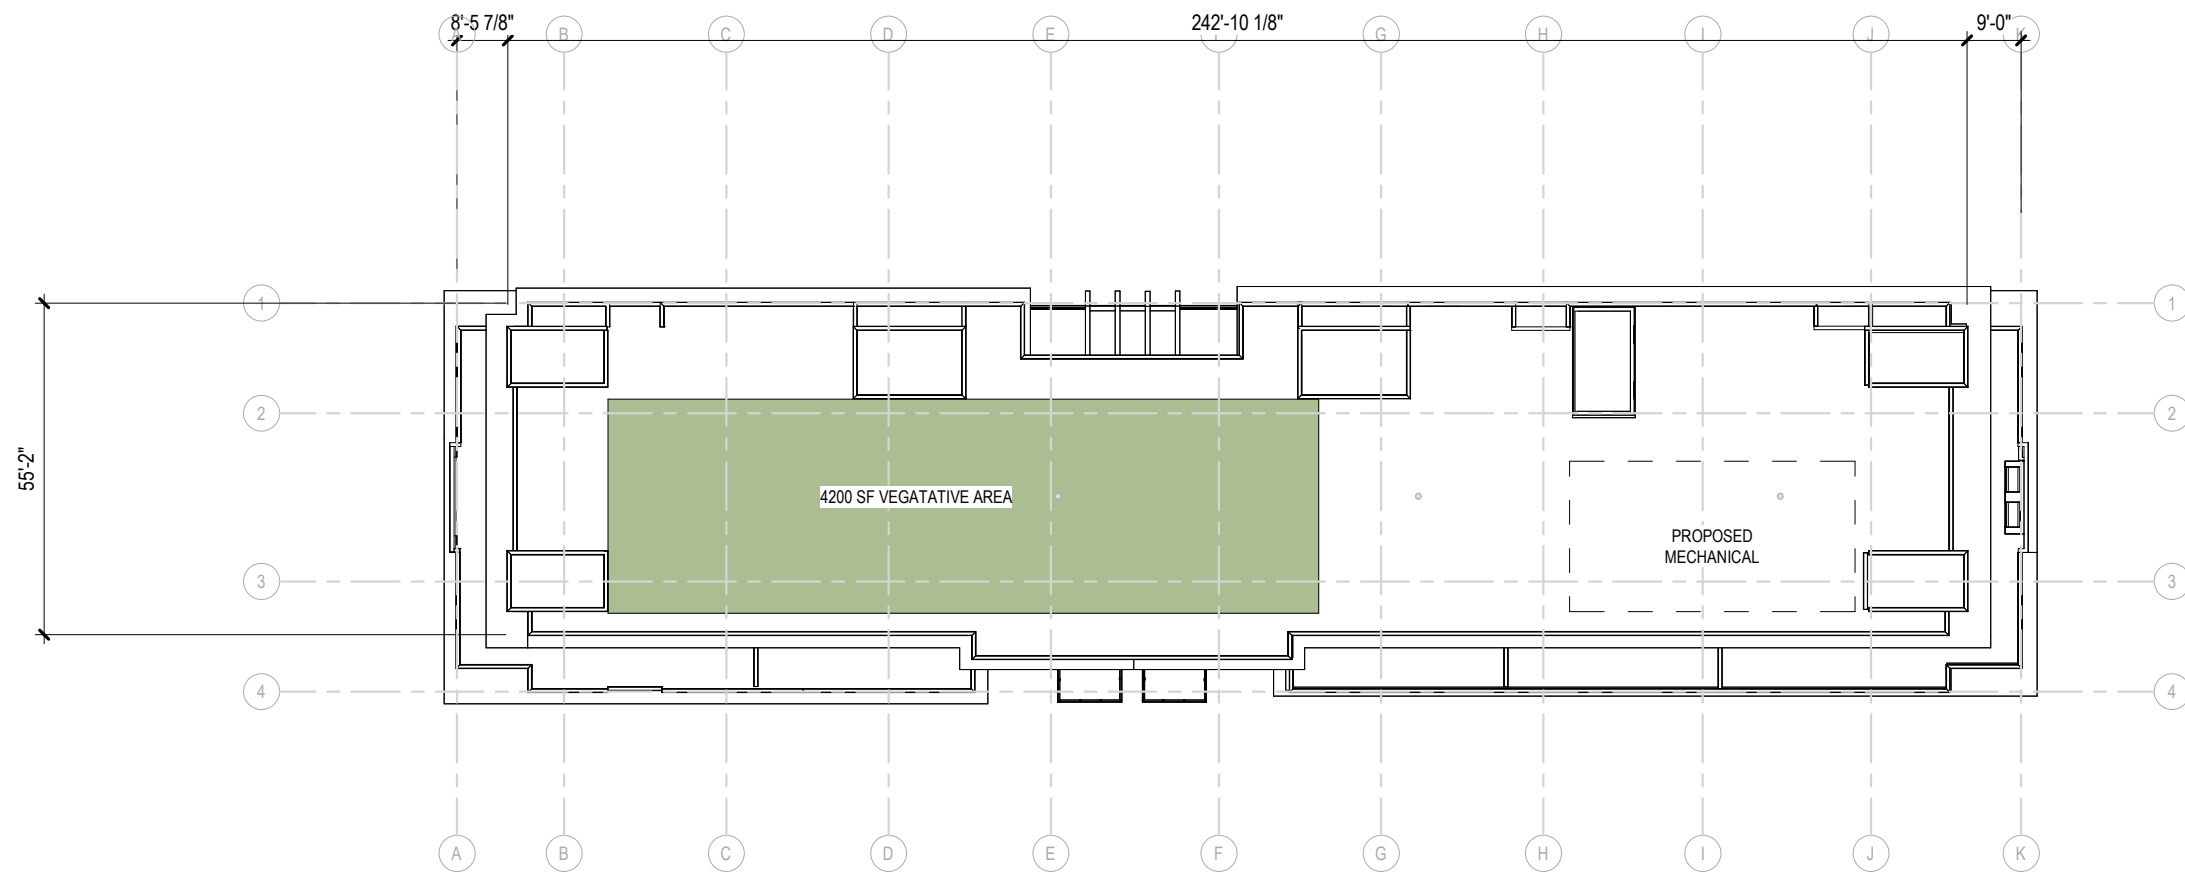


16 ROOF PLAN
1/32" = 1'-0"

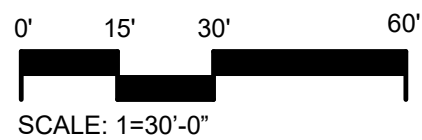


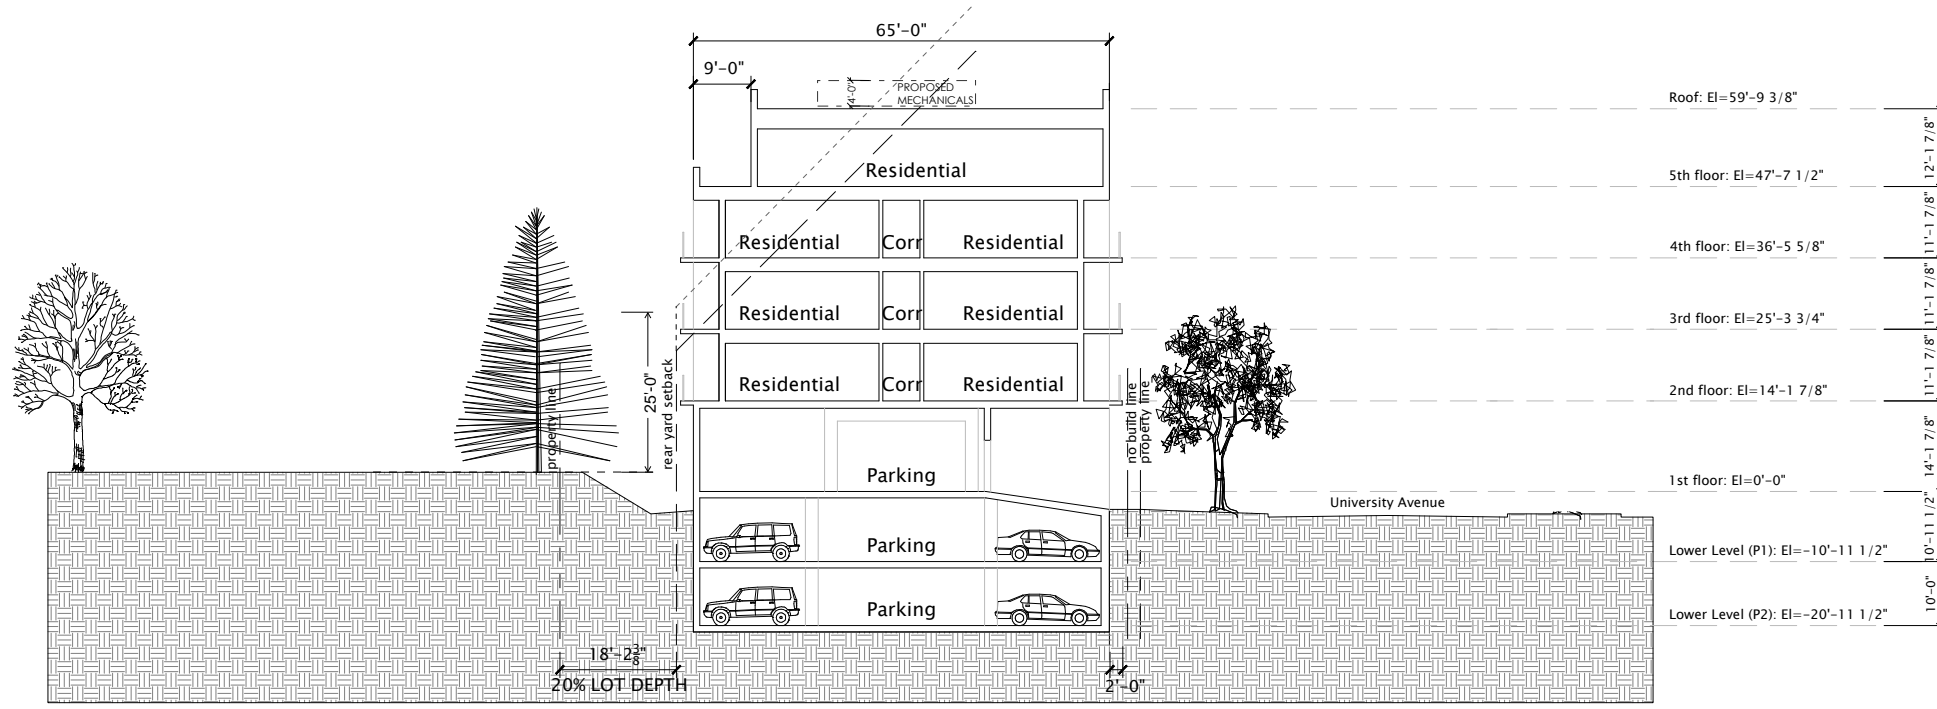

1 CROSS SECTION: SOUTH TO NORTH LOOKING WEST
1" = 30'-0"

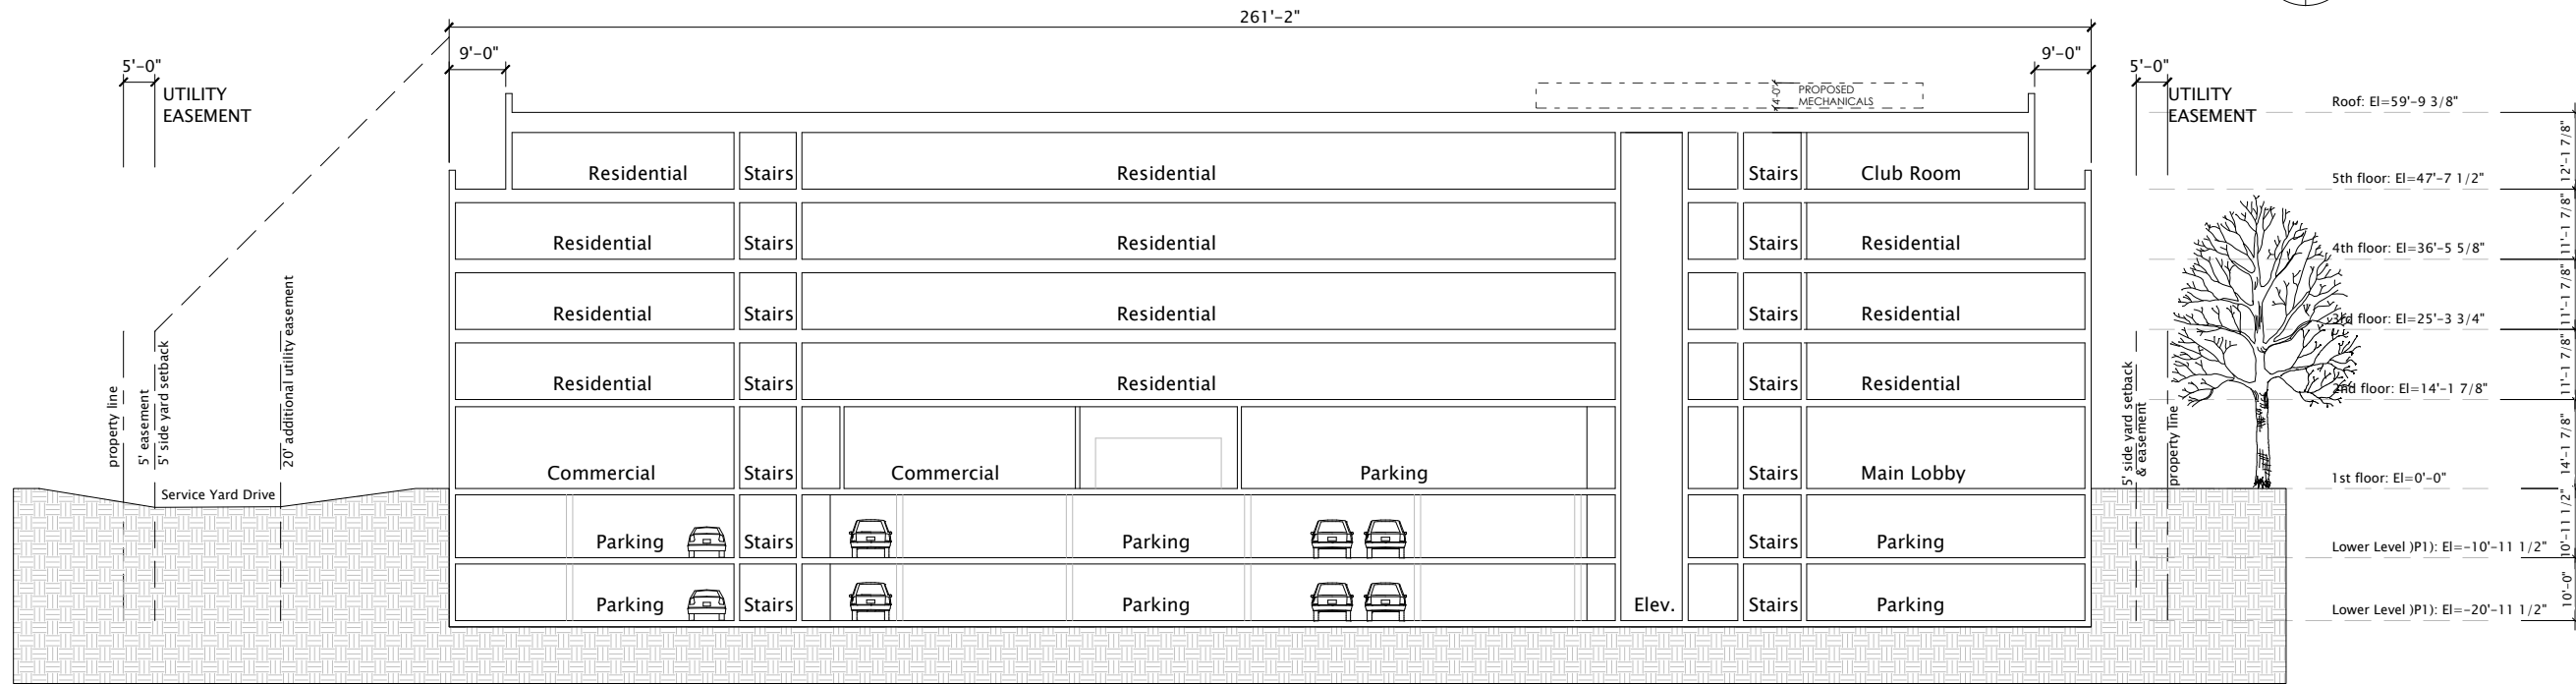

2 LONGITUDINAL SECTION: WEST TO EAST LOOKING NORTH
1" = 30'-0"

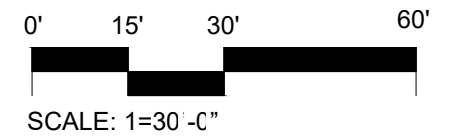

7/9/2024 7:26:42 PM



3575 UNIVERSITY AVENUE


BUILDING SECTIONS

JLA PROJECT No: W23-0222

CITY OF MADISON LAND USE AND URBAN DESIGN COMMISSION SUBMITTAL

U105

7/10/24

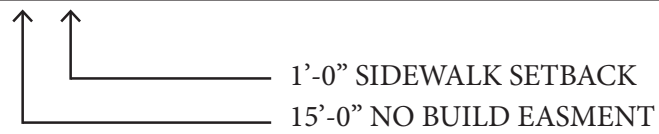

KEY

	15'-0" NO BUILD EASMENT
	1'-0" SIDEWALK SETBACK

7/9/2024 7:26:42 PM



3575 UNIVERSITY AVENUE
 UNIVERSITY AVE SETBACK DIAGRAM
 JLA PROJECT No: W23-0222

CITY OF MADISON LAND USE AND URBAN DESIGN COMMISSION SUBMITTAL

U106

7/10/24



① NORTH ELEVATION
3/64" = 1'-0"

7/10/2024 9:30:29 AM



3575 UNIVERSITY AVENUE

NORTH ELEVATION

JLA PROJECT No: W23-0222

CITY OF MADISON LAND USE AND URBAN DESIGN COMMISSION SUBMITTAL

U201

7/10/24



NOTE: 45% MAX WINDOWS
 OPENING DUE TO APPROX 20'
 FROM PROPERTY LINE. 21%
 CURRENT WINDOWS

① SOUTH ELEVATION
 3/64" = 1'-0"

7/10/2024 9:30:31 AM



3575 UNIVERSITY AVENUE


SOUTH ELEVATION

JLA PROJECT No: W23-0222

CITY OF MADISON LAND USE AND URBAN DESIGN COMMISSION SUBMITTAL

U202

7/10/24

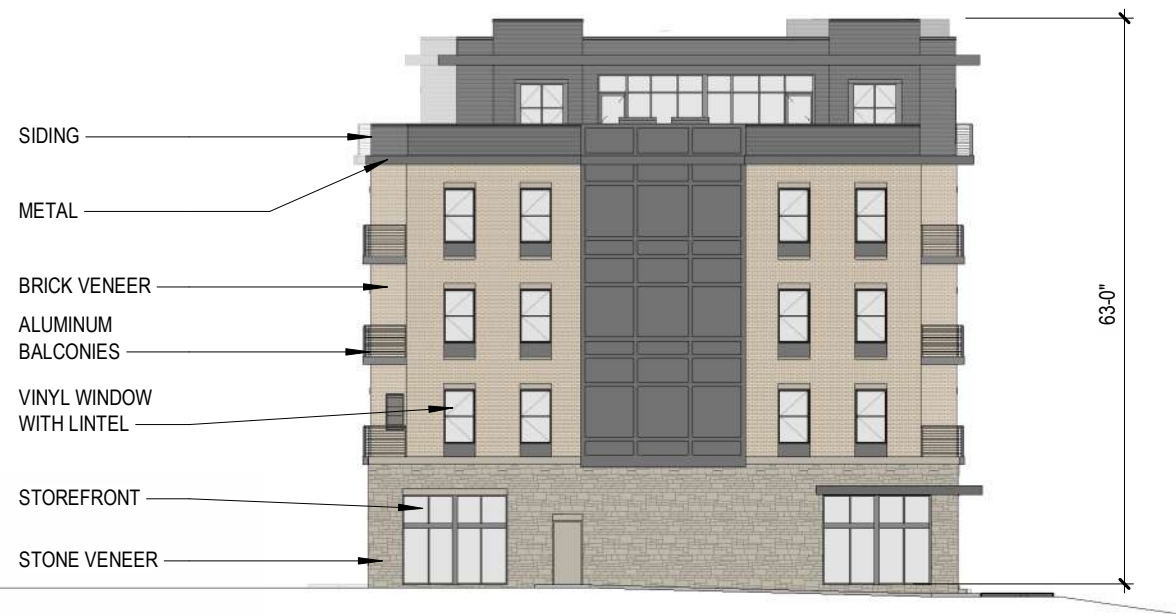

NOTE: 15% MAX WINDOWS
 OPENING DUE TO 12-13' FROM
 PROPERTY LINE. 15% CURRENT
 WINDOWS

① EAST ELEVATION
 3/64" = 1'-0"



② WEST ELEVATION
 3/64" = 1'-0"



① NORTH ELEVATION
3/64" = 1'-0"

7/10/2024 9:30:37 AM



3575 UNIVERSITY AVENUE

NORTH ELEVATION B&W

JLA PROJECT No: W23-0222

CITY OF MADISON LAND USE AND URBAN DESIGN COMMISSION SUBMITTAL

U204

7/10/24



NOTE: 45% MAX WINDOWS
 OPENING DUE TO APPROX 20'
 FROM PROPERTY LINE. 21%
 CURRENT WINDOWS

① SOUTH ELEVATION
 3/64" = 1'-0"

7/10/2024 9:30:39 AM



3575 UNIVERSITY AVENUE


SOUTH ELEVATION B&W

JLA PROJECT No: W23-0222

CITY OF MADISON LAND USE AND URBAN DESIGN COMMISSION SUBMITTAL

U205


7/10/24

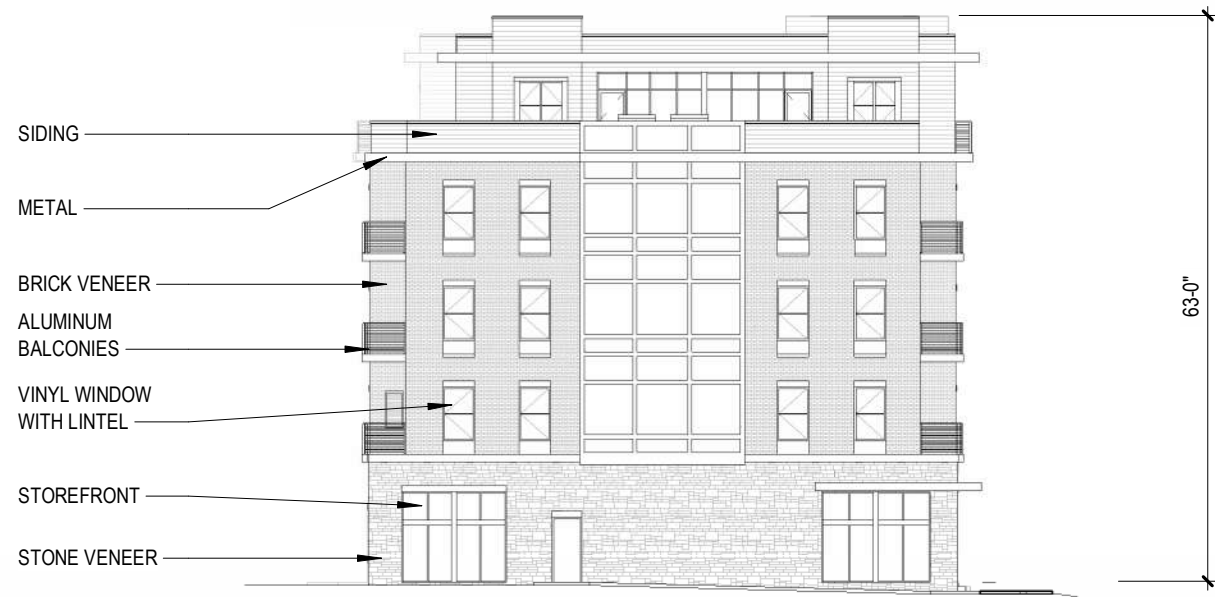

- SIDING
- METAL
- BRICK VENEER
- ALUMINUM BALCONIES
- VINYL WINDOW WITH LINTEL
- STOREFRONT
- STONE VENEER

NOTE: 15% MAX WINDOWS OPENING DUE TO 12-13' FROM PROPERTY LINE. 15% CURRENT WINDOWS

1 EAST ELEVATION
3/64" = 1'-0"

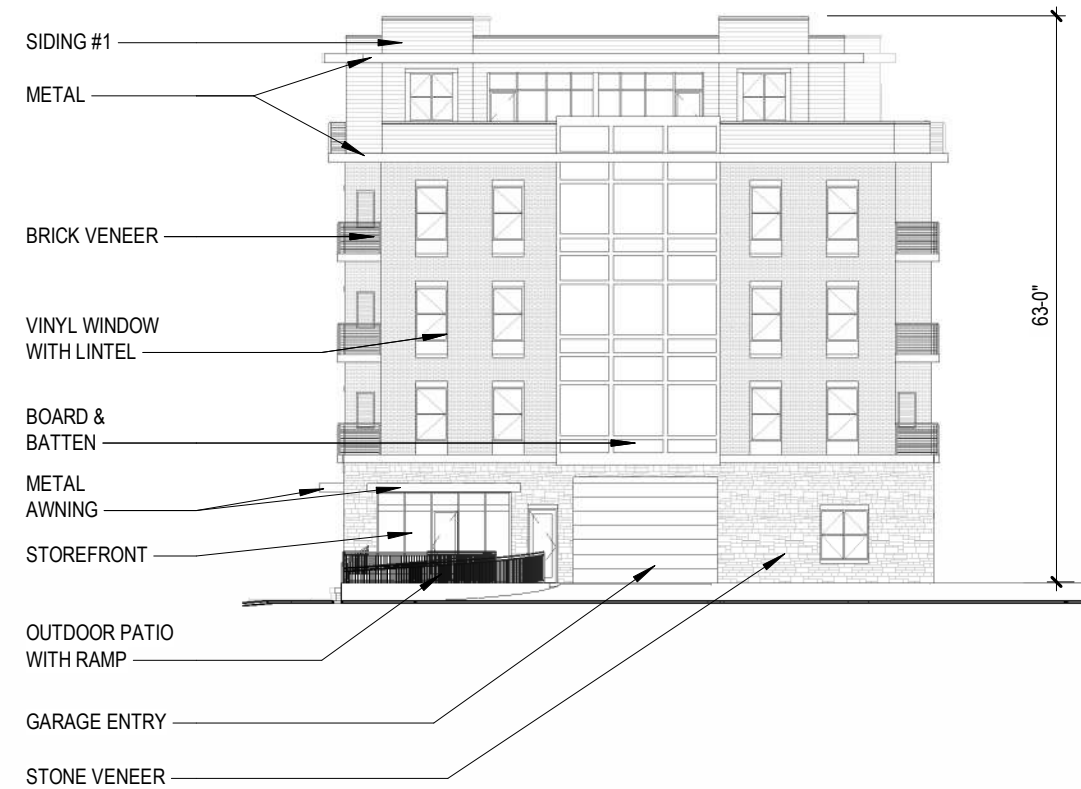

- SIDING #1
- METAL
- BRICK VENEER
- VINYL WINDOW WITH LINTEL
- BOARD & BATTEN
- METAL AWNING
- STOREFRONT
- OUTDOOR PATIO WITH RAMP
- GARAGE ENTRY
- STONE VENEER

2 WEST ELEVATION
3/64" = 1'-0"

BIRDGLASS KEYNOTES - SEE CALCULATIONS

- (A) VINYL WINDOW: 5'-4" X 5'-6"
- (B) VINYL WINDOW: 3'-0" X 4'-0"
- (C) STOREFRONT: 6'-0" X 7'-0"
- (D) PATIO DOOR: 6'-8" X 7'-0"
- (E) STOREFRONT FRAMING,
- (F) STOREFRONT: 6'-0" X 3'-0"
- (G) STOREFRONT DOOR: 3'-6" X 7'-0"
- (H) VINYL WINDOW: 3'-6" X 6'-0"



1 NORTH ELEVATION - BIRDGLASS
3/64" = 1'-0"

7/10/2024 12:27:50 PM



3575 UNIVERSITY AVENUE

NORTH ELEVATION - BIRDGLASS

JLA PROJECT No: W23-0222

CITY OF MADISON LAND USE AND URBAN DESIGN COMMISSION SUBMITTAL

U207

7/10/24

BIRDGLASS KEYNOTES - SEE CALCULATIONS

- (A) VINYL WINDOW: 5'-4" X 5'-6"
- (B) VINYL WINDOW: 3'-0" X 4'-0"
- (C) STOREFRONT: 6'-0" X 7'-0"
- (D) PATIO DOOR: 6'-8" X 7'-0"
- (E) STOREFRONT FRAMING
- (F) STOREFRONT: 6'-0" X 3'-0"
- (G) STOREFRONT DOOR: 3'-6" X 7'-0"
- (H) VINYL WINDOW: 3'-6" X 6'-0"



1 SOUTH ELEVATION
3/64" = 1'-0"

7/10/2024 12:27:53 PM



3575 UNIVERSITY AVENUE

SOUTH ELEVATION - BIRDGLASS

JLA PROJECT No: W23-0222


CITY OF MADISON LAND USE AND URBAN DESIGN COMMISSION SUBMITTAL

U208


7/10/24

BIRDGLASS KEYNOTES - SEE CALCULATIONS

- (A) VINYL WINDOW: 5'-4" X 5'-6"
- (B) VINYL WINDOW: 3'-0" X 4'-0"
- (C) STOREFRONT: 6'-0" X 7'-0"
- (D) PATIO DOOR: 6'-8" X 7'-0"
- (E) STOREFRONT FRAMING,
- (F) STOREFRONT: 6'-0" X 3'-0"
- (G) STOREFRONT DOOR: 3'-6" X 7'-0"
- (H) VINYL WINDOW: 3'-6" X 6'-0"

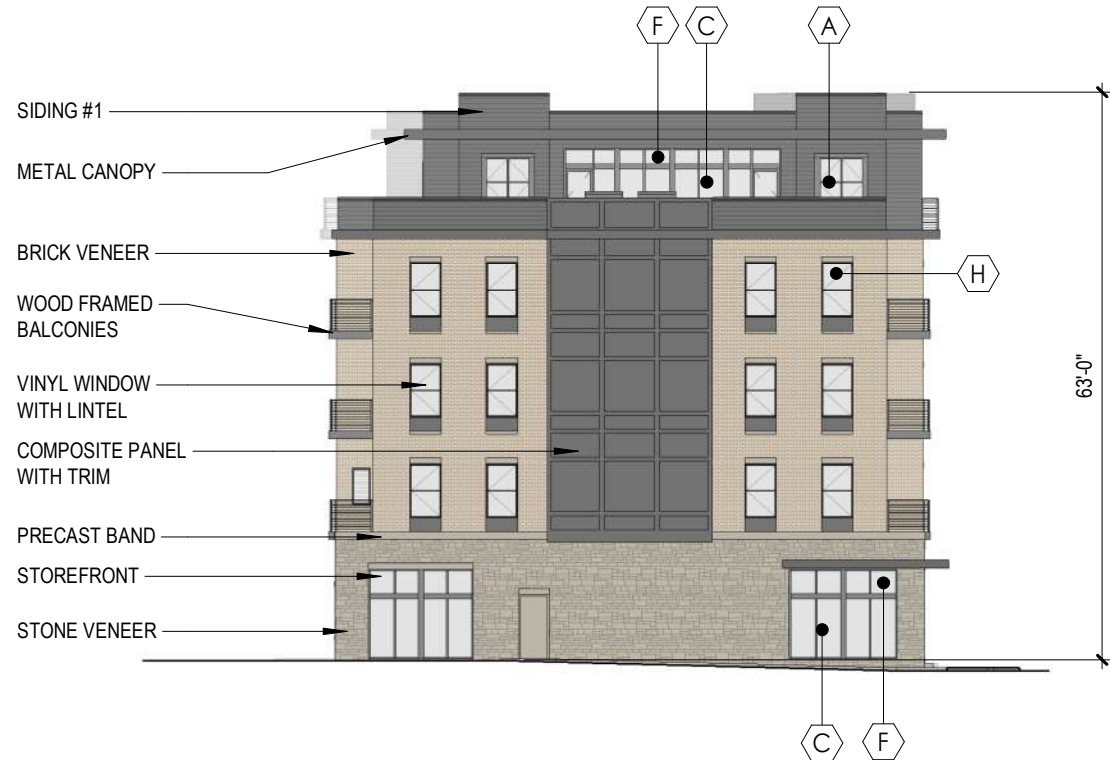

1 EAST ELEVATION
3/64" = 1'-0"

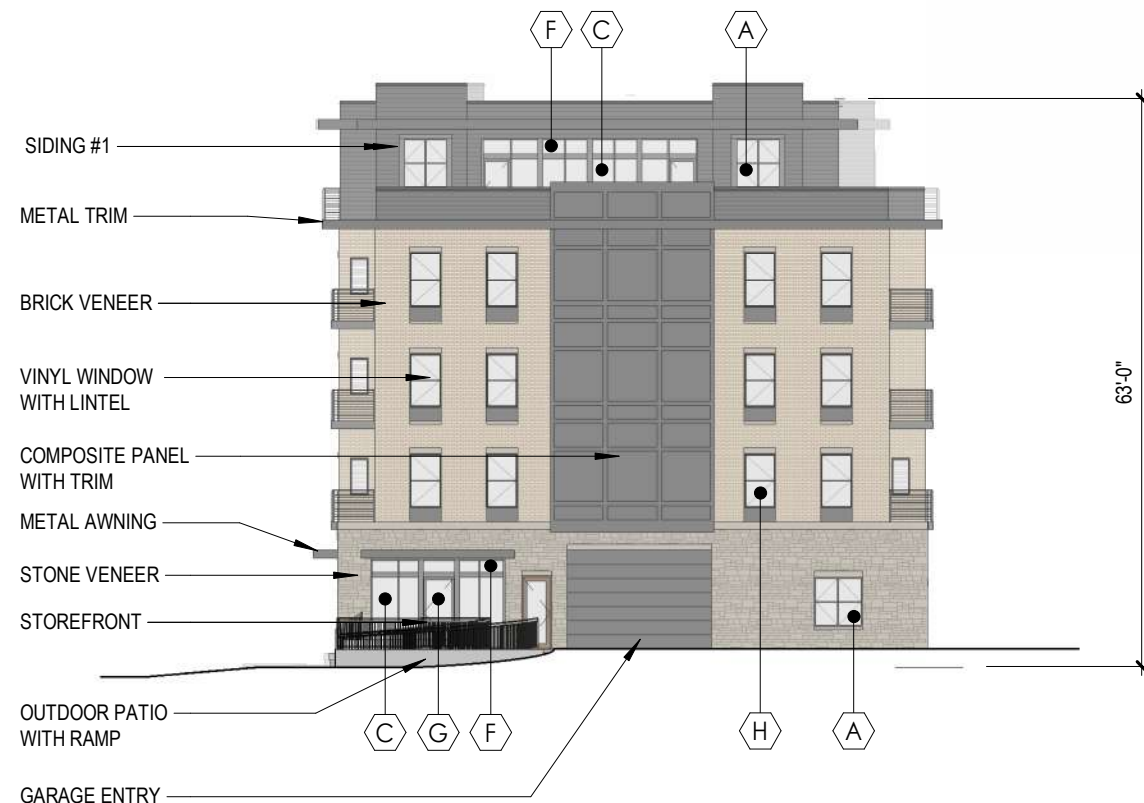

2 WEST ELEVATION
3/64" = 1'-0"

7/10/2024 12:27:54 PM



3575 UNIVERSITY AVENUE
EAST & WEST ELEVATIONS - BIRDGLASS

JLA PROJECT No: W23-0222

CITY OF MADISON LAND USE AND URBAN DESIGN COMMISSION SUBMITTAL

U209

7/10/24

28.129 BIRD-SAFE REQUIREMENTS:

(1) Statement of Purpose: The Bird-Safe Glass Requirements in this section are intended to reduce the heightened risk for bird collisions with glass on specified building designs and configurations.

(2) Applicability: Subsection (4) applies to all exterior construction and development activity, including the expansion of existing buildings and structures, as specified therein.

(3) Measuring Glass Area: Under this Ordinance, glass area shall be measured as one (1) continuous panel of glass or other transparent material, or a set of two (2) or more such panels divided by mullions of six (6) inches in width or narrower. Panels surrounded on all sides by solid walls or mullions wider than six (6) inches shall be considered individual windows. Spandrel or opaque reflectivity of 14% or less shall not be included in the calculation of glass area. See Revised Figure 1.

(4) Bird-Safe Glass Treatment Requirements: Glass areas on the following buildings or structures shall be treated to reduce the risk of bird collision by incorporating a pattern of visual markers that are either: a) dots or other isolated shapes that are 1/4" in diameter or larger and spaced at not more than a two-inch (2") by two-inch (2") pattern; or b) lines that are 1/8" in width or greater and spaced no more than 2" apart; low reflective opaque materials; building-integrated structures like non-glass double-skin facades, metal screens, fixed solar shading, exterior insect screens, and other features that cover the glass surface; or other similar mitigation treatments approved by the Zoning Administrator.

(a) Buildings or structures over 10,000 square feet: For any building or structure over 10,000 square feet in size (floor area of above-grade stories), bird-safe glass treatment is required as follows:

1. For building facades where the first sixty (60) feet (See REVISED Figure 2) from grade are comprised of greater than or equal to fifty percent (50%) glass:
 - a. At least eighty-five percent (85%) of the glass must be treated; and
 - b. All glass within fifteen (15) feet of a building corner must be treated when see through or fly through conditions exist. See Figure 3.
2. For building facades where the first sixty (60) feet from grade are comprised of less than fifty percent (50%) glass:
 - a. At least eighty-five percent (85%) of the glass on glass areas fifty (50) square feet or over must be treated; and
 - b. Of all glass areas over fifty (50) square feet, any glass within fifteen (15) feet of a building corner must be treated.
3. All glass railings must be treated.
4. All glass on enclosed building connections shall be treated up to sixty (60) feet above grade.

(b) Sky-bridges: For buildings and structures of any size, all glass on above-ground bridges must be treated.

(c) At grade glass: For buildings and structures of any size, all at grade glass features such as sound walls or glass screens must be treated.

(5) This Ordinance shall become effective October 1, 2020.

**3575 UNIVERSITY AVENUE
BIRD GLASS CALCULATIONS
7/10/2024**

***50+ SQ FT AND REQUIRE A BIRD GLAZING SAFETY SYSTEM ON A MIN. OF 85% OF THE GLAZING**

WINDOW/ STOREFRONT DESIGNATION	WIDTH	HEIGHT	# OF PANES	AREA	WALL DESIGNATION							
					NORTH ELEVATION		SOUTH ELEVATION		EAST ELEVATION		WEST ELEVATION	
					GLZ AREA	# WINDOW	GLZ AREA	# WINDOW	GLZ AREA	# WINDOW	GLZ AREA	# WINDOW
A -WINDOW - 5'-4"x 5'-6"	5.0	5.2	4.0	25.9	1344.2	52.0	1189.1	46.0	51.7	2.0	77.6	3.0
B -WINDOW - 3'-0"x 4'-0"	2.7	3.7	1.0	9.9	79.0	8.0	0.0	0.0	0.0	0.0	69.2	7.0
C-STOREFRONT -6'-0" x 7'-0"	5.7	6.7	2.0	38.2	916.6	24.0	0.0	0.0	0.0	0.0	229.1	6.0
D -PATIO DOOR - 6'-8" x 7'-0"	6.3	6.7	2.0	42.4	1484.4	35.0	1823.7	43.0	0.0	0.0	84.8	2.0
E -STOREFRONT - 6'-0" X 7'-0"	5.7	6.7	2.0	37.9	872.2	23.0	0.0	0.0	151.7	4.0	75.8	2.0
F -STOREFRONT - 6'-0"x 3'-0"	5.7	2.7	2.0	15.4	369.4	24.0	0.0	0.0	123.1	8.0	92.3	6.0
G -STOREFRONT DOOR - 3'-6" X 7'-0"	3.2	6.7	4.0	21.44	42.88	2.0	0.0	0.0	0.0	0.0	21.44	1.0
H - WINDOW - 3'-6" X 6'-0"	3.2	5.7	2.0	18.24	0	0.0	0.0	0.0	218.9	12.0	218.9	12.0
					5108.6	TOTAL GLZ	3,012.8	TOTAL GLZ	326.5	TOTAL GLZ	869.2	TOTAL GLZ
					17,130	WALL AREA	16,214.0	WALL AREA	4,153.0	WALL AREA	4,077.0	WALL AREA
					29.82%	% GLAZING	18.58%	% GLAZING	7.86%	% GLAZING	21.32%	% GLAZING




SHADOW ON MARCH 21ST @ 9AM



SHADOW ON JUNE 21ST @ 9AM



SHADOW ON MARCH 21ST @ 2PM

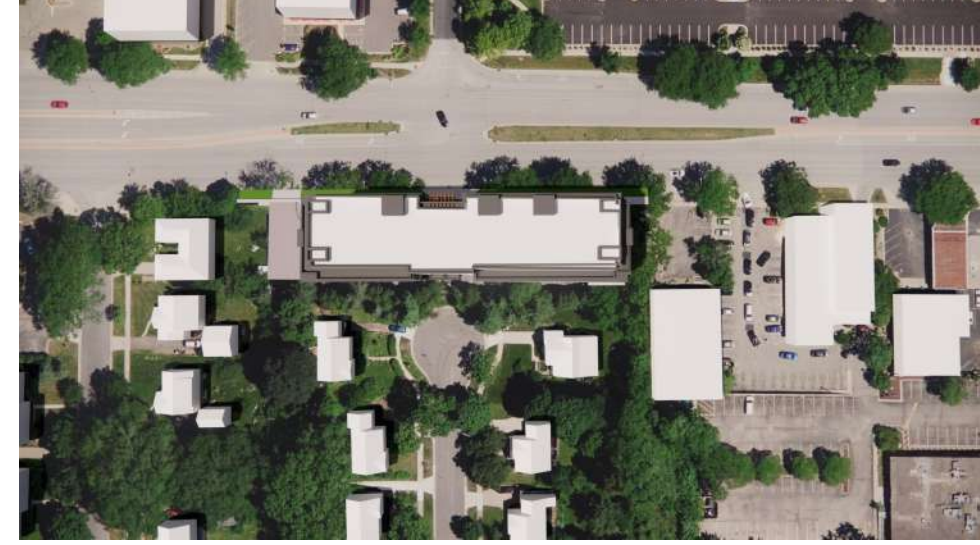

SHADOW ON JUNE 21ST @ 2PM



SHADOW ON MARCH 21ST @ 4PM



SHADOW ON JUNE 21ST @ 4PM

7/9/2024 7:27:03 PM



3575 UNIVERSITY AVENUE

SHADOW STUDY - MARCH/JUNE

JLA PROJECT No: W23-0222

CITY OF MADISON LAND USE AND URBAN DESIGN COMMISSION SUBMITTAL

U400

7/10/24



SHADOW ON SEPT 21ST @ 9AM



SHADOW ON DEC 21ST @ 9AM



SHADOW ON SEPT 21ST @ 2PM



SHADOW ON DEC 21ST @ 2PM



SHADOW ON SEPT 21ST @ 4PM



SHADOW ON DEC 21ST @ 4PM

7/9/2024 7:27:03 PM



3575 UNIVERSITY AVENUE

SHADOW STUDY - SEPT/DEC

JLA PROJECT No: W23-0222

CITY OF MADISON LAND USE AND URBAN DESIGN COMMISSION SUBMITTAL

U401

7/10/24



7/9/2024 7:27:03 PM



3575 UNIVERSITY AVENUE
BUILDING RENDERING LOOKING WEST

JLA PROJECT No: W23-0222

CITY OF MADISON LAND USE AND URBAN DESIGN COMMISSION SUBMITTAL

U402

7/10/24



7/9/2024 7:27:03 PM



3575 UNIVERSITY AVENUE
BUILDING RENDERING LOOKING EAST

JLA PROJECT No: W23-0222

CITY OF MADISON LAND USE AND URBAN DESIGN COMMISSION SUBMITTAL

U403

7/10/2



7/9/2024 7:27:03 PM



3575 UNIVERSITY AVENUE

STREET VIEW LOOKING WEST

JLA PROJECT No: W23-0222

CITY OF MADISON LAND USE AND URBAN DESIGN COMMISSION SUBMITTAL

U404

7/10/24



ARTICULATION AT GARAGE ENTRANCE



WEST END SIDEWALK

7/9/2024 7:27:03 PM



3575 UNIVERSITY AVENUE

STREET VIEW LOOKING WEST

JLA PROJECT No: W23-0222

CITY OF MADISON LAND USE AND URBAN DESIGN COMMISSION SUBMITTAL

U405

7/10/24



7/9/2024 7:27:04 PM



3575 UNIVERSITY AVENUE


PROPOSED BRUCE CT. RENDERING

JLA PROJECT No: W23-0222

CITY OF MADISON LAND USE AND URBAN DESIGN COMMISSION SUBMITTAL

U406

7/10/24

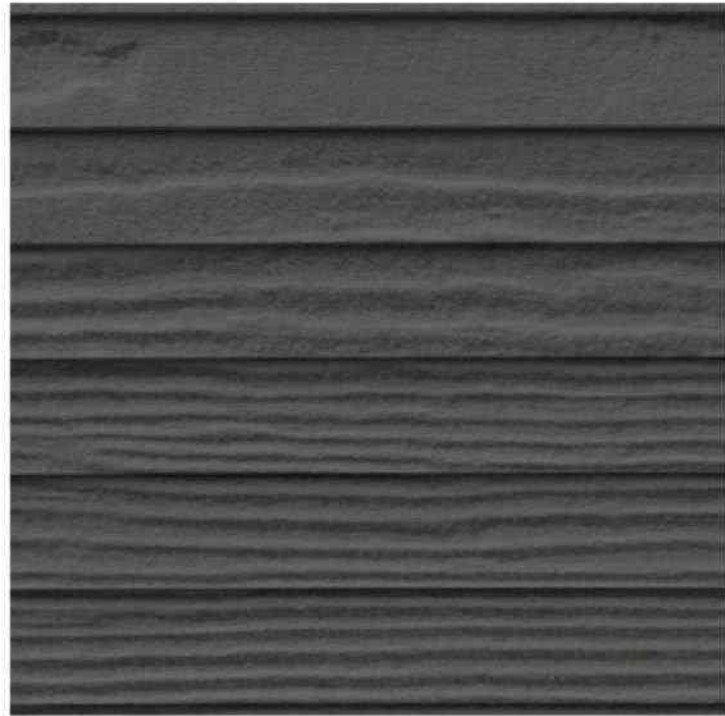

FIBER CEMENT SIDING HORIZONTAL;
HARDIE NIGHT GRAY



METAL
NIGHT GRAY



FIBER CEMENT SIDING ACCENT:
WOODTONE OLD CHERRY



MASONRY VENEER - RUNNING BOND:
SIOUX CITY BRICK BUTTERNUT VELOUR



STONE VENEER - ROUGH CUT
ELDORADO STONE WHEATFIELD

3575 UNIVERSITY AVENUE

MATERIAL BOARD

JLA PROJECT No: W23-0222

NEIGHBORHOOD MEETING

N500

5/20/24

5/21/2024 1:35:22 PM



FEATURES & SPECIFICATIONS

INTENDED USE — Typical applications include corridors, lobbies, conference rooms and private offices.

CONSTRUCTION — Galvanized steel mounting/plaster frame; galvanized steel junction box with bottom-hinged access covers and spring latches. Reflectors are retained by torsion springs.

Vertically adjustable mounting brackets with commercial bar hangers provide 3-3/4" total adjustment.

Two combination 1/2"-3/4" and four 1/2" knockouts for straight-through conduit runs. Capacity: 8 (4 in, 4 out). No. 12 AWG conductors, rated for 90°C.

Accommodates 12"-24" joist spacing.

Passive cooling thermal management for 25°C standard; high ambient (40°C) option available. Light engine and drivers are accessible from above or below ceiling.

Max ceiling thickness 1-1/2".

OPTICS — LEDs are binned to a 3-step MacAdam Ellipse; 80 CRI minimum. 90 CRI optional.

LED light source concealed with diffusing optical lens.

General illumination lighting with 1.0 S/MH and 55° cutoff to source and source image.

Self-flanged anodized reflectors in specular, semi-specular, or matte diffuse finishes. Also available in white and black painted reflectors.

A+ CAPABLE LUMINAIRE — This item is an A+ capable luminaire, which has been designed and tested to provide consistent color appearance and out-of-the-box control compatibility with simple commissioning when used with Acuity Brands controls products. All configurations of this luminaire are calibrated and tested to meet the Acuity Brands' specifications for chromatic consistency – including color rendering, color fidelity and color temperature tolerance around standard CIE chromaticity coordinates. To learn more about A+ standards, specifications, and testing visit www.acuitybrands.com/aplus.

UGR — UGR is zero for fixtures aimed at nadir with a cut-off equal to or less than 60deg, per CIE 117-1996 Discomfort Glare in Interior Lighting.

ELECTRICAL — Multi-volt (120-277V, 50/60Hz) 0-10V dimming drivers mounted to junction box, 10% or 1% minimum dimming level available.

0-10V dimming fixture requires two (2) additional low-voltage wires to be pulled.

LUMEN MAINTENANCE — 70% lumen maintenance at 60,000 hours. L70/60,000 hours

LISTINGS — Certified to US and Canadian safety standards. Wet location standard (covered ceiling). IP55 rated. ENERGY STAR® certified product. Drivers are RoHS compliant

GOVERNMENT PROCUREMENT — BAA – Product with the BAA option qualifies as a domestic end product under the Buy American Act as implemented in the FAR and DFARS. Product with the BAA option also qualifies as manufactured in the United States under DOT Buy America regulations.

BABA – Build America Buy America: Product with the BAA option also qualifies as produced in the United States under the definitions of the Build America, Buy America Act.

Please refer to www.acuitybrands.com/buy-american for additional information.

WARRANTY — 5-year limited warranty. This is the only warranty provided and no other statements in this specification sheet create any warranty of any kind. All other express and implied warranties are disclaimed.

Complete warranty terms located at: www.acuitybrands.com/support/warranty/terms-and-conditions

Note: Actual performance may differ as a result of end-user environment and application.

All values are design or typical values, measured under laboratory conditions at 25 °C.

Specifications subject to change without notice.

PERFORMANCE DATA

LDN6 3500K AR LSS 80CRI			
Nominal Lumens	Lumens	Wattage	Lm/W
500	527.9	5.8	90.5
750	758.1	8.9	85.1
1000	950.1	10.4	91.0
1500	1514	17.5	86.4
2000	2006	22.5	89.1
2500	2504	28.3	88.6
3000	3021	34.8	86.9
4000	4008	44.3	90.6
5000	4975	57.7	86.3

Notes

- Tested in accordance with IESNA LM-79-08.
- Tested to current IES and NEMA standards under stabilized laboratory conditions.
- CRI: 80 typical.



Catalog Number
Notes
Type

LDN6 STATIC WHITE

**6" Open and Wallwash LED
Non-IC
New Construction Downlight**




Open Trim




Wallwash Trim

DISTRIBUTIONS





Open

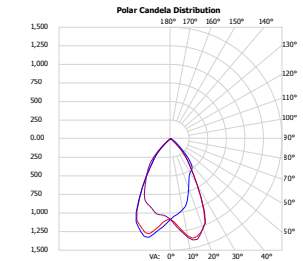

Wallwash

DIMENSIONS

LDN6 500-3000 Lumens

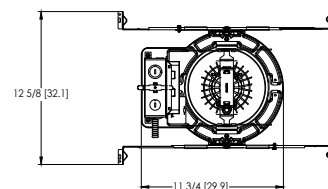

Aperture: \varnothing 6-1/4" [15.9]
Ceiling Cutout: \varnothing 7-1/8" [18.1] Self-flanged
Overlap Trim: \varnothing 7-1/2" [19.1]

See page 4 for other fixture dimensions

ORDERING INFORMATION

Lead times will vary depending on options selected. Consult with your sales representative.

Example: LDN6 35/15 L06 AR LSS MVOLT EZ10

LDN6 Series	Color temperature	Lumens ‡	Trim Style	Trim Color	Trim Finish	Flange Color ‡	Voltage
LDN6 6" round	27/ 2700K 30/ 3000K 35/ 3500K 40/ 4000K 50/ 5000K	05 500 lumens 07 750 lumens 10 1000 lumens 15 1500 lumens 20 2000 lumens 25 2500 lumens 30 3000 lumens 40 4000 lumens 50 5000 lumens	L06 Downlight LW6 Wallwash	AR Clear WR ‡ White BR ‡ Black TCPC ‡ Custom painted trim TRALTBD ‡ RAL painted trim	LSS Semi-specular LD Matte diffuse LS Specular	TRW White painted flange TRBL Black painted flange FCPC Custom painted flange only FRALTBD RAL painted flange only	MVOLT Multi-volt 120 120V 277 277V 347 ‡ 347V

Driver	Emergency ‡	Control Input ‡	Options
GZ10 0-10V driver dims to 10%	(blank) No Emergency Needed	(blank) No Control Input Needed	HAO ‡ High ambient option (40°C)
GZ1 0-10V driver dims to 1%	EL Battery pack (10W constant power), non-T20 compliant, integral test switch	JOT Wireless room control with "Just One Touch" pairing	CP ‡ Chicago Plenum
D10 Minimum dimming 10% driver for use with JOT	ELR Battery pack (10W constant power), non-T20 compliant, remote test switch	NPP16D nLight® network power/relay pack with 0-10V dimming for non-eldoLED drivers (GZ10, GZ1).	RRL___ RELOC®-ready luminaire connectors enable a simple and consistent factory installed option across all ABL luminaire brands. Refer to RRL for complete nomenclature. Available only in RRLA, RRLB, RRLAE, and RRLC12S.
D1 Minimum dimming 1% driver for use with JOT	ELSD Self-diagnostic battery pack (10W constant power), non-T20 compliant, integral test switch	NPP16DER nLight® network power/relay pack with 0-10V dimming for non-eldoLED drivers (GZ10, GZ1). ER controls fixtures on emergency circuit.	BAA Buy America(n) Act and/or Build America Buy America Qualified
EZ1 0-10V eldoLED driver with smooth and flicker-free deep dimming performance down to 1% eldoLED DALI SOLDRIVE dim to dark	ELRSD Self-diagnostic battery pack (10W constant power), non-T20 compliant, remote test switch	NPS80EZ nLight® dimming pack controls 0-10V eldoLED drivers (EZ1).	90CRI High CRI (90+)
EDAB eldoLED DALI SOLDRIVE dim to dark	E10WCP Battery pack (10W constant power), T20 compliant, integral test switch	NPS80EZER nLight® dimming pack controls 0-10V eldoLED drivers (EZ1). ER controls fixtures on emergency circuit.	SF ‡ Single fuse
	E10WCPR Battery pack (10W constant power), T20 compliant, remote test switch	N80 nLight™ Lumen Compensation	
	E10WRSTAR Emergency battery pack, 10W with remote test switch and Iota STAR technology	NLTAIR2 nLight® Air enabled	
		NLTAIRER2 nLight® AIR Dimming Pack Wireless Controls. Controls fixtures on emergency circuit, not available with battery pack options	
		NLTAIREM2 nLight® AIR Dimming Pack Wireless Controls. UL924 Emergency Operation, via power interrupt detection. Available with battery pack options.	

‡ Option Value Ordering Restrictions

Option value	Restriction
Lumens	Overall height varies based on lumen package; refer to dimensional chart.
WR, BR	Not available with finishes.
347	Not available with emergency options.
SF	Must specify voltage 120V or 277V.
TRW, TRBL	Available with clear (AR) reflector only.
EL, ELR, ELSD, ELRSD, E10WCP, E10WCPR	12.5" of plenum depth or top access required for battery pack maintenance.
NPP16D, NPP16DER, NPS80EZ, NPS80EZER	Specify voltage. ER for use with generator supply EM power. Will require an emergency hot feed and normal hot feed. See UL 924 Sequence of Operation table.
N80	Fixture begins at 80% light level. Must be specified with NPS80EZ or NPS80EZ ER. Only available with EZ1 drivers.
NLTAIR, NLTAIR2, NLTAIRER2, NLTAIREM2	Not available with CP, NPS80EZ, NPS80EZER, NPP16D, NPP16DER or N80 options. not recommended for metal ceiling installations.
HAO	Fixture height is 6.5" for all lumen packages with HAO.
CP	Must specify voltage for 3000lm and above. 5000lm with marked spacing 24 L x 24 W x 14 H. Not available with emergency battery pack option.
JOT	Must specify D10 or D1 driver. Not available with nLight options. Not available with CP. Not recommended for metal ceiling installation. Not for use with emergency backup power systems other than battery packs.
Reloc® Options	Refer to RRL specification sheet on acuitybrands.com for further details.
RRLAE	Commercial fixtures should disconnect the TSPL before unplugging the RRL so it does not go into discharge mode.
RRLC12S	RRLC12S option is to be used with the OnePass OCU, OCS, OD, OFC and OD for 0-24V integrated single-circuit or 0-10V low voltage controls applications. Not available with integral dimming sensors.
TRALTBD, FRALTBD	RALTBD for pricing only. Replace with applicable RAL number and finish when ready to order. See the RAL BROCHURE for available color options.
TCPC, FCPC	CPC options for pricing only. Custom color chip needs to be sent in to your Customer Resolution specialist before order can be processed. Click HERE for more details
E10WRSTAR	Not available with wet location, EC1, EC6, QDS, CP, 347V, NPS80EZ ER, NLTAIRER2, NLTAIREM2, AL03 & AL04 w/DALI, OR 2000-4500 lumens w/JOT. Top access installation or 17.5" plenum clearance required for roomside installation. Not available with integral test switch

Accessories: Order as separate catalog number.

EAC ISSM 375	Compact interruptible emergency AC power system	SCA6 Sloped Ceiling Adapter. Degree of slope must be specified (5D, 10D, 15D, 20D, 25D, 30D). Ex: SCA6 10D
EAC ISSM 125	Compact interruptible emergency AC power system	
GRA68 JZ	Oversized trim ring with 8" outside diameter	



Items marked by a shaded background qualify for the Design Select program and ship in 15 days or less. To learn more about Design Select, visit www.acuitybrands.com/designselect. *See ordering tree for details

(Maximum order quantity for design select lead times is 112.)

Emergency Battery Pack Options - Field Installable

Battery Model Number	Wattage	Runtime (Minutes)	Lumen Output* @ 120 Lumens/Watt	Other
ILB CP07 2H A	7W	120	840	Storm Shelter / 2 Hour Runtime
ILB CP10 A	10W	90	1200	
ILBLP CP10 HE SD A+	10W	90	1200	Title 20, Self Diagnostic
ILBLP CP15 HE SD A+	15W	90	1800	Title 20, Self Diagnostic
ILB CP20 HE A	20W	90	2400	Title 20
ILB CP20 HE SD A	20W	90	2400	Title 20, Self Diagnostic
ILBHI CP10 HE SD A+	10W	90	1200	347-480V AC Input, Title 20, Self Diagnostic
ILBHI CP15 HE SD A+	15W	90	1800	347-480V AC Input, Title 20, Self Diagnostic

All the above are UL Listed products that are certified for field install external/remote to the fixture.

*Minimum delivered lumen output to assist in product selection for increased fixture mounting height.


The CP10 delivered emergency illumination outperforms legacy 1400 lumen fluorescent emergency ballast.

Please contact us at techsupport@iotaengineering.com for any Emergency Battery related questions.


PHOTOMETRY

Distribution Curve Distribution Data Output Data Illuminance Data at 30" Above Floor for a Single Luminaire


LDN6 35/10 L06AR, input watts: 10.44, delivered lumens: 987.10, LM/W = 94.54, spacing criterion at 0= 1.02, test no. ISF 30716P262.

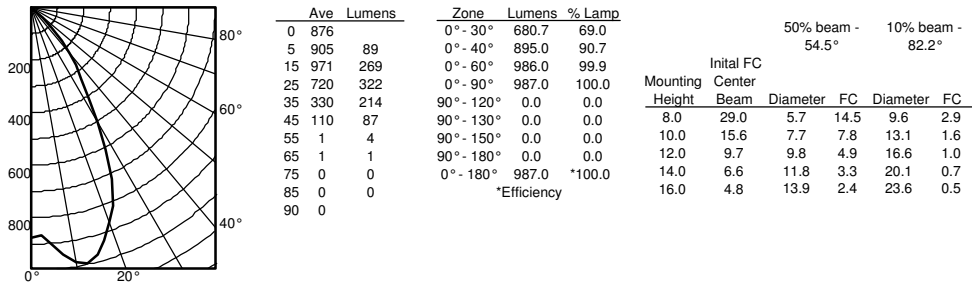

LDN6 35/15 L06AR, input watts: 17.52, delivered lumens: 1572.9, LM/W = 89.77, spacing criterion at 0= 1.02, test no. ISF 30716P265.

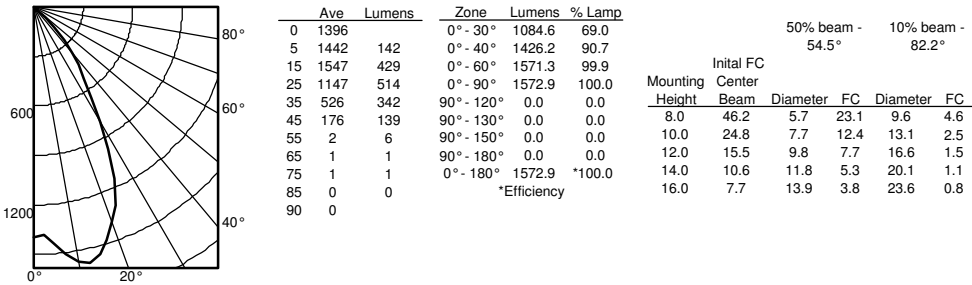

LDN6 35/30 L06AR, input watts: 34.75, delivered lumens: 3138.5, LM/W = 90.31, spacing criterion at 0= 1.02, test no. ISF 30716P274.

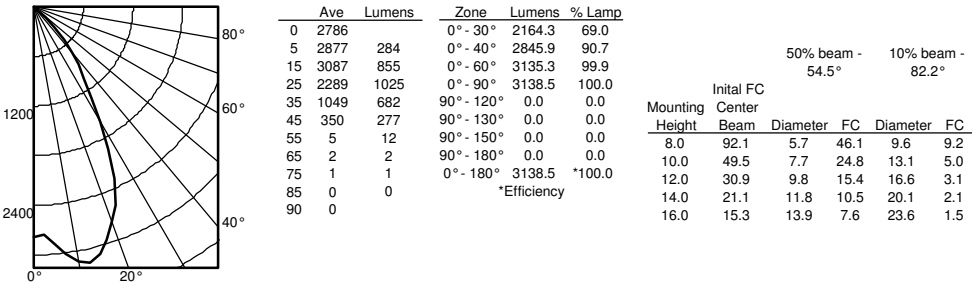

HOW TO ESTIMATE DELIVERED LUMENS IN EMERGENCY MODE

Use the formula below to estimate the delivered lumens in emergency mode

Delivered Lumens = 1.25 x P x LPW

P = Output power of emergency driver. P = 10W for PS1055CP

LPW = Lumen per watt rating of the luminaire. This information is available on the ABL luminaire spec sheet.

The LPW rating is also available at Designlight Consortium.

Notes

- Tested in accordance with IESNA LM-79-08.
- Tested to current IES and NEMA standards under stabilized laboratory conditions.
- CRI: 80 typical.

LUMEN OUTPUT MULTIPLIERS - FINISH			
	Clear (AR)	White (WR)	Black (BR)
Specular (LS)	1.0	N/A	N/A
Semi-specular (LSS)	0.950	N/A	N/A
Matte diffuse (LD)	0.85	N/A	N/A
Painted	N/A	0.87	0.73


LUMEN OUTPUT MULTIPLIERS - CRI	
80	1.0
90	0.874

LUMEN OUTPUT MULTIPLIERS - CCT					
	2700K	3000K	3500K	4000K	5000K
80CRI	0.950	0.966	1.000	1.025	1.101


LDN6

* All dimensions are inches (centimeters) unless otherwise noted.


LDN6 500-3000 Lumens

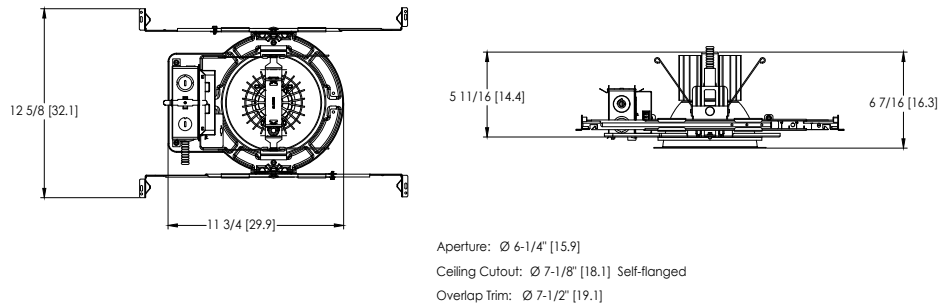


LDN6 4000-5000 Lumens

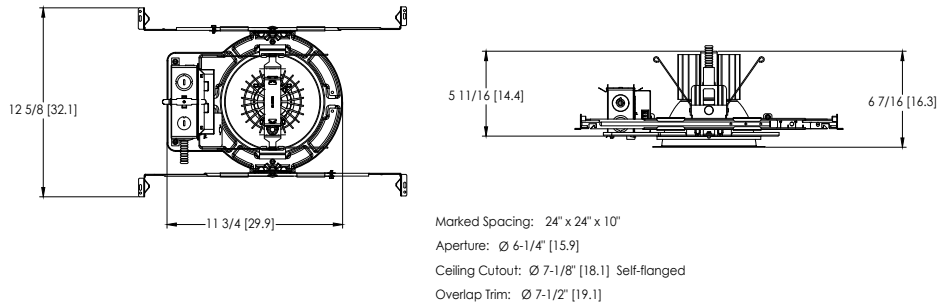

LDN6 CP

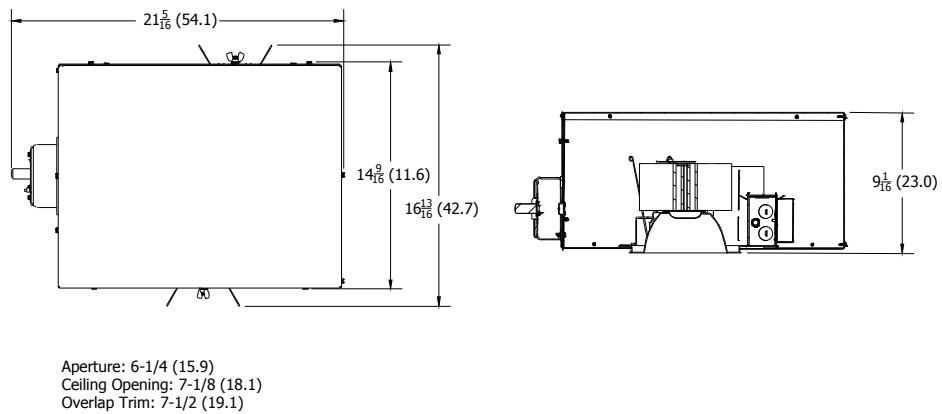

LDN6 EL

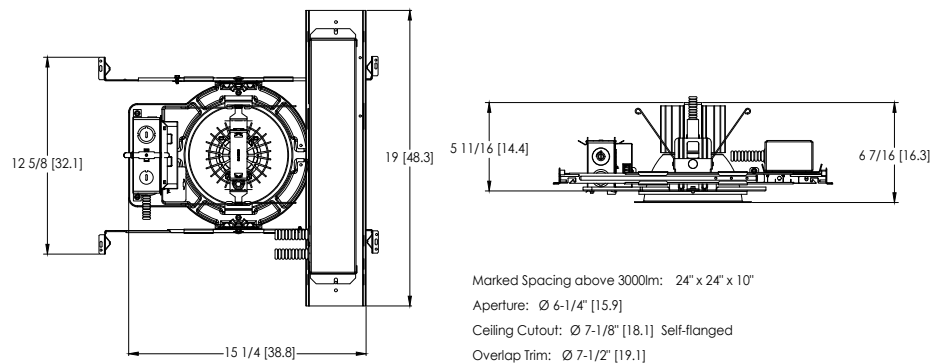

ADDITIONAL DATA



The Sensor Switch JOT enabled solution offers a wireless, app-free approach to single room lighting control. JOT enabled products use Bluetooth® Low Energy (BLE) technology to enable wireless dimming and switching.

Diagram



LDN6 Series



Sensor Switch
WSXA JOT

1. **Power:** Install JOT enabled fixtures and controls as instructed.
2. **Pair:** Insert the pairing tool into the pinhole on the wall switch; press and hold any button for 6 seconds.
3. **Play:** Once paired, each fixture will individually dim down to 10% brightness. All products will be fully functional.

COMPATIBLE 0-10V WALL-MOUNT DIMMERS		
MANUFACTURER	PART NO.	POWER BOOSTER AVAILABLE
Lutron®	Diva® DVTV	
	Diva® DVSCTV	
	Nova T® NTFTV	
	Nova® NFTV	
Leviton®	AWSMT-7DW	CN100
	AWSMG-7DW	PE300
	AMRMG-7DW	
	Leviton Centura Fluorescent Control System	
	IllumaTech® IP7 Series	
Synergy®	ISD BC	RDMFC
	SLD LPCS	
	Digital Equinox (DEQ BC)	
Douglas Lighting Controls	WPC-5721	
Entertainment Technology	Tap Glide TG600FAM120 (120V)	
	Tap Glide Heatsink TGH1500FAM120 (120V)	
	Oasis OA2000FAMU	
Honeywell	EL7315A1019	EL7305A1010 (optional)
	EL7315A1009	
HUNT Dimming	Preset slide: PS-010-IV and PS-010-WH	
	Preset slide: PS-010-3W-IV and PS-010-3W-WH	
	Preset slide, controls FD-010: PS-IFC-010-IV and PS-IFC-010-WH-120/277V	
	Preset slide, controls FD-010: PS-IFC-010-3W-IV and PS-IFC-010-3W-WH-120/277V	
	Remote mounted unit: FD-010	
Lehigh Electronic Products	Solitaire	PBX
PDM Electrical Products	WPC-5721	
Starfield Controls	TR61 with DALI interface port	RT03 DALI.net Router
WattStopper®	LS-4 used with LCD-101 and LCD-103	

EXAMPLE

Group Fixture Control*

*Application diagram applies for fixtures with eldoLED drivers only.


nPS 80 EZ Dimming/Control Pack (qty: 2 required)

nPODM 2P DX Dual On/Off/Dim Push-Button WallPod

nCM ADCX Daylight Sensor with Automatic Dimming Control

nCM PDT 9 Dual Technology Occupancy Sensor

Description: This design provides a dual on/off/dim wall station that enables manual control of the fixtures in Row A and Row B separately. Additionally, a daylight harvesting sensor is provided so the lights in Row B can be configured to dim automatically when daylight is available. An occupancy sensor turns off all lights when the space is vacant.

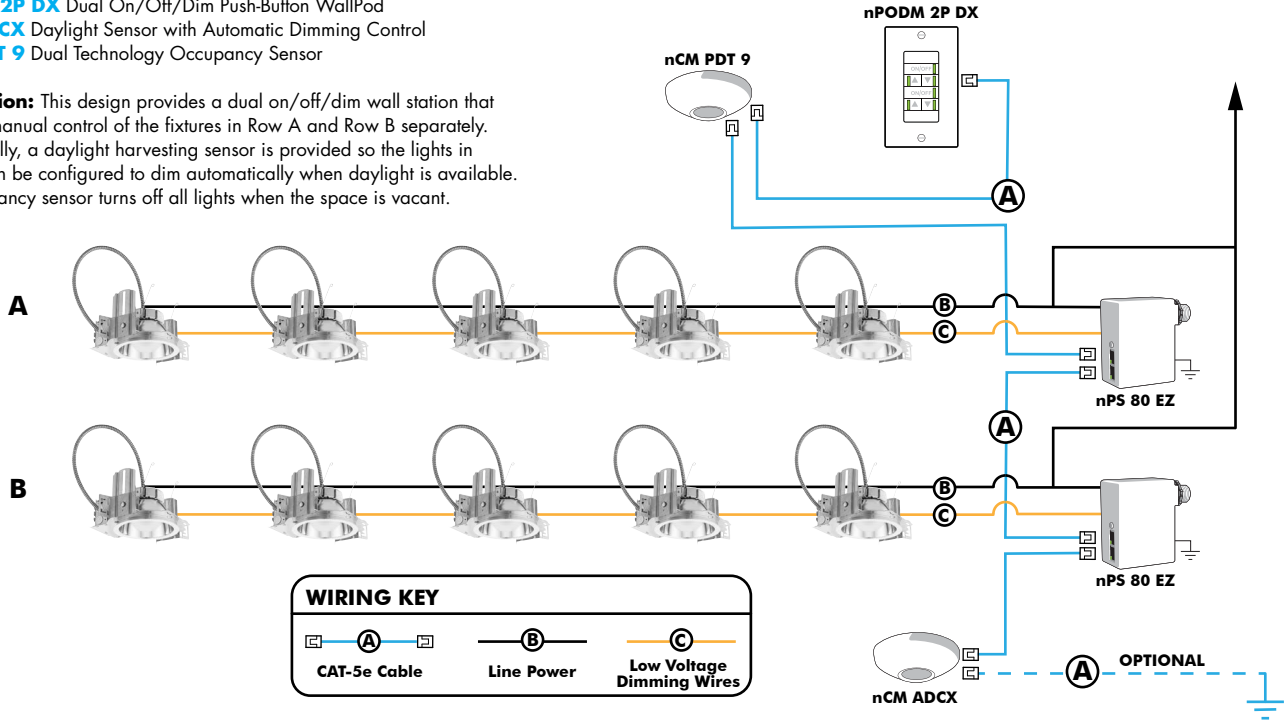

Choose Wall Controls

nLight offers multiple styles of wall controls - each with varying features and user experience.



Push-Button Wallpod
Traditional tactile buttons and LED user feedback



Graphic Wallpod
Full color touch screen provides a sophisticated look and feel

nLight® Wired Controls Accessories:

Order as separate catalog number. Visit www.acuitybrands.com/products/controls/nlight for complete listing of nLight controls.

WallPod Stations	Model number	Occupancy sensors	Model Number
On/Off	nPODM (Color)	Small motion 360°, ceiling (PIR/dual Tech)	nCM 9 / nCM PDT 9
On/Off & Raise/Lower	nPOD DX (Color)	Large motion 360°, ceiling (PIR/dual tech)	nCM 10 / nCM PDT 10
Graphic Touchscreen	nPOD GFX (Color)	Wide View (PIR/dual tech)	nWV 16 / nWV PDT 16
Photocell controls	Model Number	Wall Switch w/ Raise/Lower (PIR/dual tech)	nWSX LV DX / nWSX PDT LV DX
Dimming	nCM ADCX	Cat-5 cables (plenum rated)	Model Number
		10', CAT5 10FT	CAT5 10FT J1
		15, CAT5 15FT	CAT5 15FT J1

nLight® AIR Control Accessories:

Order as separate catalog number. Visit www.acuitybrands.com/products/controls/nlightair.

Wall switches	Model number
On/Off single pole	rPODB [color]
On/Off two pole	rPODB 2P [color]
On/Off & raise/lower single pole	rPODB DX [color]
On/Off & raise/lower two pole	rPODB 2P DX [color]
On/Off & raise/lower single pole	rPODBZ DX WH ¹

Notes

- 1 Can only be ordered with the RES7Z zone control sensor version.


UL924 Sequence of Operation

The below information applies to all nLight AIR devices with an EM option.

- EM devices will remain at their high-end trim and ignore wireless lighting control commands, unless a normal-power-sensed (NPS) broadcast is received at least every 8 seconds.
- Using the CLAIRITY+ mobile app, EM devices must be associated with a group that includes a normal power sensing device to receive NPS broadcasts.
- Only non-emergency rPP20, rLSXR, rSBOR, rSDGR, and nLight AIR luminaires with version 3.4 or later firmware can provide normal power sensing for EM devices. See specification sheets for control devices and luminaires for more information on options that support normal power sensing.

nLight AIR

nLight AIR is the ideal solution for retrofit or new construction spaces where adding communication is cost prohibitive. The integrated nLight AIR rPP20 Power Pack is part of each Lithonia LDN Luminaire. These individually addressable controls offer the ultimate in flexibility during initial setup and for space repurposing.

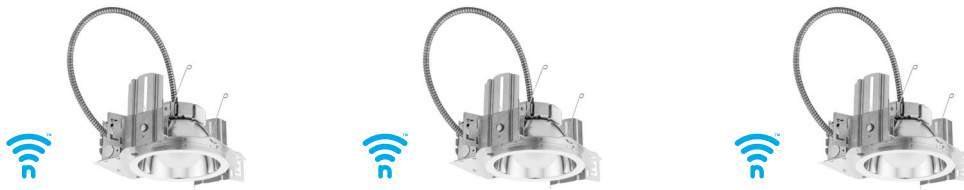

Simple as 1,2,3

1. Install the nLight® AIR fixtures with embedded smart sensor
2. Install the wireless battery-powered wall switch
3. With CLAIRITY app, pair the fixtures with the wall switch and if desired, customize the sensor settings for the desired outcome





Catalog Number
Notes
Type

Contractor Select™ WPX LED Wall packs

The WPX LED wall packs are energy-efficient, cost-effective, and aesthetically appealing full-cut off solution for both new construction and HID wall pack replacement/renovation opportunities. Reliable IP66 construction and excellent LED lumen maintenance ensure a long service life.

FEATURES:

- Architectural design at very economical prices
- Energy efficient - payback in less than two years
- Wide range of configuration options available

Note : WPX3 lumen package and all the WPX configuration options are not included in the Contractor Select program. For more information, please visit [WPX LED](#).



Luminaire	CCT	Lumens	Input Watts	Photocell	Finish	Voltage	Catalog Number	CI Code	UPC	Pallet qty.	Replaces Up To
WPX0	SWW2 3000K/ 4000K/ 5000K	850 - 1,650	6.4-13W	Switchable On/Off	DARK BRONZE	120-277V	WPX0 LED ALO SWW2 MVOLT PE DDBXD M2	*276U4U	196182511806	280	70W Metal Halide
WPX1	4000K	2,900	24W	N/A	DARK BRONZE	120-277V	WPX1 LED P2 40K MVOLT DDBXD M4	*265SWK	193048870589	160	150W Metal Halide
WPX2	4000K	6,000	47W	N/A	DARK BRONZE	120-277V	WPX2 LED 40K MVOLT DDBXD M2	*265SX3	193048870756	120	250W Metal Halide
	5000K	6,000	47W	N/A	DARK BRONZE	120-277V	WPX2 LED 50K MVOLT DDBXD M2	*265SX6	193048870770	120	250W Metal Halide

More configurations are available. [Click here](#) or visit www.acuitybrands.com and search for [WPX LED](#).



Specifications

INTENDED USE:

The WPX LED wall packs are designed to provide a cost-effective, energy-efficient solution for the one-for-one replacement of existing HID wall packs. The WPX0, WPX1, WPX2 and WPX3 are ideal for replacing up to 70W, 150W, 250W, and 400W HID luminaires respectively. WPX luminaires deliver a uniform, wide distribution. WPX is rated for -40°C to 40°C.

CONSTRUCTION:

WPX feature a die-cast aluminum main body with optimal thermal management that both enhances LED efficacy and extends component life. The luminaires are IP66 rated, and sealed against moisture or environmental contaminants.

ELECTRICAL:

Light engine(s) configurations consist of high-efficacy LEDs with a min LED lumen maintenance of L86/100,000 hours. Color temperature (CCT) options of 3000K, 4000K and 5000K with minimum CRI of 70 (80 for WPX0). Electronic drivers ensure system power factor >90% and THD <20%. All luminaires have 6kV surge protection (Note: WPX1 LED P1 package and WPX0 comes with a standard surge protection rating of 2.5kV).

Note: The standard WPX LED wall pack luminaires come with field-adjustable drive current feature. This feature allows tuning the output current of the LED drivers to adjust the lumen output (to dim the luminaire).

INSTALLATION:

WPX can be mounted directly over a standard electrical junction box. A port on the back surface allows poke-through conduit wiring on surfaces that don't have an electrical junction box. WPX1, WPX2 and WPX3 come with three 1/2 inch conduit ports on three sides that allow for surface conduit wiring. Wiring can be made in the integral wiring compartment in all cases. WPX is only recommended for installations with LEDs facing downwards.

LISTINGS:

CSA Certified to meet U.S. and Canadian standards. Suitable for wet locations. IP66 Rated.

DesignLights Consortium® (DLC) Premium qualified product and DLC qualified product. Not all versions of this product may be DLC Premium qualified or DLC qualified. Please check the DLC Qualified Products List at www.designlights.org/QPL to confirm which versions are qualified.


WARRANTY:

5-year limited warranty. This is the only warranty provided and no other statements in this specification sheet create any warranty of any kind. All other express and implied warranties are disclaimed. Complete warranty terms located at: www.acuitybrands.com/support/warranty/terms-and-conditions

Note: Actual performance may differ as a result of end-user environment and application. All values are design or typical values, measured under laboratory conditions at 25°C. Specifications subject to change without notice.

Dimensions

All dimensions are inches (centimeters) unless otherwise indicated.

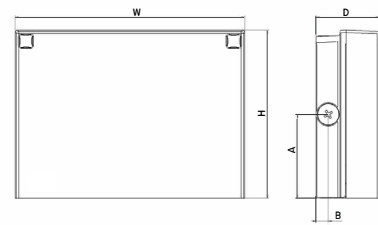

Front View

Side View

Luminaire	Height (H)	Width (W)	Depth (D)	Side Conduit Location		Weight
				A	B	
WPX0	5.75" (14.6 cm)	5.5" (14.0 cm)	2" (5.1 cm)	N/A	N/A	2.5 lbs (1.1kg)
WPX1	8.1" (20.6 cm)	11.1" (28.3 cm)	3.2" (8.1 cm)	4.0" (10.3 cm)	0.6" (1.6 cm)	6.1 lbs (2.8kg)
WPX2	9.1" (23.1 cm)	12.3" (31.1 cm)	4.1" (10.5 cm)	4.5" (11.5 cm)	0.7" (1.7 cm)	8.2 lbs (3.7kg)
WPX3	9.5" (24.1 cm)	13.0" (33.0 cm)	5.5" (13.7 cm)	4.7" (12.0 cm)	0.7" (1.7 cm)	11.0 lbs (5.0kg)