


Cured-in-Place Pipe (CIPP) 2026 - Woodvale Dr/Ferris Ave/Marg St/Meredithe Ave/Timothy Ave/Fleetwood Ave/Woodvale Circle

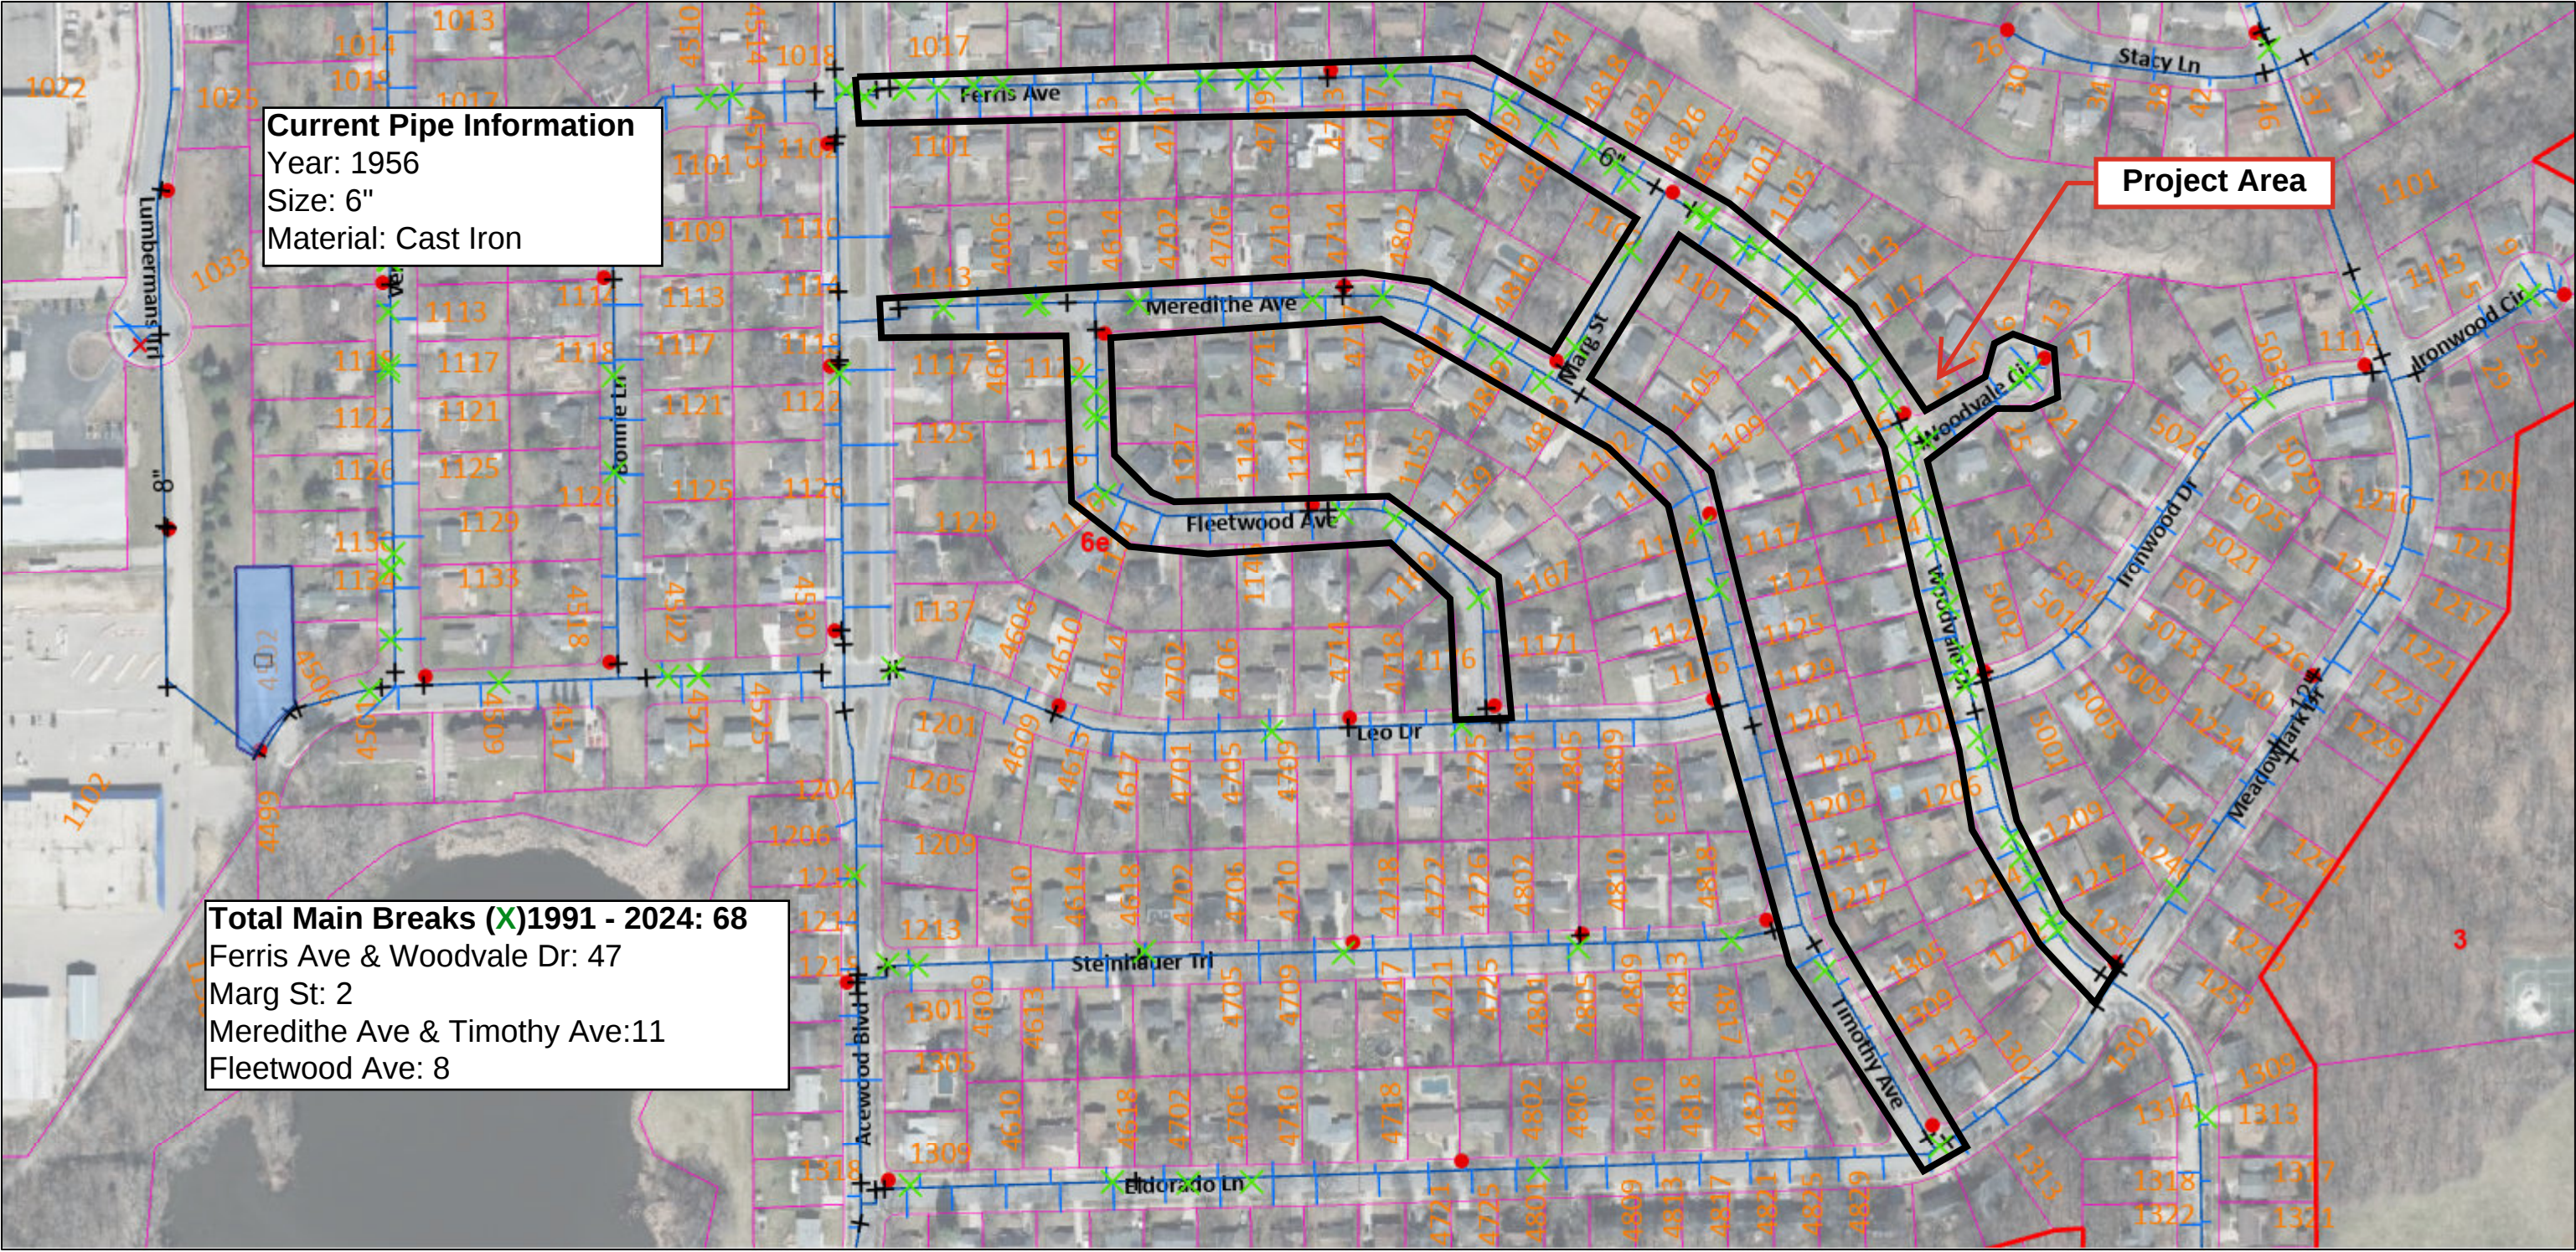

Structure

Property

Site

Failure

Pressure Zone

Valve

+

Valve (Open)

+

Valve (Closed)

⊕

Valve in Manhole (Open)

⊕

Valve in Manhole (Closed)

5" HYDRANT

Service Lateral

Water Main

- -

Water Main (Private)

- -

Water Main (Other Private)

Street Labels

Primary Address (Text)

Parcel (City of Madison)

FIRE HYDRANT

●

4" HYDRANT

Madison City Boundary