

Designed by:
City of Madison
Facilities Management
City-County Building, Room 115
210 Martin Luther King Jr. Boulevard
Madison, WI 53703



Location:
3945 Lien Road
Madison, WI 53714

Contract: 9655
Project: 15434

Fire Station 8
Lighting Retrofit
(BPW)

[illegible]

- | | | | |
|----|--|----|---|
| A. | PROJECT DESCRIPTION: | 1. | |
| B. | SPECIAL SITE CONDITIONS: | 1. | NA |
| C. | WORK HOURS | 1. | Meet requirements of local ordinances, rules and laws. |
| | | 2. | Hours of operation are limited to 7 a.m. to 7 p.m. Monday through Saturday and Sunday 10 a.m. through 7 p.m. unless approved otherwise. |
| D. | WORK AND EQUIPMENT PROVIDED BY OWNER (DON'T INCLUDE IN BID PRICE): | 1. | NA |
| E. | SPECIAL WARRANTIES: | 1. | NA |
| F. | PROVISIONS FOR FUTURE WORK | 1. | NA |
| G. | PROVISIONS FOR RETROFIT INSTALLATIONS | 1. | NA |
| H. | PERMIT REQUIREMENTS: | 1. | Contractor is responsible to obtain all permits. See specifications for details. |
| I. | UTILITIES: | 1. | Contractor may use owner's power and water at no cost. |
| J. | CONTINUITY OF SERVICE: | 1. | NA |
| K. | SEQUENCING REQUIREMENTS: | 1. | NA |
| L. | ALTERNATES: | 1. | NA |

G 01

Print Date:
4/2/2025 14:20:58
Print in color on 24" x 36"

Review Set - Not for Construction

5 Lien Road
Madison, WI 53714

Fire Station 8 Lighting Retrofit (BPW)

[illegible]


TRUE








Painting and Ceiling Work

200

Print Date:
2025 14:20:59
Print in color on 24" x 36"





Keynote Legend	
Key Value	Keynote Text
1	Repair Drywall and match texture. Paint entire field above window. Match adjacent wall color.
2	Repair Drywall and match texture. Paint entire wall. Match adjacent wall color.
3	Modify Ceiling to accommodate new fixture.



Review Set - Not for Construction

Location:
3945 Lien Road
Madison, WI 53714

Fire Station 8
Lighting Retrofit
(BPW)



Keynote Legend	
Key Value	Keynote Text
1	Remove XTG light fixture and/or control. Cover openings and patch drywall. No painting required (Paint by owner).

[illegible]

General Lighting

EL 001

Print Date:
4/2/2025 14:21:00
Print in color on 24" x 36"

Location:
3945 Lien Road
Madison, WI 53714

Fire Station 8
Lighting Retrofit
(BPW)

Type Mark	Count	Emergency Luminaire	Real Power	Estimated UL 924 Replies required
EX-A2	11	Yes	11 VA	0
LR-2-500L	1	Yes	7 VA	1
LS-VT-8-9 OK-M	5	Yes	267 VA	5
PR-2x2-0.4K	10	Yes	140 VA	10
PR-2x2-3.4K	2	Yes	46 VA	2
PR-2x2-0.4K	1	Yes	28 VA	1
			690 VA	19

Keynote Legend	
Key Value	Keynote Text
1	Connect XTG light to emergency lighting system. Install UL 924 relay and modify fixture as required. Install relay in easily accessible location inside near the fixture. Confirm location with

[illegible]

Project North


TRUE








Emergency Lighting

EL 002

Print Date:
4/2/2025 14:21:02
Print in color on 24" x 36"

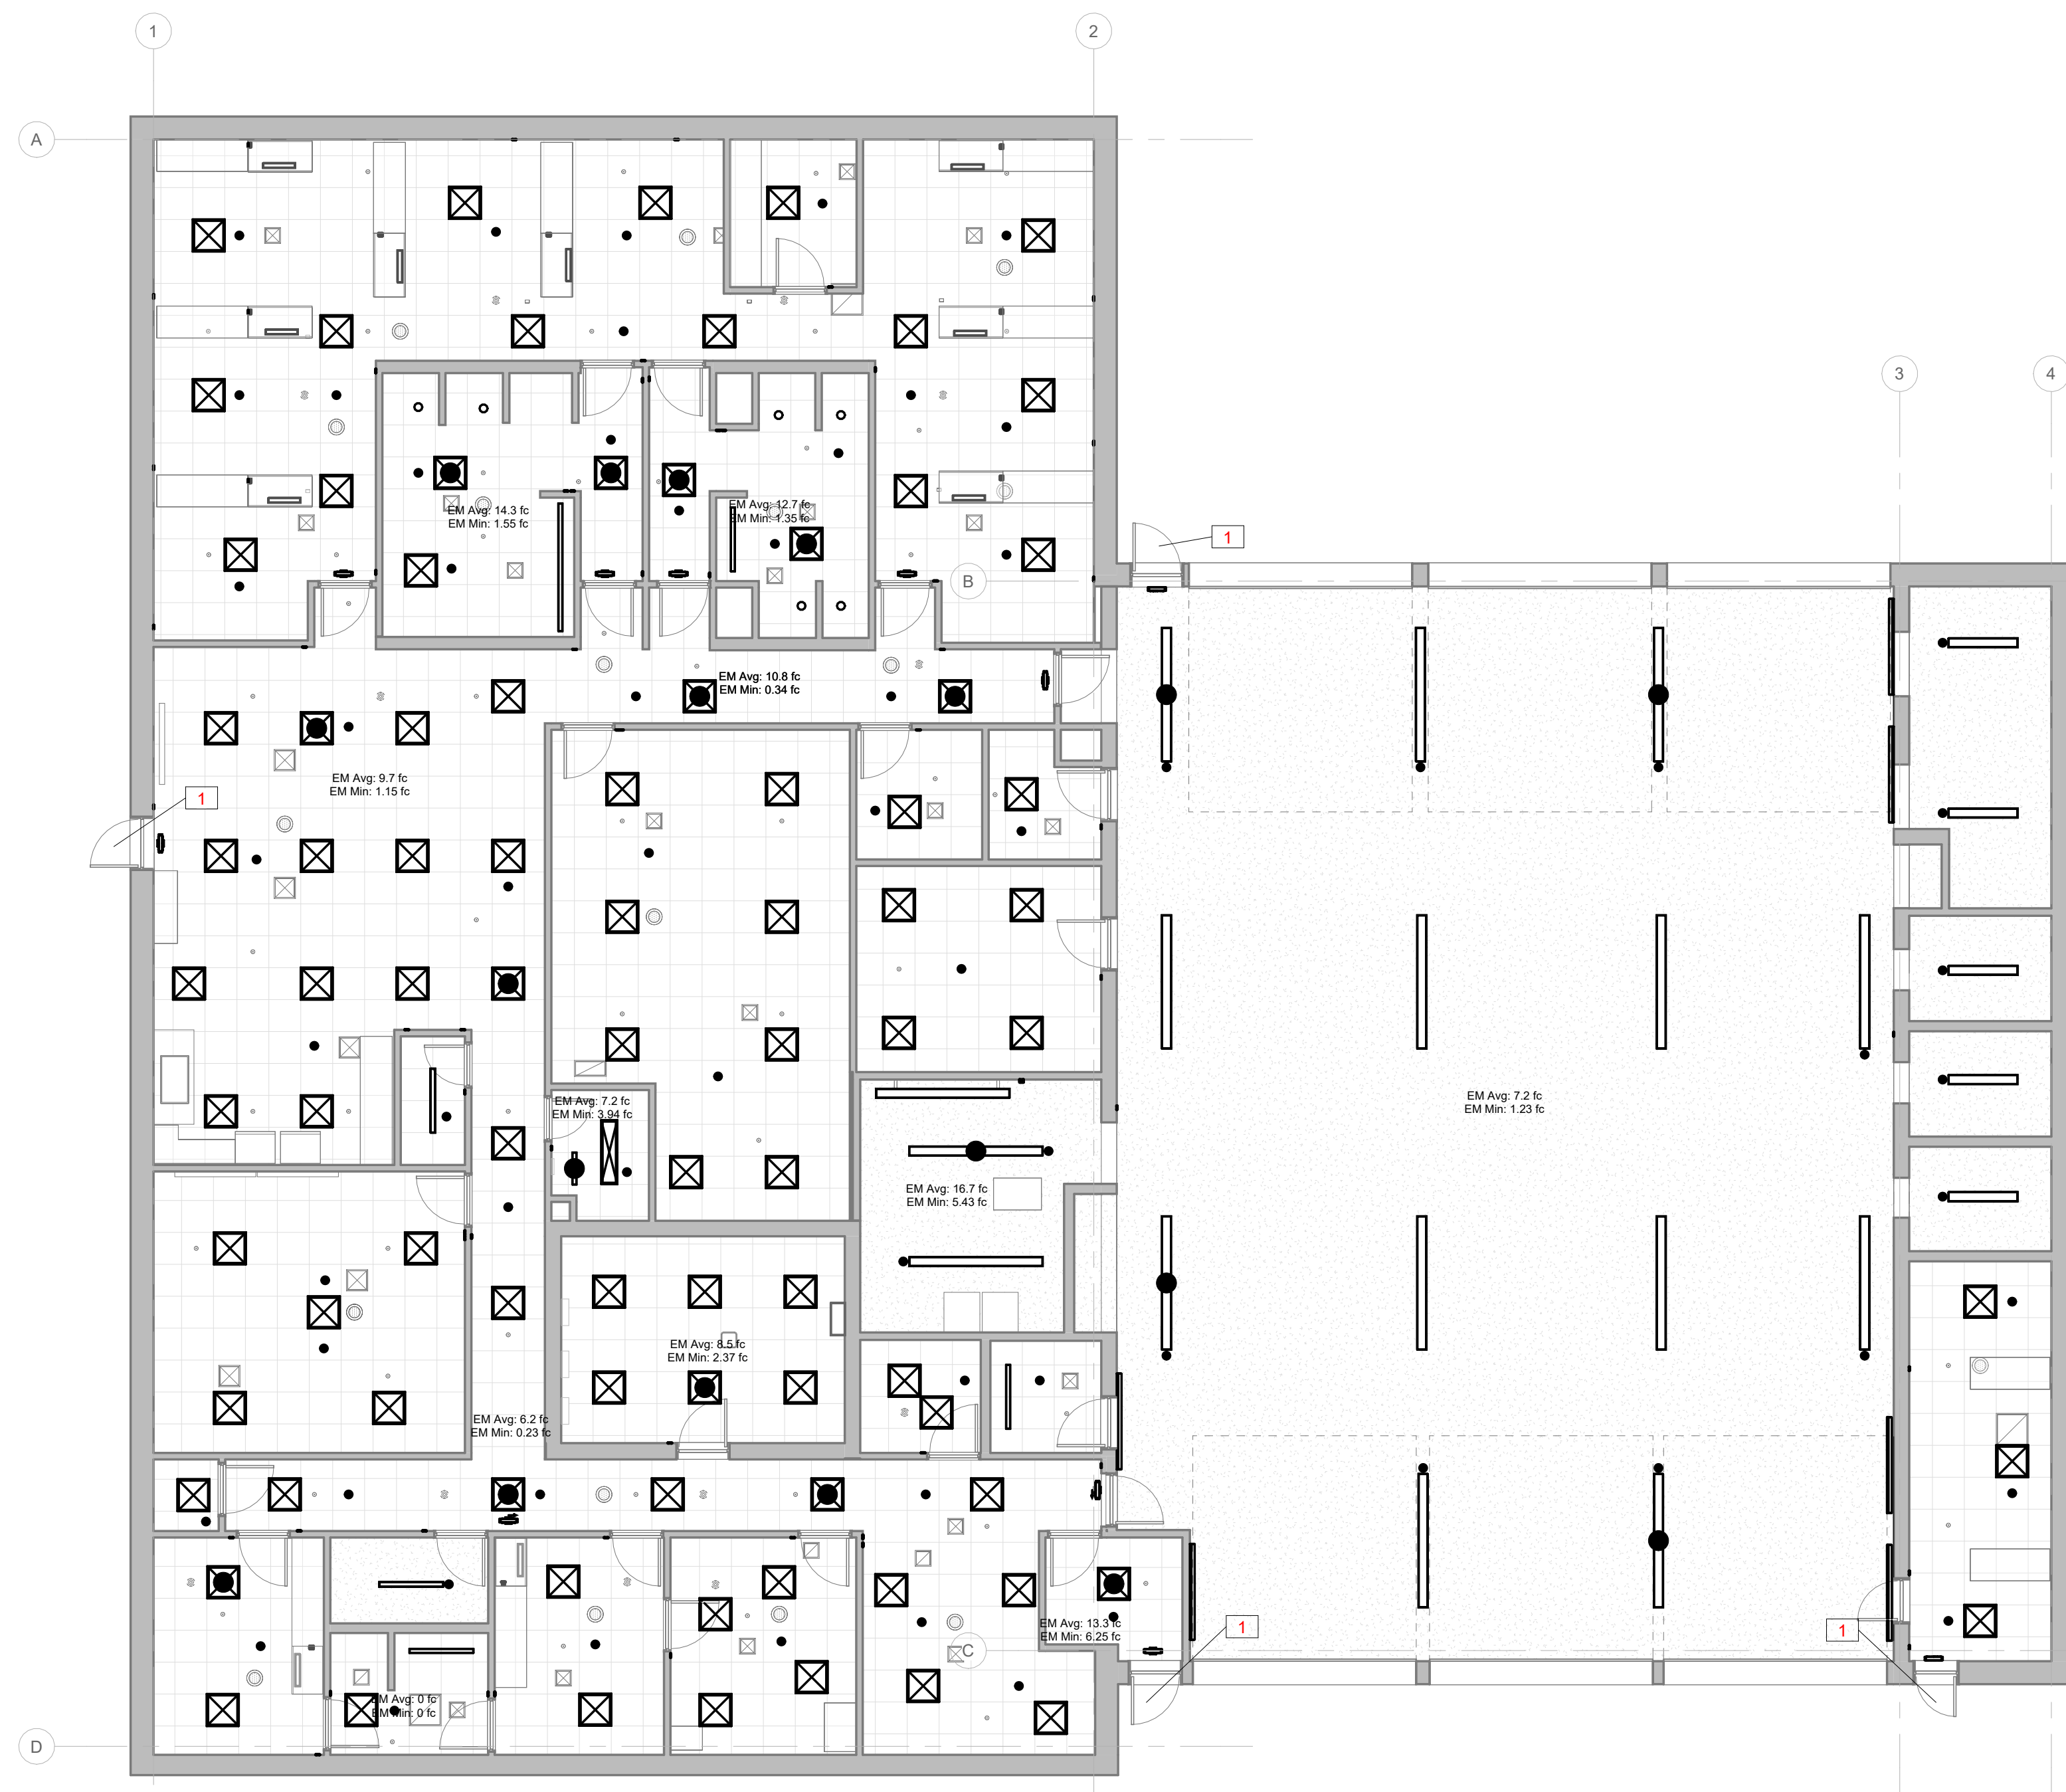

① EL Egress - Level 1 1/8" = 1'-0"

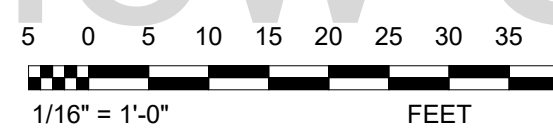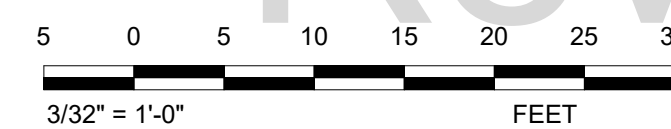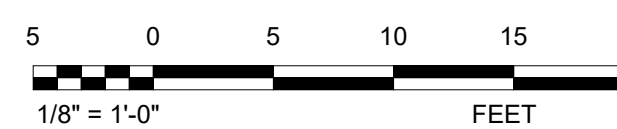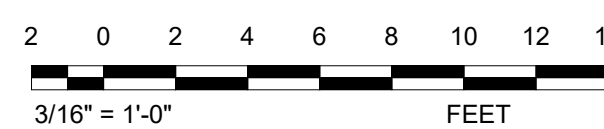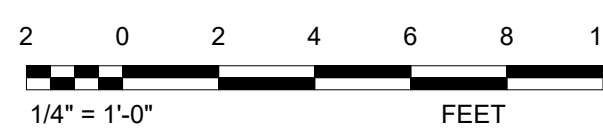

Review Set - Not for Construction

Location:
3945 Lien Road
Madison, WI 53714

Fire Station 8
Lighting Retrofit
(BPW)

[illegible]

Project North


TRUE



Interior

EL 200

Print Date:
4/2/2025 14:21:04
Print in color on 24" x 36"

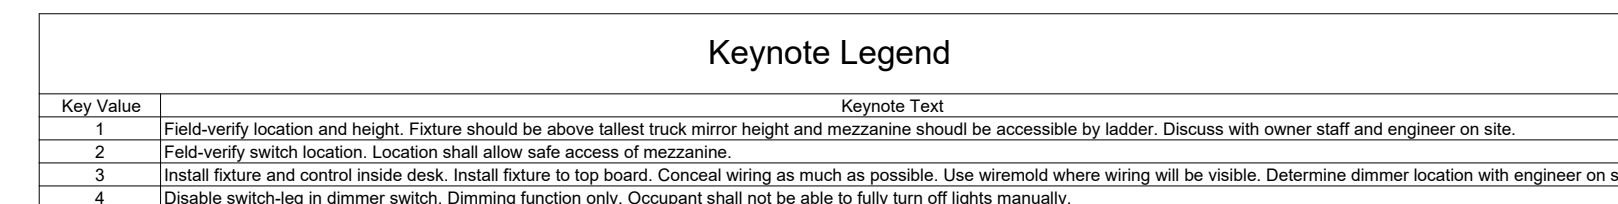

② EL - Level 2 $3/16" = 1'-0"$

Review Set - Not for Construction

