URBAN DESIGN COMMISSION APPLICATION



City of Madison Planning Division Madison Municipal Building, Suite 017 215 Martin Luther King, Jr. Blvd. P.O. Box 2985 Madison, WI 53701-2985 (608) 266-4635



FOR OFFICE USE ONLY:	
Date Received	Initial Submittal
Paid	■ Revised Submittal

_	(000	7 200-4033											
	Complete all sections of this application, including the desired meeting date and the action requested. If your project requires both UDC and Land Use application submittals, a completed Land Use Application and accompanying submittal materials are also required to be submitted.					If you need an interpreter, translator, materials in alternate formats or other accommodations of access these forms, please call the Planning Division at (608) 266-4635. Si necesita interprete, traductor, materiales en diferentes formatos, u otro tipo de ayuda paracceder a estos formularios, por favor llame al (608) 266-4635. Yog tias koj xav tau ib tug neeg txhais lus, tus neeg txhais ntawv, los sis xav tau contaub ntawv ua lwm hom ntawv los sis lwm cov kev pab kom paub txog cov lus qhi no, thov hu rau Koog Npaj (Planning Division) (608) 266-4635.							
1.	Proj	ect Informatio	on										
	Add	ress (list all add	resses on the	project site): 521 E Washingto	n Avenu	e							
						27 AV 1 2 30578							
		lication Type		at apply) and Requested D	ate								
		New developr	requested		or previ	ously-approved development							
	☐ Informational ☑ Initial Approval					Final Approval							
3.	Proi	ect Type											
	Project Type ✓ Project in an Urban Design District □ Project in the Downtown Core District (DC), Urban Mixed-Use District (UMX), or Mixed-Use Center District (MXC) □ Project in the Suburban Employment Center District (SEC), Campus Institutional District (CI), or Employment Campus District (EC) □ Planned Development (PD) □ General Development Plan (GDP) □ Specific Implementation Plan (SIP) □ Planned Multi-Use Site or Residential Building Complex					 ☐ Modifications of Height, Area, and Setback ☐ Sign Exceptions as noted in Sec. 31.043(3), MGO Other 							
4.	Appl	icant, Agent,	and Propert	y Owner Information									
		icant name	John Leja		Cor	npany LZ Ventures							
	12 27	et address	8301 Machin	ne Drive, Suite 102		//State/Zip Madison, WI 53717							
100	Telep	Felephone 608-831-3326				ail jleja@me.com							
	Project contact person Duane Johnson				Company Knothe & Bruce Architects								
		t address		way Blvd. Ste 900	50.00011350	//State/Zip Middleton, WI 53562							
9	Telep	hone	608-836-369	90	Email djohnson@knothebruce.com								
	Prop	erty owner (if	not applican	nt)									
		t address				//State/Zip							
25	Teler	hone				ail							

URBAN DESIGN COMMISSION APPROVAL PROCESS



Introduction

The City of Madison's Urban Design Commission (UDC) has been created to:

- Encourage and promote high quality in the design of new buildings, developments, remodeling, and additions so as to maintain and improve the established standards of property values within the City.
- Foster civic pride in the beauty and nobler assets of the City, and in all other ways possible assure a functionally efficient
 and visually attractive City in the future.

Types of Approvals

There are three types of requests considered by the UDC:

- Informational Presentation. A request for an Informational Presentation to the UDC may be requested prior to seeking any
 approvals to obtain early feedback and direction before undertaking detailed design efforts. Applicants should provide
 details on the context of the site, design concept, site and building plans, and other relevant information to help the UDC
 understand the proposal and provide feedback. (Does not apply to CDR's or Signage Modification requests)
- <u>Initial Approval</u>. Applicants may, at their discretion, request Initial Approval of a proposal by presenting preliminary design information. As part of their review, the Commission will provide feedback on the design information that should be addressed at Final Approval stage.
- <u>Final Approval</u>. Applicants may request Final Approval of a proposal by presenting all final project details. Recommendations
 or concerns expressed by the UDC in the Initial Approval must be addressed at this time.

Presentations to the Commission

The Urban Design Commission meets virtually via Zoom, typically on the second and fourth Wednesdays of each month at 4:30 p.m. Applicant presentations are strongly encouraged, although not required. Prior to the meeting, each individual speaker is required to complete an online registration form to speak at the meeting. A link to complete the online registration will be provided by staff prior to the meeting. Please note that individual presentations will be limited to a **maximum of three (3) minutes**. The pooling of time may be utilized to provide one speaker more time to present, however the additional time will be based on the number of registrants from the applicant team, i.e. two (2) applicant registrants = six (6) minutes for one (1) speaker.

Primarily, the UDC is interested in the appearance and design quality of projects. Emphasis should be given to the site plan, landscape plan, lighting plan, building elevations, exterior building materials, color scheme, and graphics. Please note that presentation slides, in a PDF file format, are required to be submitted **the Friday before** the UDC meeting.

URBAN DESIGN DEVELOPMENT PLANS CHECKLIST



The items listed below are minimum application requirements for the type of approval indicated. Please note that the UDC and/or staff may require additional information in order to have a complete understanding of the project.

1. Info	rma	tional Presentation								
		Letter of Intent (If the project is within an Urban Design District, a summary of how the development proposal addresses the district criteria is required) Contextual site information, including photographs and layout of adjacent buildings/structures Site Plan Two-dimensional (2D) images of proposed buildings or structures.		Providing additional information beyond these minimums may generate a greater level of feedback from the Commission.	d these 4. Scale, both written and granerate 5. Date					
2. Initia	ΙΔr		,		pians	(ij require	a)			
		Locator Map Letter of Intent (If the project is within a letter of Intent (If the project is within a letter of Intent (If the project is within a letter of Intent (If the project is within a letter of Intent (If the project is within a letter of Intent (If applicable) Letter of Intent (If the project is within a letter of Intent (If applicable)	et cr aphs prop amer ble)	iteria is required) and layout of adjacent building posed buildings, walks, drive ter	gs/stru es, bik	ectures e lanes,		Providing additional information beyond these minimums may generate a greater level of feedback from the Commission.		
3. Final	App	proval								
		equirements of the Initial Approval (see above Grading Plan Lighting Plan, including fixture cut sheets an Utility/HVAC equipment location and screen Site Plan showing site amenities, fencing, trapposed sign areas and types (if applicable) Proposed sign areas and types (if applicable)	nd pl ning ash,	notometrics plan (must be le details (with a rooftop plan i	if roof-)			
4. Signa	ge /	Approval <i>(Comprehensive Design Review (C</i>	DR)	, Sign Modifications, and Sig	n Exce	ptions (pe	er <u>S</u>	ec. 31.043(3))		
		Locator Map Letter of Intent (a summary of <u>how</u> the proposed Contextual site information, including phot project site Site Plan showing the location of existing sig driveways, and right-of-ways	ogra	aphs of existing signage bot	h on s	site and w	vithi	in proximity to the		
		Proposed signage graphics (fully dimensioned Perspective renderings (emphasis on pedestallustration of the proposed signage that med Graphic of the proposed signage as it relates	ets	/automobile scale viewshed <u>Ch. 31, MGO</u> compared to w	s) hat is	being requ	vein R vi			

		20 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0	000
5. Re	equir	ed Submittal Materials	
[JA	pplication Form	
	•		pearance. For projects also requiring Plan Commission approval, ation for Plan Commission consideration prior to obtaining any
] Le	tter of Intent	
		criteria is required.	nary of how the development proposal addresses the district
	•	For signage applications, a summary of how the proposed Review (CDR) or Signage Modification review criteria is re	signage is consistent with the applicable Comprehensive Design quired.
] De	evelopment Plans (Refer to checklist on Page 4 for plan det	cails)
] Fil	ing Fee (Refer to Section 7 (below) for a list of application f	ees by request type)
] El	ectronic Submittal	
	•	for a UDC meeting. Late materials will not be accepted. A PDF files of each item submitted should be submitted v must include the project address, project name, and appl	
	•		d 20MB and it is the responsibility of the applicant to present files to provide the materials electronically should contact the Planning
	J No	otification to the District Alder	
	٠	Please provide an email to the District Alder notifying the early in the process as possible and provide a copy of that	em that you are filing this UDC application. Please send this as temail with the submitted application.
6. A	plica	ant Declarations	
1.		ior to submitting this application, the applicant is required to disapplication was discussed with Jessica Vaughn	iscuss the proposed project with Urban Design Commission staff. on 3/19/24
2.	is		this submittal and understands that if any required information will not be placed on an Urban Design Commission agenda for
Na	me c	of applicant John Leja	Relationship to property Owner
		zing signature of property owner John J Leja	Date 5/13/24
7. Ap	plica	ation Filing Fees	
Fed sch Cit Bu an	e pay nedul y of I ilding d incl	ments are due by the submittal date. Payments received ed for the next application review cycle. Fees may be paid in Madison Building Inspection, P.O. Box 2984, Madison, WI 53 at 215 Martin Luther King, Jr. Blvd. on the E Doty Street sides.	after the submittal deadline may result in the submittal being n-person, via US Mail, or City drop box. If mailed, please mail to: 8701-2984. The City's drop box is located outside the Municipal e of the building. Please make checks payable to City Treasurer, as the project location and applicant information with all checks
Ple	ase o	consult the schedule below for the appropriate fee for your	request:
] Ui	ban Design Districts: \$350 (per §33.24(6) MGO).	A filing fee is not required for the following project
_	(D	inor Alteration in the Downtown Core District IC) or Urban Mixed-Use District (UMX): \$150 er <u>\$33.24(6)(b) MGO</u>)	applications if part of the combined application process involving both Urban Design Commission and Plan Commission:
		omprehensive Design Review: \$500 er <u>§31.041(3)(d)(1)(a) MGO</u>)	 Project in the Downtown Core District (DC), Urban Mixed-Use District (UMX), or Mixed-Use Center District (MXC)
		inor Alteration to a Comprehensive Sign Plan: \$100 er §31.041(3)(d)(1)(c) MGO)	Project in the Suburban Employment Center District (SEC), Campus Institutional District (CI), or Employment
			Campus District (EC)

Planned Multi-Use Site or Residential Building Complex

(GDP) and/or Specific Implementation Plan (SIP)

Planned Development (PD): General Development Plan

All other sign requests to the Urban Design Commission, including, but not limited to: appeals from the decisions of

approvals: \$300 (per §31.041(3)(d)(2) MGO)

the Zoning Administrator, requests for Sign Modifications

(of height, area, and setback), and additional sign code

May 13, 2024

Mr. Bill Fruhling
Department of Planning & Community & Economic Development
Madison Municipal Building, Suite 017
215 Martin Luther King Jr. Blvd.
Madison, WI 53703



Re: Letter of Intent

Porchlight Redevelopment 521 East Washington Ave. KBA Project # 2379

Mr. Bill Fruhling:

The following is submitted together with the plans and application for the staff and Plan Commission's consideration of approval.

Organizational structure:

Owner: LZ Ventures Architect: Knothe & Bruce Architects, LLC

c/o Angie Black 8401 Greenway Blvd. Ste 900

Carlson Black O'Callaghan & Battenberg Middleton, WI 53562

222 W. Washington Ave., Suite 705 608-836-3690
Madison, WI 53703 Contact: Duane Johnson

angie.black@carlsonblack.com djohnson@knothebruce.com

Engineer: Wyser Engineering Landscape Figure-Ground LLC
300 E Front Street Design: Middleton, WI 53562

Mt. Horeb, WI 53572 (608) 345-5101 (608) 437-1862 Contact: Joe Porter

Contact: Wade Wyse jporter@figureground-design.com
Wade.wyse@wyserengineering.com

Introduction:

This proposed project involves the redevelopment of the current site at 521 E Washington Avenue which has a two-level commercial office building, located on the southern corner of S Blair Street and E Washington Avenue. The proposed redevelopment would consist of a new 8-story building with administrative offices on the first floor and partial basement and 70 residential units on floors 2 through 8. There will be 8 surface parking stalls accessed off Blair St. The facility would be utilized by Porchlight for their administrative headquarters as well as long-term stable affordable housing, this would replace their current facility located on Brooks Street.

Porchlight and LZ Ventures have fostered a mutual respect and great working relationship which has developed over the past 15 years sharing the same block with Porchlights current facility on Brooks St and LZ's Grand Central and X-01 student housing facilities. This is an incredible opportunity for Porchlight to substantially improve its housing and services and therefore ultimately fulfill its mission of reducing

homelessness and providing affordable housing, and LZ ventures is excited to be a part of the solution. The proposed facility would have studio apartments, instead of the current (single room occupancy) SRO's which are at Brooks St. location. This would be life changing for the residents and greatly reduce Porchlights operational and maintenance commitments, freeing up funds to be used elsewhere. In addition, this central location will provide residents with more convenient accessibility to transportation, including the new Bus Rapid Transit line, city services, employment opportunities and living needs. Due to the generosity of LZ Ventures, this project requires no financial assistance from the city or state. This project will be a much-needed upgrade for the Porchlight non-profit organization to help with home and job placement, improving the lives of Madison citizens.

The site is located on the south corner of E. Washington Avenue and S Blair St. It is composed of one parcel in a UMX zoning district, the site is approximately 0.24 acres in area.

This application requests demolition of the existing structure and conditional use approval to allow greater than 8 dwelling units for the development of the new Porchlight facility. An application for a Certified Survey Map is being submitted contemporaneously to remove the underlying lot lines to complete the building parcel.

<u>Downtown Plan & Urban Design District</u>

The property is within the boundaries of the City of Madison Downtown Plan adopted in July 2012. The Plan was the product of 4 plus years of work including 125 group meetings with neighborhood and community groups, City Boards and Commissions, business owners and many other interested parties.

The Plan places the site within the Downtown Core which is recommended for the highest intensity of development within the city. One of the Plan's key recommendations is to accommodate future growth within the downtown. The Plan's Parcel Analysis Map identifies the site as an "underutilized site and/or obsolete building" and one of the sites for potential redevelopment to accommodate the City's growth for a 20-year horizon. The parcel analysis considered among other factors; parcel size, existing use, building condition, architectural character, and land valuation.

The Downtown Plan also provides guidelines for building height and designates this site as having a maximum building height of 8 stories.

The property is also located within Urban Design District #4 (UDD 4), which establishes the purpose of improving the appearance of those major transportation corridors east of the Capitol Square. UDD 4 has limited scope for building design. It does speak to general compatibility of building designs and for building materials to be low maintenance and harmonious with others in the area and to avoid large unbroken exterior facades.

Existing Structures and Proposed Deconstruction

The site is currently occupied by a two-level, 5,013 SF office building located at 521 E Washington Ave. The building, constructed in 1958, was originally a gas station but was converted to an office space in 1981, with an addition constructed in 1989. The building most recently was the home of Monarch Health and has been listed for sale since April 2023.

Given that the building is not historically or architecturally significant and that the Downtown Plan recommends the properties for redevelopment, and that the proposed redevelopment is consistent with

the underlying zoning and City plans, it is our opinion that the that the standards for demolition can be met and a Re-use and Recycling Plan will be submitted prior to the deconstruction of the existing structure. This building would not be a good prospect for relocation.

Project Description:

The proposed development is an 8-story residential building with 70 studio apartments, administrative offices and 8 surface parking stalls. The apartments are designed to help lower income residents. Employee parking is provided on-site, and the proposed redevelopment will not be requesting residential parking permits.

The project is well located to take advantage of public transportation as well as bike paths and is within walking distance of a grocery store as well as restaurants. There is also an abundance of streets with dedicated bike lanes within the area.

The proposed design of this building will incorporate simple balanced massing and a thoughtful use of materials. Sitting at the intersection of East Washington & Blair Streets; The most prominent architectural feature occurs at this important intersection. A proud massing announces the presence of the building as well as the main entry into this facility, with neat and orderly metal composite wall panels punched with windows. A durable masonry base anchors the building, balanced by open aluminum storefront windows which bathe the interior administrative spaces with natural light. The projecting masses above contrast the lighter colored masonry with a dark metal skin. This low maintenance material will best serve the tenants functional needs and create visual interest as wraps around the building. Recessed reliefs in the volume of the building adds an embellishment of color to the elevations in addition to identifying entry & vertical circulation. Window louvers add a textural change to the planar form of the otherwise clean metal wall cladding.

Site Development Data:

ח	Δ	ns	i+	i۵	c	٠
υ	C	ııs	ıι	ıc	3	•

Gross Lot Area 10,527 sf or .24 acres

Dwelling Units 70 DU
Lot Area / D.U. 150 sf / Unit

Building Height 8 stories

Lot Coverage 8,290 sf (78.7%)
Usable Open Space 740 sf (10.6 SF / Unit)

Dwelling Unit Mix:

Efficiency 70
Total Dwelling Units 70

Vehicle Parking:

Surface 8 stalls (including 1 EV ready)

Total 8 stalls

Bicycle Parking:

Garage – Residential 64 stalls

Surface – Residential	6 stalls
<u>Surface – Commercial / Guests</u>	<u>8 stalls</u>
Total	78 stalls


Project Schedule:

It is anticipated that the construction will begin in January 2025 with a final completion in November 2025.

Thank you for your time reviewing our proposal.


Sincerely,

Duane Johnson, AIA, Partner

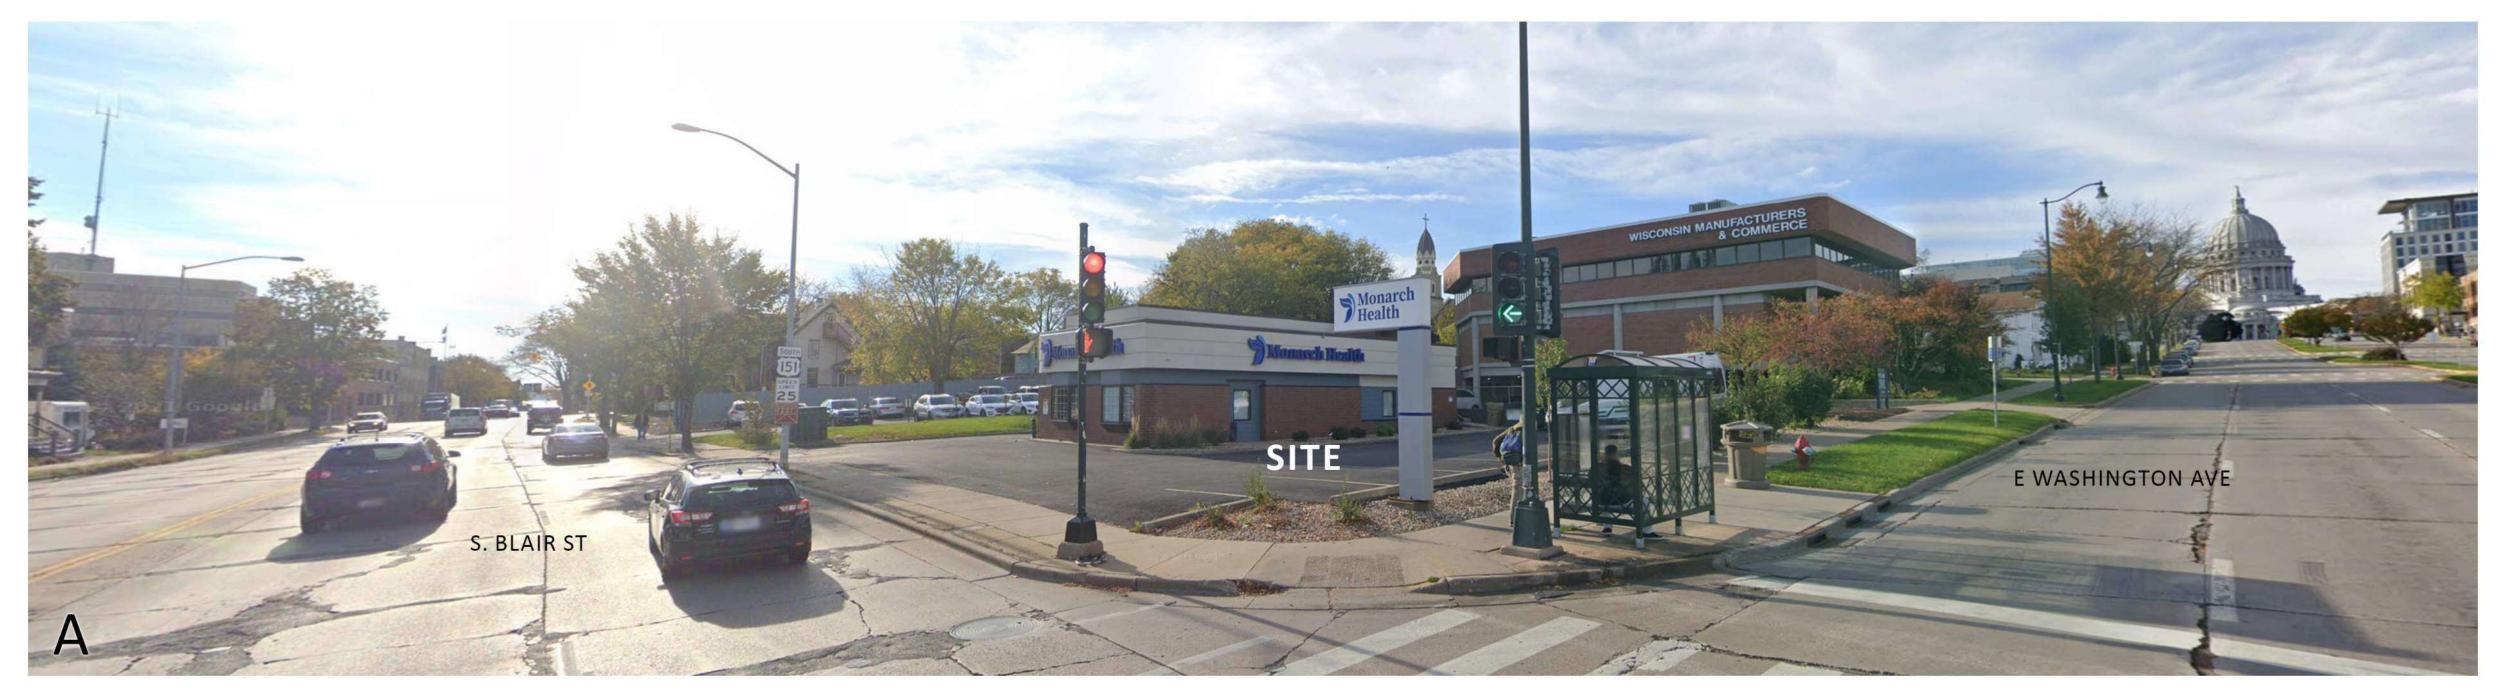







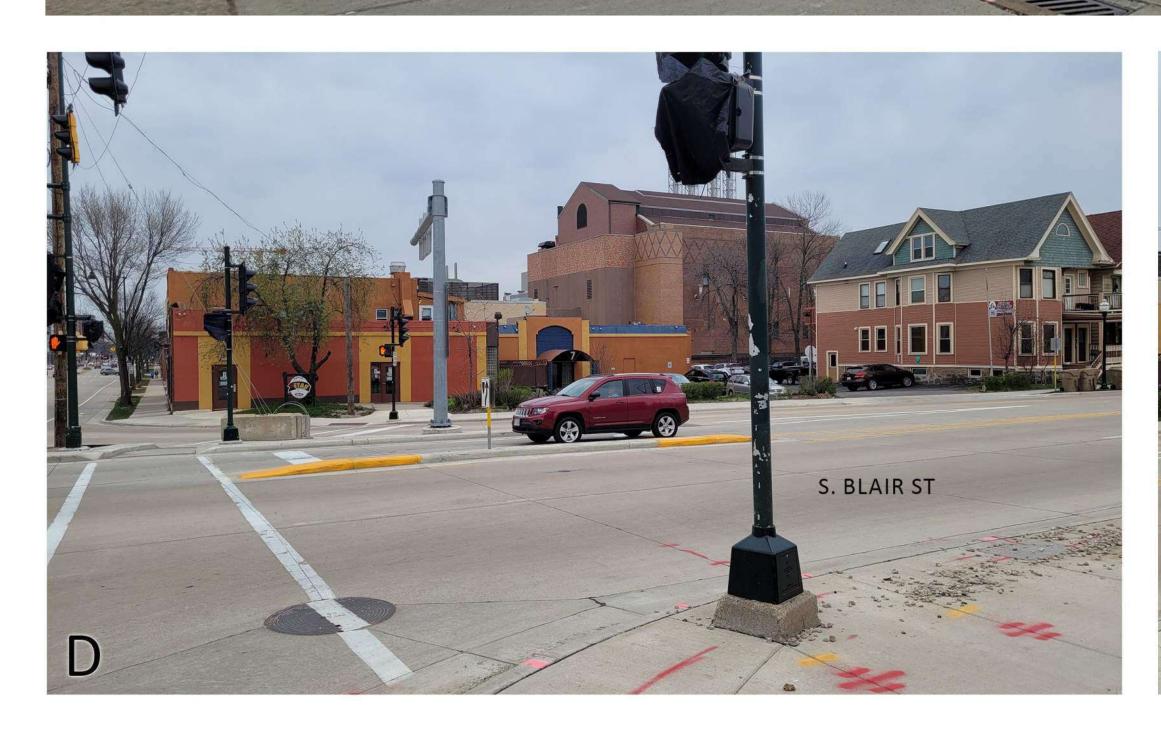



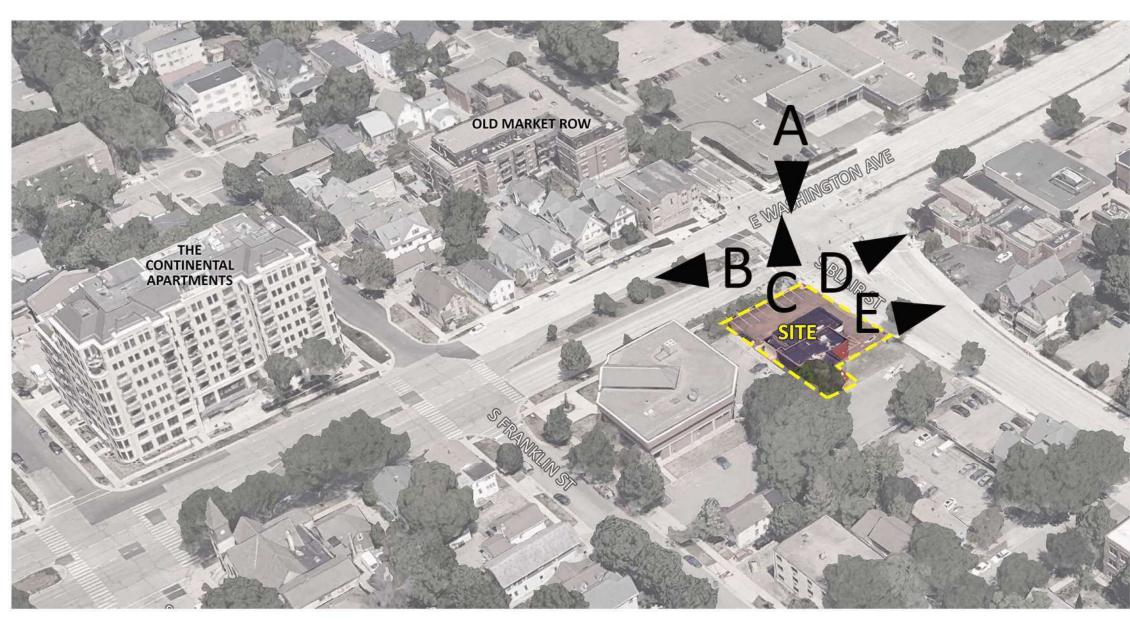







D-Series Pole Mount

LED Area Luminaire







an

Specifications

Luminaire


EPA: 0.8 ft² (.07 m²)


Width: 13-3/4" (34.9 cm)

Length: 11.5"

Height: 8" (20.3 cm)

Weight: 16.03 lbs





Catalog Number

Notes

Туре

Hit the Tab key or mouse over the page to see all interactive elements

Introduction

The D-Series Pole Mount luminaire is a stylish, fully integrated LED solution for area and site applications. It features a sleek, modern design and is carefully engineered to provide long-lasting, energy-efficient lighting with a variety of optical and control options for customized performance.

With an expected service life of over 20 years of nighttime use and up to 74% in energy savings over comparable 250W metal halide luminaires, the D-Series Pole Mount is a reliable, low-maintenance lighting solution that produces sites that are exceptionally illuminated.

Ordering Information

EXAMPLE: DSXWPM LED 20C 1000 40K T5M MVOLT SPUMBA DDBXD

DSXWPM LED						
Series	LEDs	Drive current	Color temperature	Distribution	Voltage	Mounting ³
DSXWPM LED	10C 10 LEDs (one engine) 20C 20 LEDs (two engines)	350 350 mA 530 530 mA 700 700 mA 1000 1000 mA (1 A)	30K 3000K 40K 4000K 50K 5000K AMBPC Amber phosphor converted	T2S Type II short T5M Type V medium T2M Type II medium T5S Type V short T3S Type III short T5A Type V area T3M Type III medium T5W Type V wide T4M Type IV medium SYMDF Symmetric diffuse TFTM Forward throw medium	MVOLT ¹ 120 ¹ 208 ¹ 240 ¹ 277 ¹ 347 ² 480 ²	Shipped included SPUMBA Square pole universal mounting adapter RPUMBA Round pole universal mounting adapter PUMBA Square and round universal mounting adapters

Control Opt	ions	Othe	r Options			Finish (rec	Finish (required)					
Shipped in	stalled	Ship	oped installed	Shipp	oed separately ⁹	DDBXD	Dark bronze	DDBTXD	Textured dark bronze			
PE	Photoelectric cell, button type 4	SF	Single fuse (120, 277, 347V) 8	BSW	Bird-deterrent spikes	DBLXD	Black	DBLBXD	Textured black			
DMG	0-10v dimming wires pulled outside fixture (for use	DF Double fuse (208, 240, 480 V) 8 WG	WG	Wire guard	DNAXD	Natural aluminum White	DNATXD	Textured natural aluminum				
	with an external control, ordered separately)		HS House-side shield 8	VG	Vandal guard		DWHXD	DWHGXD	Textured white			
PIR	Motion/ambient light sensor, <15' mtg ht 5,6					DDL	Diffused drop lens	DSSXD	Sandstone	DSSTXD	Textured sandstone	
PIRH	Motion/ambient light sensor, 15-30' mtg ht 5,6				552	binasea arop iens	DOSKO	Sunustone	5551,70	restared surfactorie		
PIR1FC3V	Motion/ambient sensor, 8-15' mounting height, ambient sensor enabled at 1fc ⁷											
PIRH1FC3V	Motion/ambient sensor, 15–30' mounting height, ambient sensor enabled at 1fc ⁷											

NOTES

- 1 MVOLT driver operates on any line voltage from 120-277V (50/60 Hz). Specify 120, 208, 240 or 277 options only when ordering with fusing (SF, DF options), or photocontrol (PE option).
- 2 Only available with 20C, 700mA or 1000mA. Not available with PIR, PIRH.
- 3 Not available with 90 degree mounting. Not recommended for 3" poles.
- 4 Photocontrol (PE) requires 120, 208, 240, 277 or 347 voltage option. Not available with motion/ambient light sensors (PIR or PIRH).
- 5 PIR specifies the SensorSwitch SBGR-10-ODP control; PIRH specifies the SensorSwitch SBGR-6-ODP control; see Motion Sensor Guide for details. Dimming driver standard. Includes ambient light sensor. Not available with "PE"option (button type photocell).
- Not available with 20 LED/1000 mA configuration (DSXWPM LED 20C 1000).
- 7 PIR1FC3V specify the SensorSwitch SBGR-10-ODP control; PIRH1FC3V specify the SensorSwitch SBGR-6-ODP control; see Motion Sensor Guide for details. Dimming driver standard. Not available with PER5 or PER7. Separate on/off required.
- 8 Single fuse (SF) requires 120, 277, or 347 voltage option. Double fuse (DF) requires 208, 240, or 480 voltage option.
- 9 Also available as a separate accessory; see Accessories information.


Accessories

Ordered and shipped separately.

House-side shield (one per light engine)

DSXWBSW U Bird-deterrent spikes
DSXW1WG U Wire guard accessory
DSXW1VG U Vandal guard accessory
DSXWDDL U Diffused drop lens





Visit Lithonia Lighting's POLES CENTRAL to see our wide selection of poles, accessories and educational tools.

If ordering new poles, specify the AERIS $^{\rm IM}$ drilling pattern, per the table below.

DM19AS Single unit **DM28AS** 2 at 180°

Example: SSA 20 4C DM19AS DDBXD

Performance Data

Lumen Output

Lumen values are from photometric tests performed in accordance with IESNA LM-79-08. Data is considered to be representative of the configurations shown, within the tolerances allowed by Lighting Facts. Actual performance may differ as a result of end-user environment and application. Actual wattage may differ by +/- 8% when operating between 120-480V +/- 10%. Contact factory for performance data on any configurations not shown here.

Mails Mail	6 LPW 1 64 1 61 1 63 1 63 1 63 1 64 0 67 0 68 1 64 1 57 1 59 1 63 1 60
14M	1 61 1 63 1 63 1 61 1 64 0 67 0 68 1 64 1 64 1 57 1 59 1 63
March Marc	1 63 1 63 1 61 1 64 0 67 0 68 1 64 1 64 1 57 1 59 1 63
STOMA 1,386 0 0 1 99 1,488 0 0 1 106 1,497 0 0 0 1 107 876 0 0 0 0 1 144 1,467 0 0 0 1 105 888 0 0 0 1 144 1,467 0 0 1 105 888 0 0 0 1 106 1,497 0 0 0 1 105 888 0 0 0 1 108 1,525 0 0 0 1 105 888 0 0 0 1 108 1,525 0 0 0 1 109 1,535 0 0 0 1 109 1,535 0 0 0 1 109 1,535 0 0 0 0 1 109 1,535 0 0 0 1 109 1,535 0 0 0 0 1 109 1,535 0 0 0 0 1 109 1,535 0 0 0 0 0 0 0 0 0	1 63 1 61 1 64 0 67 0 68 1 64 1 64 1 57 1 59 1 63
14W	1 61 1 64 0 67 0 68 1 64 1 64 1 57 1 59 1 63
16C 10C 10C 10C 10C 10C 10C 10C	1 64 0 67 0 68 1 64 1 64 1 57 1 59 1 63
10C 10 10 10 10 10 10 10	0 67 0 68 1 64 1 64 1 57 1 59 1 63
TSM	0 68 1 64 1 64 1 57 1 59 1 63
TSA	1 64 1 64 1 57 1 59 1 63
TSW	1 64 1 57 1 59 1 63
ASYDF	1 57 1 59 1 63
SYMDF	1 59 1 63
T2S	1 63
T2M 1,957 1 0 1 98 2,102 1 0 1 105 2,115 0 0 1 1 106 1,205 0 0 0 1 135 2,031 0 0 1 1 102 2,181 0 0 1 1 109 2,195 0 0 1 1 110 1,250 0 0 0 1 13M 2,010 1 0 1 101 2,159 1 0 1 108 2,172 0 0 1 1 109 1,237 0 0 0 1 14M 1,970 1 0 1 98 2,115 1 0 1 106 2,128 0 0 1 1 109 1,237 0 0 0 1 15M 2,159 1 0 0 1 1 100 2,195 1 0 0 1 1 100 1,260 0 0 1 1 100 2,195 1 0 0 1 1 100 2,195 1 0 0 1 1 100 2,195 1 0 0 1 1 100 1,260 0 0 1 1 100 2,195 1 0 0 1 1 100 2,195 1 0 0 1 1 100 2,195 1 0 0 1 1 100 1,260 0 0 1 1 100 2,195 1 0 0 1 1 100 2,195 1 0 0 1 1 100 2,195 1 0 0 1 1 100 1,260 0 0 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1	
T3S	1 60
T3M	
T4M 1,970 1 0 1 98 2,115 1 0 1 106 2,128 0 0 1 1 106 1,212 0 0 0 1 TFTM 2,047 0 0 1 1 102 2,198 0 0 1 1 110 2,212 0 0 0 1 1 111 1,260 0 0 0 1 TSM 2,156 1 0 0 1 18 2,315 2 0 0 1 16 2,329 1 0 0 116 1,326 1 0 1 0 TSS 2,199 1 0 0 110 2,361 1 0 0 118 2,376 1 0 0 119 1,353 1 0 TSS 2,099 1 0 0 1 1 103 2,221 2 0 0 1 1 111 2,235 1 0 0 1 19 1,127 1 0 TSW 2,065 2 0 1 1 103 2,221 2 0 0 1 1111 2,235 1 0 1 1112 1,271 1 0 TSW 2,065 2 0 1 1 103 2,221 2 0 1 1 111 2,235 1 0 0 1 1112 1,271 1 0 TSW 2,065 1 1 0 1 1 103 2,221 2 0 1 1 111 2,235 1 1 0 1 1 112 1,271 1 0 TSW 2,065 1 1,884 1 0 1 1 92 1,966 1 0 1 98 1,978 0 0 0 1 99 1,127 0 0 0 TSYMDF 1,884 1 0 1 1 94 2,023 1 0 1 1 101 2,036 1 0 1 102 1,160 1 0 TSYMDF 1,884 1 0 1 97 2,816 1 0 1 101 2,036 1 0 1 102 1,160 1 0 TSYMDF 1,884 2,499 1 0 1 93 2,684 1 0 1 1 99 2,770 0 0 1 100 1,472 0 0 TSYMDF 13M 2,567 1 0 1 96 2,785 1 0 1 103 2,802 0 0 1 1 104 1,527 0 0 TSYMDF 13M 2,567 1 0 1 98 2,757 1 0 1 102 2,774 0 0 1 104 1,527 0 0 0 TSYMDF 1,884 1 0 1 99 2,751 1 0 1 102 2,774 0 0 1 1 104 1,527 0 0 0 TSYMDF 1,884 1 0 1 99 2,751 1 0 1 102 2,774 0 0 1 103 1,512 0 0 0 TSYMDF 1,884 1 0 1 99 2,753 2 0 0 102 2,956 2 0 0 109 2,974 1 0 0 1 101 1,481 0 0 0 TSYMDF 1,555 1 0 0 1 1 98 2,836 2 0 1 10 10 1,23,34 1 0 0 110 1,661 1 0 TSYMDF 1,555 1 0 0 1 105 1,555 1 0 0 1 105 1,555 1 0 0 1 105 1,555 1 0 0 1 105 1,555 1 1 0 1 105 1,555 1 1 0 1 1 105 1,555 1 1 0 1 1 105 1,555 1 1 0 1 1 105 1,555 1 1 0 1 1 105 1,555 1 1 0 1 1 105 1,555 1 1 0 1 1 105 1,555 1 1 0 1 1 105 1,555 1 1 0 1 1 105 1,555 1 1 0 1 1 105 1,555 1 1 0 1 1 105 1,555 1 1 0 1 1 105 1,555 1 1 0 1 1 1 105 1,555 1 1 0 1 1 105 1,555 1 1	1 63
TFTM	1 62
TSM	1 61
10C TSM 2,156 1 0 0 108 2,315 2 0 0 116 2,329 1 0 0 0 116 1,326 1 0 0	1 63
TSA 2,068 2 0 1 103 2,221 2 0 1 1111 2,235 1 0 1 112 1,272 1 0 0 1 TSW 2,065 2 0 1 1 103 2,217 2 0 1 1 111 2,231 1 0 1 112 1,272 1 0 0 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1	0 66
TSW 2,065 2 0 1 103 2,217 2 0 1 111 2,231 1 0 1 112 1,271 1 0 ASYDE 1,830 1 0 1 92 1,966 1 0 1 98 1,978 0 0 1 1 99 1,127 0 0 0 SYMDF 1,884 1 0 1 94 2,023 1 0 1 101 2,036 1 0 1 102 1,160 1 1 0 1 102 1,160 1 1 102 1,160 1 1 0 1 102 1,160 1 1 102 1,160	0 68
10C ASYDF	1 64
TOCHEDS) SYMDF 1,884 1 0 1 94 2,023 1 0 1 101 2,036 1 0 1 102 1,160 1 0	1 64
(10 LEDs) T2S 2,623 1 0 1 94 2,023 1 0 1 101 2,036 1 0 1 102 1,160 1 0 0	1 56
T2M 2,499 1 0 1 93 2,684 1 0 1 99 2,701 0 0 1 100 1,472 0 0 0 T3S 2,593 1 0 1 96 2,785 1 0 1 103 2,802 0 0 1 104 1,527 0 0 0 T3M 2,567 1 0 1 95 2,757 1 0 1 102 2,774 0 0 1 103 1,512 0 0 T4M 2,515 1 0 1 93 2,701 1 0 1 100 2,718 0 0 1 101 1,481 0 0 TFIM 2,614 1 0 1 97 2,807 1 0 1 104 2,825 0 0 1 105 1,539 0 0 T5M 2,753 2 0 0 102 2,956 2 0 0 109 2,974 1 0 0 110 1,621 1 0 T5S 2,808 1 0 0 104 3,015 1 0 0 112 3,034 1 0 0 112 1,654 1 0 T5A 2,641 2 0 1 98 2,836 2 0 1 105 2,854 1 0 1 106 1,555 1 0	1 58
700mA 27W 12M 2,499 1 0 1 93 2,684 1 0 1 99 2,701 0 0 1 100 1,472 0 0	1 57
700mA	1 55
700mA	1 57
700mA 27W	1 56
T5M 2,753 2 0 0 102 2,956 2 0 0 109 2,974 1 0 0 110 1,621 1 0 15S 2,808 1 0 0 104 3,015 1 0 0 112 3,034 1 0 0 112 1,654 1 0 15A 2,641 2 0 1 98 2,836 2 0 1 105 2,854 1 0 1 106 1,555 1 0	1 55
T5M 2,753 2 0 0 102 2,956 2 0 0 109 2,974 1 0 0 110 1,621 1 0 T5S 2,808 1 0 0 104 3,015 1 0 0 112 3,034 1 0 0 112 1,654 1 0 T5A 2,641 2 0 1 98 2,836 2 0 1 105 2,854 1 0 1 106 1,555 1 0	1 57
T5A 2,641 2 0 1 98 2,836 2 0 1 105 2,854 1 0 1 106 1,555 1 0	0 60
	0 61
TSW 2027 2 0 1 00 2021 2 0 1 105 2040 1 0 1 105 105	1 58
T5W 2,637 2 0 1 98 2,831 2 0 1 105 2,849 1 0 1 106 1,553 1 0	1 58
ASYDF 2,337 1 0 1 87 2,510 1 0 1 93 2,526 1 0 1 94 1,376 1 0	1 51
SYMDF 2,406 1 0 1 89 2,584 1 0 1 96 2,600 1 0 1 96 1,417 1 0	1 52
T2S 3,685 1 0 1 92 3,957 1 0 1 99 3,982 1 0 1 100 2,235 1 0	1 58
T2M 3,512 1 0 1 88 3,771 1 0 1 94 3,795 1 0 1 95 2,130 1 0	2 55
T3S 3,644 1 0 1 91 3,913 1 0 1 98 3,938 1 0 1 98 2,210 1 0	2 57
T3M 3,607 1 0 1 90 3,874 1 0 1 97 3,898 1 0 1 97 2,187 1 0	2 56
T4M 3,534 1 0 1 88 3,795 1 0 1 95 3,819 1 0 1 95 2,143 1 0	2 55
TFTM 3,674 1 0 1 92 3,945 1 0 1 99 3,969 1 0 1 99 2,228 1 0	2 57
1000mA 40W T5M 3,868 2 0 1 97 4,153 2 0 1 104 4,179 3 0 1 104 2,345 3 0	1 60
T5S 3,946 1 0 0 99 4,237 2 0 0 106 4,264 2 0 0 107 2,393 2 0	1 62
T5A 3,711 2 0 1 93 3,985 2 0 1 100 4,010 3 0 1 100 2,250 3 0	2 58
TSW 3,705 2 0 1 93 3,978 2 0 1 99 4,003 3 0 1 100 2,247 3 0	
ASYDF 3,284 1 0 1 82 3,527 1 0 1 88 3,549 1 0 1 89 1,991 1 0	2 58
SYMDF 3,381 1 0 1 85 3,630 1 0 1 91 3,653 2 0 1 91 2,050 2 0	2 58 2 51



Performance Data

Lumen Output

Lumen values are from photometric tests performed in accordance with IESNA LM-79-08. Data is considered to be representative of the configurations shown, within the tolerances allowed by Lighting Facts. Actual performance may differ as a result of end-user environment and application. Actual wattage may differ by +/- 8% when operating between 120-480V +/- 10%. Contact factory for performance data on any configurations not shown here.

LEDs	Drive Current	System	Dist.		(3000	30K K 70 C	'RI)			(4000	40K K 70 C	'RI)			(5000	50K K 70 (RI)		(Ambe		MBPC	onvert	ed)
LLUS	(mA)	Watts	Туре	Lumens	В	11	G	LPW	Lumens	В	IJ	G	LPW	Lumens	В	II	G	LPW	Lumens	В	U	G	LPW
	(11111)		T2S	2,820	1	0	1	118	3,028	1	0	1	126	3,047	1	0	1	127	1,777	1	0	1	74
			T2M	2,688	1	0	1	112	2,886	1	0	1	120	2,904	1	0	1	121	1,693	1	0	1	71
			T3S	2,789	1	0	1	116	2,995	1	0	1	125	3,013	1	0	1	126	1,757	0	0	1	73
			T3M	2,761	1	0	1	115	2,964	1	0	1	124	2,983	1	0	1	124	1,739	1	0	1	72
			T4M	2,705	1	0	1	113	2,904	1	0	1	121	2,922	1	0	1	122	1,704	1	0	1	71
			TFTM	2,811	1	0	1	117	3,019	1	0	1	126	3,038	1	0	1	127	1,771	0	0	1	74
	350mA	24W	T5M	2,960	2	0	1	123	3,178	2	0	1	132	3,198	2	0	1	133	1,865	1	0	0	78
			T5S	3,020	1	0	0	126	3,242	1	0	0	135	3,263	1	0	0	136	1,903	1	0	0	79
			T5A	2,840	2	0	1	118	3,049	2	0	1	127	3,068	2	0	1	128	1,789	2	0	1	75
			T5W	2,835	2	0	1	118	3,044	2	0	1	127	3,063	2	0	1	128	1,786	2	0	1	74
			ASYDF	2,513	1	0	1	105	2,699	1	0	1	112	2,716	1	0	1	113	1,584	1	0	1	66
			SYMDF	2,587	1	0	1	108	2,778	1	0	1	116	2,796	1	0	1	116	1,630	1	0	1	68
			T2S	4,079	1	0	1	113	4,380	1	0	1	122	4,408	1	0	1	122	2,504	1	0	1	70
			T2M	3,887	1	0	1	108	4,174	1	0	1	116	4,200	1	0	1	117	2,387	1	0	1	66
			T3S	4,034	1	0	1	112	4,332	1	0	1	120	4,359	1	0	1	121	2,477	1	0	1	69
			T3M	3,993	1	0	1	111	4,288	1	0	1	119	4,315	1	0	1	120	2,451	1	0	2	68
			T4M	3,912	1	0	2	109	4,201	1	0	2	117	4,227	1	0	1	117	2,402	1	0	1	67
	520 4	2411	TFTM	4,066	1	0	1	113	4,367	1	0	1	121	4,394	1	0	1	122	2,496	1	0	1	69
	530mA	36W	T5M	4,281	3	0	1	119	4,597	3	0	1	128	4,626	3	0	1	129	2,629	3	0	1	73
			T5S	4,368	2	0	1	121	4,690	2	0	1	130	4,719	2	0	1	131	2,682	2	0	1	75
			T5A	4,108	3	0	2	114	4,411	3	0	2	123	4,438	3	0	2	123	2,522	3	0	2	70
			T5W	4,101	3	0	2	114	4,403	3	0	2	122	4,431	3	0	2	123	2,518	3	0	2	70
			ASYDF	3,635	1	0	2	101	3,904	1	0	2	108	3,928	1	0	2	109	2,232	1	0	1	62
20C			SYMDF	3,742	2	0	2	104	4,018	2	0	2	112	4,044	2	0	2	112	2,297	2	0	2	64
(20150-)			T2S	5,188	1	0	1	110	5,571	1	0	1	119	5,606	1	0	1	119	3,065	1	0	1	65
(20 LEDs)			T2M	4,945	1	0	1	105	5,310	1	0	1	113	5,343	1	0	1	114	2,921	1	0	1	62
		47W	T3S	5,131	1	0	1	109	5,510	1	0	2	117	5,544	1	0	2	118	3,031	1	0	1	64
			T3M	5,079	1	0	2	108	5,454	1	0	2	116	5,488	1	0	2	117	3,000	1	0	1	64
			T4M	4,976	1	0	2	106	5,343	1	0	2	114	5,377	1	0	2	114	2,939	1	0	1	63
	700mA		TFTM	5,172	1	0	2	110	5,554	1	0	2	118	5,589	1	0	2	119	3,055	1	0	1	65
			T5M	5,446	3	0	1	116	5,848	3	0	1	124	5,884	3	0	1	125	3,217	3	0	1	68
			T5S	5,555	2	0	1	118	5,966	2	0	1	127	6,003	2	0	1	128	3,282	2	0	1	70
			T5A	5,225	3	0	2	111	5,610	3	0	2	119	5,645	3	0	2	120	3,086	3	0	2	66
			T5W	5,216	3	0	2	111	5,601	3	0	2	119	5,636	3	0	2	120	3,081	3	0	2	66
			ASYDF	4,624	1	0	2	98	4,966	1	0	2	106	4,997	1	0	2	106	2,732	1	0	1	58
			SYMDF	4,760	2	0	2	101	5,111	2	0	2	109	5,143	2	0	2	109	2,812	2	0	2	60
			T2S	7,205	1	0	1	97	7,736	1	0	1	105	7,785	1	0	1	105	4,429	1	0	1	61
			T2M	6,866	1	0	2	93	7,373	1	0	2	100	7,419	1	0	2	100	4,221	1	0	2	58
			T3S	7,124	1	0	2	96	7,650	1	0	2	103	7,698	1	0	2	104	4,380	1	0	2	60
			T3M	7,052	1	0	2	95	7,573	1	0	2	102	7,620	1	0	2	103	4,335	1	0	2	59
			T4M	6,909	1	0	2	93	7,420	1	0	2	100	7,466	1	0	2	101	4,248	1	0	2	58
	4000 :	7.00	TFTM	7,182	1	0	2	97	7,712	1	0	2	104	7,760	1	0	2	105	4,415	1	0	2	60
	1000mA	74W	T5M	7,562	3	0	1	102	8,120	3	0	1	110	8,171	3	0	1	110	4,648	3	0	1	63
			T5S	7,714	2	0	1	104	8,284	2	0	1	112	8,335	2	0	1	113	4,742	2	0	1	64
			T5A	7,255	3	0	2	98	7,790	3	0	2	105	7,839	3	0	2	106	4,460	3	0	2	62
			T5W	7,243	3	0	2	98	7,777	3	0	2	105	7,826	3	0	2	106	4,452	3	0	2	61
			ASYDF	6,421	1	0	2	87	6,895	2	0	2	93	6,938	1	0	2	94	3,947	1	0	2	54
			SYMDF	6,609	2	0	2	89	7,097	2	0	2	96	7,142	2	0	2	97	4,063	2	0	2	55



Performance Data

Lumen Ambient Temperature (LAT) Multipliers

Use these factors to determine relative lumen output for average ambient temperatures

Amb	ient	Lumen Multiplier
0°C	32°F	1.02
10°C	50°F	1.01
20°C	68°F	1.00
25°C	77°F	1.00
30°C	86°F	1.00
40°C	104°F	0.98

Projected LED Lumen Maintenance

Data references the extrapolated performance projections for the **DSXWPM LED 20C 1000** platform in a **25°C ambient**, based on 10,000 hours of LED testing (tested per IESNA LM-80-08 and projected per IESNA TM-21-11).

To calculate LLF, use the lumen maintenance factor that corresponds to the desired number of operating hours below. For other lumen maintenance values, contact factory.

Operating Hours	0	25,000	50,000	100,000		
Lumen Maintenance Factor	1.0	0.95	0.93	0.88		

Electrical Load

					Curre	nt (A)		
LEDs	Drive Current (mA)	System Watts	120	208	240	277	347	480
	350	14 W	0.13	0.07	0.06	0.06	-	-
10C	530	20 W	0.19	0.11	0.09	0.08	-	-
100	700	27 W	0.25	0.14	0.13	0.11	-	-
	1000	40 W	0.37	0.21	0.19	0.16	-	-
	350	24 W	0.23	0.13	0.12	0.10	-	-
20C	530	36 W	0.33	0.19	0.17	0.14	-	-
200	700	47 W	0.44	0.25	0.22	0.19	0.15	0.11
	1000	74 W	0.69	0.40	0.35	0.30	0.23	0.17

Photometric Diagrams


To see complete photometric reports or download .ies files for this product, visit Lithonia Lighting's D-Series Wall Pole Mount homepage.

Isofootcandle plots for the DSXWPM LED 20C 1000 40K. Distances are in units of mounting height (20').














with IESNA LM-79-08. -3


























Test No. LTL25762P1 to with IESNA LM-79-08.









Options and Accessories



Mounting detail



ASYDF - Asymmetric diffuse (left engine is T3M, right engine is diffused)



HS - House-side shields



BSW - Bird-deterrent spikes



WG - Wire guard



VG - Vandal guard



DDL - Diffused drop lens

FEATURES & SPECIFICATIONS

INTENDED USE

The energy savings, long life and easy-to-install design of the D-Series Pole Mount make it the smart choice for area and site illumination for nearly any facility.

CONSTRUCTION

Two-piece die-cast aluminum housing has integral heat sink fins to optimize thermal management through conductive and convective cooling. Modular design allows for ease of maintenance. The LED driver is mounted to the door to thermally isolate it from the light engines for low operating temperature and long life. Housing is completely sealed against moisture and environmental contaminants (IP65).

FINISH

Exterior parts are protected by a zinc-infused Super Durable TGIC thermoset powder coat finish that provides superior resistance to corrosion and weathering. A tightly controlled multi-stage process ensures a minimum 3 mils thickness for a finish that can withstand extreme climate changes without cracking or peeling. Available in textured and non-textured finishes.

OPTICS

Precision-molded proprietary acrylic lenses provide multiple photometric distributions tailored specifically to area lighting applications. Light engines are available in 3000K, 4000K or 5000K with 70 min. CRI configurations.

ELECTRICAI

Light engine(s) consist of 10 high-efficacy LEDs mounted to a metal-core circuit board to maximize heat dissipation and promote long life (L88/100,000 hrs at 25°C). Class 1 electronic drivers have a power factor >90%, THD <20%, and a minimum 6KV surge rating. The luminaire meets a minimum Category C Low (per ANSI/IEEE C62.41.2).

INSTALLATION

Includes universal mounting plate, which utilizes existing drill patterns and allows for quick and easy installation. Stainless steel bolts fasten the mounting block securely to poles.

LISTINGS

CSA certified to U.S. and Canadian standards. Rated for -40°C minimum ambient.

DesignLights Consortium® (DLC) qualified product. Not all versions of this product may be DLC qualified. Please check the DLC Qualified Products List at www.designlights.org to confirm which versions are qualified.

BUY AMERICAN

This product is assembled in the USA and meets the Buy America(n) government procurement requirements under FAR, DFARS and DOT. Please refer to www.acuitybrands.com/resources/buy-american for additional information.

WARRANTY

Five-year limited warranty. Complete warranty terms located at: www.acuitybrands.com/support/customer-support/terms-and-conditions

 $\ensuremath{\textbf{Note:}}$ Actual performance may differ as a result of end-user environment and application.

All values are design or typical values, measured under laboratory conditions at 25 $^{\circ}\text{C}.$

Specifications subject to change without notice.



FCSL550



Date:	Approved:
Туре:	
Fixture:	
Project:	

FCSL550 IP65 rated exterior recessed cut-off 6" tall mini step light for masonry applications. Corrosion resistant, die-cast aluminum construction, this fixture provides illumination for damp, dry or wet areas.



SPECIFICATIONS

PHYSICAL					
dimensions	3.6"W x 5.9"H x 5.5"Deep				
weight	1 lbs				
housing	Marine grade, corrosion resistant, heavy gauge aluminum faceplate				
lens	Clear tempered glass lens				
mounting	Concrete pour, masonry applications				
ingress protection	IP65 : dry, damp or wet locations with extruded silicone gasket to seal out contaminants				
faceplate finish	Six stage chemical iron phosphate conversion pre-treatment. Polyester powder coat finish, 18 µm Min., 5000hr salt spray test (ASTM B117) compliant with Florida / AAMA 2604 specification.				

PERFORMANCE							
color temperature	2700K	3000K	3500K	4000K			
lumen output	157 lm						
lifetime	> 70,000 hours / L70 or better						
color consistency	3 SDCM / 85 CRI	3 SDCM / 85 CRI					
operating temperature	-13°F to 104°F (-25°C to 40°	-13°F to 104°F (-25°C to 40°C)					
junction temperature	73°C @ T ^A 25°C						
warranty	5-Year limited warranty (refer to website for details)						

ELECTRICAL				
input voltage	Universal 120 - 277 VAC			
power supply	Integral Class II, electronic high-power factor > 94% @ 120V			
certifications	ETL / cETL Listed			
standards	UL1598/CSA C22.2 No. 250.0; UL 8750/CSA C22.2 No. 250.13/IES LM-79/LM-80			
power consumption	10W (157 lm)			
dimming	Optional: 0-10V (Integral)			

Due to continuous development and improvements, specifications are subject to change without notice. FC Lighting reserves the right to change lab test details or specifications without notice. Product use certifies agreement to FC terms and conditions.





Ordering Information

PART NUMBER												
FCSL550		UNV						2L				
SERIES		VOLTAGE		CCT		CRI		LUMENS		FINISH		OPTIONS
FCSL550	UNV	120 - 277 VAC	27K	2700K	CRI85	85 CRI	2L	157 lm (10W)	BKE	Black	LD	0-10V Dimming
			3K	3000K					BRE	Bronze	LBB	
			35K	3500K					GRE	Graphite Grey		separate of Back Box)
			4K	4000K					SLE	Silver		
									WHE	White		
									CCE	Custom Color		


BACK BOX KITS

99074D-ETL

Back Box Kit - Complete Back Box shipped in advance of fixture without mounting kit.

Consult Factory for other options and configurations.

To ensure you receive proper configurations for your lighting specifications, contact us directly about any unique application requirements. This may include but not be limited to lumen output, mounting needs, or electrical requirements.

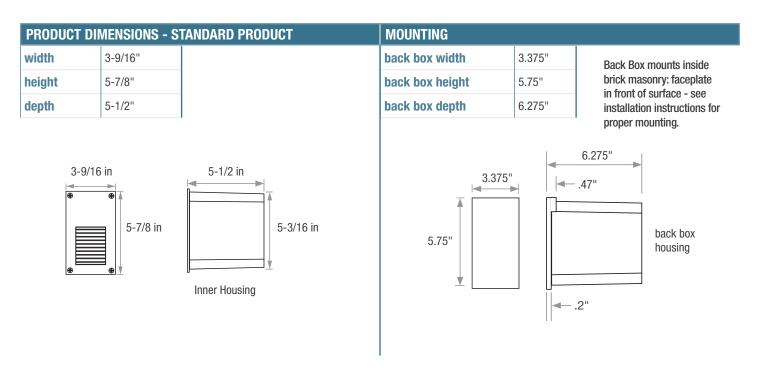

Due to continuous development and improvements, specifications are subject to change without notice. FC Lighting reserves the right to change lab test details or specifications without notice. Product use certifies agreement to FC terms and conditions.



Specification Sheet


Photometry

OPTICAL DISTRIBUTION

lumen output	157 lm @ 4000K
power consumption	10W



itl illuminations testing labroatory: Report #1023



Due to continuous development and improvements, specifications are subject to change without notice. FC Lighting reserves the right to change lab test details or specifications without notice. Product use certifies agreement to FC terms and conditions.



FEATURES & SPECIFICATIONS

INTENDED USE — The 3" Wafer-Thin LED recessed downlight with remote driver box combines high quality light output and efficiency while eliminating the pot light housing for competitive affordability. This innovate wafer-slim Type IC design allows easy installation for new construction or remodel from $below the ceiling without the requirement of a pot light housing for insulation. \ The LED module maintains$ at least 70% light output for 36,000 hours. These LED Wafer downlights are intended for closets, attics, hallways, bathrooms, kitchens, basements, soffits, entry ways, porches, garages, stairwells, corridors, nursing/retirement homes, condos, elevators, apartments, and any other small areas.

CONSTRUCTION — IC rated driver and fixture - approved for direct contact with insulation. Aluminum die cast outer frame. Durable, powder coat paint to prevent rust. Round fixture with integral edge-lit LED's. Plenum rated cable connector to connect from module to remote driver box. Isolated driver integrated inside steel remote box with four 7/8" knockouts with slots for pryout. Suitable for pulling wires with the 12 cubic-inch wiring compartment to accommodate up to (8) 14 gauge insulated conductors, or (6) 12 gauge insulated conductors; making the Wafer LED Downlights much easier to wire in 2in/2out (plus ground) daisy-chain applications and contractor friendly.

INSTALLATION — Ideal for shallow ceiling plenum; no housing required. Steel spring clip for easy installation. 3" cut out template is provided to ensure a correct sized hole is cut into ceiling for proper $in stall at ion of the trim. Size of hole should not exceed 3\,1/8\,in ches for this product. Suitable for installation$ in t-grid and drop ceiling applications. 6" plenum space required for installation of remote driver box.

OPTICS — Wafer-Thin downlight edge-lit LED technology uses light guided plate to distribute light. Polycarbonate lens provides even illumination throughout the space. Utilizes 2700K, 3000K, and 4000K color temperature LEDs.


ELECTRICAL — Connect directly to 120V power supply via provided UL recognized driver. Driver and Fixture Wet location approved and IC rated. High efficient driver with power factor > 0.9. Ambient operating temperature: $-40^{\circ}F$ ($-40^{\circ}C$) to $+104^{\circ}F$ ($+40^{\circ}C$). Dimming down to 10% (See page 2 for recommended dimmers). Standard input wattage is 8W ,68 lumens per watt. Actual wattage may differ by +/-5% when operating at 120V +/-10%. Replaces 50W incandescent.

LISTINGS — CSA certified to US and Canadian safety standards. ENERGY STAR® qualified. Wet location. Air Tight certified in accordance with ASTM E283-2004. NOM certified.


WARRANTY — 5-year limited warranty. Complete warranty terms located at: www.acuitybrands.com/support/warranty/terms-and-conditions

Note: Actual performance may differ as a result of end-user environment and application. All values are design or typical values, measured under laboratory conditions at 25 °C. Specifications subject to change without notice.

(8.6)



Matte black



Example: WF3 LED 30K MW

All dimensions are inches (centimeters) unless otherwise indicated

ORDERING INFORMATION

Specifications

Ceiling opening: 3 (7.6)

2.2 (5.6)

3.4 (8.6)

1.1 (2.8)

Aperture:

Overlap trim:

DOWNLIGHTING

Height:

For shortest lead times, configure product using standard options (shown in bold).

WF3	LED				
Series	Lamp	CCT/CRI/W/Lumens ¹	Finish		
WF3 3" wafer-thin LED downlight	LED LED	27K ² 2700K/80CRI/8W/540L 30K 3000K/80CRI/8W/550L 40K 4000K/80CRI/7.9W/590L	MW Matte white MB Matte black BN Brushed nickel ORB Oil-rubbed bronze		

Accessories: Order as separate catalog number. WF3 PAN R12 3" new construction pan, retail pack of 12 WFEXC6 U 6' FT4 cable WFEXC10 U 10' FT4 cable WFEXC20 U 20' FT4 cable





- 1 Total system delivered lumens.
- 2 Available in Matte White only.

WF3

Catalog

Number

Notes Туре

Wafer LED Recessed Downlight

3" LED Module

New Construction/Remodel










Oil-rubbed bronze

PHOTOMETRICS


20°

Distribution Curve	Distribution Data	Output Data		Coefficient	t of Utilization		Illuminand		a at 30" Al le Lumina		r for
WF3 LED 27K , 2700 K LEDs	8 watts, 545 lumens, 68.	1 lm/w, test no. ISF 30891P2	pf		20%						
	_		pc	80%	70%	50%					
	Ave Lumens	Zone Lumens % Lamp	pw	50% 30% 10%	50% 30% 10%	50% 30% 10%			===:		
	80° 0 201	0°-30° 154.4 28.3	0	119 119 119	116 116 116	111 111 111			50% bean		
	5 200 19	0°-40° 250.9 46.0	1	104 100 96	102 98 95	98 94 92			63.3°	108	3.2°
	15 192 54	0°-60° 435.3 79.8	2	91 84 79	89 83 78	86 80 76	I	nital FC			
	25 176 81	0°-90° 545.2 100.0	3	80 72 65	78 71 65	75 69 64	Mounting	Center			
$1111/\sqrt{4}$	cos 35 154 96	90°- 180° 0.0 0.0	4	71 62 56	70 61 55	67 60 54		Beam	Diameter F	C Diamete	r FC
111×1	60° 35 154 96 45 127 98	0°- 180° 545.2 *100.0	5	63 54 48	62 54 48	60 53 47	8.0	6.6	6.8 3	.3 15.2	0.7
$HT \setminus V \setminus V$	55 97 86	*Efficiency	6	57 48 42	56 48 42	54 47 41	10.0	3.6	9.2 1	.8 20.7	0.4
$1 \mid 1 \mid 1 \mid X \mid X$	65 65 65	Emolectory	7	52 43 37	51 43 37	50 42 37	12.0	2.2	11.7 1	.1 26.2	0.2
	75 34 36		8	47 39 33	47 39 33	45 38 33		1.5	14.2 0		0.2
1 \ V \ .			0				40.0	1.1		.6 37.3	0.1
$I \setminus V \setminus V$	85 8 9		9			42 35 30	.0.0	•••	10.0	.0 07.0	0.1
	90 0 40°		10	40 32 27	40 32 27	39 32 27					

WF3 LED 30K, 3000 K LEDs, 8 watts, 550 lumens, 68.8 lm/w, test no. ISF 30891

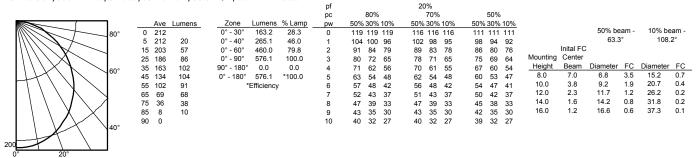

WF3 LED 40K, 4000 K LEDs, 7.9 watts, 590 lumens, 74.7 lm/w, test no. ISF 31230

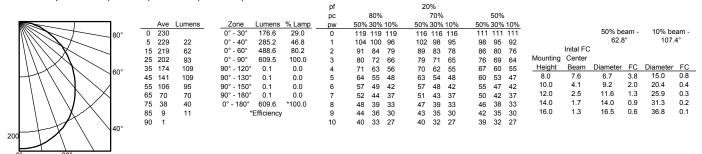

DIMMER COMPATIBILITY

COMPATIBLE DIMMERS								
Leviton	Lutron			Sensorswitch	Synergy/Leviton			
6633-PA	Maestro MACL-153M (TX)	Diva/Skylark DVRP-253PCTRP-253P	Panel Module HW/LP-RPM-4A-120	nSP5 PCD 2W	ISD 600 I 120/IPI06			
IPL06-LED/INC mode	Maestro Wireless MRF2-6ELV	Skylark CTCL-150	Panel Module HW/LP-RPM-4U-120	nSP5 PCD ELV 120	ISD 400 ELV 120/IPE04			
6615-P	Gen 3.0 DVCL-153P (T9)	Caseta Wireless PD-5NE	Grafik QS/Wallbox LQRJ-WPM-6P					
	Maestro MSCL-OP153M	Maestro MACL-LFQ	Grafik Eye 3000 Family HWI-WPM-6D-120					
	Caseta Wireless PD-6WCL	RadioRA2 RRD-6NA	HomeWorksQS / my Room LQSE-4A1-D/ MQSE-4A1-D/MQSE-3A1/MQSE-2A1-D,120V					
	Grafik T GT-5NEM / GTJ-5NEM	HomeWorks HQRD-6NA	Homeworks QS LQSE-4A-120-D					

^{*}Requires Lutron Smart Bridge L-BDG2-WH for wireless applications (sold separately)

ENERGY DATA

3" ENERGY DATA - 2700K				
Lumens	540			
Color temperature	2700K			
CRI	80			
Lumens/Watt	67.5			
Min. starting temperature	-40°C (-40°F)			
EMI/RFI	FCC Title 47 CFR, Part 15, Class B			
Sound rating	Class A standards			
Input voltage	120V			
Total Harmonic Distortion	13.5%			
Min. power factor	0.97			
Input frequency	50/60 Hz			
Rated wattage	8W			
Input power	8W			
Input current	0.07A			




3" ENERGY DATA - 3000K				
Lumens	550			
Color temperature	3000K			
CRI	80			
Lumens/Watt	68.75			
Min. starting temperature	-40°C (-40°F)			
EMI/RFI	FCC Title 47 CFR, Part 15, Class B			
Sound rating	Class A standards			
Input voltage	120V			
Total Harmonic Distortion	13.5%			
Min. power factor	0.97			
Input frequency	50/60 Hz			
Rated wattage	8			
Input power	8W			
Input current	0.07A			



ENERGY DATA

3" ENERGY DATA - 4000K							
Lumens	590						
Color temperature	4000K						
CRI	80						
Lumens/Watt	74.68						
Min. starting temperature	-40°C (-40°F)						
EMI/RFI	FCC Title 47 CFR, Part 15, Class B						
Sound rating	Class A standards						
Input voltage	120V						
Total Harmonic Distortion	13.5%						
Min. power factor	0.97						
Input frequency	50/60 Hz						
Rated wattage	7.9						
Input power	7.9W						
Input current	0.07A						

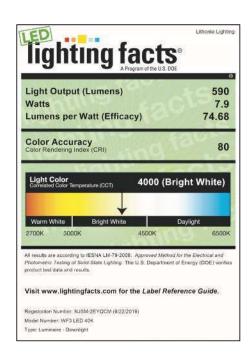



FEATURES & SPECIFICATIONS

INTENDED USE — The 4"Wafer™ LED Downlight with Switchable White provides high-quality light output and efficiency featuring a switch for easy color temperature adjustment - while eliminating the need for recessed housings. The innovative, slim design allows for easy retrofit, remodel or new construction installation from below the ceiling. The Wafer LED downlight is wet location listed — making it ideal for use in a breadth of outdoor residential, hospitality, commercial and multifamily applications. The LED module maintains at least 70% light output for 50,000 hours.

CONSTRUCTION — Aluminum die cast outer frame. Durable, powder coat paint to prevent rust. FT4 plenum rated cable connector to connect from module to remote driver box. IC rated driver with convenience and value of two remote selectable color temperature options, each with a setting choice to chose either 2700K, 3000K, and 3500K or 3000K, 4000K, and 5000K using the switch. The isolated driver integrated inside steel remote box with four 7/8" knockouts with slots for pryout. Suitable for pulling wires with the 12 cubic-inch wiring compartment to accommodate up to (6) 14 gauge insulated conductors; making the Wafer LED Downlights much easier to wire in 2in/2out (plus ground) daisy-chain applications and contractor friendly.

INSTALLATION — Ideal for shallow ceiling plenum; no housing required. Steel spring clip for easy installation. 4" cut out template is provided to ensure a correct sized hole is cut into ceiling for proper installation of the trim. Size of hole should not exceed 4 1/4 inches for this product. Suitable for installation in t-grid and drop ceiling applications. 3" plenum space required for installation of the remote driver box.

OPTICS — Edge-lit LED technology uses light guided plate to distribute light. Polycarbonate lens provides even illumination throughout the space.


ELECTRICAL — Connect directly to 120V Class-2 (CAN ICES-005 (B) / NMB-005 (B))LED driver. High efficient driver with power factor > 0.9. Ambient operating temperature: $-40^{\circ}F(-40^{\circ}C)$ to $+104^{\circ}F(+40^{\circ}C)$. Dimming down to 10% with most standard incandescent dimers (see list of approved dimmers). Replaces 65W incandescent for 750 lumens...

LISTINGS — CSA certified to US and Canadian safety standards. ENERGY STAR® certified. Wet location. Air Tight certified in accordance with ASTM E283-2004. NOM Certified. Can be used to comply with California Title 24 Part 6 High Efficacy LED light Source Requirements.

WARRANTY — 5-year limited warranty. This is the only warranty provided and no other statements in this specification sheet create any warranty of any kind. All other express and implied warranties are disclaimed. Complete warranty terms located at:

www.acuitybrands.com/support/warranty/terms-and-conditions

Note: Actual performance may differ as a result of end-user environment and application. All values are design or typical values, measured under laboratory conditions at 25 °C. Specifications subject to change without notice.

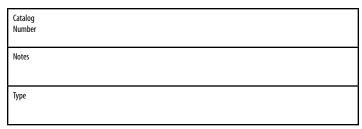


Wafer LED Recessed Downlight


WF4 4" LED Switchable White Color Temperature

IC/Non-IC New Construction/Remodel









Example: WF4 LED 30K40K50K 90CRI MW

All dimensions are inches (centimeters) unless otherwise indicated.

ORDERING INFORMATION

Specifications

3.2 (8.1) 4.2 (10.7)

4.7 (12.0)

1.1 (2.8)

Aperture:

Ceiling opening:

Overlap trim:

Height:

For shortest lead times, configure product using standard options (shown in bold).

WF4	LED			
Series	Lamp	CCT/W/Lumens ¹	CRI	Finish
WF4 4" wafer-thin LED downlight	LED LED	27K30K35K 2700K/10.5W/730L 3000K/10.5W/800L 3500K/10.5W/780L 30K40K50K 3000K/10.5W/750L 4000K/10.5W/810L 5000K/10.5W/790L	90CRI 90CRI	MW Matte White MB Matte Black BN Brush Nickel ORB Oil-Rubbed Bronze

Accessories: Order as separate catalog number.

WF8643 Pan U Universal new construction pan
WFJB U Remodel joist bar
WFEXC6 SW3PIN FT4 3-Pin 10ft Cable
WFEXC10 SW3PIN FT4 3-Pin 10ft Cable
WFEXC20 SW3PIN FT4 3-Pin 20ft Cable
WF4GR MW JZ 4" round oversized trim ring





Notes

 Total system delivered lumens.


DOWNLIGHTING WF4 LED - Switchable White

WF4 Switchable White 4" LED Wafer Module

PHOTOMETRICS

Distribution Curve	Distribution Data	Output Data	Coefficient of Utilization	Illuminance Data at 30" Above Floor for
				a Single Luminaire


WF4 LED 27K30K35K, 2700 K LEDs, input watts: 11, delivered lumens: 732, LM/W=67, test no. ISF 36826P1



			pt					20	1%					
			рс		80%				70%				50%	
Zone	Lumens	% Lamp	pw	50%	30%	10%	50	1%	30%	10%	50)%	30%	10%
0°-30°	203.9	27.8	0	119	119	119	11	16	116	116	1	11	111	111
0°-40°	331.3	45.2	1	104	99	96	10)1	98	94	9	7	94	91
0°-60°	575.9	78.7	2	90	84	78	8	8	82	77	8	5	80	75
0°-90°	732.2	100.0	3	79	71	65	7	8	70	64	7	'5	68	63
90° - 120°	0.0	0.0	4	70	62	55	6	9	61	54	6	7	59	54
90° - 130°	0.0	0.0	5	63	54	47	6	2	53	47	6	0	52	46
90° - 150°	0.0	0.0	6	57	48	41	5	6	47	41	5	4	46	41
90° - 180°	0.0	0.0	7	51	43	36	5	1	42	36	4	9	42	36
0° - 180°	732.2	*100.0	8	47	38	33	4	6	38	32	4	5	38	32
	Efficiency		9	43	35	29	4	3	35	29	4	1	34	29
	,		10	40	32	27	3	9	32	27	3	8	31	26

		50% be 63.5		10% be 108.5	
	Inital FC				
Mounting	Center				
_Height	Beam	Diameter	FC	Diameter	FC
8.0	8.7	6.8	4.4	15.3	0.9
10.0	4.7	9.3	2.3	20.8	0.5
12.0	2.9	11.7	1.5	26.4	0.3
14.0	2.0	14.2	1.0	31.9	0.2
16.0	1.4	16.7	0.7	37.5	0.1


WF4 LED 27K30K35K, 3000 K LEDs, input watts: 10, delivered lumens: 830, LM/W=83, test no. ISF 36826P2



						ы				20	//0				
						рс		80%			70%			50%	
	Ave	Lumens	Zone	Lumens	% Lamp	pw	50%	30%	10%	50%	30%	10%	50%	30%	10%
)	299		0°-30°	231.3	27.8	0	119	119	119	116	116	116	111	111	111
5	299	28	0°-40°	375.7	45.2	1	104	99	96	101	98	94	97	94	91
5	288	81	0°-60°	653.2	78.7	2	90	84	78	88	82	77	85	80	75
5	264	122	0°-90°	830.4	100.0	3	79	71	65	78	70	64	75	68	63
	232	144	90°-120°	0.0	0.0	4	70	62	55	69	61	54	67	59	54
	190	147	90°-130°	0.0	0.0	5	63	54	47	62	53	47	60	52	46
	147	131	90°-150°	0.0	0.0	6	57	48	41	56	47	41	54	46	41
	101	99	90°-180°	0.0	0.0	7	51	43	36	51	42	36	49	42	36
	56	60	0°-180°	830.4	*100.0	8	47	38	33	46	38	32	45	38	32
5		18		Efficiency		9	43	35	29	43	35	29	41	34	29
0	0	.0				10	40	32	27	39	32	27	38	31	26

	Inital FC	50% be 63.5		10% be 108.5	
Mounting	Center				
Height	Beam	Diameter	FC	Diameter	FC
8.0	9.9	6.8	4.9	15.3	1.0
10.0	5.3	9.3	2.7	20.8	0.5
12.0	3.3	11.7	1.7	26.4	0.3
14.0	2.3	14.2	1.1	31.9	0.2
16.0	1.6	16.7	8.0	37.5	0.2


WF4 LED 27K30K35K, 3500 K LEDs, input watts: 10, delivered lumens: 784, LM/W=78, test no. ISF 36826P3



						pc		80%			70%			50%	
	Ave	Lumens	Zone	Lumens	% Lamp	pw	50%	30%	10%	50%	30%	10%	50%	30%	10%
0	282		0°-30°	218.2	27.8	0	119	119	119	116	116	116	111	111	111
5	282	27	0°-40°	354.5	45.2	1	104	99	96	101	98	94	97	94	91
15	272	77	0°-60°	616.4	78.7	2	90	84	78	88	82	77	85	80	75
25	249	115	0°-90°	783.6	100.0	3	79	71	65	78	70	64	75	68	63
35		136	90° - 120		0.0	4	70	62	55	69	61	54	67	59	54
45	180	139	90° - 130	° 0.0	0.0	5	63	54	47	62	53	47	60	52	46
55	138	123	90° - 150		0.0	6	57	48	41	56	47	41	54	46	41
65	95	94	90° - 180		0.0	7	51	43	36	51	42	36	49	42	36
75	53	56	0° - 180		*100.0	8	47	38	33	46	38	32	45	38	32
85	15	17		*Efficiency		9	43	35	29	43	35	29	41	34	29
90	0	•		,		10	40	32	27	39	32	27	38	31	26

	Inital FC	50% be 63.5		10% be 108.5	
Mounting	Center				
Height	Beam	Diameter	FC	Diameter	FC
8.0	9.3	6.8	4.7	15.3	0.9
10.0	5.0	9.3	2.5	20.8	0.5
12.0	3.1	11.7	1.6	26.4	0.3
14.0	2.1	14.2	1.1	31.9	0.2
16.0	1.5	16.7	8.0	37.5	0.2

WF4 LED 30K40K50K, 3000 K LEDs, input watts: 11, delivered lumens: 753, LM/W=68, test no. ISF 36826P4




						ρı				20	70				
						рс		80%			70%			50%	
	Ave	Lumens	Zone	Lumens	% Lamp	pw	50%	30%	10%	50%	30%	10%	50%	30%	10%
0	271		0°-30°	209.7	27.8	0	119	119	119	116	116	116	111	111	111
5	271	26	0°-40°	340.7	45.2	1	104	99	96	101	98	94	97	94	91
15	261	74	0°-60°	592.3	78.7	2	90	84	78	88	82	77	85	80	75
25	240	110	0°-90°	753.0	100.0	3	79	71	65	78	70	64	75	68	63
35	210	131	90° - 120°	0.0	0.0	4	70	62	55	69	61	54	67	59	54
45	173	133	90° - 130°	0.0	0.0	5	63	54	47	62	53	47	60	52	46
55	133	119	90° - 150°	0.0	0.0	6	57	48	41	56	47	41	54	46	41
65	91	90	90° - 180°	0.0	0.0	7	51	43	36	51	42	36	49	42	36
75	51	54	0°-180°	753.0	*100.0	8	47	38	33	46	38	32	45	38	32
85	15	17	*	Efficiency		9	43	35	29	43	35	29	41	34	29
90	0			,		10	40	32	27	39	32	27	38	31	26

		50% be 63.5		10% beam - 108.5°			
	Inital FC						
Mounting	Center						
Height	Beam	Diameter	FC	Diameter	FC		
8.0	9.0	6.8	4.5	15.3	0.9		
10.0	4.8	9.3	2.4	20.8	0.5		
12.0	3.0	11.7	1.5	26.4	0.3		
14.0	2.1	14.2	1.0	31.9	0.2		
16.0	1.5	16.7	0.7	37.5	0.1		


PHOTOMETRICS

Distribution Curve	Distribution Data	Output Data	Coefficient of Utilization	Illuminance Data at 30" Above Floor for
				a Single Luminaire

WF4 LED 30K40K50K, 4000 K LEDs, input watts: 11, delivered lumens: 840, LM/W=76, test no. ISF 36826P5

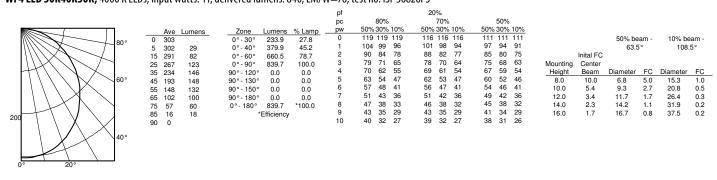

WF4 LED 30K40K50K, 5000 K LEDs, input watts: 10, delivered lumens: 791, LM/W=79, test no. ISF 36826P6

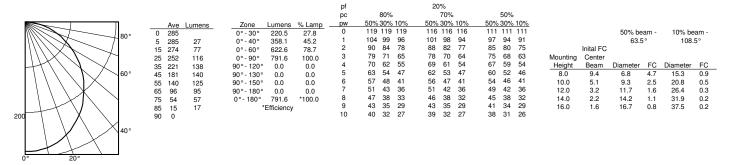

ENERGY DATA


	WF4 LED 27K30K35K					
Color Temperature	2700K	3000K	3500K			
Lumens	730	800	780			
CRI	90	90	90			
Rated wattage	10.7	10.1	10.4			
Lu/Watts	68.2	79.2	75.0			
Min. starting temp	-40°C (-40°F)	-40°C (-40°F)	-40°C (-40°F)			
EMI/RFI	FCC Title 47 CFR, Part 15, Class B	FCC Title 47 CFR, Part 15, Class B	FCC Title 47 CFR, Part 15, Class B			
Sound rating	Class A Standards	Class A Standards	Class A Standards			
Input voltage	120V	120V	120V			
Min. power factor	0.97	0.97	0.97			
Input frequency	50/60 Hz	50/60 Hz	50/60 Hz			
Input power	120V	120V	120V			
Input current	0.09A	0.09A	0.09A			

	WF4 LED 30K40K50K				
Color Temperature	3000K	4000K	5000K		
Lumens	750	810	790		
CRI	90	90	90		
Rated wattage	10.6	10.6	10.1		
Lu/Watts	70.8	76.4	78.2		
Min. starting temp	-40°C (-40°F)	-40°C (-40°F)	-40°C (-40°F)		
EMI/RFI	FCC Title 47 CFR, Part 15, Class B	FCC Title 47 CFR, Part 15, Class B	FCC Title 47 CFR, Part 15, Class B		
Sound rating	Class A Standards	Class A Standards	Class A Standards		
Input voltage	120V	120V	120V		
Min. power factor	0.97	0.97	0.97		
Input frequency	50/60 Hz	50/60 Hz	50/60 Hz		
Input power	120V	120V	120V		
Input current	0.09A	0.09A	0.09A		



LIGHTING PERFORMANCE DATA






























Specifications



Front View

Side View

Luminaire	Unight (U)	Width (W)	Depth (D)	Side Condu	it Location	Weight
Lummaire	Height (H)	wiath (w)	Depth (D)	Α	В	weight
WPX1	8.1" (20.6 cm)	11.1" (28.3 cm)	3.2" (8.1 cm)	4.0" (10.3 cm)	0.6" (1.6 cm)	6.1 lbs (2.8kg)
WPX2	9.1" (23.1 cm)	12.3" (31.1 cm)	4.1" (10.5 cm)	4.5" (11.5 cm)	0.7" (1.7 cm)	8.2 lbs (3.7kg)
WPX3	9.5" (24.1 cm)	13.0" (33.0 cm)	5.5" (13.7 cm)	4.7" (12.0 cm)	0.7" (1.7 cm)	11.0 lbs (5.0kg)

Catalog Number			
Notes			
Туре			

Introduction

The WPX LED wall packs are energy-efficient, costeffective, and aesthetically appealing solutions for both HID wall pack replacement and new construction opportunities. Available in three sizes, the WPX family delivers 1,550 to 9,200 lumens with a wide, uniform distribution.

The WPX full cut-off solutions fully cover the footprint of the HID glass wall packs that they replace, providing a neat installation and an upgraded appearance. Reliable IP66 construction and excellent LED lumen maintenance ensure a long service life. Photocell and emergency egress battery options make WPX ideal for every wall mounted lighting application.

Ordering Information

EXAMPLE: WPX2 LED 40K MVOLT DDBXD

Series		Color Temperature	Voltage	Options	Finish
WPX1 LED P1 WPX1 LED P2 WPX2 LED WPX3 LED	1,550 Lumens, 11W ¹ 2,900 Lumens, 24W 6,000 Lumens, 47W 9,200 Lumens, 69W	30K 3000K 40K 4000K 50K 5000K	MVOLT 120V - 277V 347 347V ³	(blank) None E4WH Emergency battery backup, CEC compliant (4W, 0°C min)² E14WC Emergency battery backup, CEC compliant (14W, -20°C min)² PE Photocell³	DDBXD Dark bronze DWHXD White DBLXD Black Note: For other options, consult factory.

Note: The lumen output and input power shown in the ordering tree are average representations of all configuration options. Specific values are available on request.

- All WPX wall packs come with 6kV surge protection standard, except WPX1 LED P1 package which comes with 2.5kV surge protection standard. Add SPD6KV option to get WPX1 LED P1 with 6kV surge protection.
 Sample nomenclature: WPX1 LED P1 40K MVOLT SPD6KV DDBXD
- 2. Battery pack options only available on WPX1 and WPX2.
- 3. Battery pack options not available with 347V and PE options.

FEATURES & SPECIFICATIONS

The WPX LED wall packs are designed to provide a cost-effective, energy-efficient solution for the one-for-one replacement of existing HID wall packs. The WPX1, WPX2 and WPX3 are ideal for replacing up to 150W, 250W, and 400W HID luminaires respectively. WPX luminaires deliver a uniform, wide distribution. WPX is rated for -40°C to 40°C.

WPX feature a die-cast aluminum main body with optimal thermal management that both enhances LED efficacy and extends component life. The luminaires are IP66 rated, and sealed against moisture or environmental contaminants.

Light engine(s) configurations consist of high-efficacy LEDs and LED lumen maintenance of L90/100,000 hours. Color temperature (CCT) options of 3000K, 4000K and 5000K with minimum CRI of 70. Electronic drivers ensure system power factor >90% and THD <20%. All luminaires have 6kV surge protection (Note: WPX1 LED P1 package comes with a standard surge protection rating of 2.5kV. It can be ordered with an optional 6kV surge protection). All photocell (PE) operate on MVOLT (120V - 277V) input.

Note: The standard WPX LED wall pack luminaires come with field-adjustable drive current feature. This feature allows tuning the output current of the LED drivers to adjust the lumen output (to dim the luminaire).

WPX can be mounted directly over a standard electrical junction box. Three 1/2 inch conduit ports on three sides allow for surface conduit wiring. A port on the back surface allows poke-through conduit wiring on surfaces that don't have an electrical junction box. Wiring can be made in the integral wiring compartment in all cases. WPX is only recommended for installations with LEDs facing downwards.

LISTINGS

CSA Certified to meet U.S. and Canadian standards. Suitable for wet locations. IP66 Rated. DesignLights Consortium® (DLC) qualified product. Not all versions of this product may be DLC qualified. Please check the DLC Qualified Products List at w which versions are qualified. International Dark Sky Association (IDA) Fixture Seal of Approval (FSA) is available for all products on this page utilizing 3000K color temperature only.

WARRANTY

5-year limited warranty. This is the only warranty provided and no other statements in this specification sheet create any warranty of any kind. All other express and implied warranties are disclaimed. Complete warranty terms located at:

Note: Actual performance may differ as a result of end-user environment and application. All values are design or typical values, measured under laboratory conditions at 25°C. Specifications subject to change without notice.



Performance Data

Electrical Load

Luminaire	Input Power (W)	120V	208V	240V	277V	347V
WPX1 LED P1	11W	0.09	0.05	0.05	0.04	0.03
WPX1 LED P2	24W	0.20	0.12	0.10	0.09	0.07
WPX2	47W	0.39	0.23	0.20	0.17	0.14
WPX3	69W	0.58	0.33	0.29	0.25	0.20

Projected LED Lumen Maintenance

Data references the extrapolated performance projections in a 25° C ambient, based on 6,000 hours of LED testing (tested per IESNA LM-80-08 and projected per IESNA TM-21-11).

To calculate LLF, use the lumen maintenance factor that corresponds to the desired number of operating hours below. For other lumen maintenance values, contact factory.

Operating Hours	50,000	75,000	100,000
Lumen Maintenance Factor	>0.94	>0.92	>0.90

HID Replacement Guide

Luminaire	Equivalent HID Lamp	WPX Input Power
WPX1 LED P1	100W	11W
WPX1 LED P2	150W	24W
WPX2	250W	47W
WPX3	400W	69W

Lumen Output

Luminaire	Color Temperature	Lumen Output
	3000K	1,537
WPX1 LED P1	4000K	1,568
	5000K	1,602
	3000K	2,748
WPX1 LED P2	4000K	2,912
	5000K	2,954
	3000K	5,719
WPX2	4000K	5,896
	5000K	6,201
	3000K	8,984
WPX3	4000K	9,269
	5000K	9,393

Lumen Ambient Temperature (LAT) Multipliers

Use these factors to determine relative lumen output for average ambient temperatures from 0-50°C (32-122°F).

Ambient	Ambient	Lumen Multiplier
0°C	32°F	1.05
5℃	41°F	1.04
10°C	50°F	1.03
15℃	59°F	1.02
20°C	68°F	1.01
25°C	77°F	1.00
30°C	86°F	0.99
35℃	95°F	0.98
40°C	104°F	0.97

Emergency Egress Battery Packs


The emergency battery backup is integral to the luminaire — no external housing or back box is required. The emergency battery will power the luminaire for a minimum duration of 90 minutes and deliver minimum initial output of 550 lumens. Both battery pack options are CEC compliant.


Battery Type	Minimum Temperature Rating	Power (Watts)	Controls Option	Ordering Example
Standard	0°C	4W	E4WH	WPX2 LED 40K MVOLT E4WH DDBXD
Cold Weather	-20°C	14W	E14WC	WPX2 LED 40K MVOLT E14WC DDBXD


Photometric Diagrams


To see complete photometric reports or download .ies files for this product, visit the Lithonia Lighting WPX LED homepage. Tested in accordance with IESNA LM-79 and LM-80 standards












Mounting Height = 12 Feet.



GENERAL NOTES:

- 1. THE APPLICANT SHALL REPLACE ALL SIDEWALK AND CURB AND GUTTER THAT ABUTS THE PROPERTY THAT IS DAMAGED BY THE CONSTRUCTION, OR ANY SIDEWALK AND CURB AND GUTTER WHICH THE CITY ENGINEER DETERMINES NEEDS TO BE REPLACED BECAUSE IT IS NOT AT A DESIRABLE GRADE, REGARDLESS OF WHETHER THE CONDITION EXISTED PRIOR TO BEGINNING CONSTRUCTION.
- 2. ALL WORK IN THE PUBLIC RIGHT OF WAY SHALL BE PERFORMED BY A CITY-LICENSED CONTRACTOR.
- 3. ALL DAMAGE TO THE PAVEMENT ON CITY STREETS, AND ADJACENT TO THIS DEVELOPMENT SHALL BE RESTORED IN ACCORDANCE WITH THE CITY OF MADISON'S PAVEMENT PATCHING CRITERIA.
- 4. ALL PROPOSED STREET TREE REMOVALS WITHIN THE RIGHT OF WAY SHALL BE REVIEWED BY CITY FORESTRY BEFORE THE PLAN COMMISSION MEETING. STREET TREE REMOVALS REQUIRE APPROVAL AND A TREE REMOVAL PERMIT ISSUED BY CITY FORESTRY. ANY STREET TREE REMOVALS REQUESTED AFTER THE DEVELOPMENT PLAN IS APPROVED BY THE PLAN COMMISSION OR THE BOARD OF PUBLIC WORKS AND CITY FORESTRY WILL REQUIRE A MINIMUM OF A 72-HOUR REVIEW PERIOD WHICH SHALL INCLUDE THE NOTIFICATION OF THE ALDERPERSON WITHIN WHO'S DISTRICT IS AFFECTED BY THE STREET TREE REMOVAL(S) PRIOR TO A TREE REMOVAL PERMIT BEING ISSUED.
- 5. AS DEFINED BY THE SECTION 107.13 OF CITY OF MADISON STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION: NO EXCAVATION IS PERMITTED WITHIN 5 FEET OF THE TRUNK OF THE STREET TREE OR WHEN CUTTING ROOTS OVER 3 INCHES IN DIAMETER. IF EXCAVATION IS NECESSARY, THE CONTRACTOR SHALL CONTACT MADISON CITY FORESTRY (266-4816) PRIOR TO EXCAVATION. CITY OF MADISON FORESTRY PERSONNEL SHALL ASSESS THE IMPACT TO THE TREE AND TO ITS ROOT SYSTEM PRIOR TO WORK COMMENCING. TREE PROTECTION SPECIFICATIONS CAN BE FOUND ON THE FOLLOWING WEBSITE: CITYOFMADISON.COM/BUSINESS/PW/SPECS.CFM
- 6. CONTRACTOR SHALL TAKE PRECAUTIONS DURING CONSTRUCTION TO NOT DISFIGURE, SCAR, OR IMPAIR THE HEALTH OF ANY STREET TREE. CONTRACTOR SHALL OPERATE EQUIPMENT IN A MANNER AS TO NOT DAMAGE THE BRANCHES OF THE STREET TREE(S). THIS MAY REQUIRE USING SMALLER EQUIPMENT AND LOADING AND UNLOADING MATERIALS IN A DESIGNATED SPACE AWAY FROM TREES ON THE CONSTRUCTION SITE. ANY DAMAGE OR INJURY TO EXISTING STREET TREES (EITHER ABOVE OR BELOW GROUND) SHALL BE REPORTED IMMEDIATELY TO CITY FORESTRY AT 266-4816. PENALTIES AND REMEDIATION SHALL BE REQUIRED.
- 7. SECTION 107.13(G) OF CITY OF MADISON STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION ADDRESSES SOIL COMPACTION NEAR STREET TREES AND SHALL BE FOLLOWED BY CONTRACTOR. THE STORAGE OF PARKED VEHICLES, CONSTRUCTION EQUIPMENT, BUILDING MATERIALS, REFUSE, EXCAVATED SPOILS OR DUMPING OF POISONOUS MATERIALS ON OR AROUND TREES AND ROOTS WITHIN FIVE (5) FEET OF THE TREE OR WITHIN THE PROTECTION ZONE IS PROHIBITED.
- 8. ON THIS PROJECT, STREET TREE PROTECTION ZONE FENCING IS REQUIRED. THE FENCING SHALL BE ERECTED BEFORE THE DEMOLITION, GRADING OR CONSTRUCTION BEGINS. THE FENCE SHALL INCLUDE THE ENTIRE WIDTH OF TERRACE AND, EXTEND AT LEAST 5 FEET ON BOTH SIDES OF THE OUTSIDE EDGE OF THE TREE TRUNK. DO NOT REMOVE THE FENCING TO ALLOW FOR DELIVERIES OR EQUIPMENT ACCESS THROUGH THE TREE PROTECTION ZONE.
- 9. STREET TREE PRUNING SHALL BE COORDINATED WITH MADISON FORESTRY AT A MINIMUM OF TWO WEEKS PRIOR TO THE START OF CONSTRUCTION FOR THIS PROJECT. ALL PRUNING SHALL FOLLOW THE AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI) A300 PART 1 STANDARDS FOR PRUNING.
- 10. AT LEAST ONE WEEK PRIOR TO STREET TREE PLANTING, CONTRACTOR SHALL CONTACT CITY FORESTRY AT (608) 266-4816 TO SCHEDULE INSPECTION AND APPROVAL OF NURSERY TREE STOCK AND REVIEW PLANTING SPECIFICATIONS WITH THE LANDSCAPER.
- 11. APPROVAL OF PLANS FOR THIS PROJECT DOES NOT INCLUDE ANY APPROVAL TO PRUNE, REMOVE, OR PLANT TREES IN THE PUBLIC RIGHT-OF-WAY. PERMISSION FOR SUCH ACTIVITIES MUST BE OBTAINED FROM THE CITY FORESTER (266-4816).
- 12. THE PUBLIC RIGHT-OF-WAY IS THE SOLE JURISDICTION OF THE CITY OF MADISON AND IS SUBJECT TO CHANGE AT ANY TIME. NO ITEMS SHOWN ON THIS SITE PLAN IN THE RIGHT-OF-WAY ARE PERMANENT AND MAY NEED TO BE REMOVED AT THE APPLICANTS EXPENSE UPON NOTIFICATION BY THE CITY.

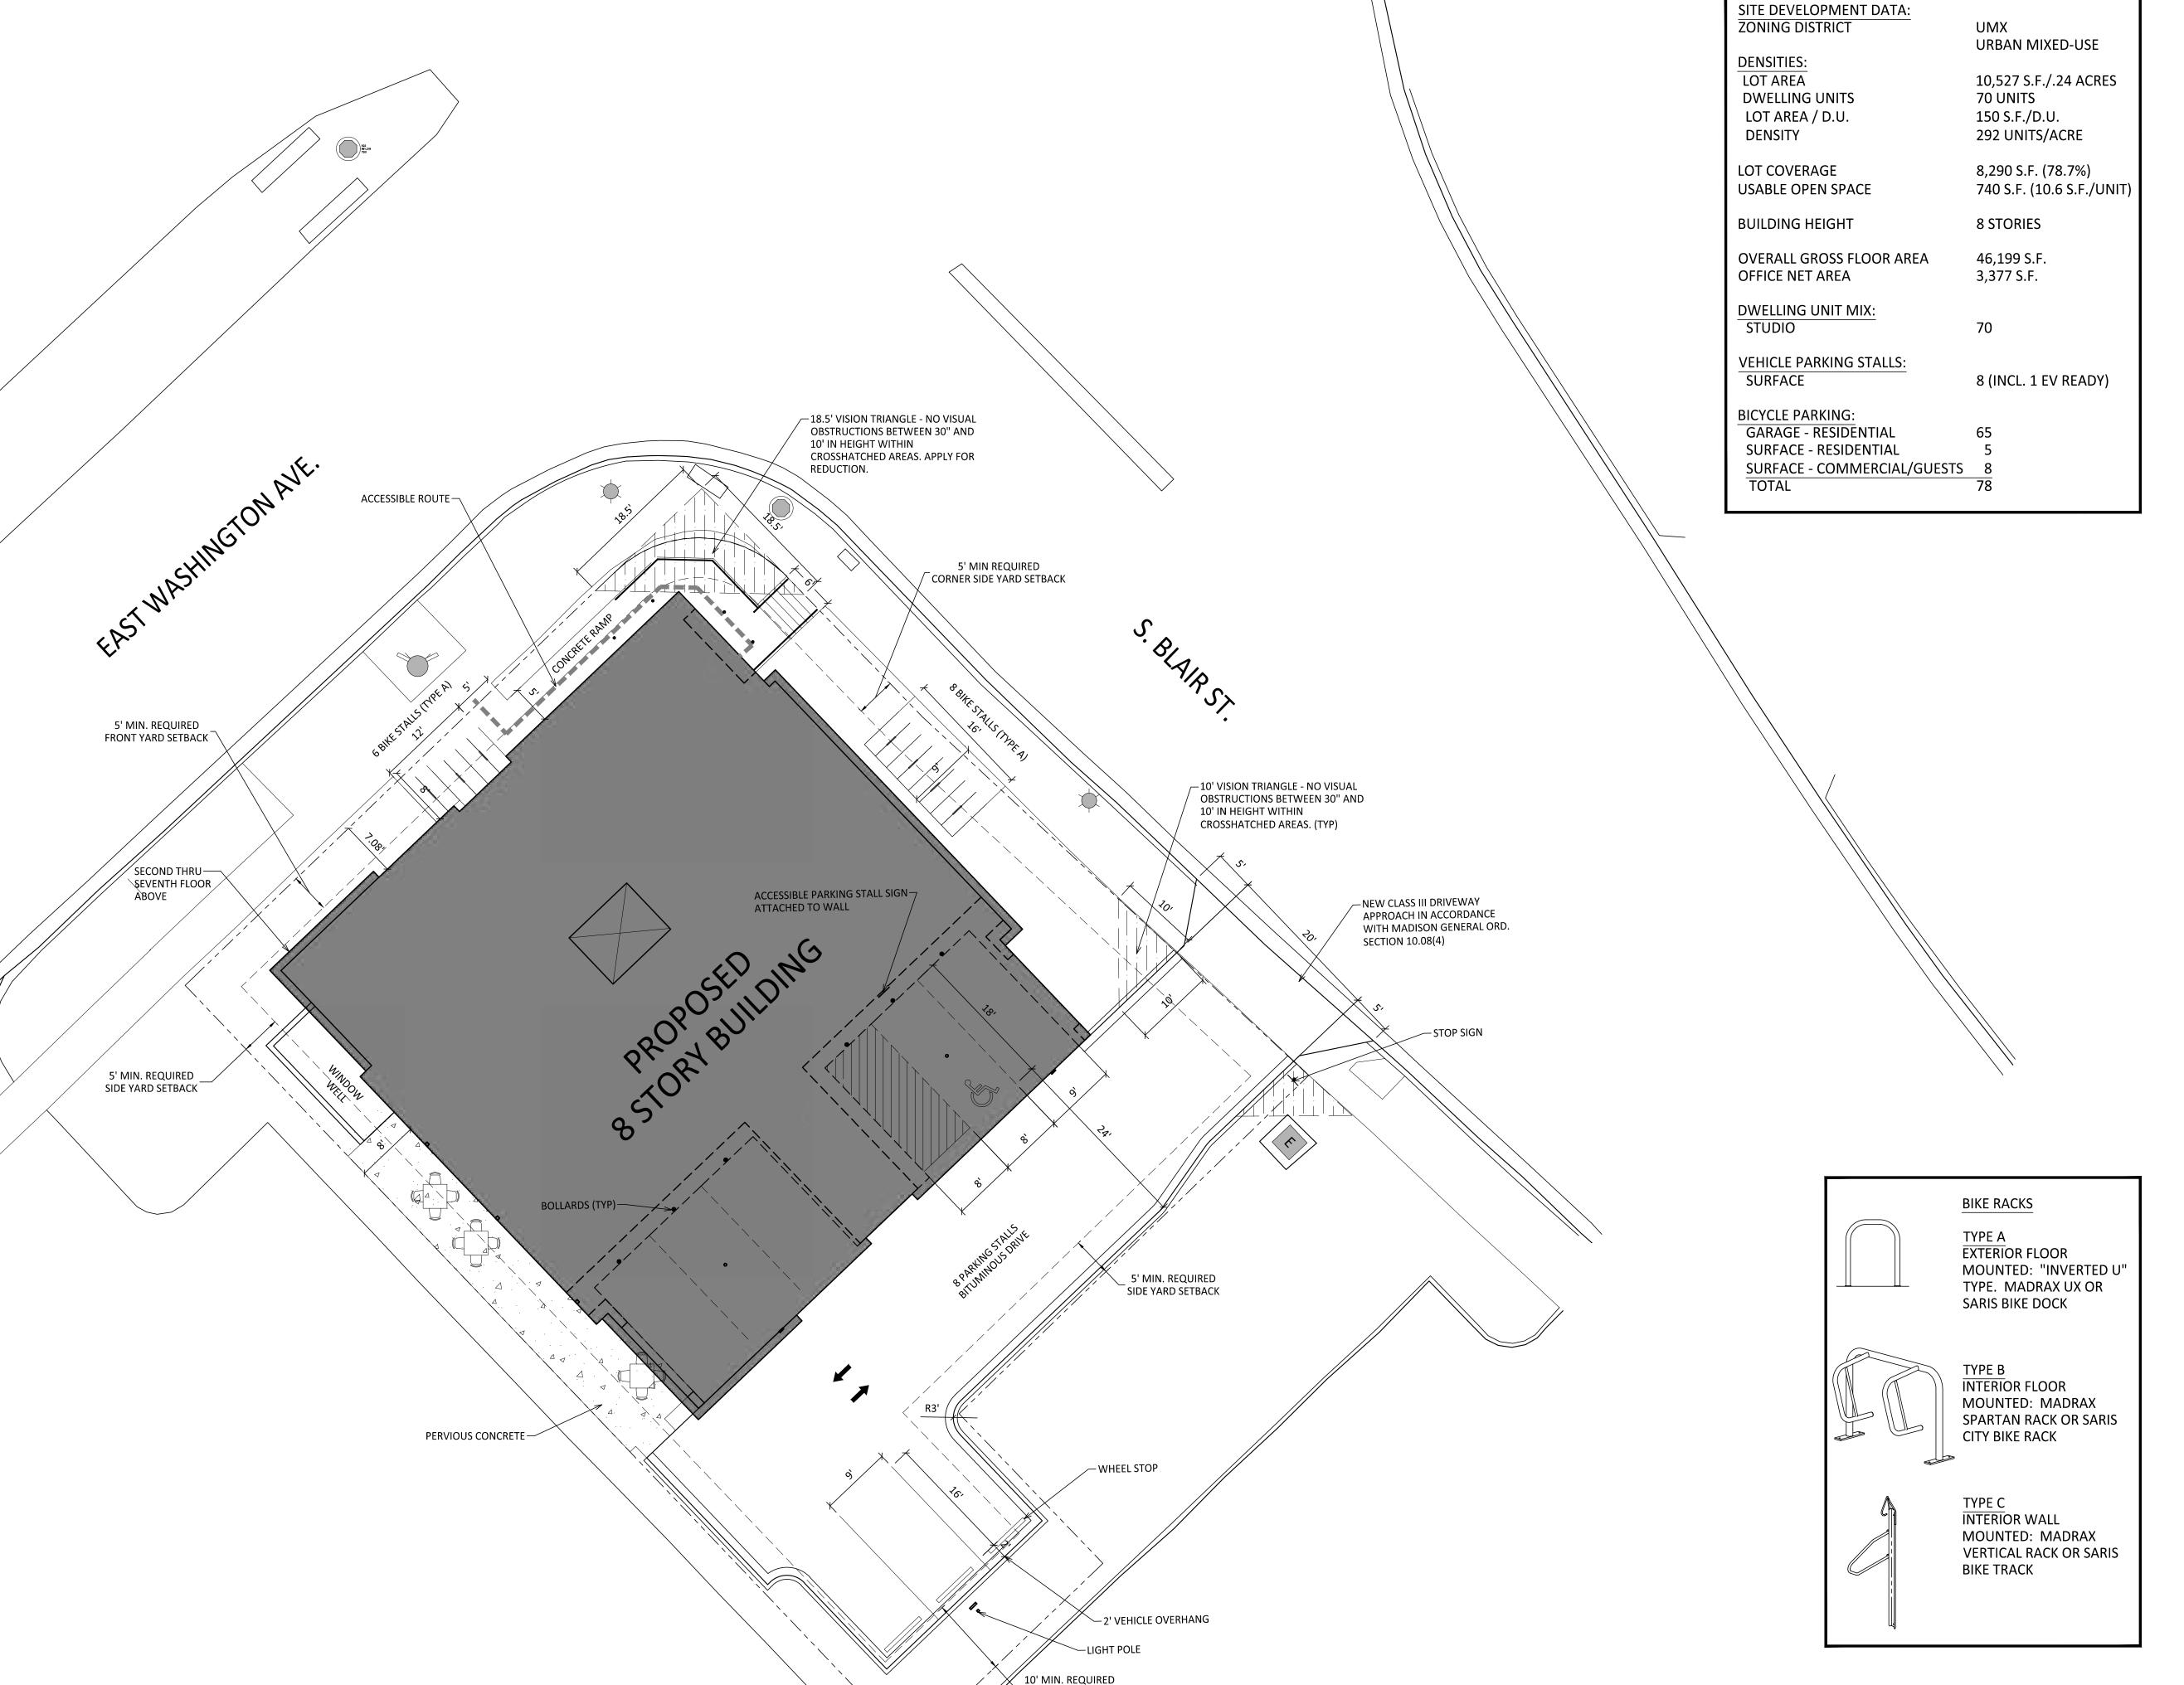

REAR YARD SETBACK

ARCHITECTURAL SITE PLAN



ISSUED LU & UDC SUBMITTAL - 05.13.2024

PROJECT TITLE
PORCHLIGHT
REDEVELOPMENT

521 E. WASHINGTON AVE. MADISON, WI

SHEET TITLE
ARCHITECTURAL
SITE PLAN

SHEET NUMBER


GRAPHIC SCALE

1 INCH = 10 FT (24X36 SHEET)

C201

PROJECT NUMBER 2379

© Knothe & Bruce Architects, LLC

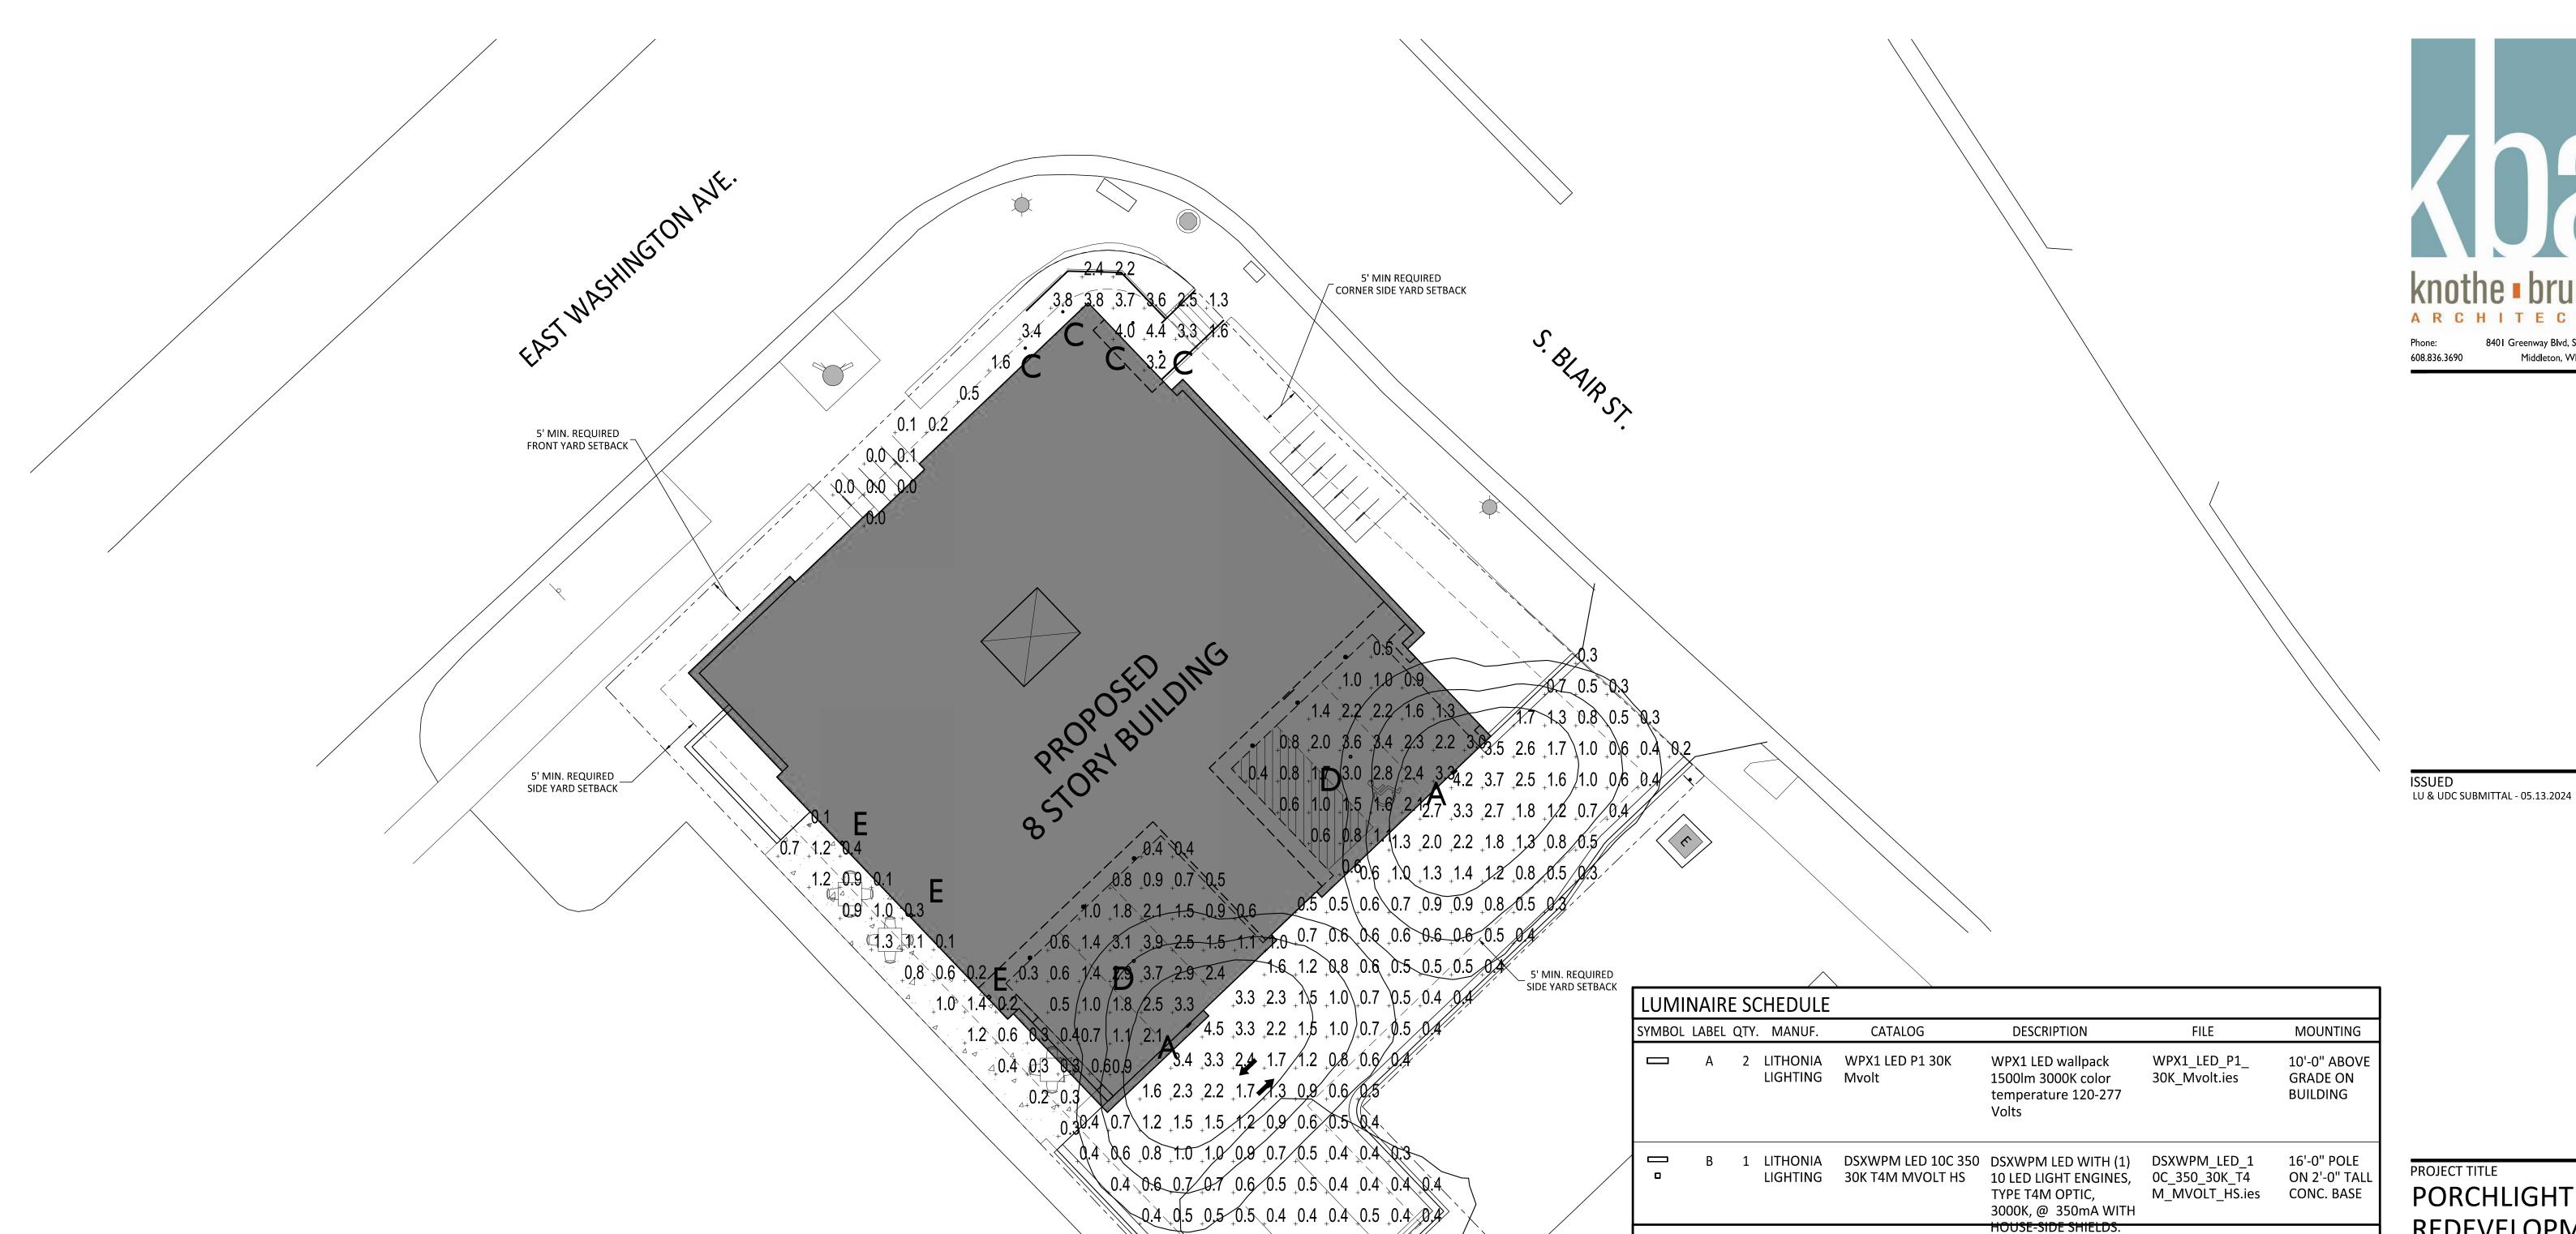

0.4 0.4 0.4 0.4 0.5 0.5 0.5

LIGHT LEVEL STATISTICS

Covered Parking Southwest

Covered Parking Southeast

Outdoor Seating Area

E Wash Entrance Area

Drive Aisle and Parking Area

SYMBOL AVG. MAX. MIN. MAX./MIN. AVG./MIN.

5.0:1

4.3:1

6.0:1

N/A

5.0:1

N/A

1.5 fc 3.9 fc 0.3 fc 13.0:1

1.7 fc 3.6 fc 0.4 fc 9.0:1

0.6 fc 1.4 fc 0.1 fc 14.0:1

1.0 fc 4.5 fc 0.2 fc 22.5:1

1.9 fc 4.4 fc 0.0 fc

DESCRIPTION


0.3 ,0.4 ,0.4 ,0.5 ,0.6


0.3 _{0.4} 0.5 B

_ 10' MIN. REQUIRED REAR YARD SETBACK

4 LITHONIA WF3 LED 27K 9'-3" ABOVE WF3_LED_27K.ies 3" Matte White LED Ultra-Thin Wafer LIGHTING GRADE CANOPY CANS Downlight, 2700K CCT 2 LITHONIA WF4 LED 50K WF4_LED_50K.ies 9'-0" ABOVE 4" Ultra-Thin LED LIGHTING GRADE Wafer Downlight, 5000K CCT, 120V **CANOPY CANS** L004005FCSL54 FCSL510 **Exterior Die-Cast** 2 FC/SSL 6'-0" ABOVE Aluminum Steplight for 04K.ies **GRADE ON** Lighting Masonry Applications. BUILDING **EXAMPLE LIGHT FIXTURE DISTRIBUTION** ISOLUX CONTOUR = 0.25 FC ISOLUX CONTOUR = 0.5 FC ISOLUX CONTOUR = 1.0 FC LIGHT FIXTURE

SITE LIGHTING PLAN C202 1" = 10'-0"





PROJECT TITLE PORCHLIGHT REDEVELOPMENT

521 E. WASHINGTON AVE.


MADISON, WI SHEET TITLE SITE LIGHTING **PLAN**

SHEET NUMBER

C202

PROJECT NUMBER

2379 © Knothe & Bruce Architects, LLC

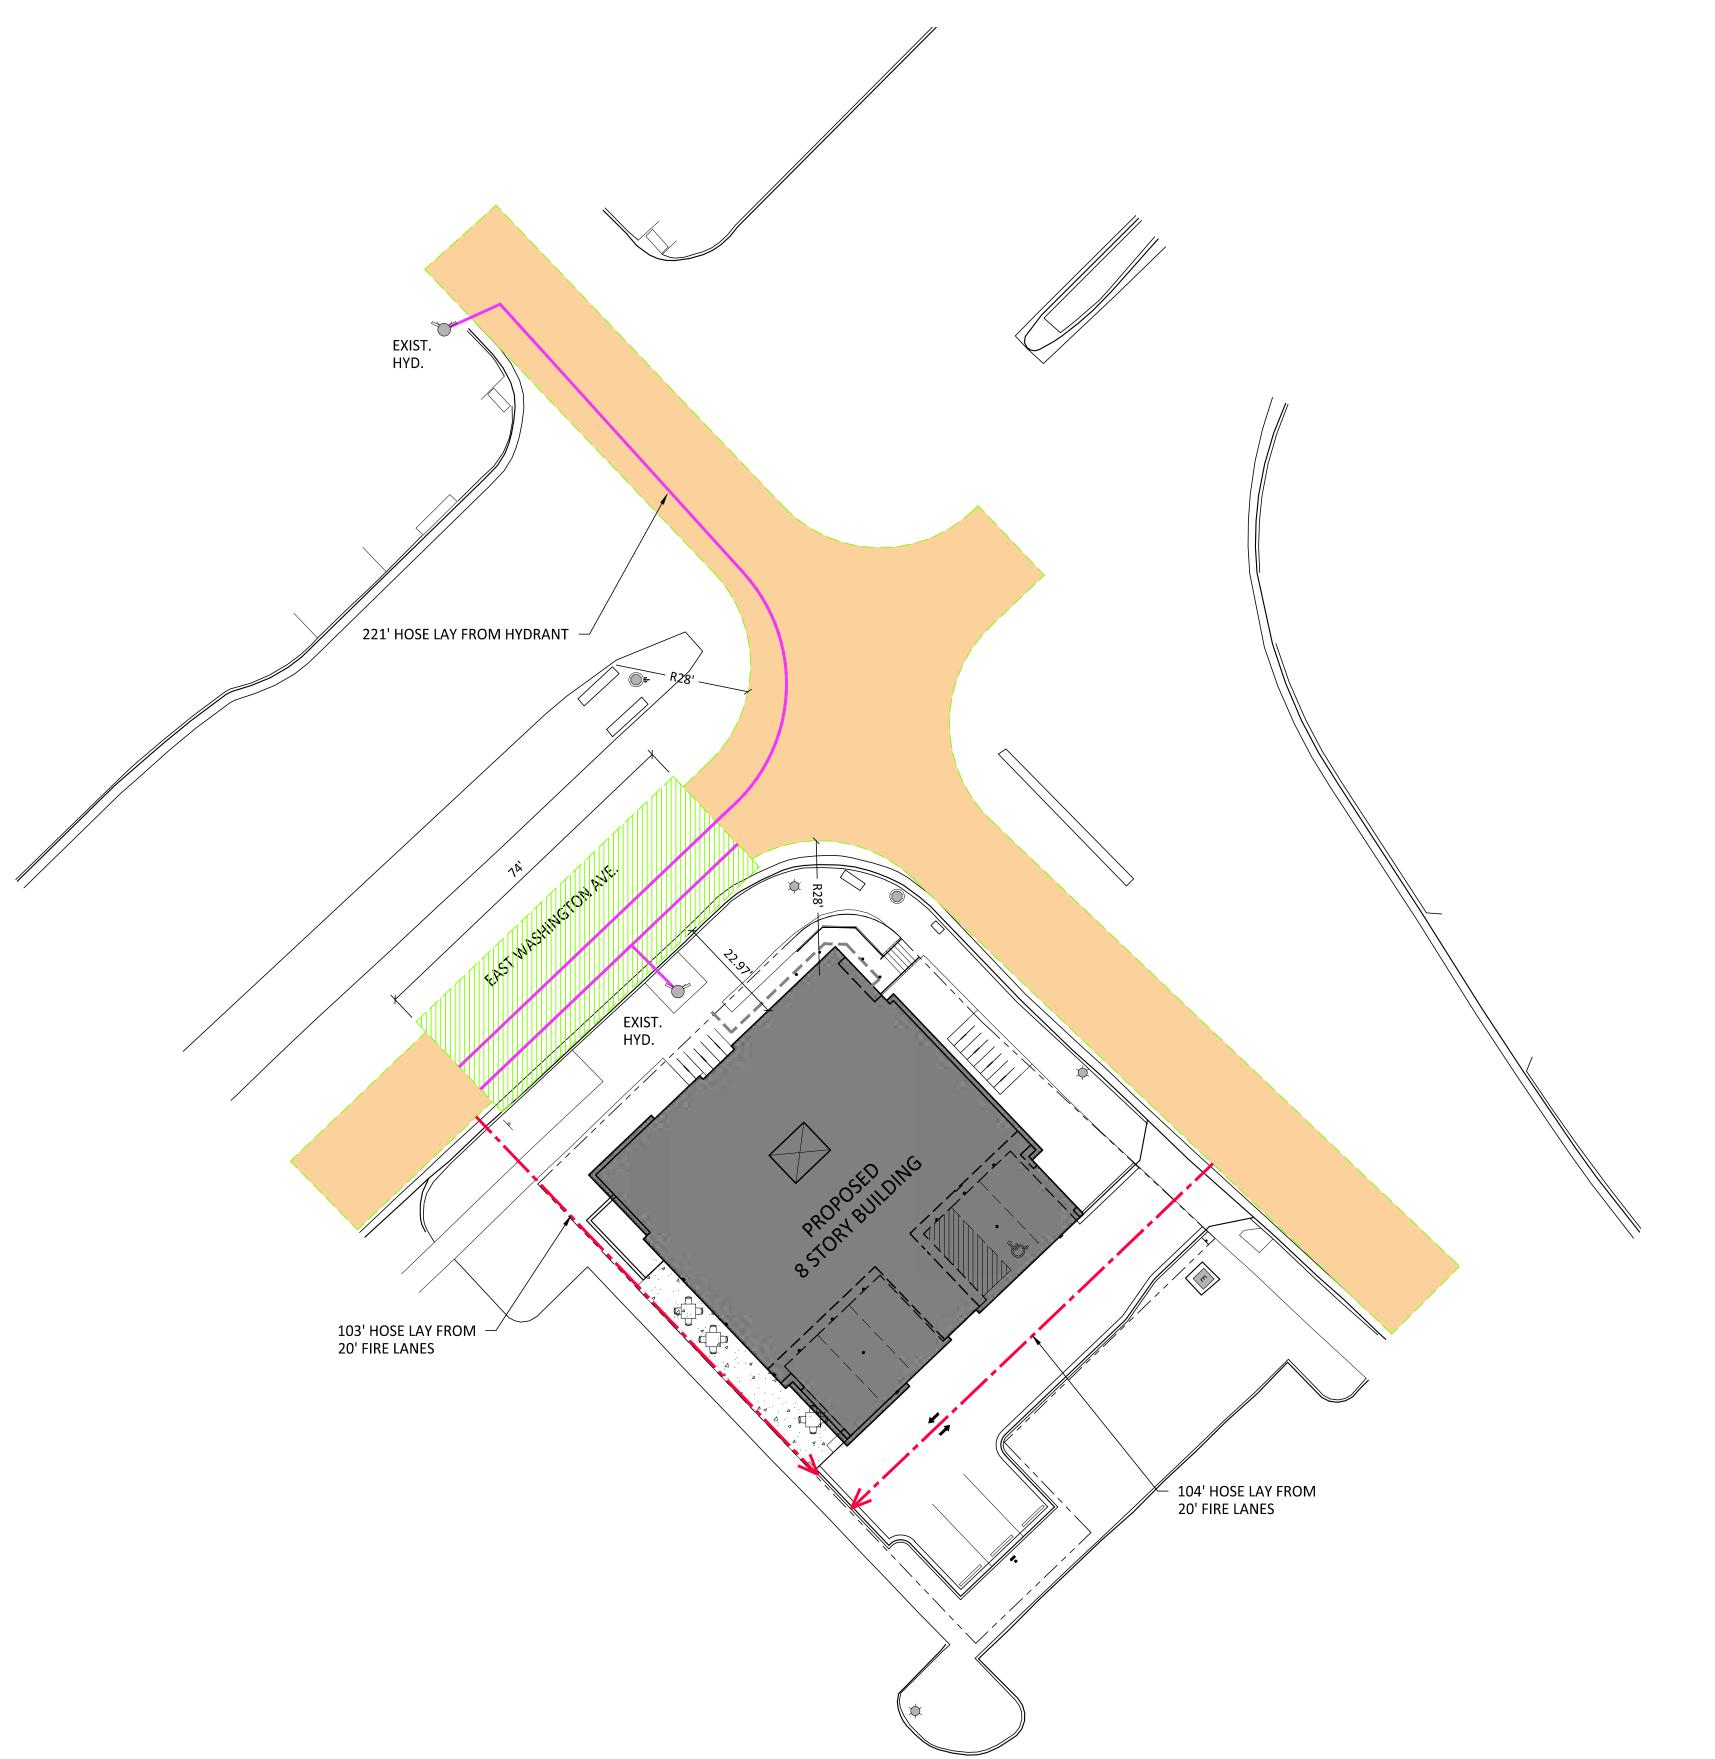

FIRE ACCESS DATA 295 LINEAR FEET **BUILDING PERIMETER** 26' WIDE AERIAL APPARATUS FIRE LANE 74 LR. FT. REQUIRED (25%) # LR. FT. PROVIDED 20' WIDE FIRE ACCESS LANE 250' MAX. HOSE LAY FROM 20' FIRE ACCESS LANE 500' MAX. HOSE LAY FROM HYDRANT TO FAR END OF AERIAL APPARATUS LANE



ISSUED LU & UDC SUBMITTAL - 05.13.2024

PROJECT TITLE PORCHLIGHT REDEVELOPMENT

521 E. WASHINGTON AVE. MADISON, WI

FIRE DEPARTMENT **ACCESS PLAN**


SHEET NUMBER


C203

PROJECT NUMBER 2379

© Knothe & Bruce Architects, LLC



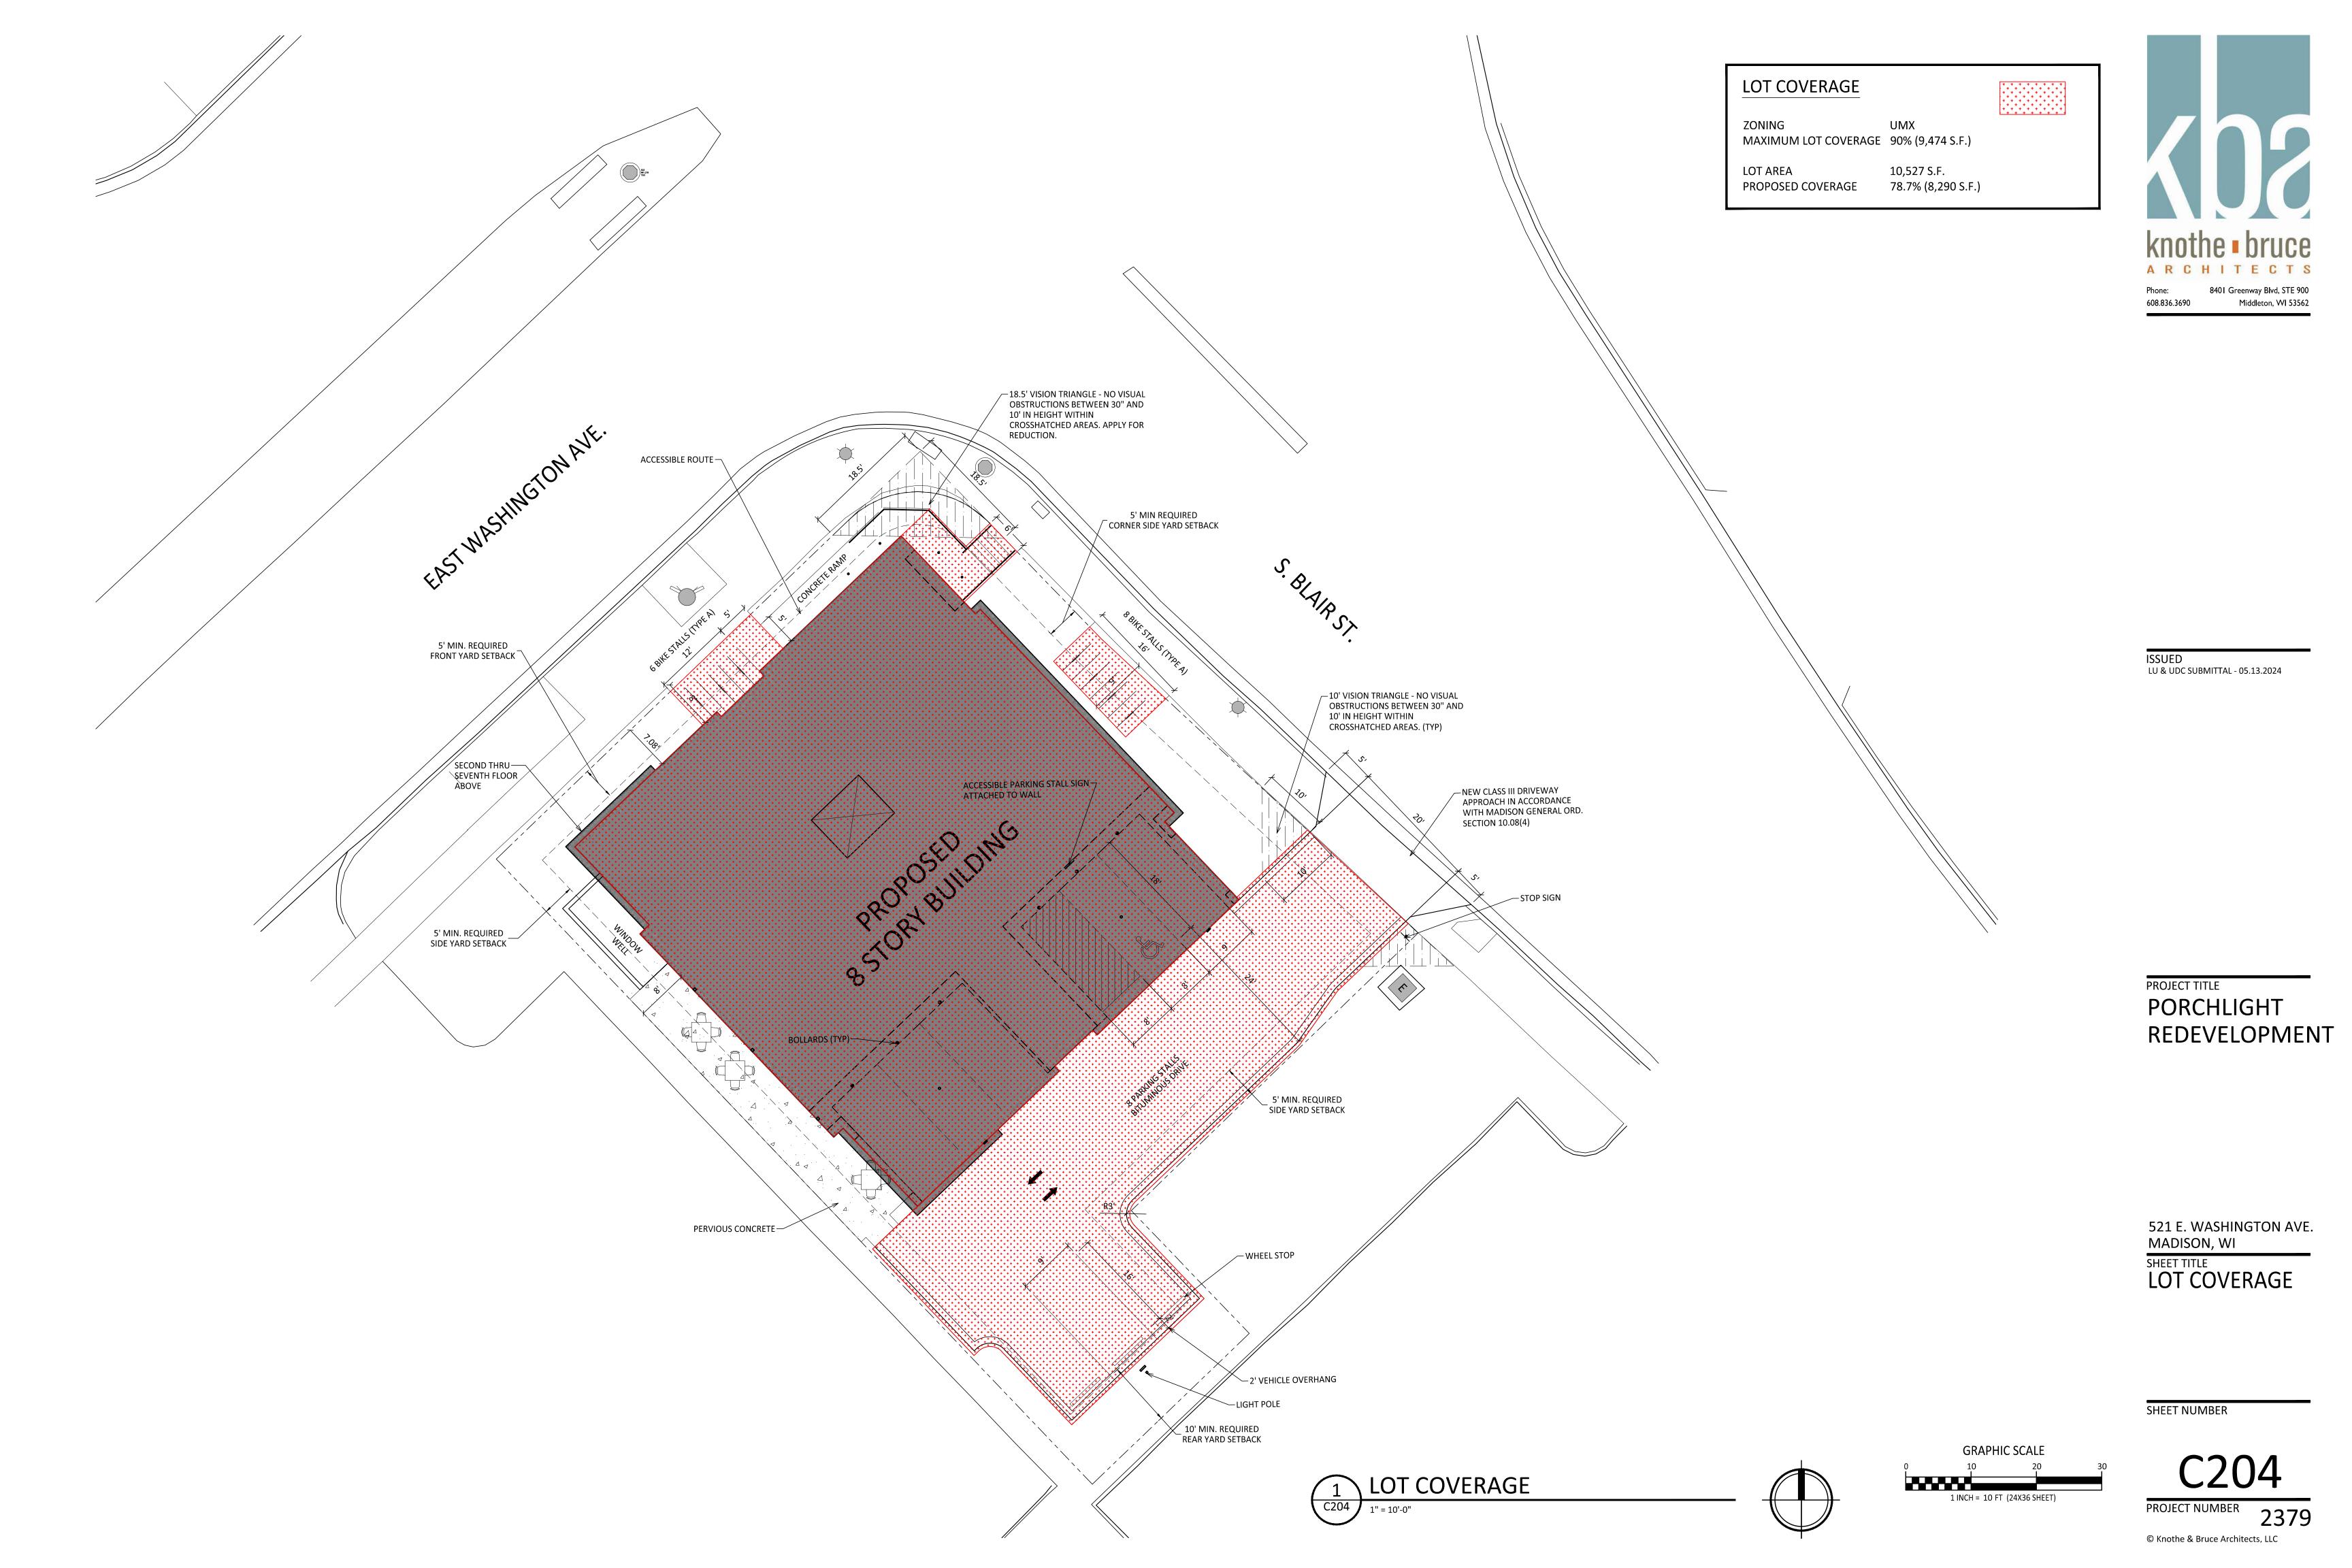

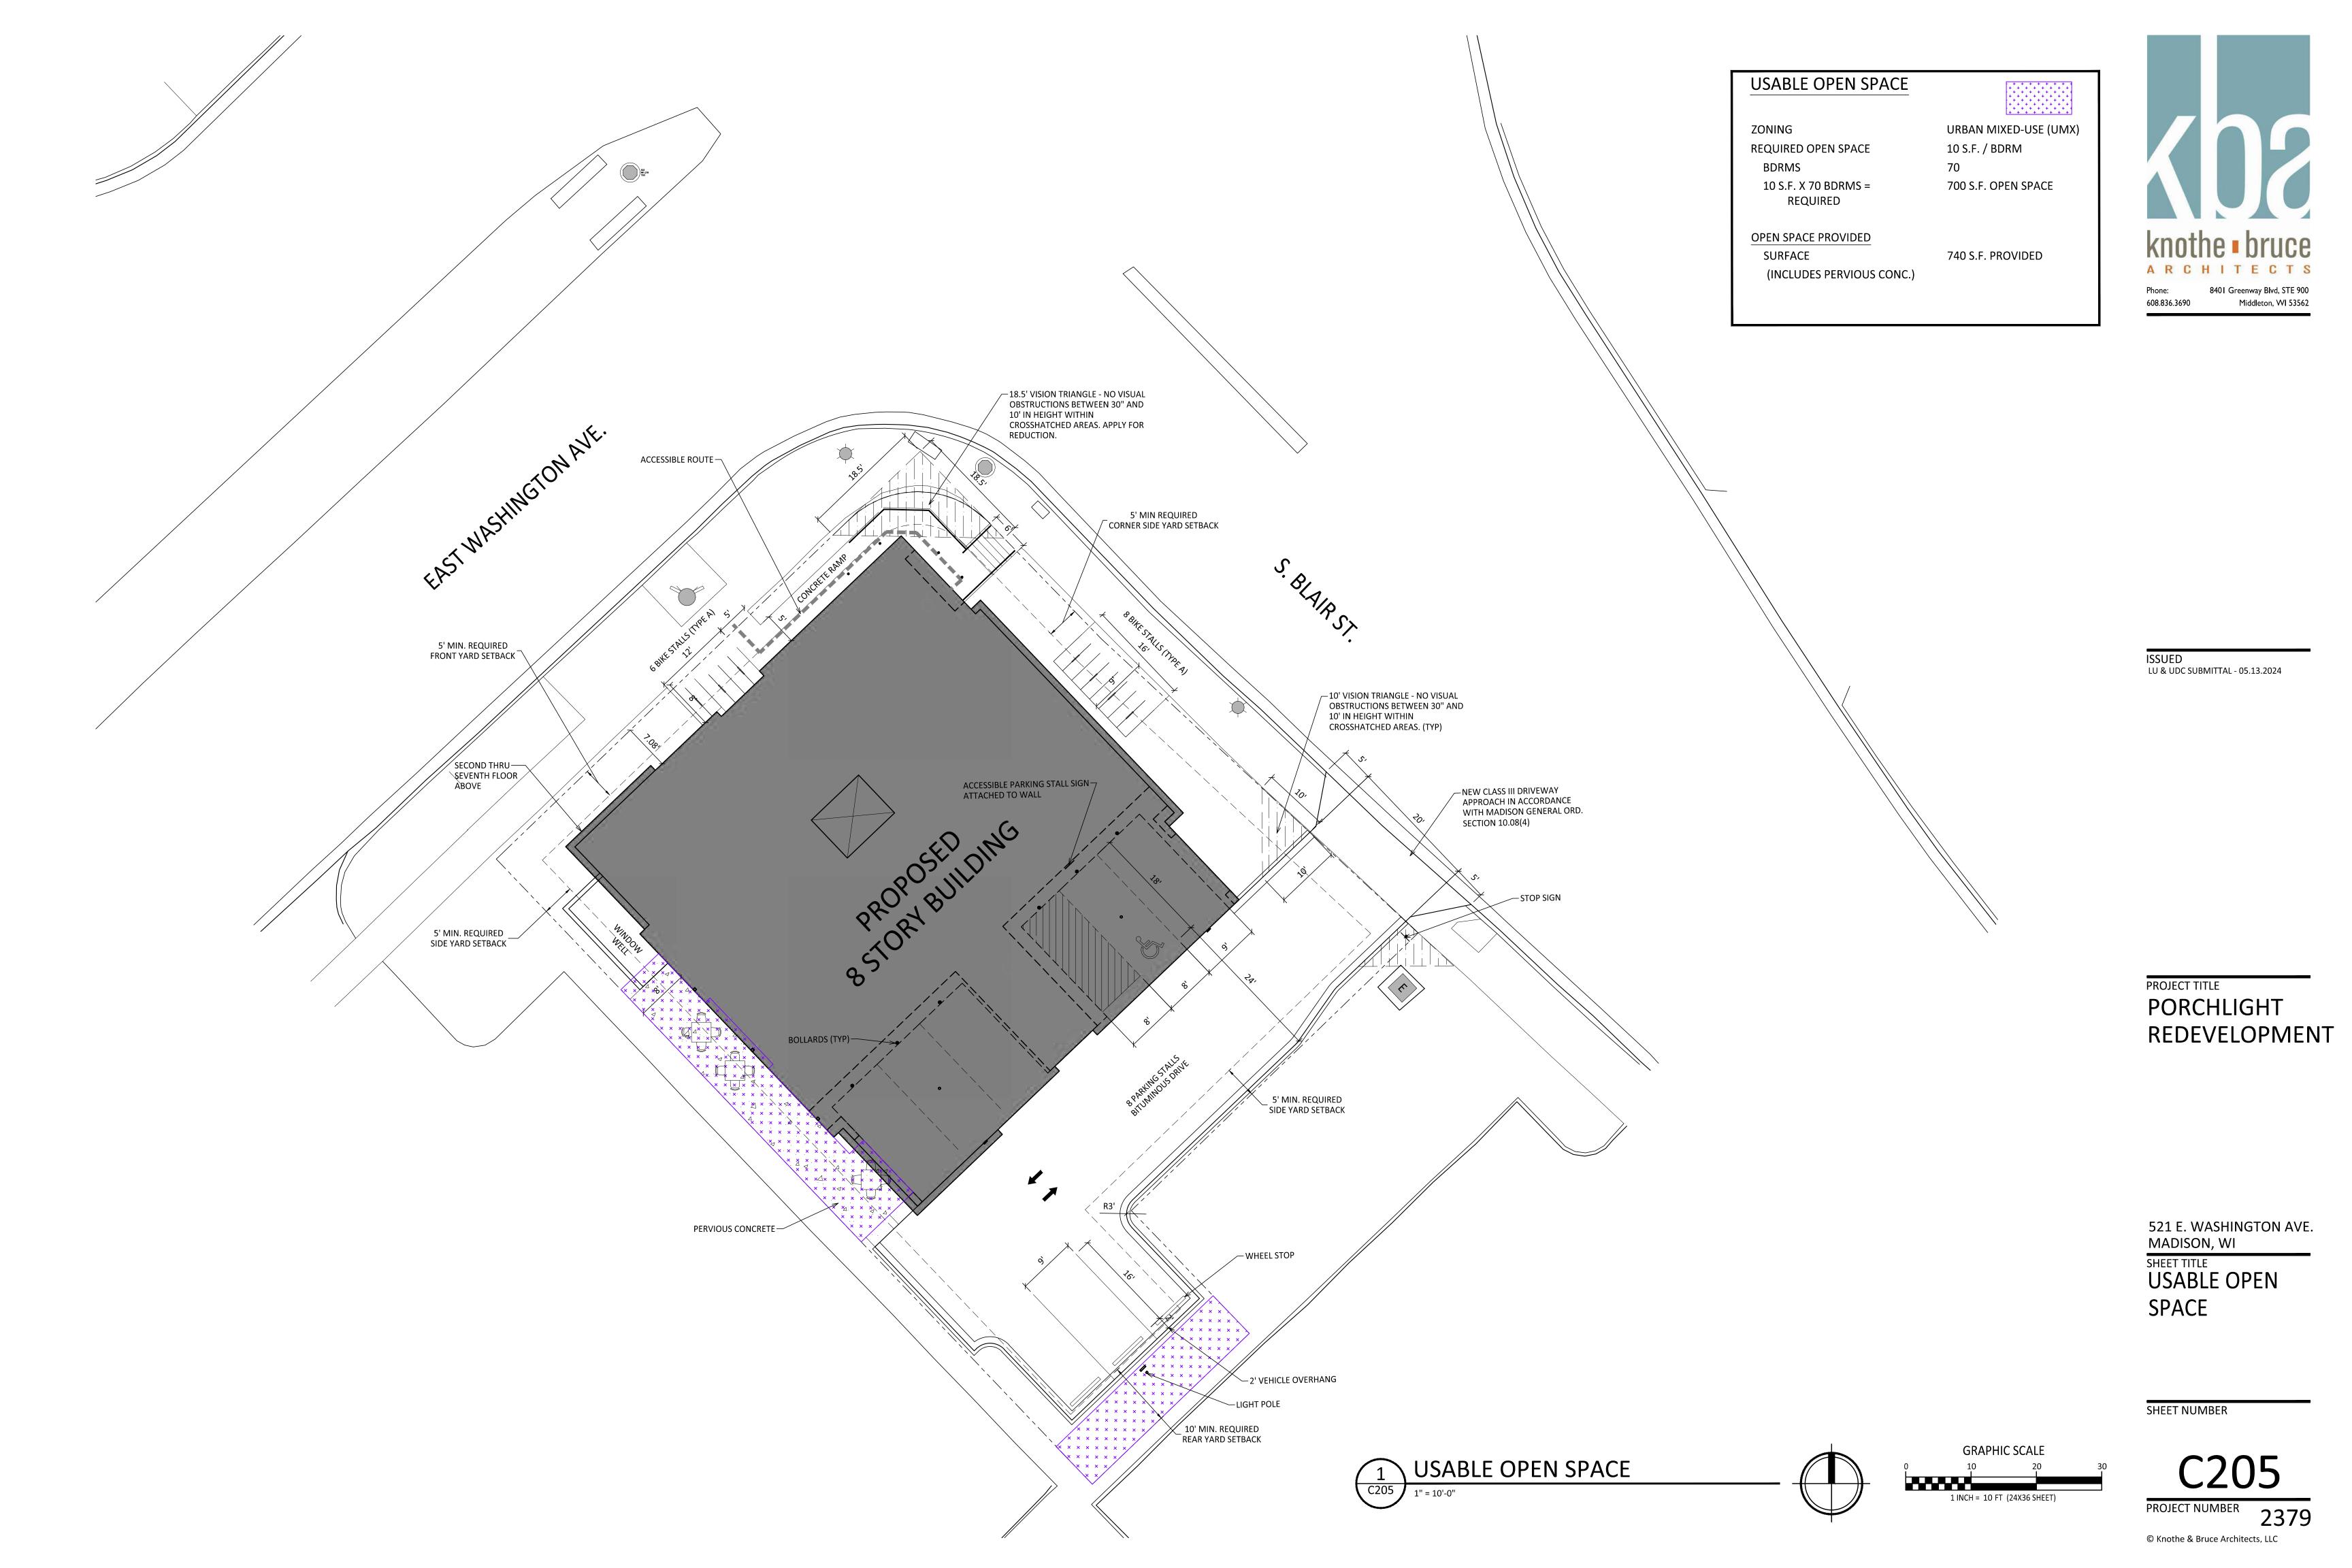



PORCHLIGHT REDEVELOPMENT

521 E. WASHINGTON AVE. MADISON, WI

PROJECT NUMBER: 2379



Cover Sheet

EXISTING SURVEY SITE DEMOLITION PLAN C100 C101 SITE PLAN LEVELS 02-07 PLAN C200 GRADING & EROSION PLAN ARCHITECTURAL SITE PLAN SITE LIGHTING PLAN FIRE DEPARTMENT ACCESS PLAN C204 LOT COVERAGE **EXTERIOR ELEVATIONS** C205 **USABLE OPEN SPACE** AC202 UTILITY PLAN C300 DETAILS AC204 EXTERIOR COLOR ELEVATIONS

AC205 BIRD-SAFE COMPLIANCE BIRD-SAFE COMPLIANCE AC901 Render View 01 AC902 Render View 02 AC903 Render View 03 AC904 Render View 04 AC905 Render View 05 AC906 Render View 06 Render View 07 AC908 Render View 08

LANDSCAPE PLAN PLANT SCHEDULE & LANDSCAPE POINTS WORKSHEET

PARKING COUNT - VEHICLES **TYPE** LEVEL 01 ADA PARKING STALL TYP. PARKING STALL TOTAL VEHICLE PARKING COUNT: 8

UNIT - TOTALS

STUDIO

TOTAL UNITS: 60

PARKING COUNT - BIKES			
LEVEL	ТҮРЕ		
LEVEL 01	SITE BIKE STALL		
6			
LEVEL 01: 6			
LOWER LEVEL	F.M. BIKE STALL		
42			
LOWER LEVEL	W.M. BIKE STALL		
5			
LOWER LEVEL: 47			
TOTAL BIKE PARKING COUNT	T: 53		

GROSS AREAS		
LEVEL	GROSS AREA	
LOWER LEVEL	4254 SF	
LEVEL 01	4020 SF	
LEVEL 02	5435 SF	
LEVEL 03	5435 SF	
LEVEL 04	5435 SF	
LEVEL 05	5435 SF	
LEVEL 06	5435 SF	
LEVEL 07	5435 SF	
LEVEL 08	5318 SF	
TOTAL AREA	46199 SF	

LEVEL	TYPE	AREA
	-	
LOWER LEVEL	PROGRAM	1692 SF
LEVEL 01	PROGRAM	2120 SF
LEVEL 02	UNITS	4212 SF
LEVEL 03	UNITS	4212 SF
LEVEL 04	UNITS	4250 SF
LEVEL 05	UNITS	4212 SF
LEVEL 06	UNITS	4212 SF
LEVEL 07	UNITS	4212 SF
LEVEL 08	UNITS	4095 SF
		33214 SF



LU & UDC SUBMITTAL - 05.13.2024



BEARINGS ARE BASED UPON THE WISCONSIN COUNTY COORDINATE SYSTEM, DANE ZONE, THE SE R/W LINE OF E. WASHINGTON AVENUE MEASURED AS BEARING N46°06'33"E

LEGEND

BM-2 (40' ± NW)

		MONITORING WELL
	\Box	MAILBOX
		SIGN
	0	BOLLARD
	S	SANITARY MANHOLE
	@	SEWER CLEANOUT
	GM	GAS METER
2	\bowtie	GAS VALVE
الا ا		FIRE HYDRANT
2	\oslash	WATER VALVE
NYO O	(S)	CURB STOP
		INLETS
	(57)	STORM MANHOLE
)	☑	STORM ROOF DRAIN
	Ø	UTILITY POLE
	EM	ELECTRICAL METER
	E	ELECTRICAL TRANSFORMER
	AC	AIR CONDITIONING UNIT
		STOP LIGHT GUY ANCHOR
IM)	LIGHT POLE
	X	UTILITY PEDESTAL
л ——	\\\\ (E)	WALL LIGHT ELECTRIC MANHOLE
	9	DECIDUOUS TREE OR BUSH
		CONIFEROUS TREE
	7//////////////////////////////////////	BUILDING FOOTPRINT EDGE OF CONCRETE
		EDGE OF ASPHALT
		CHAIN LINK FENCE
	SAN SAN	CHAIN LINK FENCE RAILING SANITARY SEWER LATERAL
	SAN SAN	CHAIN LINK FENCE RAILING SANITARY SEWER LATERAL 6" PVC SANITARY SEWER
	SAN SAN	CHAIN LINK FENCE RAILING SANITARY SEWER LATERAL 6" PVC SANITARY SEWER 8" PVC SANITARY SEWER
	——————————————————————————————————————	CHAIN LINK FENCE RAILING SANITARY SEWER LATERAL 6" PVC SANITARY SEWER 8" PVC SANITARY SEWER 10" PVC SANITARY SEWER
	SAN SAN SAN 6"SAN 6"SAN 10"SAN 10"SAN 10"SAN WAT WAT 6"WAT 6"WAT 6"WAT	CHAIN LINK FENCE RAILING SANITARY SEWER LATERAL 6" PVC SANITARY SEWER 8" PVC SANITARY SEWER 10" PVC SANITARY SEWER WATER SERVICE 6" DUCTILE IRON WATER MAIN
	SAN	CHAIN LINK FENCE RAILING SANITARY SEWER LATERAL 6" PVC SANITARY SEWER 8" PVC SANITARY SEWER 10" PVC SANITARY SEWER WATER SERVICE 6" DUCTILE IRON WATER MAIN 10" PVC WATER MAIN
	——————————————————————————————————————	CHAIN LINK FENCE RAILING SANITARY SEWER LATERAL 6" PVC SANITARY SEWER 10" PVC SANITARY SEWER WATER SERVICE 6" DUCTILE IRON WATER MAIN 10" PVC WATER MAIN 12" DUCTILE IRON WATER MAIN
	SAN	CHAIN LINK FENCE RAILING SANITARY SEWER LATERAL 6" PVC SANITARY SEWER 8" PVC SANITARY SEWER 10" PVC SANITARY SEWER WATER SERVICE 6" DUCTILE IRON WATER MAIN 10" PVC WATER MAIN 12" DUCTILE IRON WATER MAIN
	SAN SAN SAN 6"SAN 6"SAN 6"SAN 10"SAN 10"SAN 10"SAN MAT MAT 10"WAT 10"WAT 10"WAT 12"WAT 12"WAT 12"STM 12"STM 12"STM	CHAIN LINK FENCE RAILING SANITARY SEWER LATERAL 6" PVC SANITARY SEWER 10" PVC SANITARY SEWER UNITARY SEWER DUCTILE IRON WATER MAIN 10" PVC WATER MAIN 12" DUCTILE IRON WATER MAIN 12" DUCTILE IRON WATER MAIN 12" RCP STORM SEWER 14" HERCP STORM SEWER
	SAN	CHAIN LINK FENCE RAILING SANITARY SEWER LATERAL 6" PVC SANITARY SEWER 8" PVC SANITARY SEWER 10" PVC SANITARY SEWER UNITARY SEWER DUCTILE IRON WATER MAIN 10" PVC WATER MAIN 12" DUCTILE IRON WATER MAIN 12" COLOTILE IRON WATER MAIN 12" COLOTILE IRON WATER MAIN 12" COLOTILE IRON WATER MAIN 12" RCP STORM SEWER 14" HERCP STORM SEWER NATURAL GAS LINE
	SAN	CHAIN LINK FENCE RAILING SANITARY SEWER LATERAL OF PVC SANITARY SEWER SIPPC SANITARY SEWER OF PVC WATER MAIN SIPPC WATER MAIN SIPPC WATER MAIN SIPPC STORM SEWER SIPPC STORM SEWER OF STORM SEWER OF STORM SEWER SIPPC STORM SEWER OF STORM SEWER
	SAN	CHAIN LINK FENCE RAILING SANITARY SEWER LATERAL 6" PVC SANITARY SEWER 8" PVC SANITARY SEWER 10" PVC SANITARY SEWER WATER SERVICE 6" DUCTILE IRON WATER MAIN 10" PVC WATER MAIN 12" DUCTILE IRON WATER MAIN 12" RCP STORM SEWER 14" HERCP STORM SEWER NATURAL GAS LINE COMMUNICATION LINE
	SAN	CHAIN LINK FENCE RAILING SANITARY SEWER LATERAL 6" PVC SANITARY SEWER 8" PVC SANITARY SEWER 10" PVC SANITARY SEWER UNITARY SEWER DUCTILE IRON WATER MAIN 10" PVC WATER MAIN 12" DUCTILE IRON WATER MAIN 12" DUCTILE IRON WATER MAIN 12" RCP STORM SEWER 14" HERCP STORM SEWER NATURAL GAS LINE COMMUNICATION LINE ELECTRIC LINE
		CHAIN LINK FENCE RAILING SANITARY SEWER LATERAL 6" PVC SANITARY SEWER 8" PVC SANITARY SEWER 10" PVC SANITARY SEWER DUCTILE IRON WATER MAIN 10" PVC WATER MAIN 12" DUCTILE IRON WATER MAIN 12" DUCTILE IRON WATER MAIN 12" RCP STORM SEWER 14" HERCP STORM SEWER NATURAL GAS LINE COMMUNICATION LINE ELECTRIC LINE ASPHALT PAVEMENT CONCRETE PAVEMENT



BIKE PARKING

21.0

VENT UNKNOWN—

WASHED STONE ™

521 E. WASHINGTON AVENUE EXISTING ONE-STORY BRICK BUILDING 3,333 SQ. FT. AT GROUND LEVEL

WASHED STONE

MULCH / WASHED STONE WASHED STONE WASHED STONE

MULCH /

MARCH 07TH, 2024 REVISED: MARCH 29TH, 2024

BENCHMARK TABLE		
BM - #	ELEVATION	DESCRIPTION
BM - 1	863.74'	NE BOLT OF FIRE HYDRANT LOCATED ON THE SOUTHEAST SIDE OF E. WASHINGT AVENUE, 60' ± SOUTHWEST OF THE INTERSECTION WITH S. BLAIR STREET.
BM - 2	861.17'	SE BOLT OF FIRE HYDRANT LOCATED ON THE SOUTHWEST SIDE OF N. BLAIR STREET, 40' \pm NORTHWEST OF THE INTERSECTION WITH E. WASHINGTON AVENUATION OF THE INTERSECTION OF THE INTERSECTION WITH E. WASHINGTON AVENUATION OF THE INTERSECTION OF THE INTERSECTION OF THE INTERSECTION WITH E. WASHINGTON AVENUATION OF THE INTERSECTION OF THE INTERS
BM - 3	875.58'	EAST TAG BOLT "BURY 6-0" OF FIRE HYDRANT LOCATED IN THE SOUTH QUADRAI OF E. WASHINGTON AVE. & S. FRANKLIN ST. ON E. WASHINGTON AVE. FRONTAGI
BM - 4	874.55'	SOUTH TAG BOLT "BURY 7-0" OF FIRE HYDRANT LOCATED IN THE SOUTH QUADR/ OF E. WASHINGTON AVE. & S. FRANKLIN ST. ON S. FRANKLIN ST. FRONTAGE.



Toll Free (800) 242-8511

Hearing Impaired TDD (800) 542-2289


www.DiggersHotline.com

WYSE	ER NG
PREPARED BY: MICHAEL S. MARTY 300 EAST FRONT STREET MOUNT HOREB, WI 53572 (608) 437-1872 (direct) (608) 209-5284 (mobile) mike.marty@wyserengineering.com	
PREPARED FOR: JOHN LEJA 5603 SURREY LANE WAUNAKEE, WI 53597	N AVENUE 3
SURVEYED BY: MSM DRAWN BY: MSM REVIEWED BY: ZMR APPROVED BY: MSM	521 E. WASHINGTO MADISON, WI 5370
THE NE ½ OF LOT 3, AND THE NW 106 FEET OF LOT FOUR, BLOCK 116, ORIGINAL PLAT OF MADISON, AS RECORDED IN VOLUME A OF PLATS, ON PAGE 3, AS DOCUMENT NUMBER 102, DANE COUNTY REGISTER OF DEEDS, EXCEPT THAT PART CONVEYED TO THE CITY OF MADISON IN WARRANTY DEED RECORDED AS DOCUMENT NUMBER 1852305, DANE COUNTY REGISTER OF DEEDS, LOCATED IN THE NE ¼-SW ¼ AND THE SE ¼-SW ¼ ALL CITY OF MADISON, DANE COUNTY, WISCONSIN	ALTA/NSPS LAND TITLE SURVEY MADISON, WI 53703
Revisions: No. Date: Description:	
Revisions:	ption and
	HE NW 106 FEET OF LOT FOUR, BLOCK 116, J. AS RECORDED IN VOLUME A OF PLATS, ON BER 102, DANE COUNTY REGISTER OF DEEDS, BER 102, DANE COUNTY REGISTER OF DEEDS, IMENT NUMBER 1852305, DANE COUNTY MOUNT HOREB. WI 53572 MOUN

03/29/2024

Issued

Sheet Number

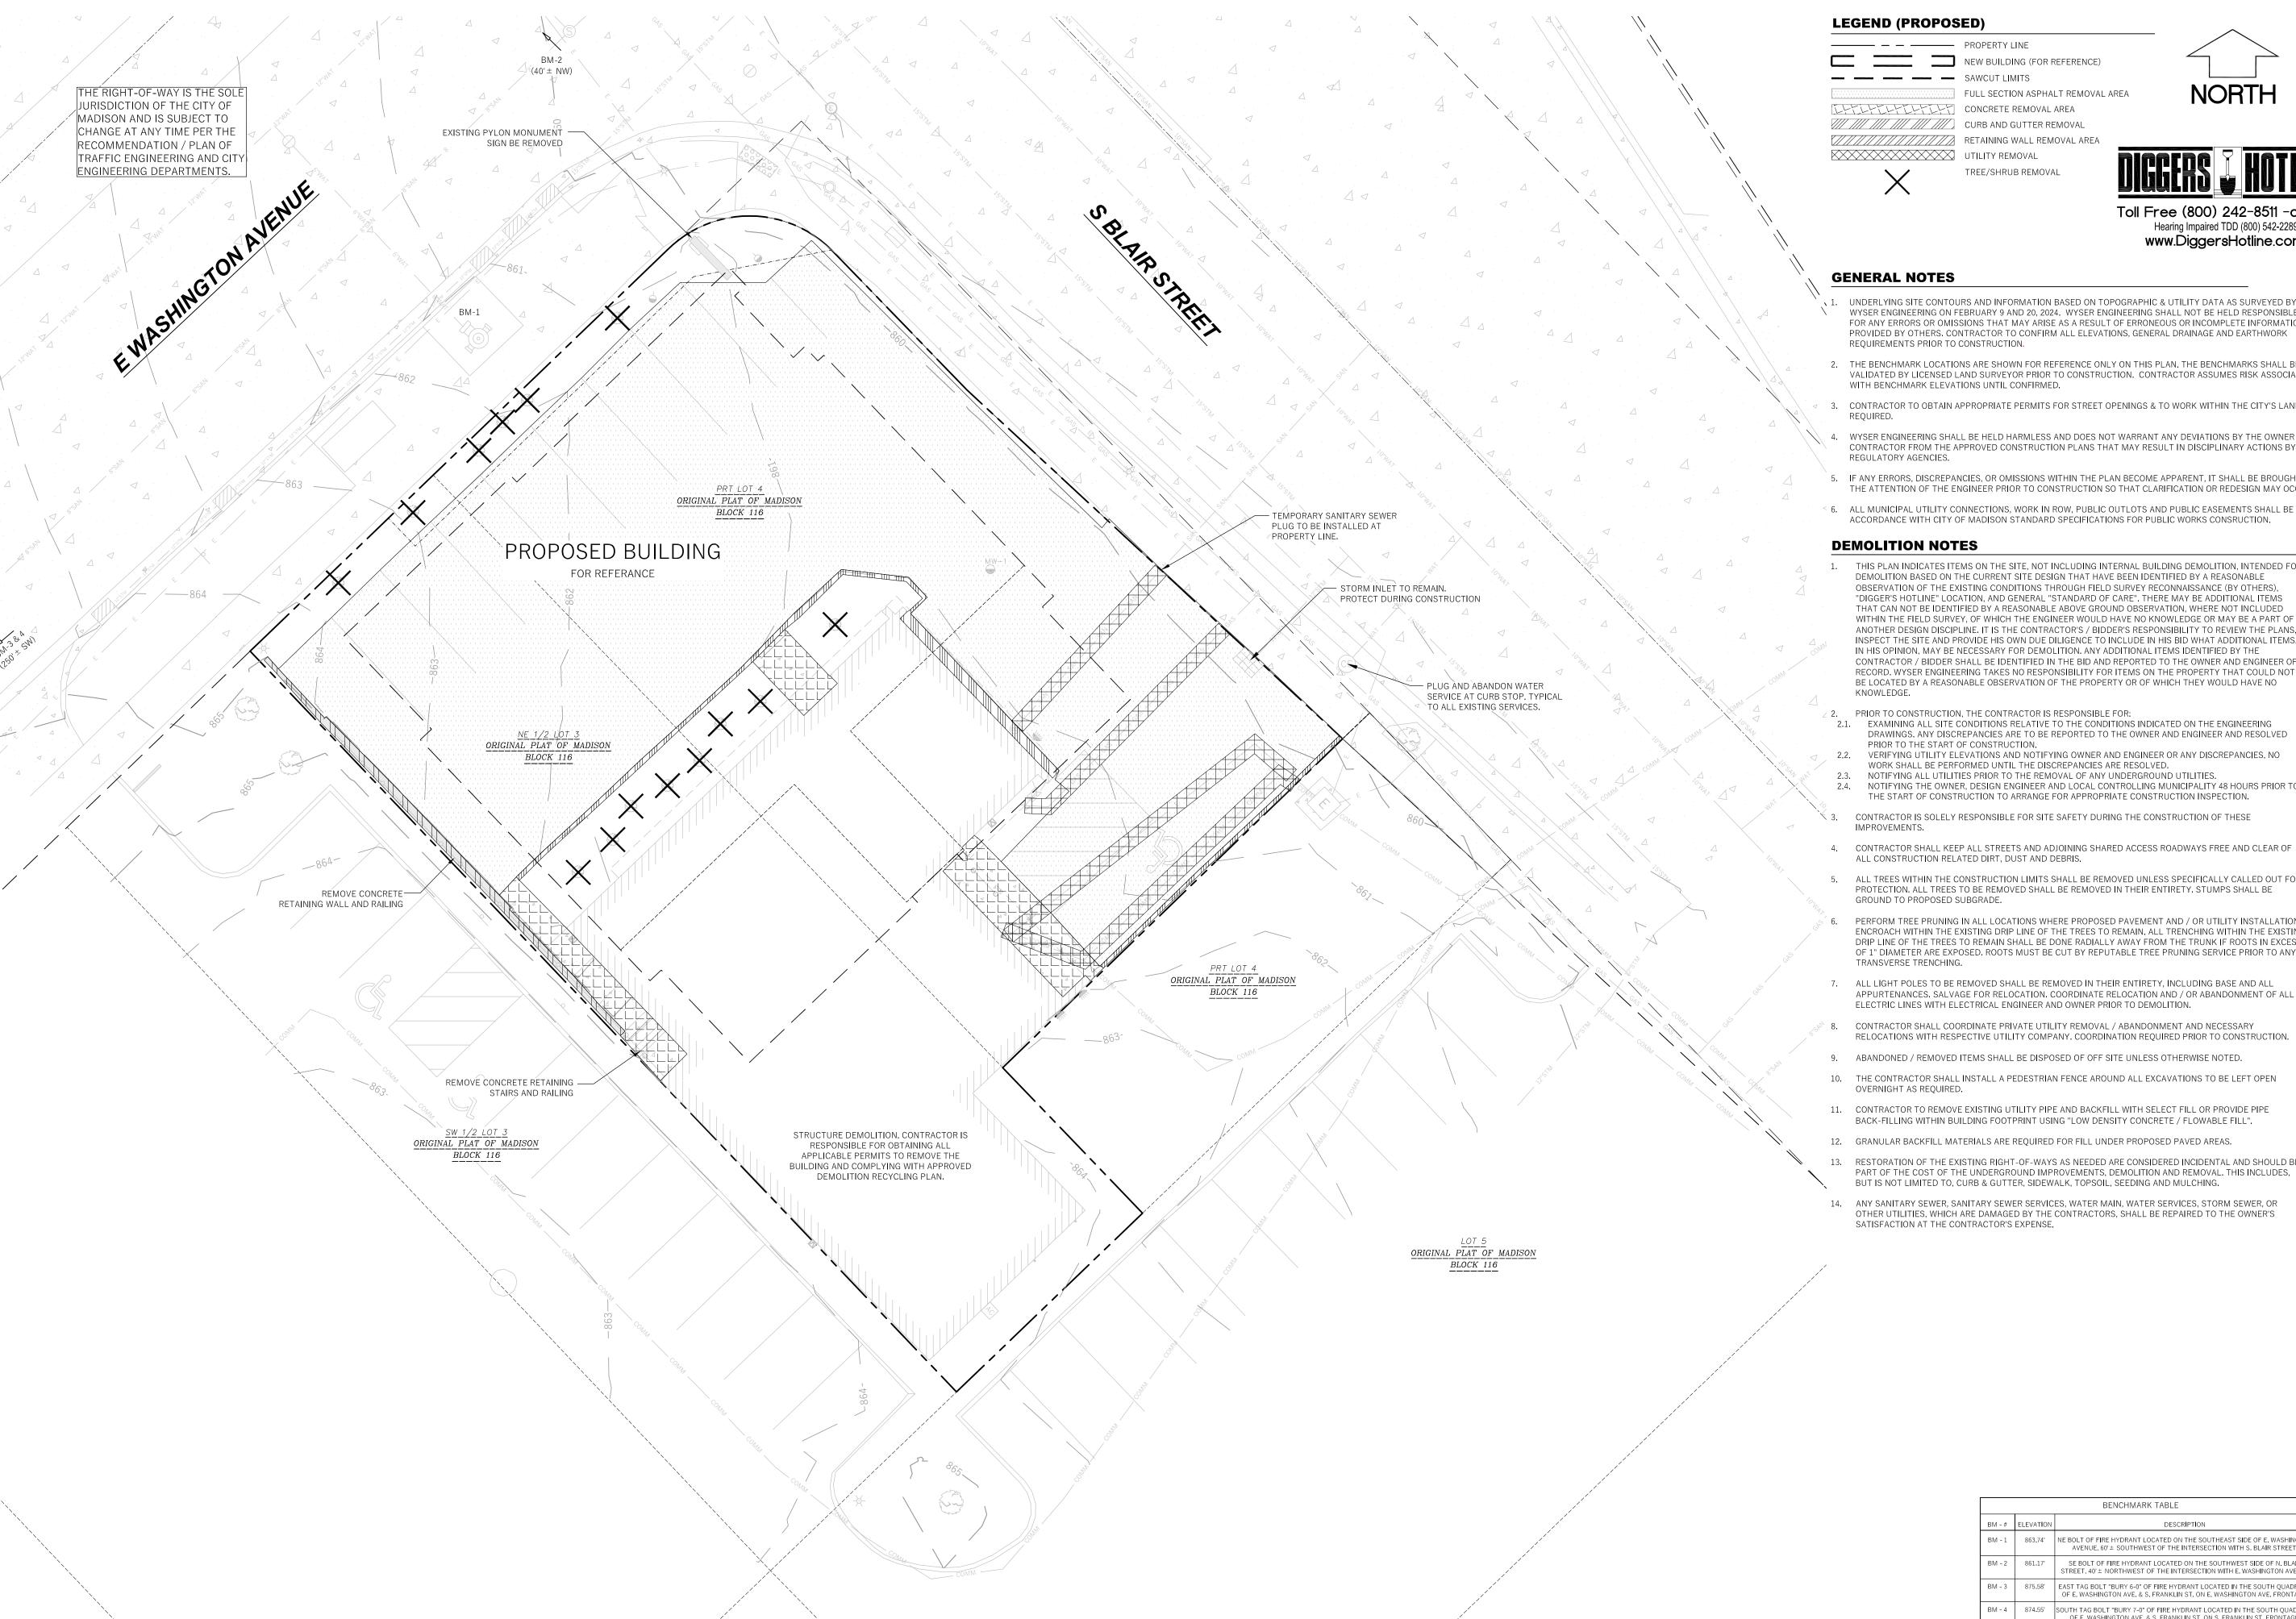

LEGEND (PROPOSED)

PROPERTY LINE NEW BUILDING (FOR REFERENCE) FULL SECTION ASPHALT REMOVAL AREA CONCRETE REMOVAL AREA //// //// CURB AND GUTTER REMOVAL

TREE/SHRUB REMOVAL







Toll Free (800) 242-8511 -or- 811

Hearing Impaired TDD (800) 542-2289

www.DiggersHotline.com

GENERAL NOTES

- UNDERLYING SITE CONTOURS AND INFORMATION BASED ON TOPOGRAPHIC & UTILITY DATA AS SURVEYED BY WYSER ENGINEERING ON FEBRUARY 9 AND 20, 2024. WYSER ENGINEERING SHALL NOT BE HELD RESPONSIBLE FOR ANY ERRORS OR OMISSIONS THAT MAY ARISE AS A RESULT OF ERRONEOUS OR INCOMPLETE INFORMATION PROVIDED BY OTHERS. CONTRACTOR TO CONFIRM ALL ELEVATIONS, GENERAL DRAINAGE AND EARTHWORK REQUIREMENTS PRIOR TO CONSTRUCTION.
- 2. THE BENCHMARK LOCATIONS ARE SHOWN FOR REFERENCE ONLY ON THIS PLAN. THE BENCHMARKS SHALL BE VALIDATED BY LICENSED LAND SURVEYOR PRIOR TO CONSTRUCTION. CONTRACTOR ASSUMES RISK ASSOCIATED WITH BENCHMARK ELEVATIONS UNTIL CONFIRMED.
- 3. CONTRACTOR TO OBTAIN APPROPRIATE PERMITS FOR STREET OPENINGS & TO WORK WITHIN THE CITY'S LAND IF
- 4. WYSER ENGINEERING SHALL BE HELD HARMLESS AND DOES NOT WARRANT ANY DEVIATIONS BY THE OWNER OR CONTRACTOR FROM THE APPROVED CONSTRUCTION PLANS THAT MAY RESULT IN DISCIPLINARY ACTIONS BY REGULATORY AGENCIES.
- 5. IF ANY ERRORS, DISCREPANCIES, OR OMISSIONS WITHIN THE PLAN BECOME APPARENT, IT SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER PRIOR TO CONSTRUCTION SO THAT CLARIFICATION OR REDESIGN MAY OCCUR.
- 6. ALL MUNICIPAL UTILITY CONNECTIONS, WORK IN ROW, PUBLIC OUTLOTS AND PUBLIC EASEMENTS SHALL BE IN ACCORDANCE WITH CITY OF MADISON STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSRUCTION.

DEMOLITION NOTES

- THIS PLAN INDICATES ITEMS ON THE SITE, NOT INCLUDING INTERNAL BUILDING DEMOLITION, INTENDED FOR DEMOLITION BASED ON THE CURRENT SITE DESIGN THAT HAVE BEEN IDENTIFIED BY A REASONABLE OBSERVATION OF THE EXISTING CONDITIONS THROUGH FIELD SURVEY RECONNAISSANCE (BY OTHERS), "DIGGER'S HOTLINE" LOCATION, AND GENERAL "STANDARD OF CARE". THERE MAY BE ADDITIONAL ITEMS THAT CAN NOT BE IDENTIFIED BY A REASONABLE ABOVE GROUND OBSERVATION, WHERE NOT INCLUDED WITHIN THE FIELD SURVEY, OF WHICH THE ENGINEER WOULD HAVE NO KNOWLEDGE OR MAY BE A PART OF ANOTHER DESIGN DISCIPLINE. IT IS THE CONTRACTOR'S / BIDDER'S RESPONSIBILITY TO REVIEW THE PLANS, INSPECT THE SITE AND PROVIDE HIS OWN DUE DILIGENCE TO INCLUDE IN HIS BID WHAT ADDITIONAL ITEMS, IN HIS OPINION, MAY BE NECESSARY FOR DEMOLITION. ANY ADDITIONAL ITEMS IDENTIFIED BY THE CONTRACTOR / BIDDER SHALL BE IDENTIFIED IN THE BID AND REPORTED TO THE OWNER AND ENGINEER OF RECORD. WYSER ENGINEERING TAKES NO RESPONSIBILITY FOR ITEMS ON THE PROPERTY THAT COULD NOT BE LOCATED BY A REASONABLE OBSERVATION OF THE PROPERTY OR OF WHICH THEY WOULD HAVE NO
- PRIOR TO CONSTRUCTION, THE CONTRACTOR IS RESPONSIBLE FOR:
- 2.1. EXAMINING ALL SITE CONDITIONS RELATIVE TO THE CONDITIONS INDICATED ON THE ENGINEERING DRAWINGS. ANY DISCREPANCIES ARE TO BE REPORTED TO THE OWNER AND ENGINEER AND RESOLVED PRIOR TO THE START OF CONSTRUCTION.
- 2.2. VERIFYING UTILITY ELEVATIONS AND NOTIFYING OWNER AND ENGINEER OR ANY DISCREPANCIES. NO WORK SHALL BE PERFORMED UNTIL THE DISCREPANCIES ARE RESOLVED.
- 2.3. NOTIFYING ALL UTILITIES PRIOR TO THE REMOVAL OF ANY UNDERGROUND UTILITIES. 2.4. NOTIFYING THE OWNER, DESIGN ENGINEER AND LOCAL CONTROLLING MUNICIPALITY 48 HOURS PRIOR TO THE START OF CONSTRUCTION TO ARRANGE FOR APPROPRIATE CONSTRUCTION INSPECTION.
- CONTRACTOR IS SOLELY RESPONSIBLE FOR SITE SAFETY DURING THE CONSTRUCTION OF THESE
- 4. CONTRACTOR SHALL KEEP ALL STREETS AND ADJOINING SHARED ACCESS ROADWAYS FREE AND CLEAR OF
- 5. ALL TREES WITHIN THE CONSTRUCTION LIMITS SHALL BE REMOVED UNLESS SPECIFICALLY CALLED OUT FOR PROTECTION. ALL TREES TO BE REMOVED SHALL BE REMOVED IN THEIR ENTIRETY. STUMPS SHALL BE GROUND TO PROPOSED SUBGRADE.
- PERFORM TREE PRUNING IN ALL LOCATIONS WHERE PROPOSED PAVEMENT AND / OR UTILITY INSTALLATION ENCROACH WITHIN THE EXISTING DRIP LINE OF THE TREES TO REMAIN. ALL TRENCHING WITHIN THE EXISTING DRIP LINE OF THE TREES TO REMAIN SHALL BE DONE RADIALLY AWAY FROM THE TRUNK IF ROOTS IN EXCESS OF 1" DIAMETER ARE EXPOSED. ROOTS MUST BE CUT BY REPUTABLE TREE PRUNING SERVICE PRIOR TO ANY
- 7. ALL LIGHT POLES TO BE REMOVED SHALL BE REMOVED IN THEIR ENTIRETY, INCLUDING BASE AND ALL APPURTENANCES. SALVAGE FOR RELOCATION. COORDINATE RELOCATION AND / OR ABANDONMENT OF ALL ELECTRIC LINES WITH ELECTRICAL ENGINEER AND OWNER PRIOR TO DEMOLITION.
- CONTRACTOR SHALL COORDINATE PRIVATE UTILITY REMOVAL / ABANDONMENT AND NECESSARY
- 9. ABANDONED / REMOVED ITEMS SHALL BE DISPOSED OF OFF SITE UNLESS OTHERWISE NOTED.
- 10. THE CONTRACTOR SHALL INSTALL A PEDESTRIAN FENCE AROUND ALL EXCAVATIONS TO BE LEFT OPEN OVERNIGHT AS REQUIRED.
- 11. CONTRACTOR TO REMOVE EXISTING UTILITY PIPE AND BACKFILL WITH SELECT FILL OR PROVIDE PIPE BACK-FILLING WITHIN BUILDING FOOTPRINT USING "LOW DENSITY CONCRETE / FLOWABLE FILL".
- 12. GRANULAR BACKFILL MATERIALS ARE REQUIRED FOR FILL UNDER PROPOSED PAVED AREAS.
- 13. RESTORATION OF THE EXISTING RIGHT-OF-WAYS AS NEEDED ARE CONSIDERED INCIDENTAL AND SHOULD BE PART OF THE COST OF THE UNDERGROUND IMPROVEMENTS, DEMOLITION AND REMOVAL. THIS INCLUDES, BUT IS NOT LIMITED TO, CURB & GUTTER, SIDEWALK, TOPSOIL, SEEDING AND MULCHING.
- 14. ANY SANITARY SEWER, SANITARY SEWER SERVICES, WATER MAIN, WATER SERVICES, STORM SEWER, OR OTHER UTILITIES, WHICH ARE DAMAGED BY THE CONTRACTORS, SHALL BE REPAIRED TO THE OWNER'S SATISFACTION AT THE CONTRACTOR'S EXPENSE.

				521 e washinglon avenue
521 EAST WASHINGTON AVENUE	REDEVELOPMENT	CITY OF MADISON, DANE COUNTY, W	Sheet Title:	SITE DEMOLITION PLAN
evis	Date:	Description	:	
	i .	1		

Scale

Number

Туре

Issued


Sheet


24-1199

CITY REVIEW

05/13/2024

	BENCHMARK TABLE			
BM - #	ELEVATION	DESCRIPTION		
BM - 1	863.74'	NE BOLT OF FIRE HYDRANT LOCATED ON THE SOUTHEAST SIDE OF E. WASHINGTON AVENUE, 60' ± SOUTHWEST OF THE INTERSECTION WITH S. BLAIR STREET.		
BM - 2	861.17'	SE BOLT OF FIRE HYDRANT LOCATED ON THE SOUTHWEST SIDE OF N. BLAIR STREET, $40^{\circ}\pm$ NORTHWEST OF THE INTERSECTION WITH E. WASHINGTON AVENUE.		
BM - 3	875.58'	EAST TAG BOLT "BURY 6-0" OF FIRE HYDRANT LOCATED IN THE SOUTH QUADRANT OF E. WASHINGTON AVE. & S. FRANKLIN ST. ON E. WASHINGTON AVE. FRONTAGE.		
BM - 4	874.55'	SOUTH TAG BOLT "BURY 7-0" OF FIRE HYDRANT LOCATED IN THE SOUTH QUADRANT OF E. WASHINGTON AVE. & S. FRANKLIN ST. ON S. FRANKLIN ST. FRONTAGE.		

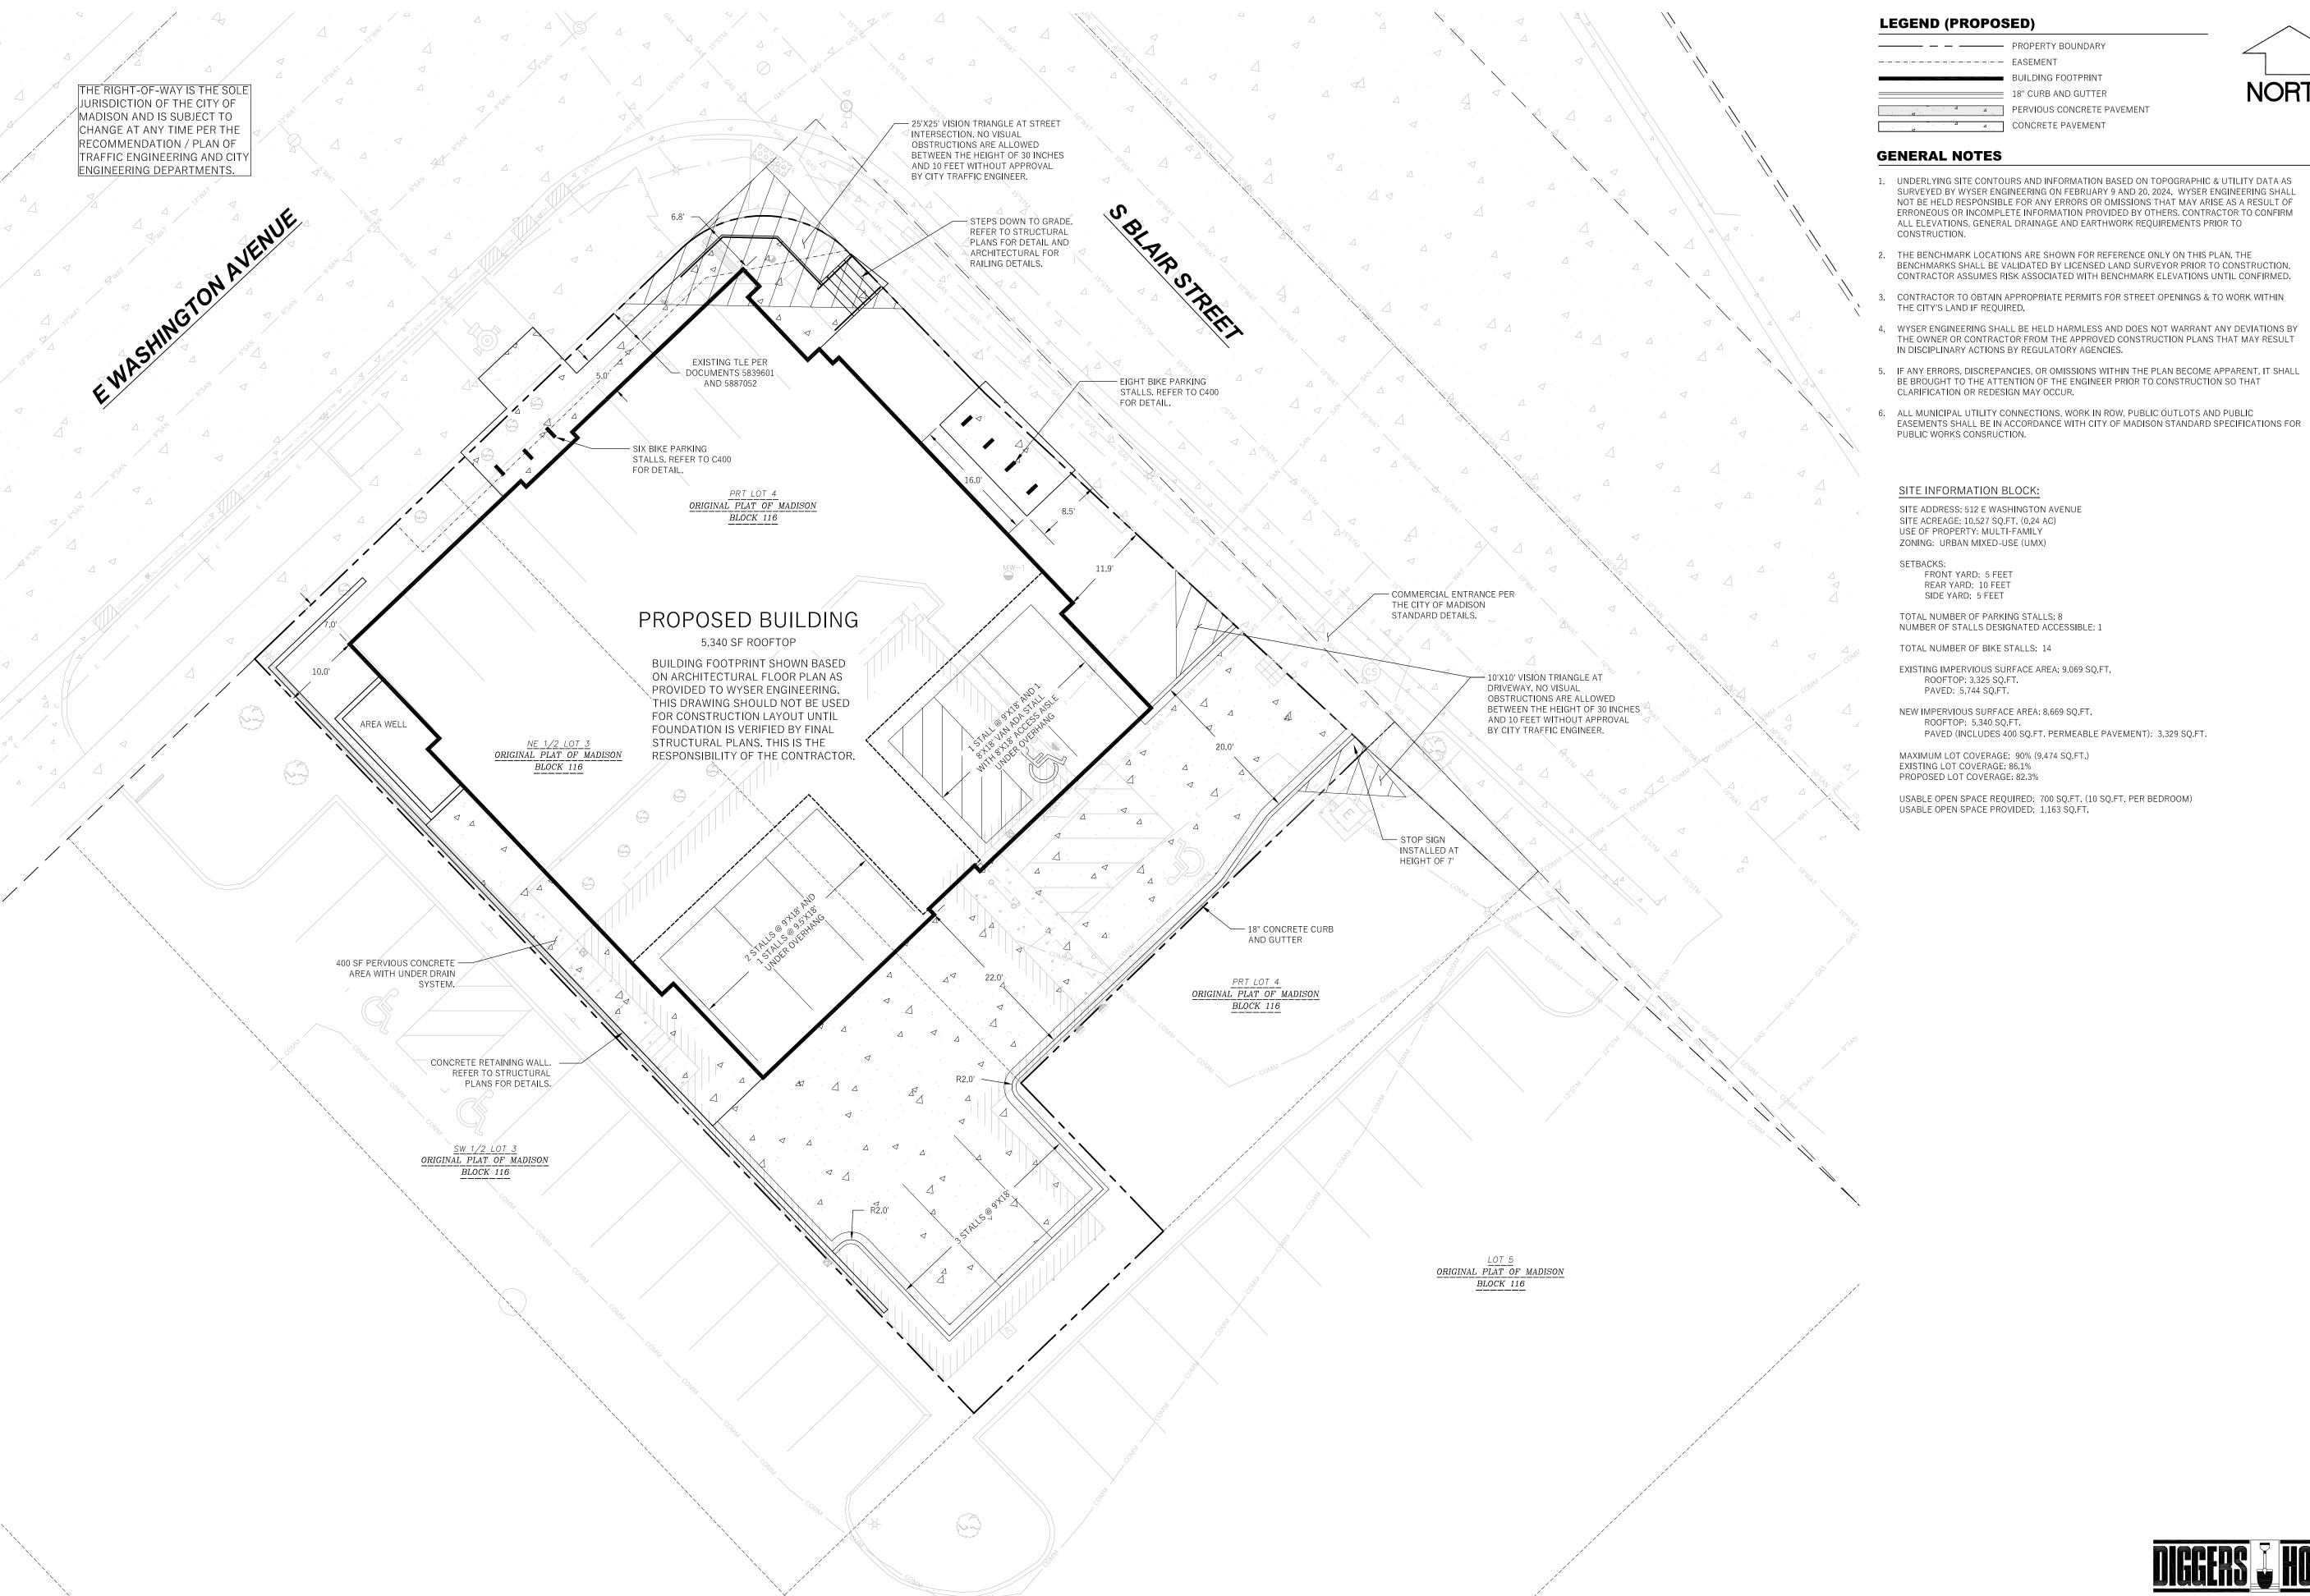






- 1. UNDERLYING SITE CONTOURS AND INFORMATION BASED ON TOPOGRAPHIC & UTILITY DATA AS SURVEYED BY WYSER ENGINEERING ON FEBRUARY 9 AND 20, 2024. WYSER ENGINEERING SHALL NOT BE HELD RESPONSIBLE FOR ANY ERRORS OR OMISSIONS THAT MAY ARISE AS A RESULT OF ERRONEOUS OR INCOMPLETE INFORMATION PROVIDED BY OTHERS. CONTRACTOR TO CONFIRM
- BENCHMARKS SHALL BE VALIDATED BY LICENSED LAND SURVEYOR PRIOR TO CONSTRUCTION.

- BE BROUGHT TO THE ATTENTION OF THE ENGINEER PRIOR TO CONSTRUCTION SO THAT

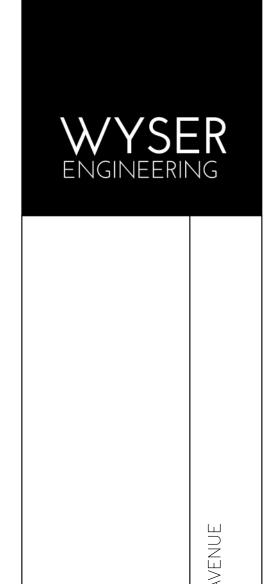

sions: Date: Descript	REDEVELOPMENT SITY OF MADISON, DANE COUNTY, WI
------------------------	--

Scale

Number


Number


24-1199

CITY REVIEW

05/13/2024

Toll Free (800) 242-8511 -or- 811 Hearing Impaired TDD (800) 542-2289 www.DiggersHotline.com

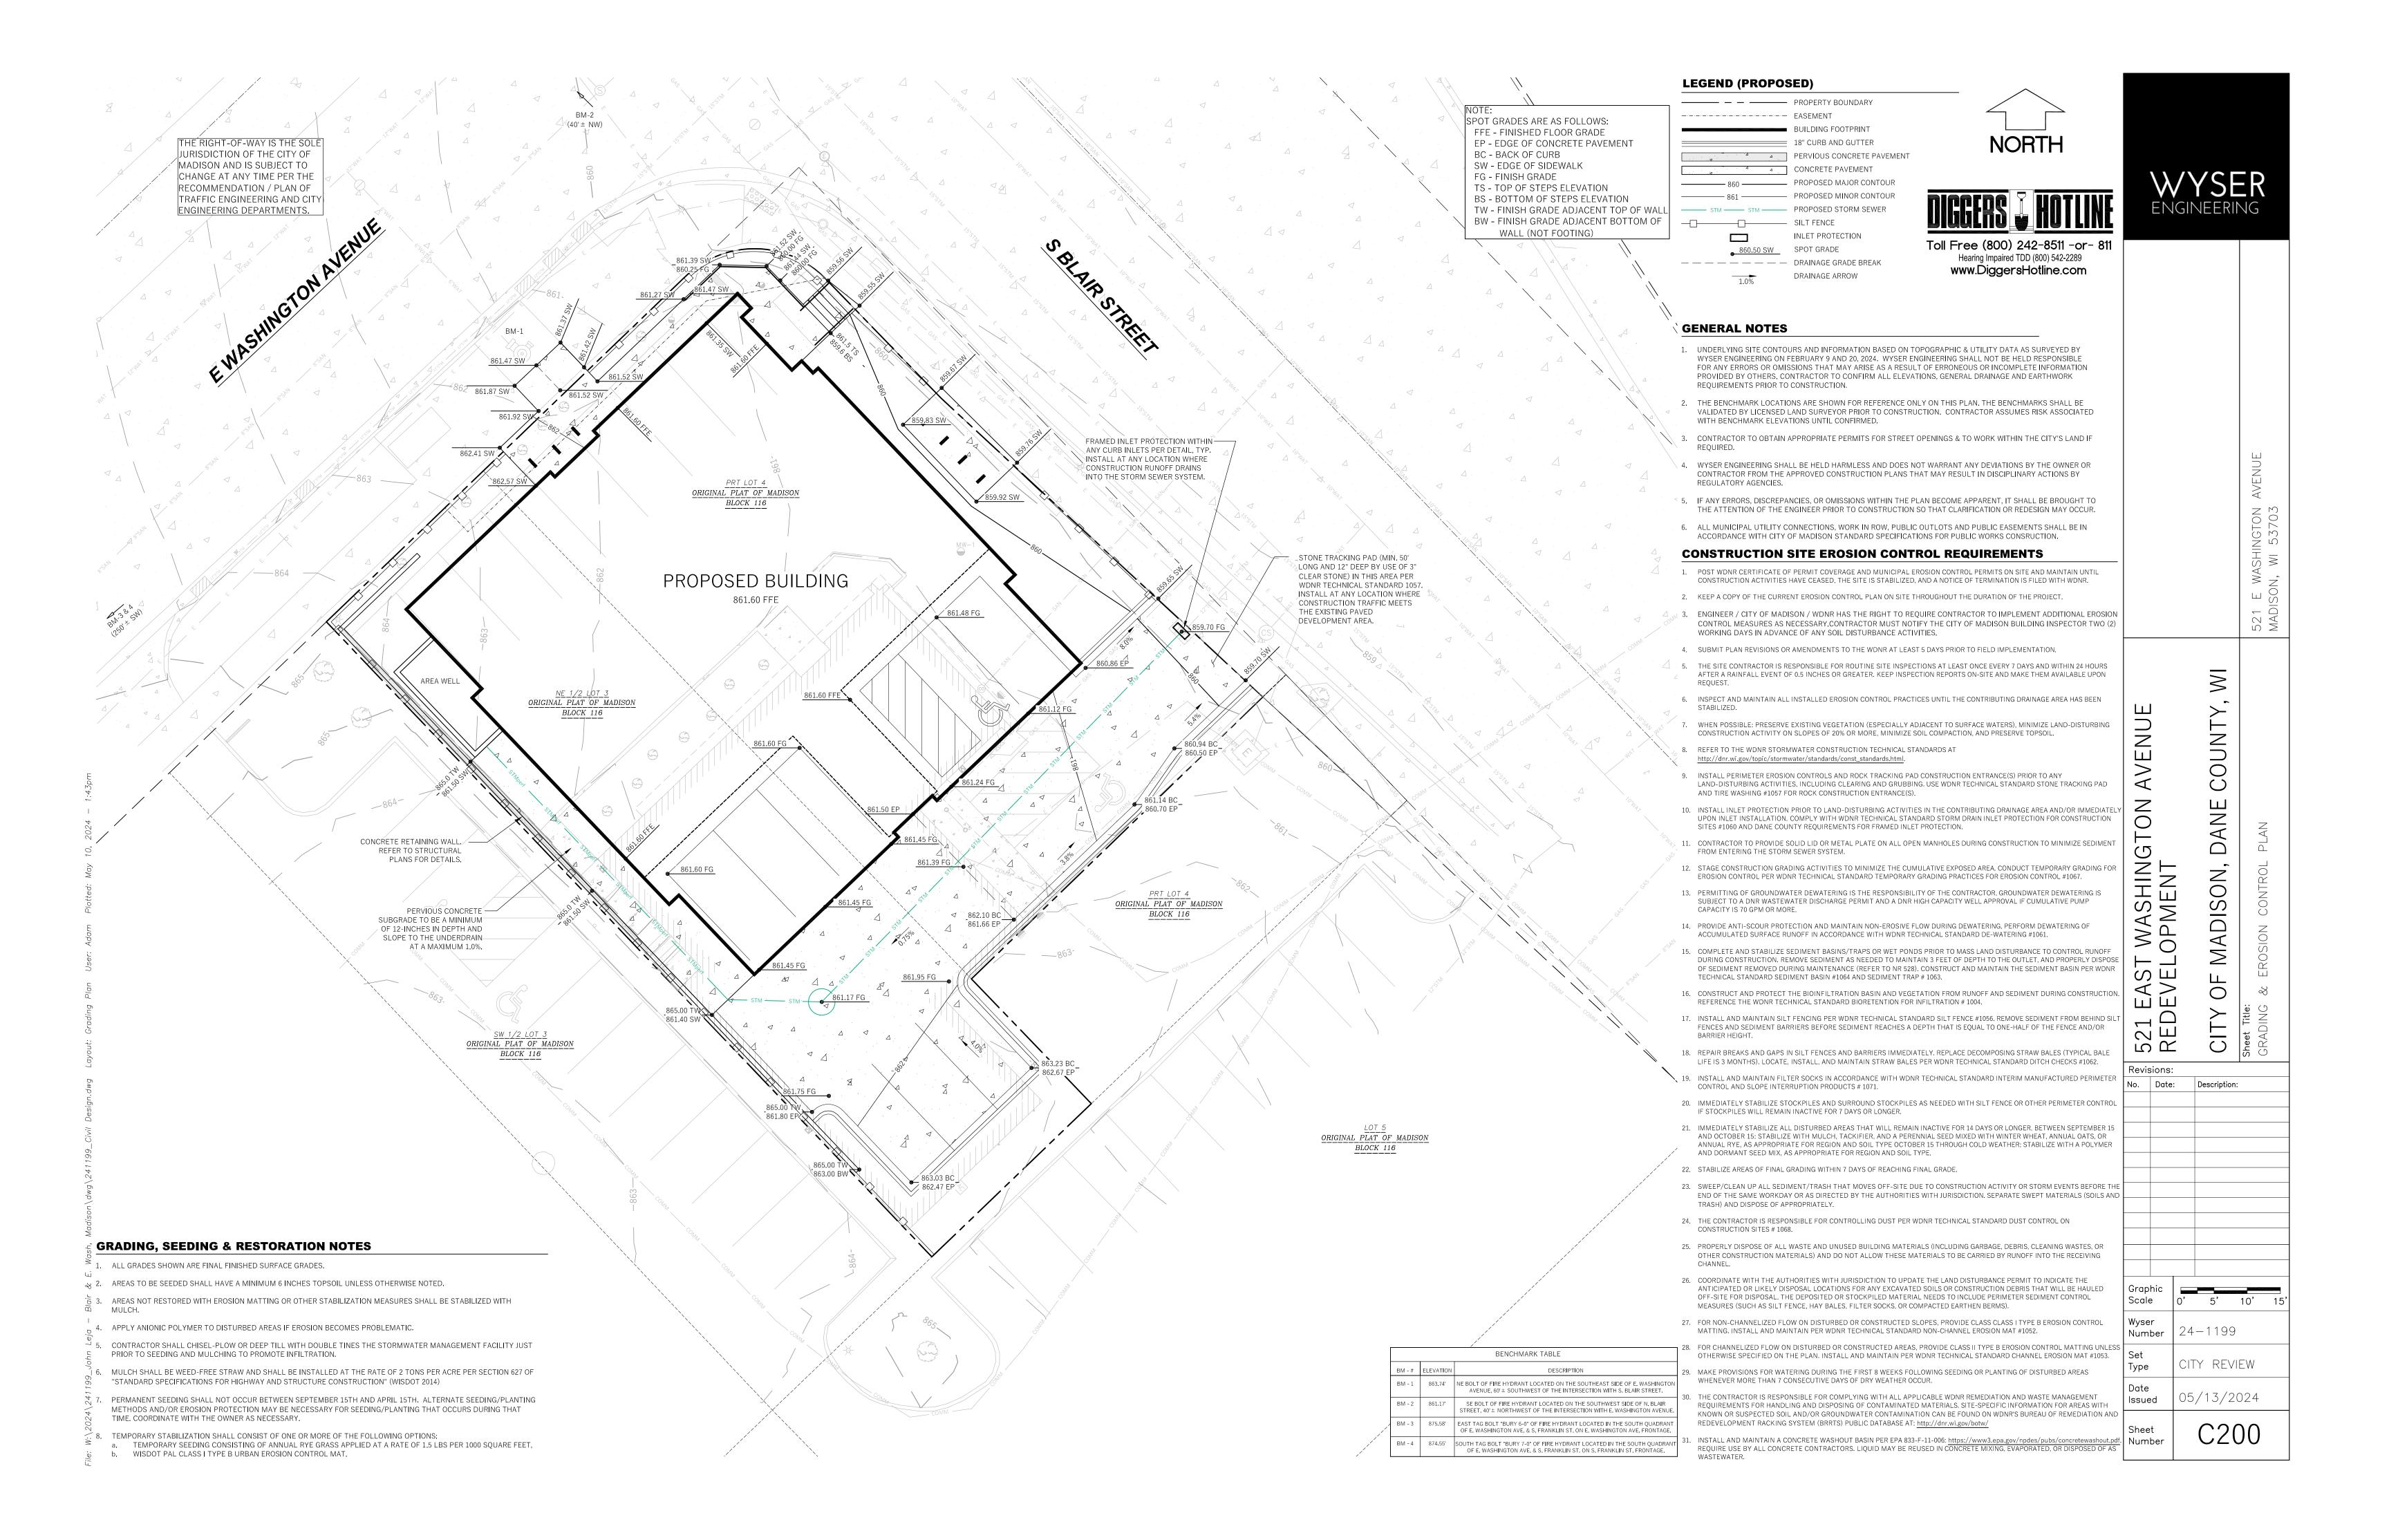

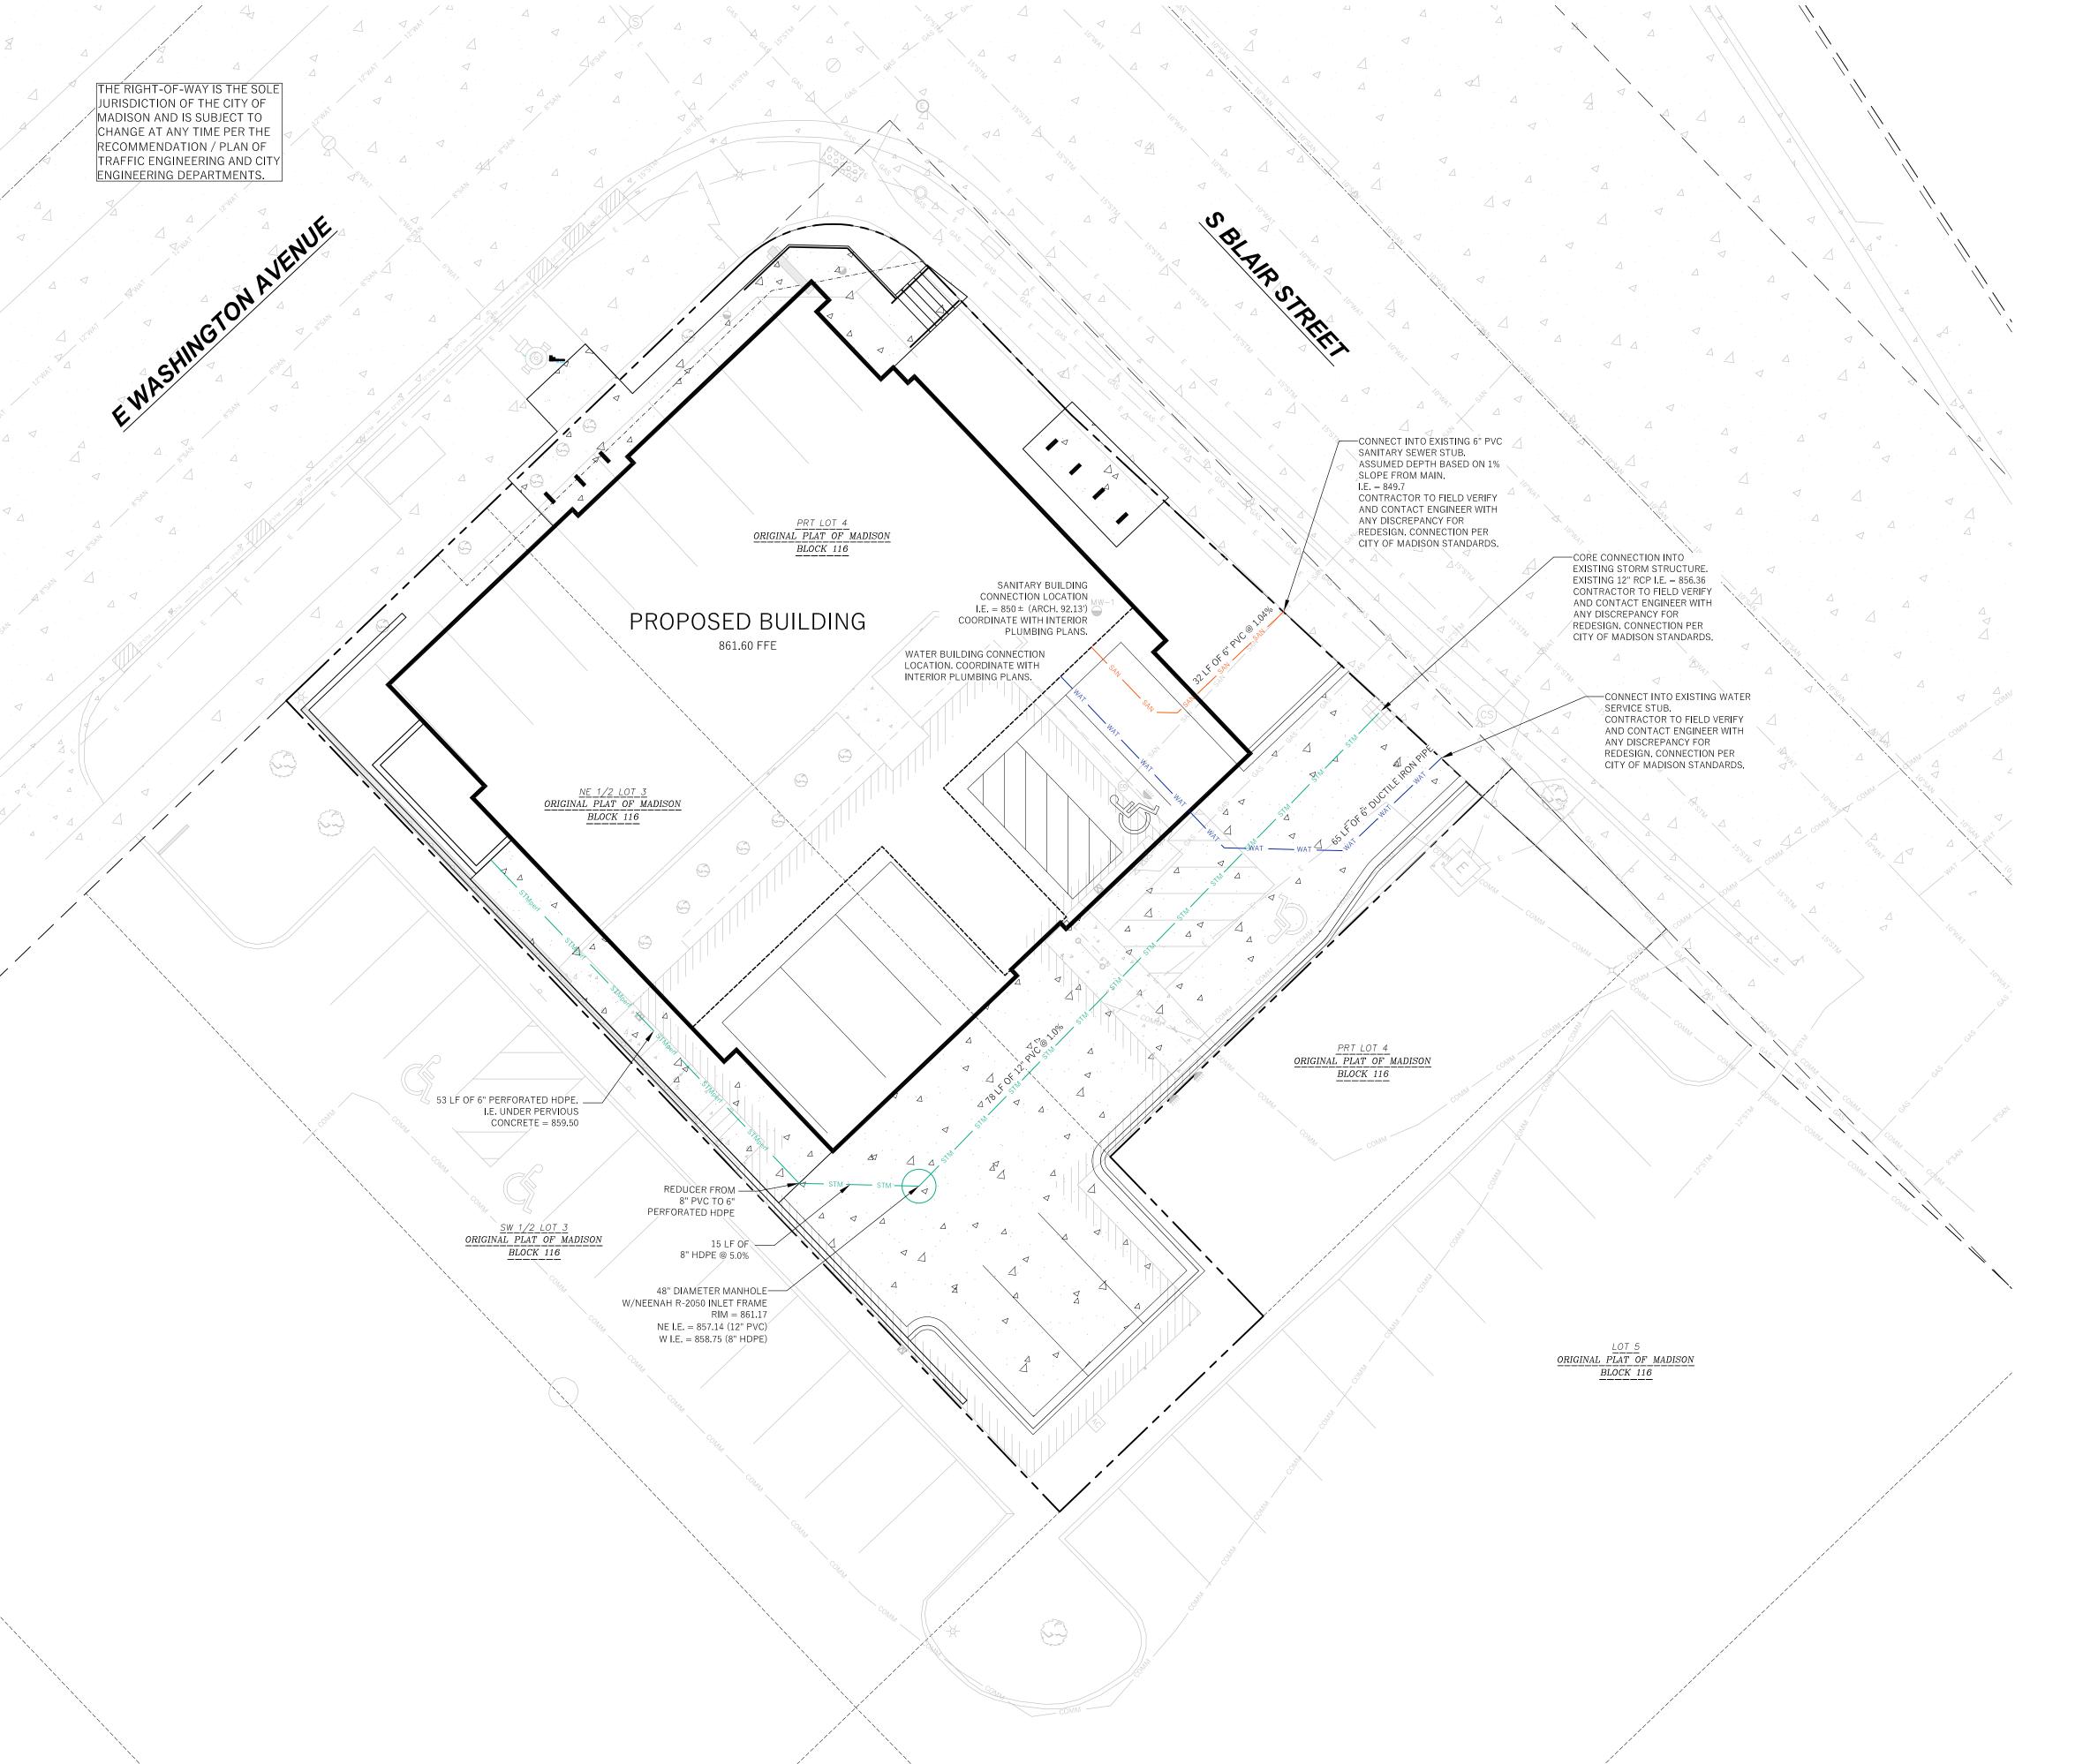

LEGEND (PROPOSED)

	PROPOSED PROPERTY BOUNDARY	
	EASEMENT	
	BUILDING FOOTPRINT	
	18" CURB AND GUTTER	NORTH
Δ Δ	PERVIOUS CONCRETE PAVEMENT	11011111
4 4	CONCRETE PAVEMENT	
WAT WAT	PROPOSED WATER MAIN	
——————————————————————————————————————	PROPOSED SANITARY SEWER	
STM STM	PROPOSED STORM SEWER	
———— GAS ————	PROPOSED GAS SERVICE (DESIGN BY O	THERS)
— в — в —	PROPOSED ELECTRIC SERVICE (DESIGN	BY OTHERS)

GENERAL NOTES

- 1. UNDERLYING SITE CONTOURS AND INFORMATION BASED ON TOPOGRAPHIC & UTILITY DATA AS SURVEYED BY WYSER ENGINEERING ON FEBRUARY 9 AND 20, 2024. WYSER ENGINEERING SHALL NOT BE HELD RESPONSIBLE FOR ANY ERRORS OR OMISSIONS THAT MAY ARISE AS A RESULT OF ERRONEOUS OR INCOMPLETE INFORMATION PROVIDED BY OTHERS, CONTRACTOR TO CONFIRM ALL ELEVATIONS, GENERAL DRAINAGE AND EARTHWORK REQUIREMENTS PRIOR TO CONSTRUCTION.
- 2. THE BENCHMARK LOCATIONS ARE SHOWN FOR REFERENCE ONLY ON THIS PLAN. THE BENCHMARKS SHALL BE VALIDATED BY LICENSED LAND SURVEYOR PRIOR TO CONSTRUCTION. CONTRACTOR ASSUMES RISK ASSOCIATED WITH BENCHMARK ELEVATIONS UNTIL CONFIRMED.
- 3. CONTRACTOR TO OBTAIN APPROPRIATE PERMITS FOR STREET OPENINGS & TO WORK WITHIN THE CITY'S LAND IF REQUIRED.
- 4. WYSER ENGINEERING SHALL BE HELD HARMLESS AND DOES NOT WARRANT ANY DEVIATIONS BY THE OWNER OR CONTRACTOR FROM THE APPROVED CONSTRUCTION PLANS THAT MAY RESULT IN DISCIPLINARY ACTIONS BY REGULATORY AGENCIES.
- 5. IF ANY ERRORS, DISCREPANCIES, OR OMISSIONS WITHIN THE PLAN BECOME APPARENT, IT SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER PRIOR TO CONSTRUCTION SO THAT CLARIFICATION OR REDESIGN MAY OCCUR.
- 6. ALL MUNICIPAL UTILITY CONNECTIONS, WORK IN ROW, PUBLIC OUTLOTS AND PUBLIC EASEMENTS SHALL BE IN ACCORDANCE WITH CITY OF MADISON STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSRUCTION.

UTILITY NOTES


- 1. DIMENSIONS TAKE PRECEDENCE OVER SCALE. CONTRACTOR TO VERIFY ALL DIMENSIONS IN
- 2. LENGTHS OF ALL UTILITIES ARE TO CENTER OF STRUCTURES OR FITTINGS AND MAY VARY SLIGHTLY FROM PLAN. LENGTHS SHALL BE VERIFIED IN THE FIELD DURING CONSTRUCTION.
- 3. CONTRACTOR SHALL VERIFY ALL ELEVATIONS, LOCATIONS, AND SIZES OF SANITARY, WATER
- AND STORM LATERALS AND CHECK ALL UTILITY CROSSINGS FOR CONFLICTS.
- 4. THE PROPOSED IMPROVEMENTS MUST BE CONSTRUCTED IN ACCORDANCE WITH ENGINEERING PLANS DESIGNED TO MEET ORDINANCES AND REQUIREMENTS OF THE MUNICIPALITY AND WISDOT, WISDSPS, AND WDNR.
- 5. PRIOR TO CONSTRUCTION, THE CONTRACTOR IS RESPONSIBLE FOR: EXAMINING ALL SITES CONDITIONS RELATIVE TO THE CONDITIONS INDICATED ON THE ENGINEERING DRAWINGS. ANY DISCREPANCIES ARE TO BE REPORTED TO THE ENGINEER
- AND RESOLVED PRIOR TO THE START OF CONSTRUCTION. OBTAINING ALL PERMITS INCLUDING PERMIT COSTS, TAP FEES, METER DEPOSITS, BONDS,
- AND ALL OTHER FEES REQUIRED FOR PROPOSED WORK TO OBTAIN OCCUPANCY. VERIFYING UTILITY ELEVATIONS AND NOTIFYING ENGINEER OF ANY DISCREPANCY. NO
- WORK SHALL BE PERFORMED UNTIL THE DISCREPANCY IS RESOLVED. • NOTIFYING ALL UTILITIES PRIOR TO THE INSTALLATION OF ANY UNDERGROUND
- IMPROVEMENTS. • NOTIFYING THE DESIGN ENGINEER AND MUNICIPALITY 48 HOURS PRIOR TO THE START OF CONSTRUCTION TO ARRANGE FOR APPROPRIATE CONSTRUCTION OBSERVATION.
- THE CONTRACTOR IS RESPONSIBLE FOR PROVIDING THE ENGINEER WITH AS-RUILT

CONDITIONS OF THE DESIGNATED IMPROVEMENTS IN ORDER THAT THE APPROPRIATE

- DRAWINGS CAN BE PREPARED, IF REQUIRED. ANY CHANGES TO THE DRAWINGS OR ADDITIONAL ITEMS MUST BE REPORTED TO THE ENGINEER AS WORK PROGRESSES. 10. ANY SANITARY SEWER, SANITARY SEWER SERVICES, WATER MAIN, WATER SERVICES, STORM
- SEWER, OR OTHER UTILITIES, WHICH ARE DAMAGED BY THE CONTRACTORS, SHALL BE REPAIRED TO THE OWNER'S SATISFACTION AT THE CONTRACTOR'S EXPENSE. NO BLASTING IS ALLOWED WITHIN 30 FEET OF EXISTING UTILITIES.
- 11. ALL PRIVATE INTERCEPTOR WATER MAIN AND WATER SERVICES SHALL BE INSTALLED WITH A 6.5' MINIMUM BURY. PROVIDE INSULATION ABOVE PIPES WITH LESS THAN 5' OF GROUND
- 12. GRANULAR BACKFILL MATERIALS ARE REQUIRED IN ALL UTILITY TRENCHES UNDER SIDEWALKS AND PROPOSED PAVED AREAS (UNLESS OTHERWISE SPECIFIED BY A GEOTECHNICAL ENGINEER). ALL UTILITY TRENCH BACKFILL SHALL BE COMPACTED PER SPECIFICATIONS. ALL PAVEMENT PATCHING SHALL COMPLY WITH THE CITY OF MADISON STANDARD SPECIFICATIONS. ADDITIONAL PAVEMENT MILLING AND OVERLAY MAY BE REQUIRED BY
- 13. CONTRACTOR SHALL NOTIFY THE MUNICIPAL PUBLIC WORKS DEPARTMENT A MINIMUM OF 48 HOURS BEFORE CONNECTING TO PUBLIC UTILITIES.
- 14. ALL NON-METALLIC BUILDING SEWER AND WATER SERVICES MUST BE ACCOMPANIED BY MEANS OF LOCATING UNDERGROUND PIPE. TRACER WIRE VALVE BOXES SHALL BE INSTALLED ON ALL LATERALS AND AS INDICATED ON THESE PLANS.
- 15. ALL, EXTERIOR CLEANOUTS SHALL BE PROVIDED WITH A FROST SLEEVE IN ACCORDANCE WITH SPS 382.34(5)(a)b AND SPS 384.30(2)(c).
- 16. ALL PRIVATE PLUMBING MATERIALS SHALL CONFORM TO SPS 384.30.
- 17. ALL PRIVATE PIPE JOINTS SHALL BE INSTALLED PER SPS 384.40.
- 18. ALL PRIVATE WATER PIPE, INCLUDING DEPTH AND SEPARATION REQUIREMENTS, SHALL BE IN ACCORDANCE WITH SPS 382.40(8).
- 19. THE CONTRACTOR SHALL ALLOW 10 WORKING DAYS FOR THE CONSTRUCTION OF GAS MAINS WHEN SCHEDULING THE WORK AND SHALL NOT RESTRICT ACCESS TO THE GAS MAIN CONTRACTOR OR OTHER UTILITY COMPANIES.
- 20. INLET CASTINGS SHALL BE SET TO GRADE PRIOR TO AND SEPARATE FROM THE POURING OF THE CONCRETE CURB AND GUTTER. IS IS REQUIRED THAT THREE FEET OF CONCRETE CURB AND GUTTER ON EACH SIDE OF THE INLET SHALL BE POURED BY HAND, NOT THROUGH THE USE OF A CURB MACHINE. THE INLET CASTING SHALL BE SET TO GRADE ON A BED OF MORTAR WHICH SHALL BE A MINIMUM OF TWO INCHES THICK. THE INLET SHALL BE PLACED ON THE MORTAR BED AND SHALL BE ADJUSTED TO GRADE BY APPLYING DIRECT PRESSURE TO THE CASTING. ONCE THE CASTING ADJUSTMENT IS COMPLETE, THREE FEET OF CURB AND GUTTER ON EACH SIDE OF THE CASTING SHALL BE POURED BY HAND.
- 21. CONTRACTOR SHALL VERIFY AND COORDINATE ALL UTILITY CONNECTIONS WITH THE BUILDING PRIOR TO CONSTRUCTION.
- 22. THE CONTRACTOR SHALL CONDUCT THEIR OPERATIONS SO AS TO BE IN CONFORMANCE WITH THE CITY EROSION CONTROL AND STORMWATER ORDINANCE, AND DNR ADMINISTRATIVE RULE NR 216 AT ALL TIMES.




Hearing Impaired TDD (800) 542-2289 www.DiggersHotline.com

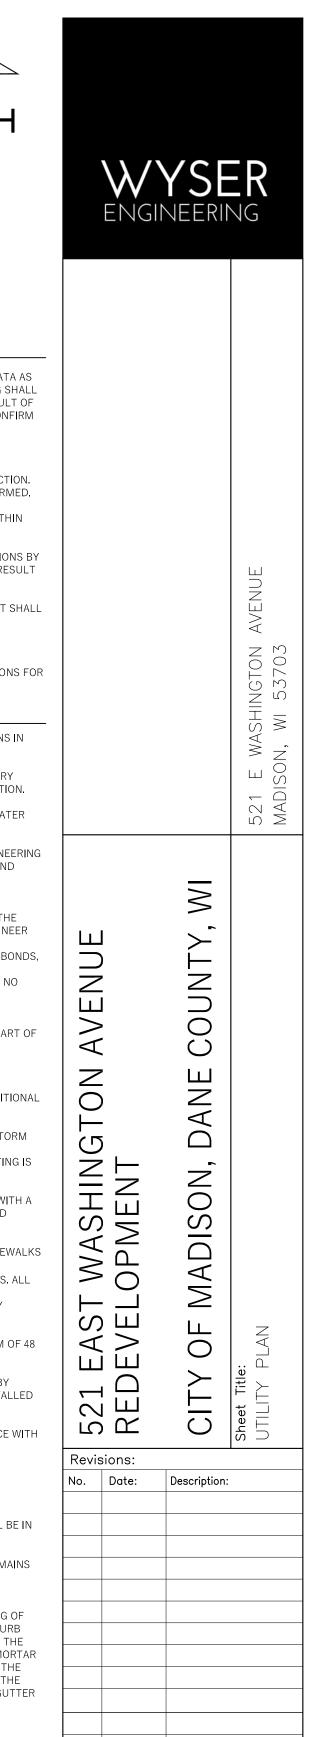

raphic cale	0'	5'	10'	15'
yser umber	24	-119	9	
et ype	CIT	Y RE	VIEW	
ate sued	05	/13/	2024	
heet umber		C3	00	

Number

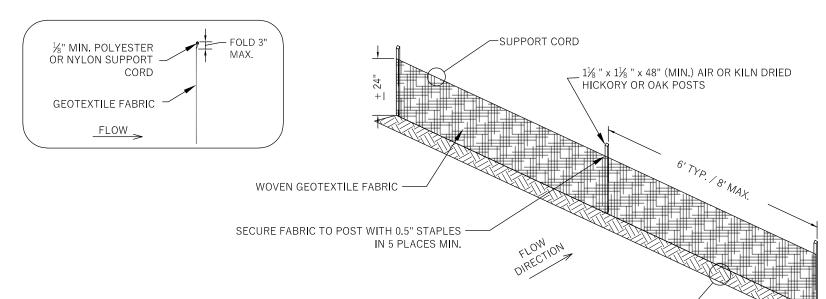

MATERIAL NOTES

1. GEOTEXTILE FABRIC SHALL BE WOVEN AND SHALL CONFORM TO THE MATERIAL REQUIREMENTS LISTED IN SECTION 628 OF THE WISDOT STANDARD SPECIFICATIONS FOR HIGHWAY AND STRUCTURE CONSTRUCTION, 2003

INSTALLATION NOTES

- 1. INSTALLATION SHALL CONFORM WITH THE REQUIREMENTS OF WDNR CONSERVATION PRACTICE STANDARD 1056.
- 2. CONSTRUCT THE SILT FENCE IN AN ARC WITH THE ENDS POINTING UPSLOPE TO
- AVOID EROSION AROUND THE ENDS OF THE FENCE, 3. FAILURE TO PROPERLY ANCHOR SILT FENCE COULD RESULT IN WATER AND
- FENCE INTO THE ANCHOR TRENCH. 4. CONSTRUCT THE FENCE FROM A CONTINUOUS ROLL OF GEOTEXTILE TO AVOID JOINTS. WHERE JOINTS ARE NECESSARY, OVERLAP TO THE NEXT POST OR WRAP ADJOINING FABRICS TOGETHER AROUND THE JOINT POST AND TIGHTLY

SEDIMENT RELEASE BENEATH THE SILT FENCE. PROPERLY SECURE THE SILT


5. SILT FENCE SHALL NOT BE USED IN AREAS OF CONCENTRATED FLOW.

ANCHOR TRENCH — BACKFILL AND COMPACT ANCHOR TRENCH B" MIN. GEOTEXTILE IN -20" MIN. POST ANCHOR TRENCH BURIAL 4" WIDE x 6" DEEP ─/ ANCHOR TRENCH

INSPECTION & MAINTENANCE NOTES

- 1. AT A MINIMUM, PERFORM INSPECTIONS WEEKLY AND WITHIN 24 HOURS OF PRECIPITATION EVENTS PRODUCING 0.5 INCHES OR MORE OF RAINFALL.
- 2. INSPECT FENCES FOR DAMAGE TO STAKES AND FABRIC, UNDERCUTTING, EXCESSIVE SEDIMENT ACCUMULATION (GREATER THAN ½ OF THE FENCE HEIGHT), AND
- 3. REPAIR OR REPLACE SILT FENCE WITHIN 24 HOURS OF IDENTIFYING AND DEFICIENCIES.


INDICATIONS OF SCOUR AROUND THE EDGES.

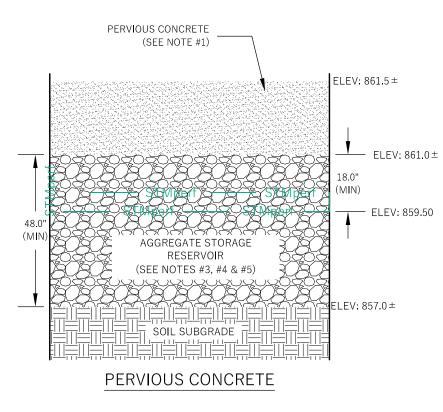



PAVEMENT SURFACE PERCENT VOIDS SHALL BE LESS THAN 25%. JOINT STONE AND BEDDING COURSE SHALL CONSIST OF ASTM C-33, 8, 9, 89, OR 57 AGGREGATE.

AGGREGATE STORAGE RESERVOIR DEPTH SHALL BE A MINIMUM OF 12 INCHES. BASE AND/OR SUBBASE COURSES WITH MINIMUM POROSITY OF 30% CAN BE CONSIDERED AGGREGATE STORAGE RESERVOIR. UNDERDRAINS CAN BE LOCATED WITHIN OR BELOW THE AGGREGATE STORAGE RESERVOIR. UNDERDRAINS (OR EQUIVALENT) ARE REQUIRED IF THE AGGREGATE STORAGE RESERVOIR DRAIN DOWN TIME WILL EXCEED 72 HOURS.

PERMEABLE PAVEMENT

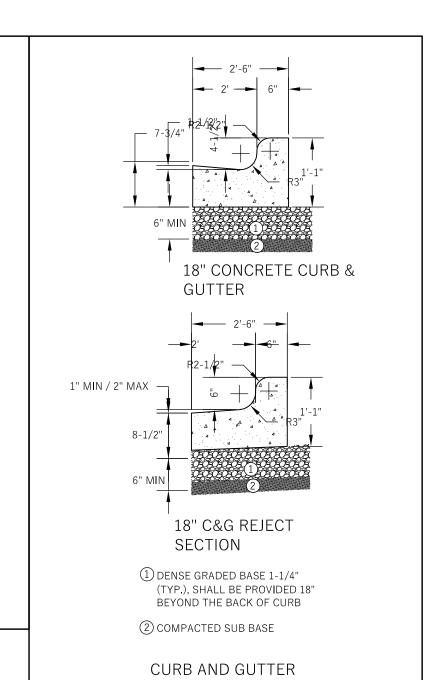

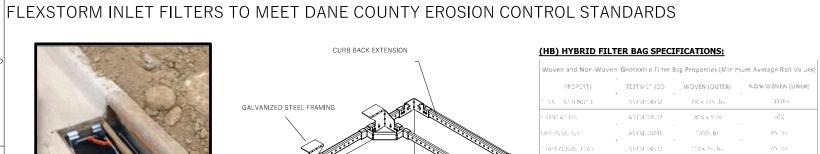

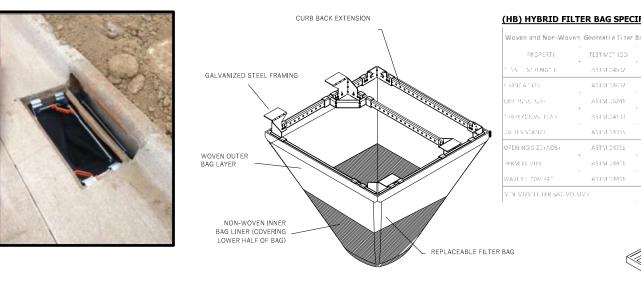


Neenah Bag Cap FlowRatings (CFS)					100000000000000000000000000000000000000		
Casting	Inlet Type	Grate Size	Opening Size	(ft ³)	HB (Hybrid Bag)	Bypass	ADS P/N
3067	Curb Box	35.25 x 17.75	33.0 x 15.0	4.4	2.0	5.8	62LCBEXTHB
3246A	Curb Box	35.75 x 23.875	33.5 x 21.0	4.2	1.1	3.3	62LCB3624HB
3030	Square/Rect (SQ)	23 x 16	20.5 x 13.5	1.6	0.7	2.2	62MCB2316HE
3067-C	Square/Rect (SQ)	35.25 x 17.75	33 x 15	3.2	1.0	5.2	62LSQ3618HB
R-2501	Round (RD)	~26	~24	2.3	0.8	5.2	62MRD26HB
R-1772/2560	Round (RD)	22.25-23.5	20.5-21	1.5	0.6	4.6	62MRD22HB

Installation Instructions 1. Remove grate from the drainage structure 2. Clean stone and dirt from ledge (lip) of drainage


structure 3. Drop the inlet filter through the clear opening such that the hangers rest firmly on the lip of the 4. Replace the grate and confirm it is not elevated more

Empty the sediment bag if more than half filled with sediment and

2. Remove the grate, engage the lifting points, and lift filter from the 3. Dispose of sediment and debris as directed by the Engineer or Maintenance Contract 4. Alternatively, an industrial vacuum can be used to collect sediment from filter bag




SILT FENCE

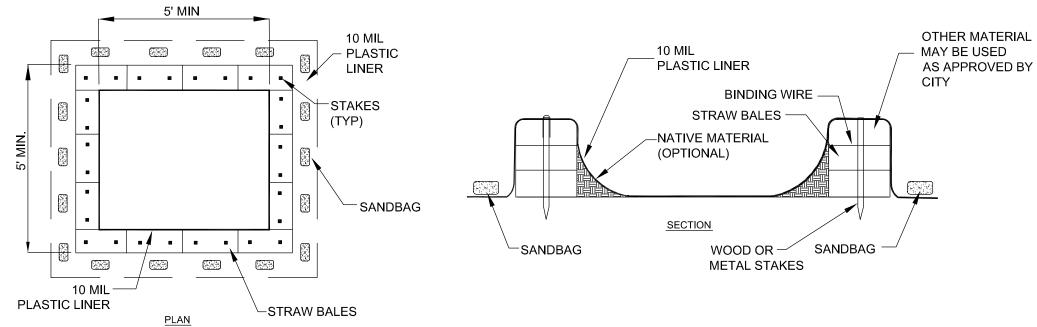

WASHOUT NOTES

- ALTERNATIVE CONCRETE WASHOUTS ALLOWABLE AS APPROVED BY ENGINEER, INCLUDING DISPOSABLE WASHOUTS, ETC.
- NO WASHING OUT OF CONCRETE TRUCKS OR WASHING OF SWEEPINGS FROM EXPOSED AGGREGATE CONCRETE INTO STORM DRAINS, OPEN DITCHES, STREETS, OR STREAMS IS ALLOWED. EXCESS CONCRETE IS NOT ALLOWED TO BE DUMPED ON-SITE, EXCEPT IN DESIGNATED TEMPORARY CONCRETE WASHOUT PIT AREAS.
- 4. ON-SITE TEMPORARY CONCRETE WASHOUT AREAS WILL BE LOCATED AT LEAST 50 FEET FROM STORM DRAINS, OPEN DITCHES, OR WATER BODIES AS DETERMINED IN THE FIELD. 5. TEMPORARY CONCRETE WASHOUT FACILITIES WILL BE CONSTRUCTED AND MAINTAINED IN SUFFICIENT QUANTITY AND SIZE TO CONTAIN ALL LIQUID AND CONCRETE WASTE GENERATED BY
- WASHOUT FACILITIES WILL BE CLEANED OUT OR REPLACED ONCE THE WASHOUT IS 75% FULL. PLASTIC LINING MATERIAL WILL BE MINIMUM OF 10 MIL POLYETHYLENE SHEETING AND WILL BE FREE OF HOLES, TEARS, OR OTHER DEFECTS.
- 8. WHEN WASHOUT FACILITIES ARE NO LONGER REQUIRED FOR WORK, THE HARDENED CONCRETE WILL BE REMOVED AND DISPOSED OF OFFSITE. MATERIALS USED TO CONSTRUCT TEMPORARY CONCRETE WASHOUT FACILITIES WILL BE REMOVED FROM THE SITE AND DISPOSED OF.

CONCRETE WASHOUT

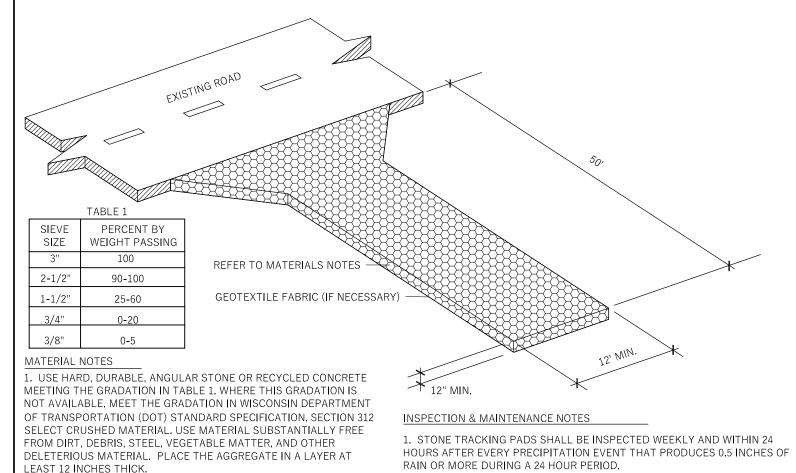

CONSTRUCTION ENTRANCE (STONE TRACKING PAD)

. THE TRACKING PAD SHALL BE UNDERLAIN WITH A WDOT TYPE R GEOTEXTILE FABRIC WHERE WARRANTED BASED ON SOIL TYPE OR

HIGH GROUNDWATER. . INSTALLATION SHALL CONFORM WITH THE REQUIREMENTS OF

WDNR CONSERVATION PRACTICE STANDARD 1057. 2. INSTALL THE TRACKING PAD ACROSS THE FULL WIDTH OF THE ACCESS POINT, OR RESTRICT EXITING TRAFFIC TO A DEDICATED

EGRESS LANE WITH A DRIVING SURFACE AT LEAST 12 FEET WIDE. 3. DIMENSIONS OF THE TRACKING PAD SHALL BE MINIMUM AS NOTED

ON THE FIGURE ABOVE. 4. DIVERT SURFACE FLOWS AWAY FROM TRACKING PADS OR CONVEY FLOW UNDER AND/OR AROUND USING CULVERTS AND SWALES. DIRECT

RUNOFF FROM TRACKING PADS TO SEDIMENT CONTROL PRACTICES. 5. DO NOT COMPACT AGGREGATE PRIOR TO USE. COMPACTION, GROUTING, OR OTHER MEANS OF CREATING A SMOOTH SURFACE COMPROMISE THE EFFECTIVENESS OF THE TRACKING PAD.

6. TRACKING PAD SHALL BE REMOVED OR INCORPORATED INTO GRAVEL DRIVEWAY ONLY AFTER CONSTRUCTION IS COMPLETE AND THE SITE HAS BEEN STABILIZED.

RAIN OR MORE DURING A 24 HOUR PERIOD.

2. MONITOR AND MAINTAIN DEVICES TO MINIMIZE SHIFTING, RUTTING OF ADJACENT SURFACES, AND STRUCTURAL FAILURE. MAINTAIN A LOOSENED, ROUGH SURFACE BY SCRAPING, LOOSENING, OR TOP-DRESSING WITH ADDITIONAL AGGREGATE.

2. ADDITIONAL AGGREGATE SHALL BE PLACED IF THE TRACKING PAD BECOMES BURIED OR IF SEDIMENT IS NOT BEING REMOVED EFFECTIVELY FROM THE VEHICLE TIRES.

3. A MINIMUM 30-FEET WIDE BY 50-FEET LONG BY 12-INCH THICK PAD SHALL BE MAINTAINED AT ALL TIMES. ADD STONE AS NEEDED TO MAINTAIN THE MINIMUM PAD THICKNESS.


4. THE TRACKING PAD PERFORMANCE SHALL BE MAINTAINED BY SCRAPING OR TOP-DRESSING WITH ADDITIONAL AGGREGATE. 5. ANY SEDIMENT TRACKED ONTO A PUBLIC OR PRIVATE ROAD SHOULD BE


6. REMOVE STONES LODGED BETWEEN THE TIRES OF DUAL WHEEL VEHICLES PRIOR TO LEAVING THE CONSTRUCTION SITE.


CONSIDERATION FOR SITE CONDITIONS. 8. REPLACE DAMAGED OR CRUSHED CULVERTS UNDER TRACKING PAD.

REMOVED BY STREET CLEANING AT THE END OF EACH WORKING DAY.

7. MAINTENANCE SHALL BE COMPLETED AS SOON AS POSSIBLE WITH

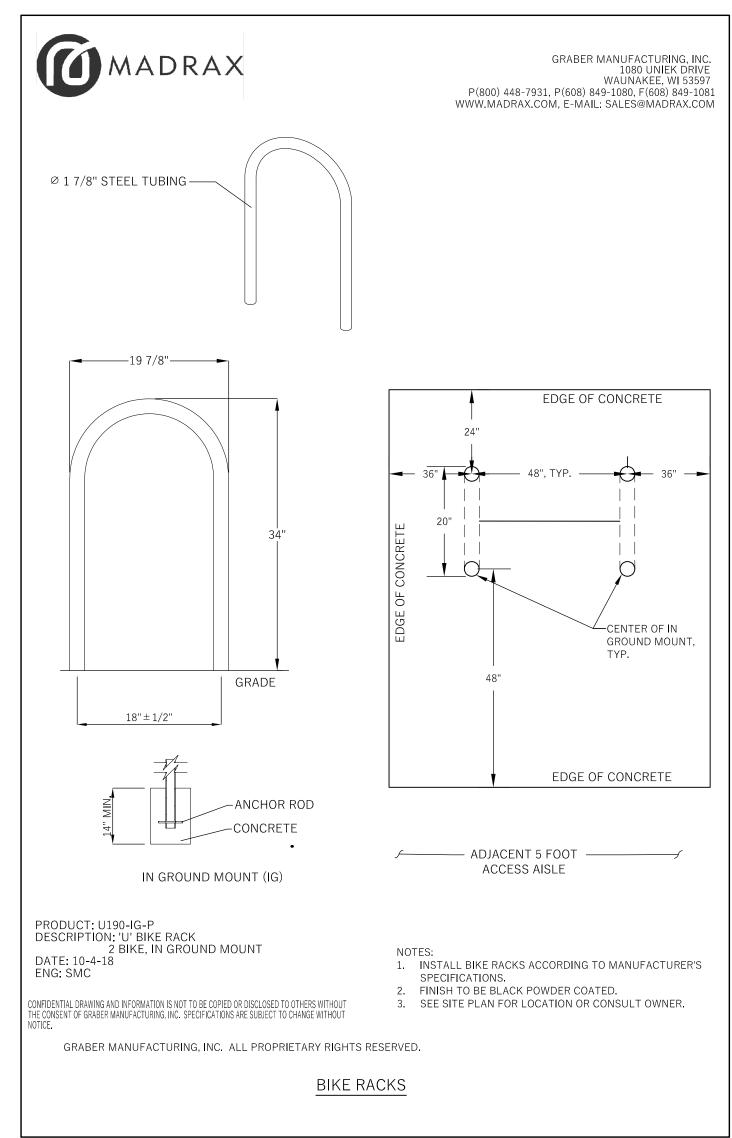

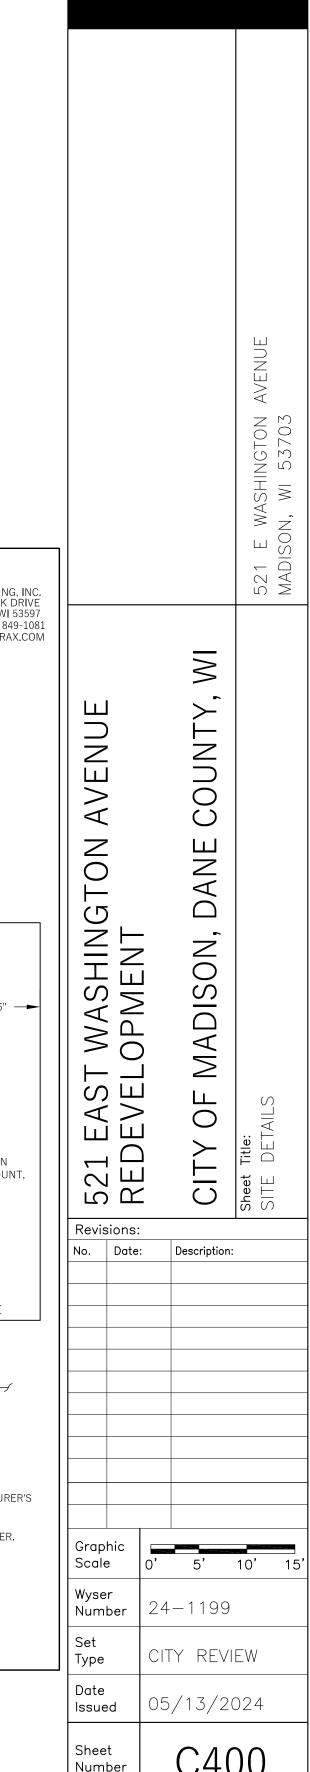

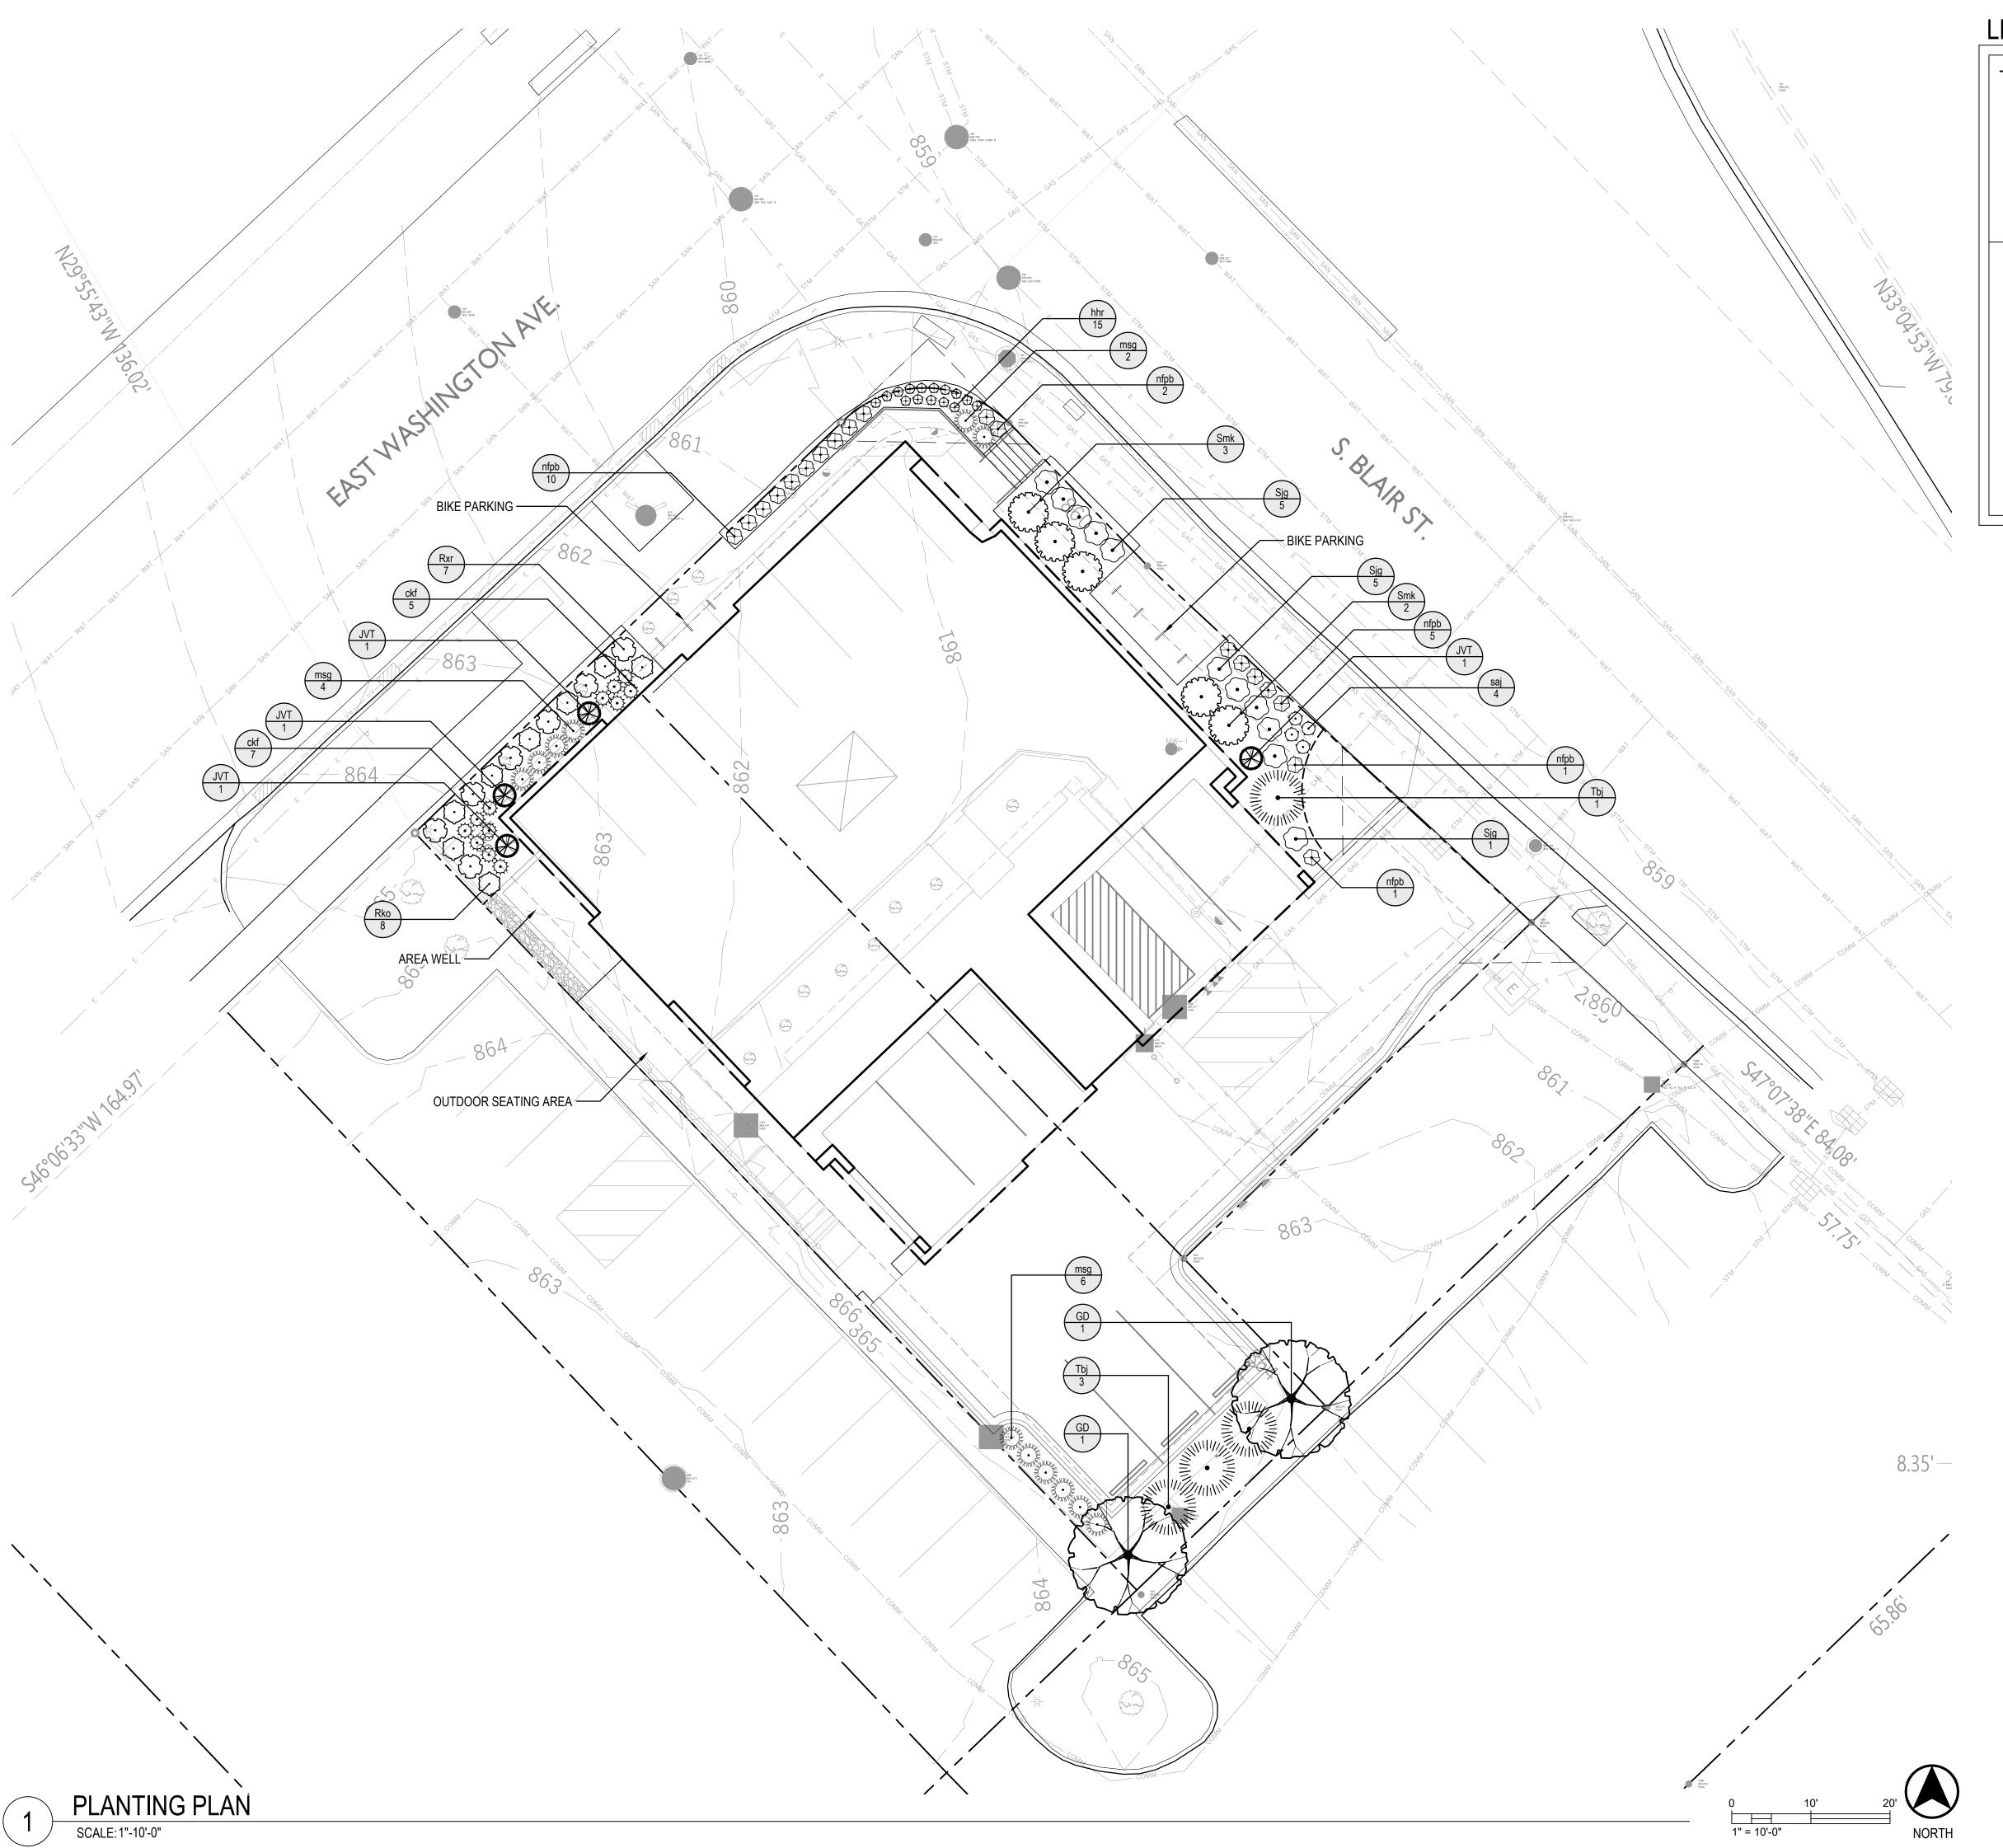

LEGEND:

PROPERTY LINE

 $1\frac{1}{2}$ " DIAMETER, WASHED, DECORATIVE STONE MULCH

RIGID ALUMINUM EDGING.

--858___ **EXISTING CONTOURS**

- 1. SEE C102 FOR SITE DEMOLITION PLAN.
- 2. SEE C201 FOR SITE PLAN.
- 6. SEE C202 FOR SITE LIGHTING PLAN.
- 7. SEE C203 FOR FIRE ACCESS PLAN.
- 8. SEE C204 FOR LOT COVERAGE PLAN. 9. SEE C300 FOR GRADING AND EROSION CONTROL PLAN.
- 10. SEE C400 FOR SITE UTILITIES PLAN.
- 11. ANY NEW TREES WITHIN PUBLIC ROW SHALL BE DETERMINED
- BY THE CITY FORESTER. 12. LAWN AREAS WITHIN STREET TERRACE SHALL BE SEEDED.
- 13. ALL PLANT BEDS SHALL RECEIVE 3" OF SHREDDED
 - HARDWOOD BARK MULCH.
 - RAISED PLANTERS.

14. PERMANENT IRRIGATION SHALL BE INSTALLED WITHIN ALL

FIGUREGROUND jporter@figureground-design.com

608-345-5101

608.836.3690

8401 Greenway Blvd, STE 900

Middleton, WI 53562

ISSUED LAND USE SUBMITTAL NOT FOR CONSTRUCTION

PROJECT TITLE East Washington Avenue Redevelopment

521 E. Washington Ave Madison, WI SHEET TITLE LANDSCAPE PLAN

SHEET NUMBER

PROJECT NUMBER 2379

PLANT SC	CHEDULE						
SYMBOL	CODE	BOTANICAL NAME	COMMON NAME	SIZE	STOCK	<u>HEIGHT</u>	<u>QTY</u>
EVERGREE	N TREES						
	JVT	Juniperus virginiana 'Taylor'	Taylor Eastern Redcedar	See Height	B&B	8`	4
OVERSTOR	RY DECIDU	JOUS TREES					
	GD	Gleditsia triacanthos inermis 'Draves'	Street Keeper® Honey Locust	2.5" Cal.	B&B	18`	2
DECIDUOU	S SHRUBS						
\bigcirc	Rxr	Rosa x 'Radcon'	Pink Knock Out® Shrub Rose	#3	Container	30"	7
\bigcirc	Rko	Rosa x 'Radrazz'	Knock Out® Shrub Rose	#3	Container	24"	8
•	Sjg	Spiraea japonica 'Goldmound'	Goldmound Japanese Spirea	#3	Container	24"	11
**************************************	Smk	Syringa patula 'Miss Kim'	Miss Kim Korean Lilac	#5	Container	36"	5
EVERGREE	N SHRUB	<u>S</u>					
	Tbj	Thuja occidentalis `BailJohn` TM	Technito Arborvitae	#5	Container	48" Height	4
GRASSES 8	& SEDGES						
•	ckf	Calamagrostis x acutiflora `Karl Foerster`	Karl Foerster Feather Reed Grass	#1	Container	N/A	12
3000 M	msg	Miscanthus sinensis 'Gracillimus'	Gracillimus Eulalia Grass	#1	Container	N/A	12
HERBACEOUS PERENNIALS							
	hhr	Hemerocallis x `Happy Returns`	Happy Returns Daylily	#1	Container	N/A	15
	nfpb	Nepeta x faassenii 'Purrsian Blue'	Purrsian Blue Catmint	#1	Container	N/A	19
	saj	Sedum x `Autumn Joy`	Autumn Joy Sedum	#1	Container	N/A	4

City of Madison, WI Landscape Worksheet - 521 E. Washington Ave.

5/13/2024

Zoning: Regional Mixed-Use (RMX)

Developed Area (SF)	Landscape Points Required	Landscape Points Achieved
10,527	175	467
Points Tabulation		


Plant Type/Element	Points	Quantity	Points Achieved
Overstory deciduous trees	35	2	70
Tall evergreen trees	35	4	140
Ornamental trees	15	0	0
Upright evergreen shrubs	10	4	40
Shrubs, deciduous	3	31	93
Shrubs, evergreen	4	0	0
Ornamental grasses/perennials	2	62	124
Decorative fencing/wall	4/LF	0	0
Existing specimen tree	14/cal. inch	0	0
Landscape furniture (public)	5/seat	0	0
Total Points Achieved			467

Development Frontage Landscaping (1) overstory deciduous tree and (5) shrubs /30 LF *(2) ornamental trees or (2) evergreen trees may be used	Frontage (LF)	Overstory Trees Required	Overstory Trees Proposed/Existing	Shrubs Required	Shrubs Proposed/Existir
in place of (1) overstory deciduous tree E. Washington Ave.	90	3	1.5 (3) evergreen trees]	15	15
S. Blair St.	106	4	0.50	18	17

[(1) evergreen tree]

*Interior Parking Lot Landscaping (for lots with 20 or more parking spaces) - N/A (No surface parking lots with 20 or more parking spaces)

(Insufficient area for substantial landscaping between building and sidewalks)

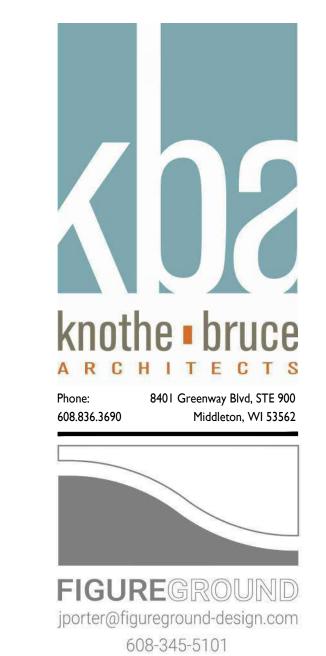

ISSUED
LAND USE SUBMITTAL
NOT FOR CONSTRUCTION

East Washington
Avenue
Redevelopment

521 E. Washington Ave
Madison, WI
SHEET TITLE

PLANT SCHEDULE
& LANDSCAPE
POINTS
WORKSHEET

SHEET NUMBER

PROJECT NUMBER

^{**}In cases where development frontage landscaping cannot be provided due to site constraints, the zoning administrator may waive the requirement or substitute alternative screening methods for the required landscaping.



LU & UDC SUBMITTAL - 05.13.2024


PROJECT TITLE
PORCHLIGHT
REDEVELOPMENT

521 E. WASHINGTON
AVE. MADISON, WI
SHEET TITLE
LOWER LEVEL
PLAN

SHEET NUMBER

AC100

PROJECT NUMBER 2379

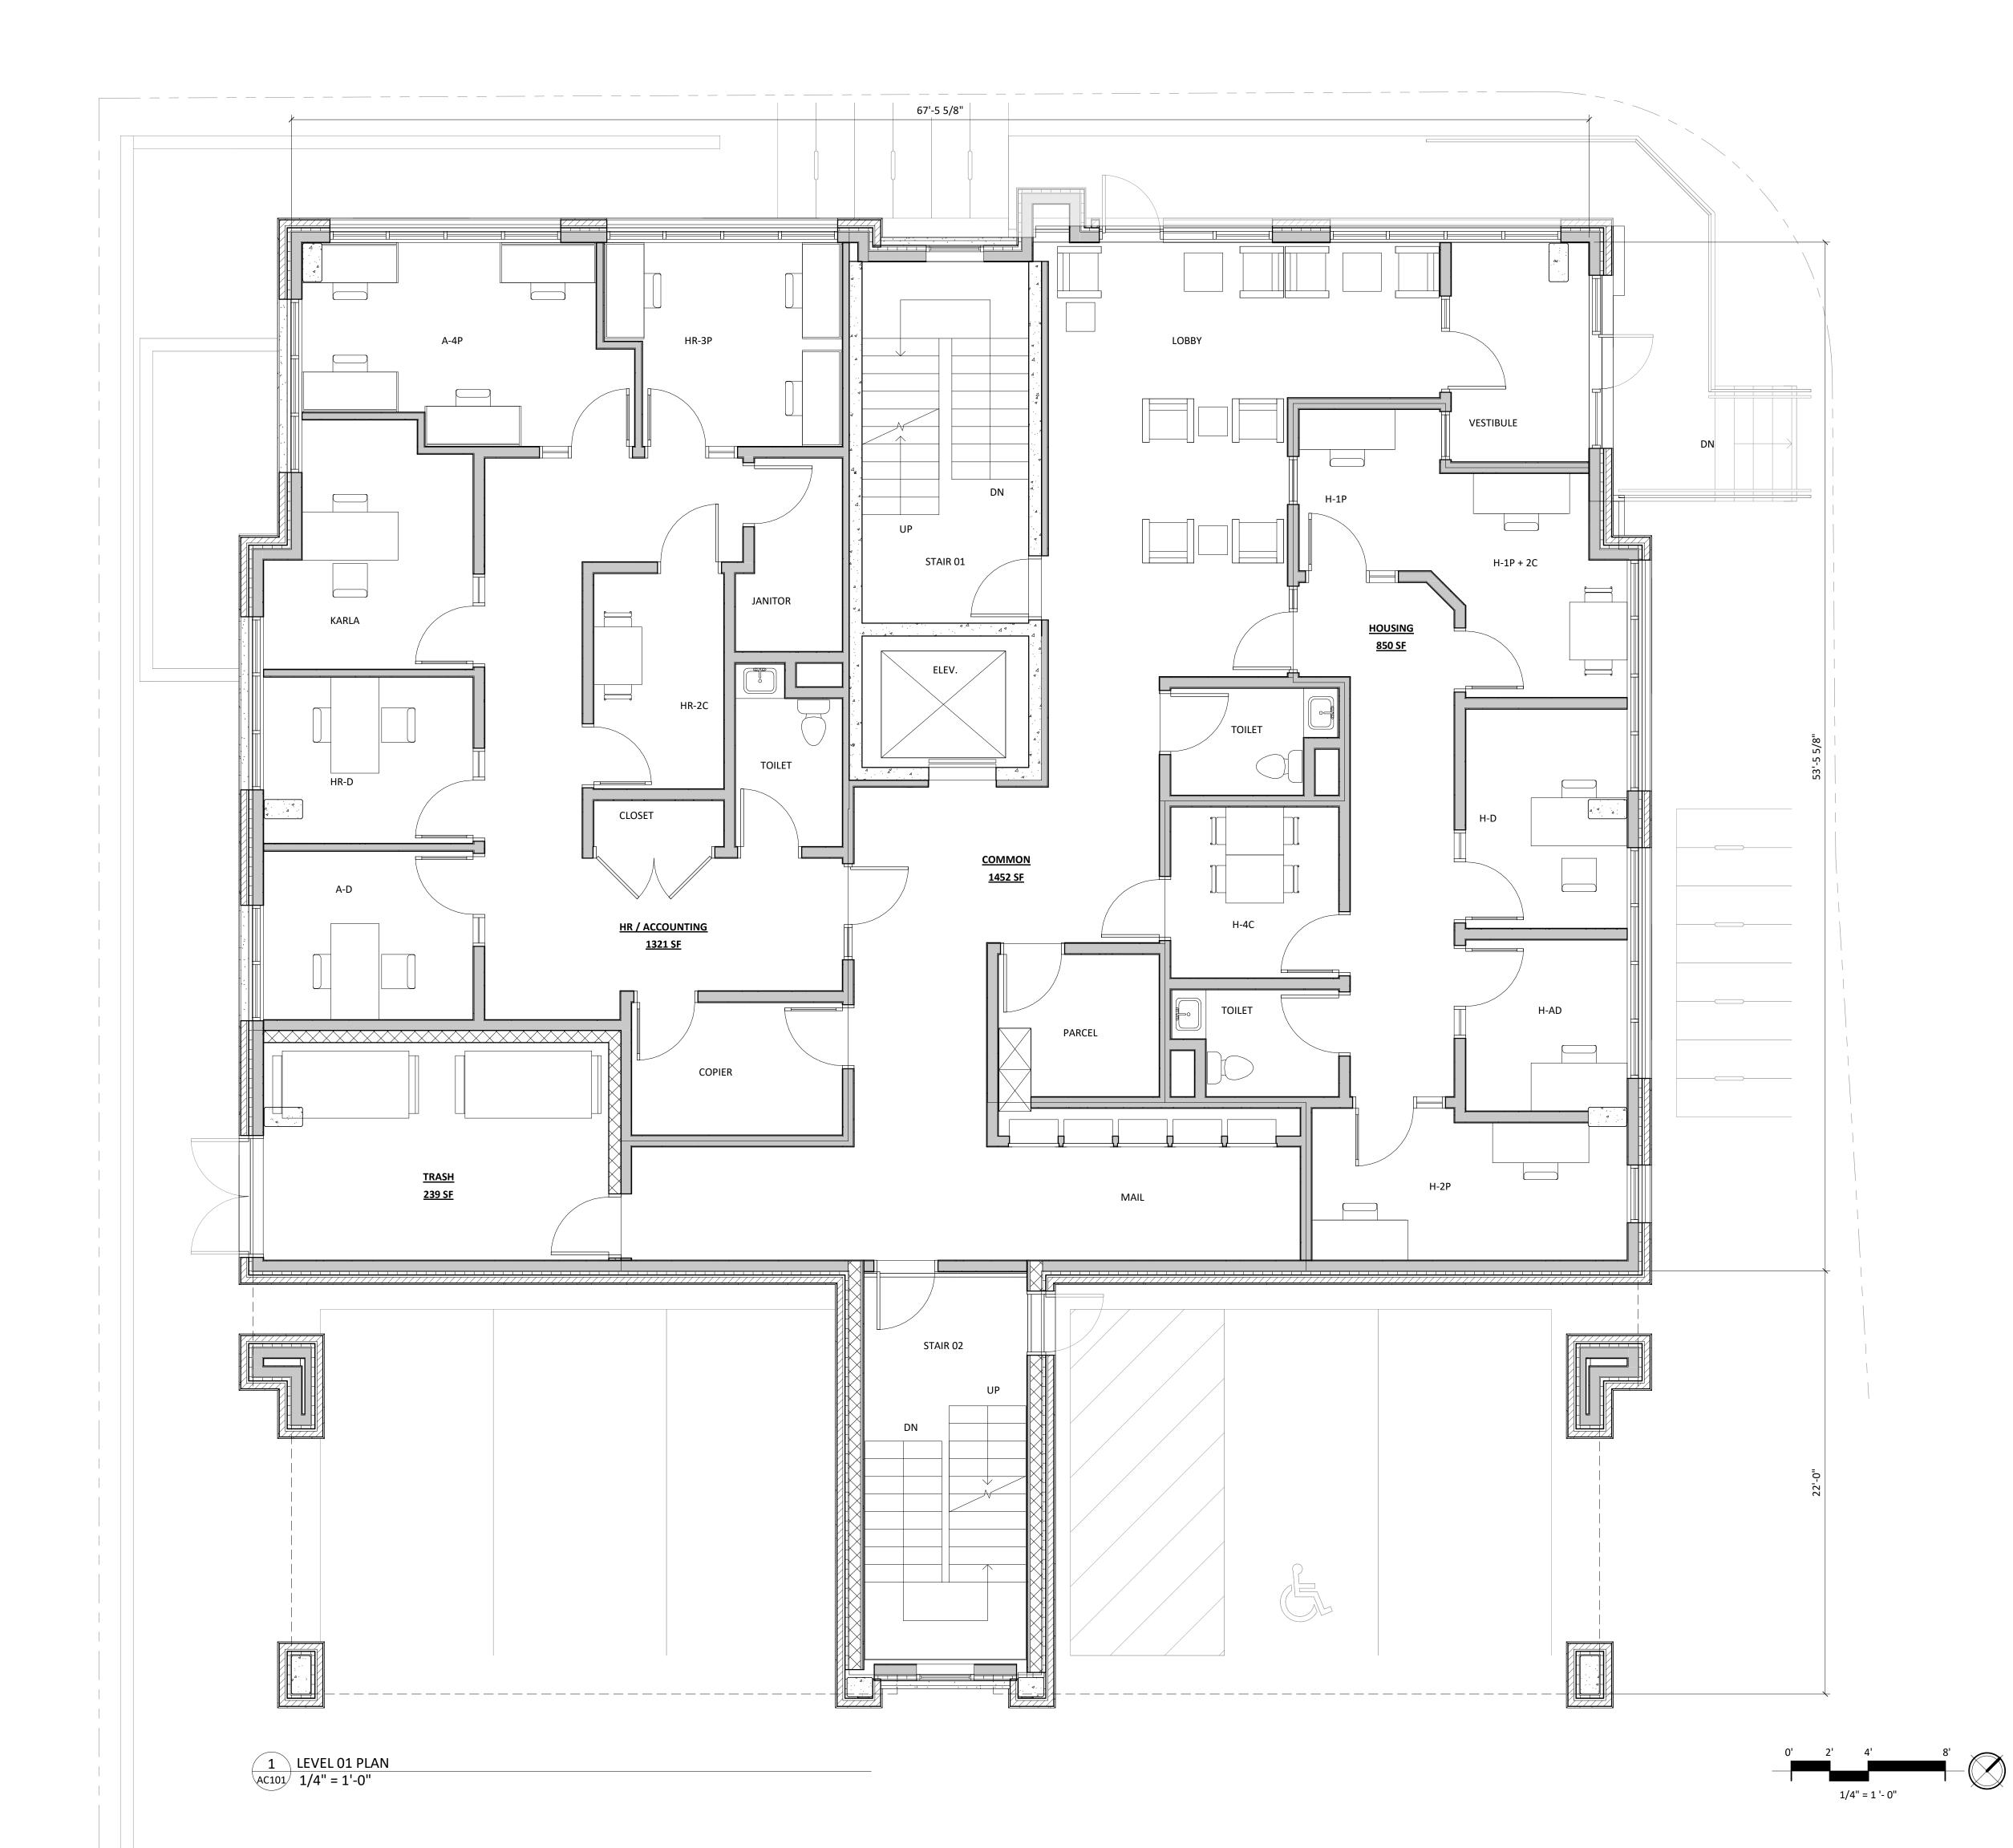




PROJECT TITLE
PORCHLIGHT
REDEVELOPMENT

521 E. WASHINGTON
AVE. MADISON, WI
SHEET TITLE
LEVEL 01 PLAN

SHEET NUMBER

AC101

PROJECT NUMBER 2379

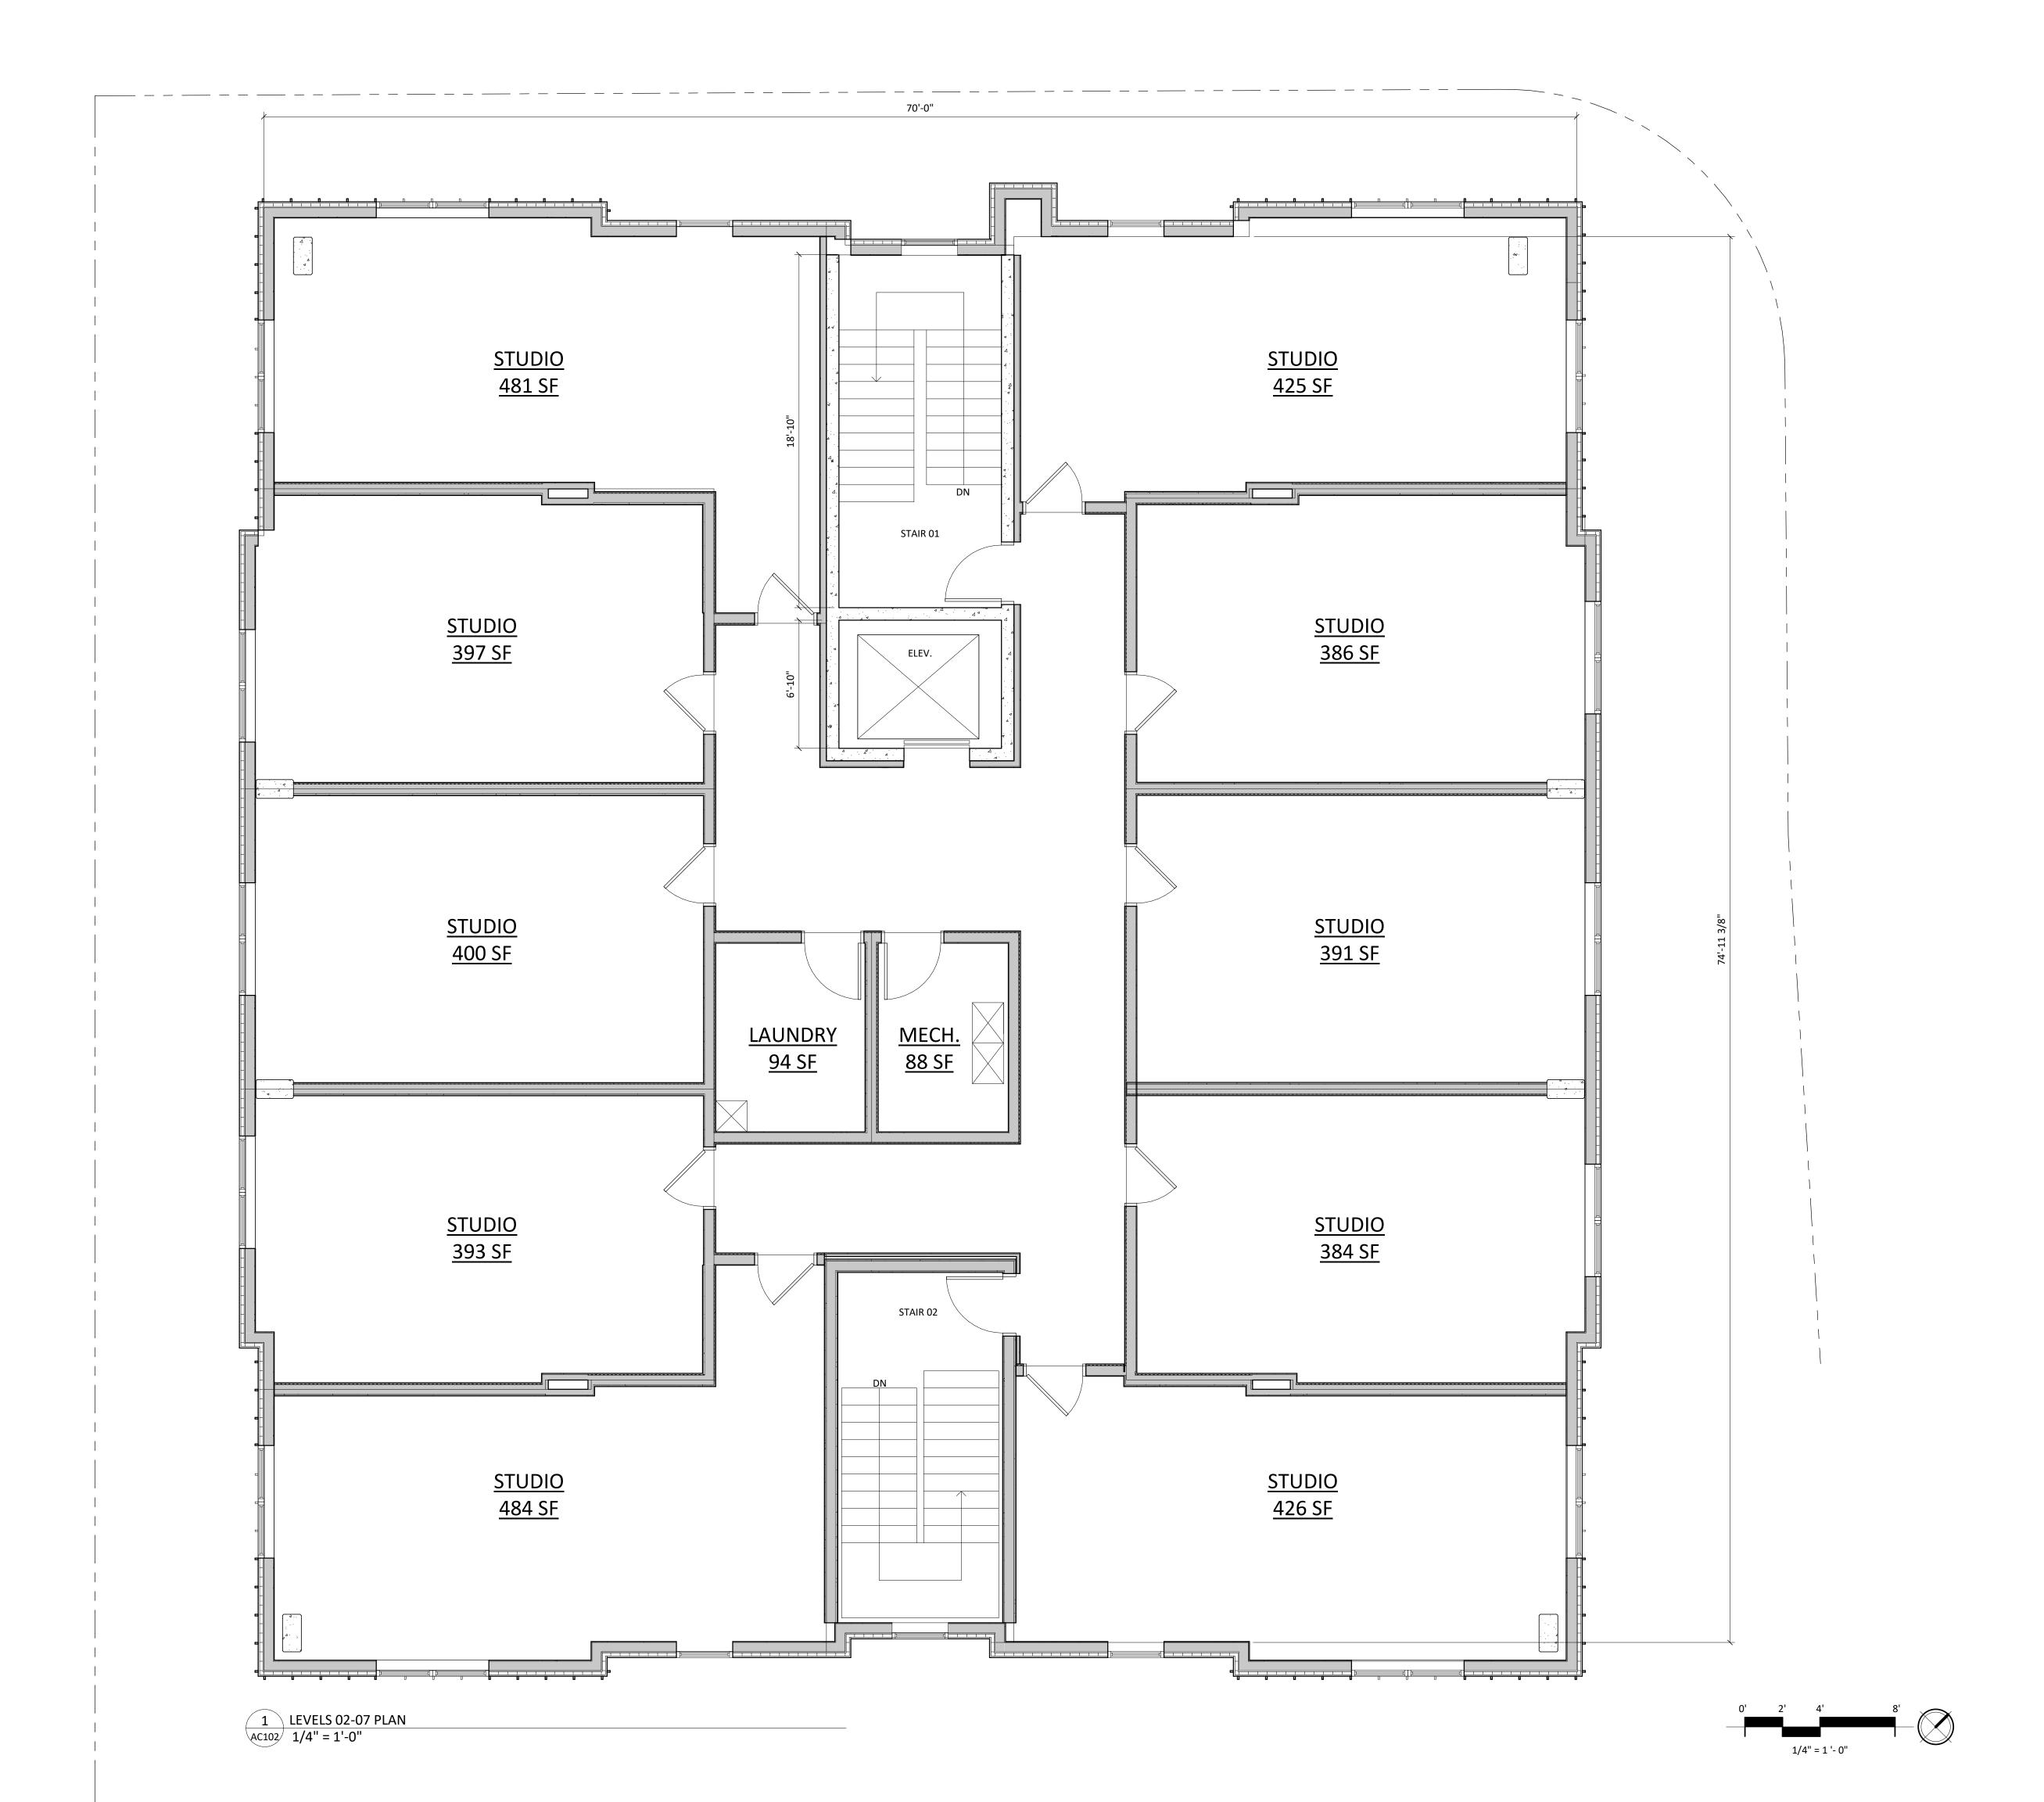




PROJECT TITLE PORCHLIGHT REDEVELOPMENT

521 E. WASHINGTON AVE. MADISON, WI **LEVELS 02-07** PLAN

SHEET NUMBER

AC102

PROJECT NUMBER 2379

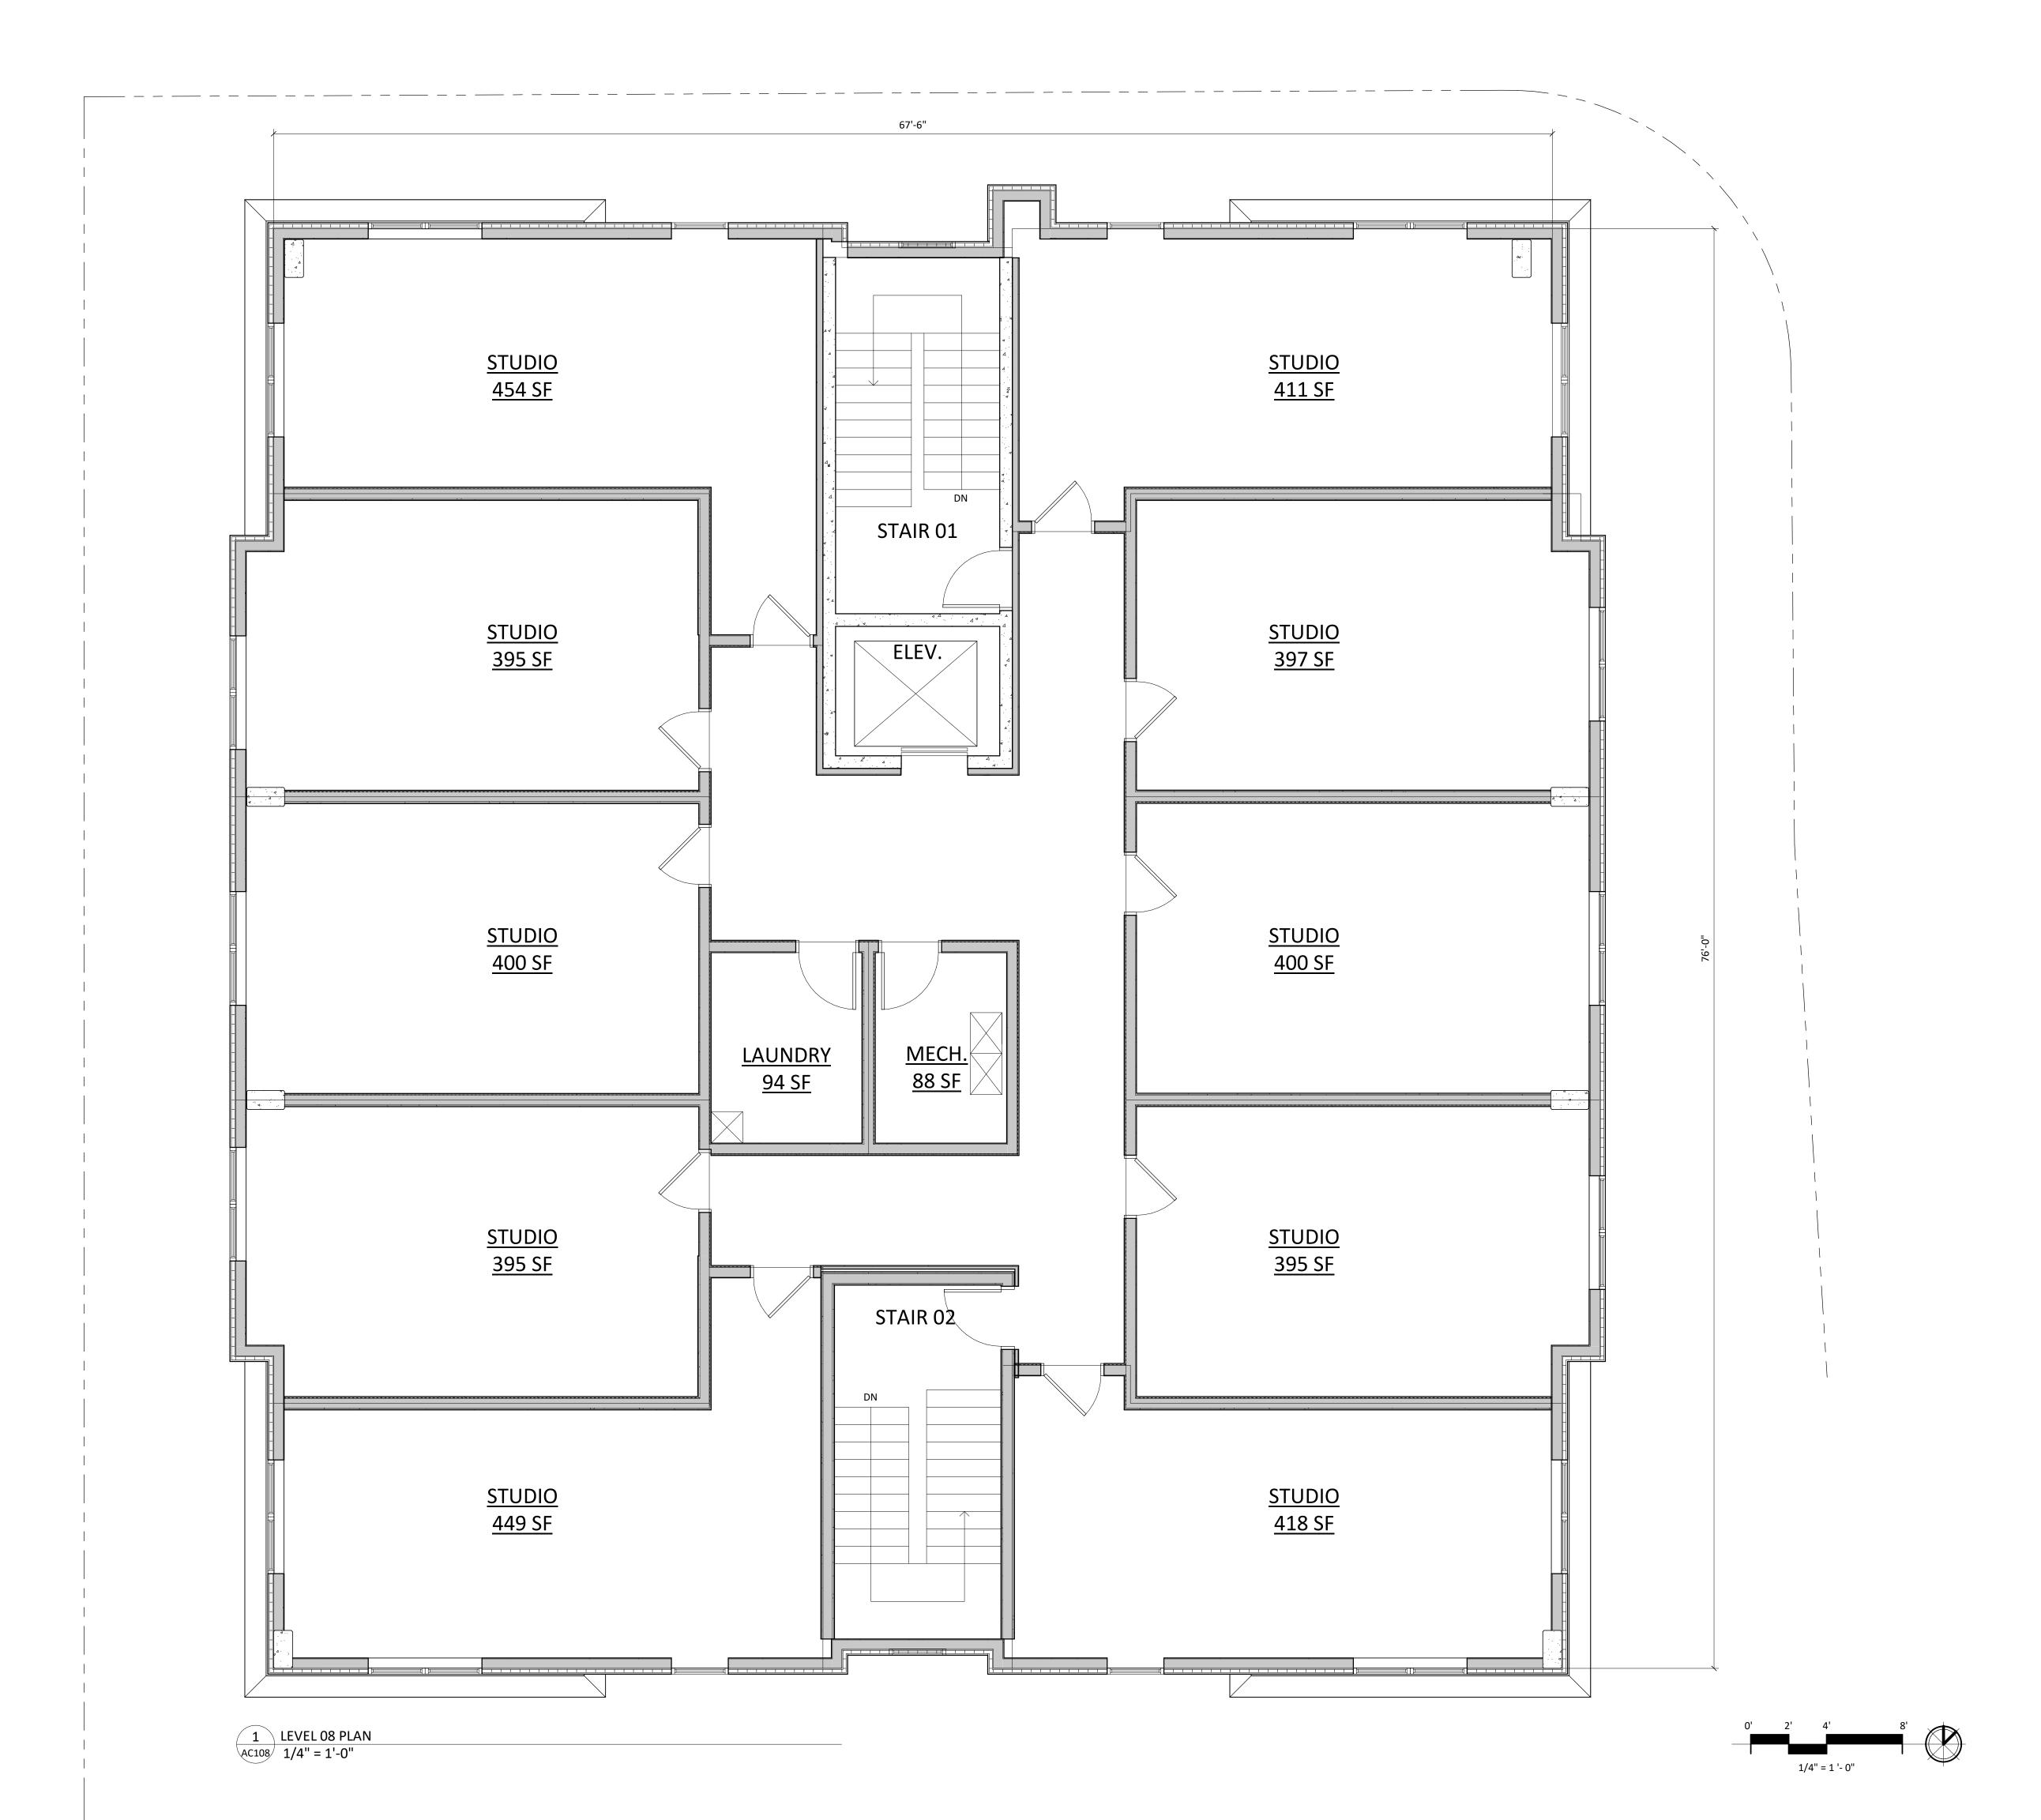




PROJECT TITLE PORCHLIGHT REDEVELOPMENT

521 E. WASHINGTON AVE. MADISON, WI LEVEL 08 PLAN

SHEET NUMBER

AC108

PROJECT NUMBER 2379

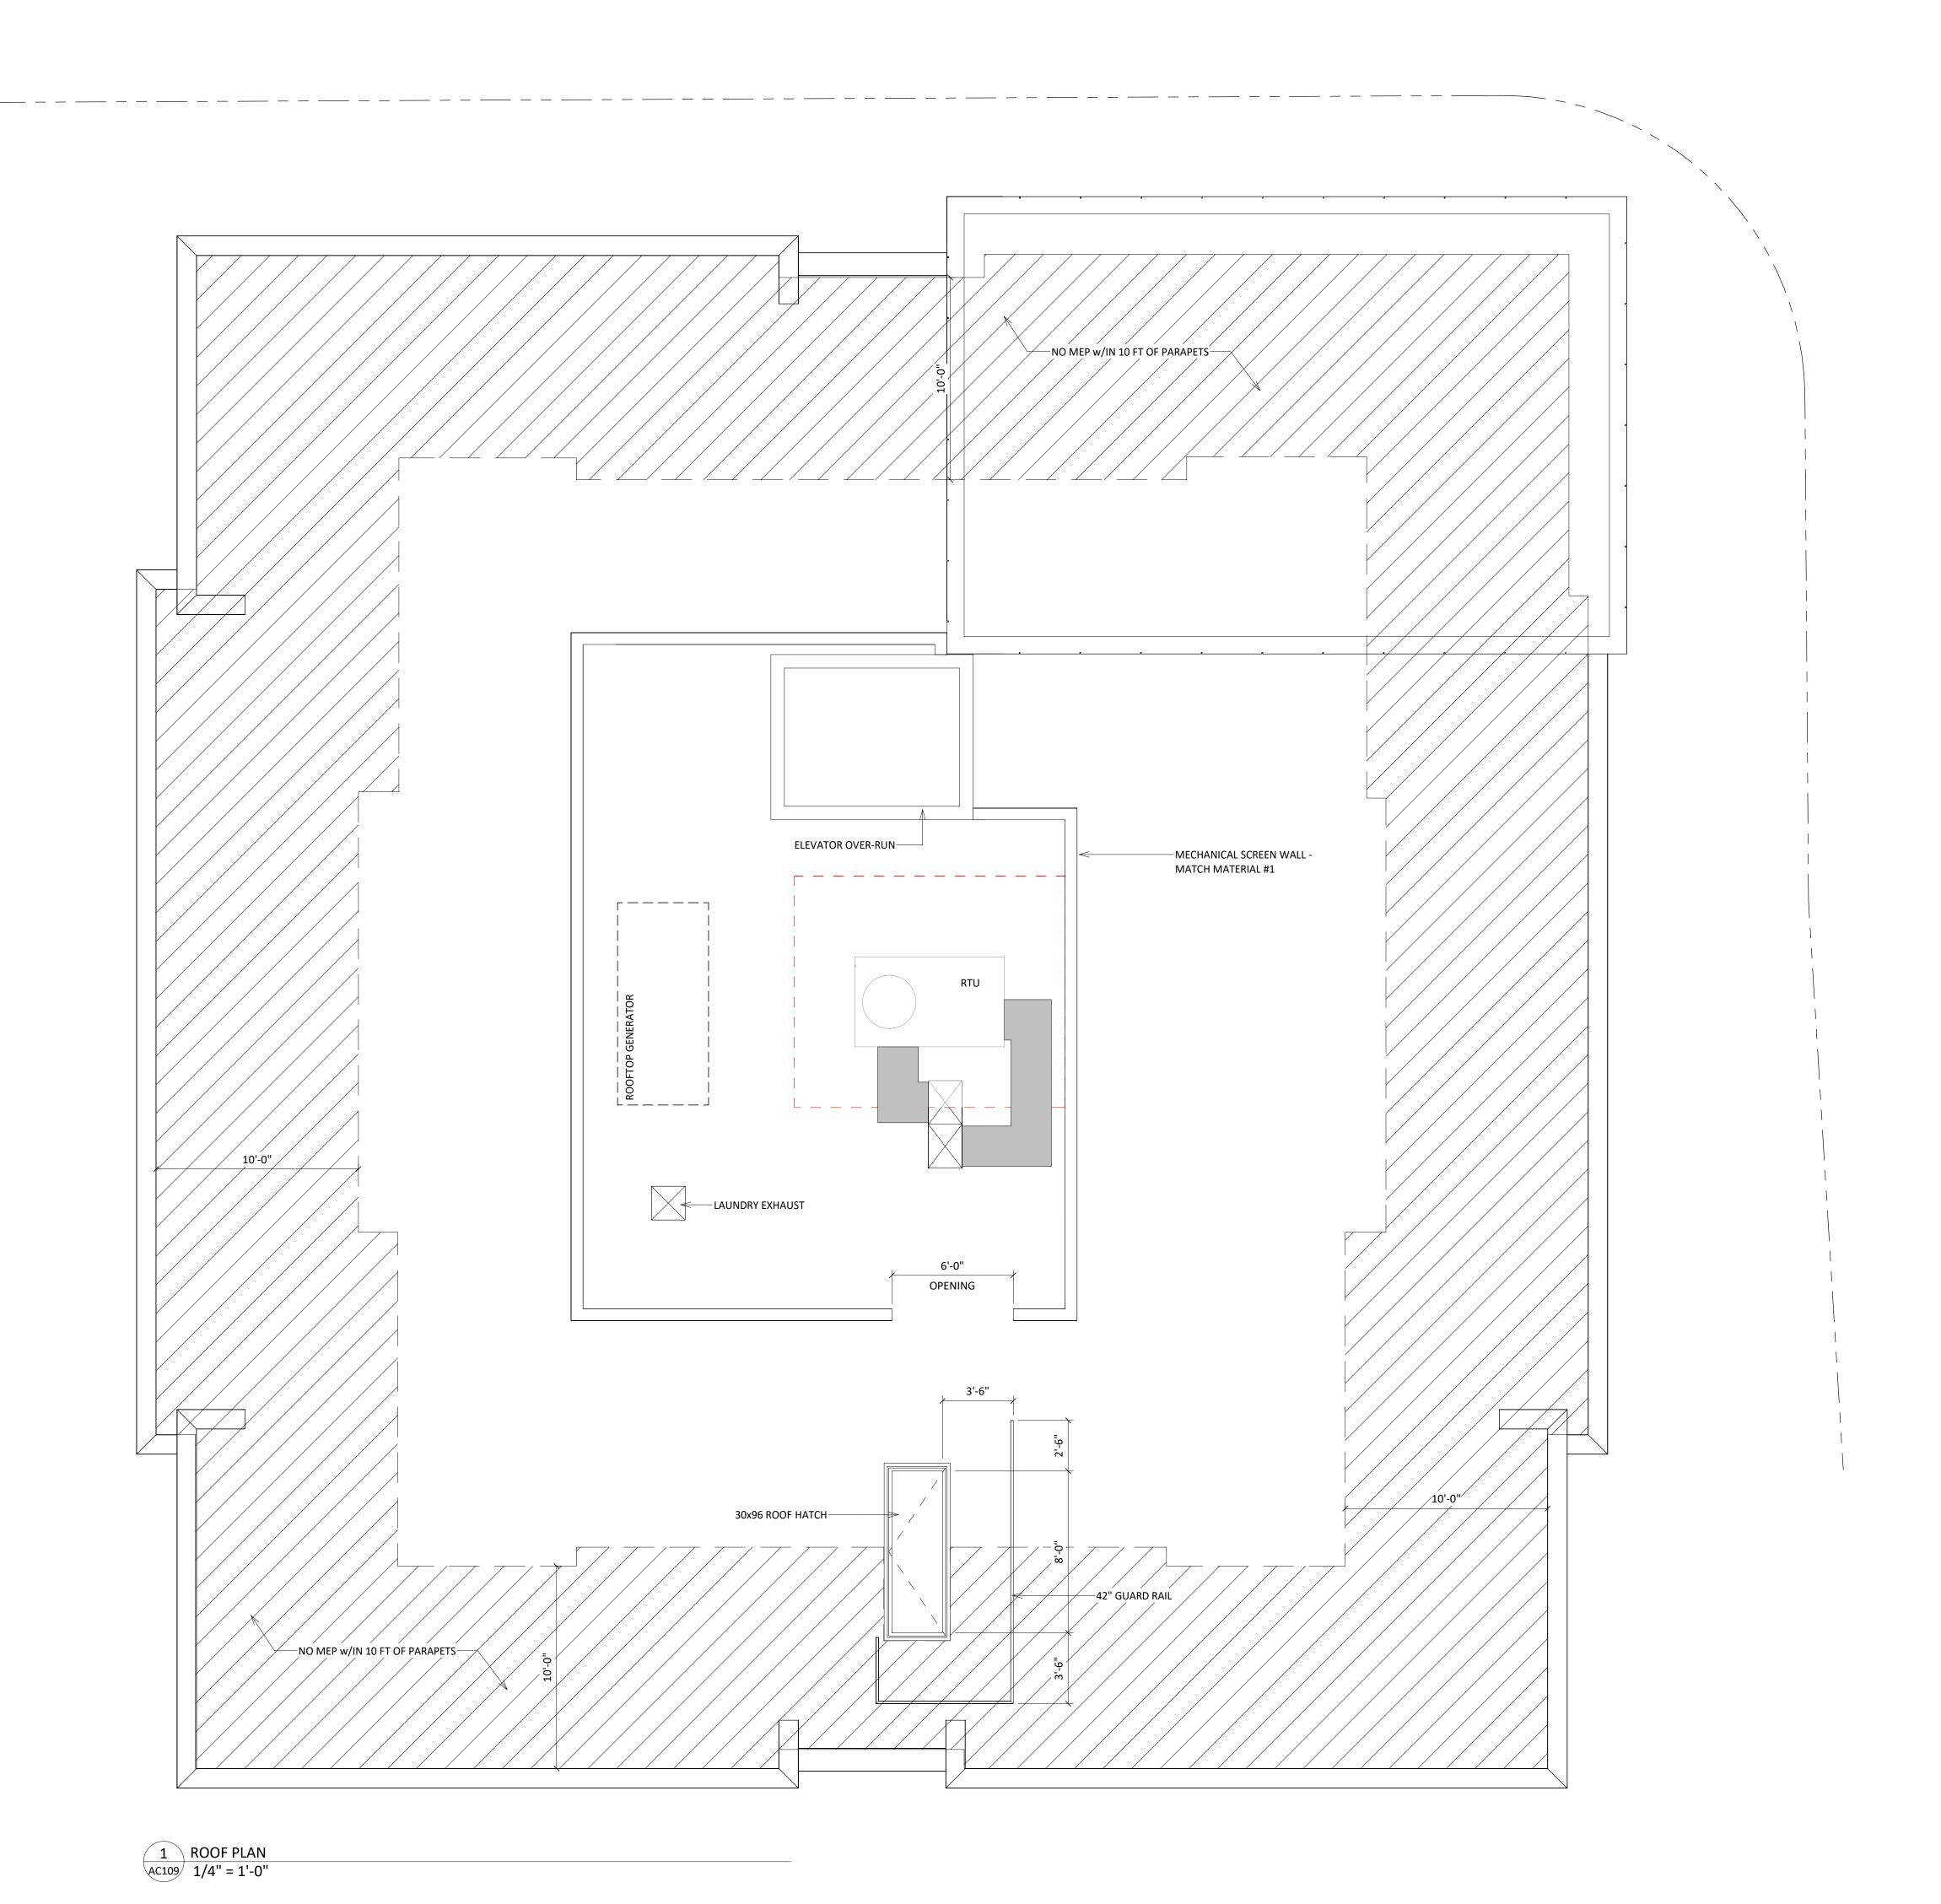



PROJECT TITLE PORCHLIGHT REDEVELOPMENT

521 E. WASHINGTON AVE. MADISON, WI SHEET TITLE **ROOF PLAN**

SHEET NUMBER

AC109

PROJECT NUMBER 2379





PROJECT TITLE PORCHLIGHT

REDEVELOPMENT

521 E. WASHINGTON AVE. MADISON, WI SHEET TITLE **EXTERIOR**

ELEVATIONS

SHEET NUMBER

PROJECT NUMBER 2379

© Knothe & Bruce Architects, LLC

2 CITY ELEVATION - NORTH EAST AC201 1/8" = 1'-0"

1 CITY ELEVATION - NORTH WEST AC201 1/8" = 1'-0"

EXTERIOR MATERIAL SCHEDULE					
MARK	BUILDING ELEMENT	MANUFACTURER	COLOR		
1A	MTL HORIZONTAL REVEAL PANEL	PAC-CLAD	SLATE GRAY		
1B	MTL HORIZONTAL REVEAL PANEL	PAC-CLAD	COLONIAL RED		
2	MCM PANEL	TBD	ASCOT WHITE		
3	STANDING SEAM VERTICAL SIDING	PAC-CLAD	MIDNIGHT-BRONZE		
5	BRICK VENEER	SUMMIT BRICK	THISTLEDOWN		
6	BRICK VENEER - SOLDIER COURSE	SUMMIT BRICK	THISTLEDOWN		
7	CAST STONE BANDS & SILLS	ROCKCAST	RIESLING		
8	COMPOSITE WINDOWS	TBD	DARK BRONZE		
9	ALUM. STOREFRONT	TBD	DARK BRONZE		





PROJECT TITLE PORCHLIGHT

REDEVELOPMENT

521 E. WASHINGTON AVE. MADISON, WI SHEET TITLE **EXTERIOR ELEVATIONS**

SHEET NUMBER

© Knothe & Bruce Architects, LLC

PROJECT NUMBER 2379

EXTERIOR MATERIAL SCHEDULE COLOR MANUFACTURER 1A MTL HORIZONTAL REVEAL PANEL PAC-CLAD SLATE GRAY MTL HORIZONTAL REVEAL PANEL PAC-CLAD COLONIAL RED MCM PANEL ASCOT WHITE TBD STANDING SEAM VERTICAL SIDING PAC-CLAD MIDNIGHT-BRONZE SUMMIT BRICK THISTLEDOWN BRICK VENEER BRICK VENEER - SOLDIER COURSE SUMMIT BRICK THISTLEDOWN CAST STONE BANDS & SILLS ROCKCAST RIESLING COMPOSITE WINDOWS TBD DARK BRONZE

TBD

9 ALUM. STOREFRONT

1 CITY ELEVATION - SOUTH EAST

DARK BRONZE

AC202 1/8" = 1'-0"

MARK BUILDING ELEMENT

2 CITY ELEVATION - SOUTH WEST AC202 1/8" = 1'-0"





PROJECT TITLE PORCHLIGHT

REDEVELOPMENT

1 CITY ELEVATION - NORTH WEST COLOR AC203 1/8" = 1'-0"

EXTERIOR MATERIAL SCHEDULE					
MARK	BUILDING ELEMENT	MANUFACTURER	COLOR		
1A	MTL HORIZONTAL REVEAL PANEL	PAC-CLAD	SLATE GRAY		
1B	MTL HORIZONTAL REVEAL PANEL	PAC-CLAD	COLONIAL RED		
2	MCM PANEL	TBD	ASCOT WHITE		
3	STANDING SEAM VERTICAL SIDING	PAC-CLAD	MIDNIGHT-BRONZE		
5	BRICK VENEER	SUMMIT BRICK	THISTLEDOWN		
6	BRICK VENEER - SOLDIER COURSE	SUMMIT BRICK	THISTLEDOWN		
7	CAST STONE BANDS & SILLS	ROCKCAST	RIESLING		
8	COMPOSITE WINDOWS	TBD	DARK BRONZE		
9	ALUM. STOREFRONT	TBD	DARK BRONZE		
	<u> </u>	<u> </u>	·		

521 E. WASHINGTON AVE. MADISON, WI SHEET TITLE **EXTERIOR COLOR ELEVATIONS**

SHEET NUMBER

PROJECT NUMBER 2379



LU & UDC SUBMITTAL - 05.13.2024



PORCHLIGHT REDEVELOPMENT

521 E. WASHINGTON AVE. MADISON, WI SHEET TITLE **EXTERIOR COLOR**

SHEET NUMBER

ELEVATIONS

PROJECT NUMBER 2379

EXTERIOR MATERIAL SCHEDULE MANUFACTURER COLOR MARK BUILDING ELEMENT 1A MTL HORIZONTAL REVEAL PANEL PAC-CLAD SLATE GRAY MTL HORIZONTAL REVEAL PANEL PAC-CLAD COLONIAL RED MCM PANEL ASCOT WHITE TBD STANDING SEAM VERTICAL SIDING PAC-CLAD MIDNIGHT-BRONZE SUMMIT BRICK THISTLEDOWN BRICK VENEER BRICK VENEER - SOLDIER COURSE SUMMIT BRICK THISTLEDOWN CAST STONE BANDS & SILLS ROCKCAST RIESLING COMPOSITE WINDOWS TBD DARK BRONZE

TBD

DARK BRONZE

9 ALUM. STOREFRONT

PROJECT TITLE





LU & UDC SUBMITTAL - 05.13.2024

PROJECT TITLE PORCHLIGHT REDEVELOPMENT

521 E. WASHINGTON AVE. MADISON, WI SHEET TITLE

BIRD-SAFE COMPLIANCE

SHEET NUMBER

PROJECT NUMBER 2379

© Knothe & Bruce Architects, LLC

FOR BUILDINGS AND STRUCTURES OF ANY SIZE, ALL AT-GRADE GLASS FEATURES SUCH AS SOUND WALLS OR GLASS SCREENS MUST BE TREATED.

FOR NON-RESIDENTIAL USES AT GROUND FLOOR LEVEL, WINDOWS AND DOORS OR OTHER OPENINGS SHALL COMPRISE AT LEAST SIXTY PERCENT (60%) OF THE LENGTH AND AT LEAST (40%) OF THE AREA OF THE GROUND FLOOR OF THE PRIMARY STREET FACADE. AT LEAST FIFTY PERCENT (50%) OF THE WINDOWS ON THE PRIMARY STREET FACADE SHALL HAVE THE LOWER SILL WITHIN THREE (3) FEET OF GRADE. FOR RESIDENTIAL USES AT GROUND LEVEL, A MINIMUM OF FIFTEEN PERCENT (15%) OF THE GROUND LEVEL OF RESIDENTIAL FACADES OR SIDE AND REAR FACADES NOT FRONTING A PUBLIC STREET SHALL CONSIST OF WINDOWS AND DOOR OPENINGS. ON UPPER STORIES, WINDOW OR BALCONY OPENINGS SHALL OCCUPY A MINIMUM OF FIFTEEN PERCENT (15%) OF THE UPPER-STORY WALL AREA.

INDICATES BIRD-SAFE GLAZING

INDICATES BIRD-SAFE GLAZING NOT REQ'D

GLASS AREA SHALL BE MEASURED AS ONE (1) CONTINUOUS PANEL OF GLASS OR OTHER TRANSPARENT MATERIAL, OR A SET OF TWO (2) OR MORE SUCH PANELS DIVIDED BY MULLIONS OF SIX (6) INCHES IN WIDTH OR NARROWER. PANELS SURROUNDED ON ALL SIDES BY SOLID WALLS OR MULLIONS WIDER THAN SIX (6) INCHES SHALL BE CONSIDERED INDIVIDUAL WINDOWS. SPANDREL OR OPAQUE GLASS WITH REFLECTIVITY OF 14% OR LESS SHALL NOT BE INCLUDED IN THE CALCULATION OF GLASS AREA.

FOR BUILDING FACADES WHERE THE FIST SIXTY (60) FEET FROM GRADE ARE COMPRISED OF LESS THAN FIFTY PERCENT (50%) GLASS: A. AT LEAST EIGHTY-FIVE PERCENT (85%) OF THE GLASS ON GLASS AREAS FIFTY (50) SQUARE FEET OR OVER MUST BE TREATED; AND

B. OF ALL GLASS AREAS OVER FIFTY (50) SQUARE FEET, ANY GLASS WITHIN FIFTEEN (15) FEET OF A BUILDING CORNER MUST BE TREATED





LU & UDC SUBMITTAL - 05.13.2024

PROJECT TITLE PORCHLIGHT

REDEVELOPMENT

521 E. WASHINGTON AVE. MADISON, WI SHEET TITLE BIRD-SAFE

COMPLIANCE

SHEET NUMBER

PROJECT NUMBER 2379

© Knothe & Bruce Architects, LLC

FIFTEEN (15) FEET OF A BUILDING CORNER MUST BE TREATED FOR BUILDINGS AND STRUCTURES OF ANY SIZE, ALL AT-GRADE GLASS FEATURES

FOR NON-RESIDENTIAL USES AT GROUND FLOOR LEVEL, WINDOWS AND DOORS OR OTHER OPENINGS SHALL COMPRISE AT LEAST SIXTY PERCENT (60%) OF THE LENGTH AND AT LEAST (40%) OF THE AREA OF THE GROUND FLOOR OF THE PRIMARY STREET FACADE. AT LEAST FIFTY PERCENT (50%) OF THE WINDOWS ON THE PRIMARY STREET FACADE SHALL HAVE THE LOWER SILL WITHIN THREE (3) FEET OF GRADE. FOR RESIDENTIAL USES AT GROUND LEVEL, A MINIMUM OF FIFTEEN PERCENT (15%) OF THE GROUND LEVEL OF RESIDENTIAL FACADES OR SIDE AND REAR FACADES NOT FRONTING A PUBLIC STREET SHALL CONSIST OF WINDOWS AND DOOR OPENINGS. ON UPPER STORIES, WINDOW OR BALCONY OPENINGS SHALL OCCUPY A MINIMUM OF FIFTEEN PERCENT (15%) OF THE UPPER-STORY WALL AREA.

INDICATES BIRD-SAFE GLAZING

INDICATES BIRD-SAFE GLAZING NOT REQ'D

GLASS AREA SHALL BE MEASURED AS ONE (1) CONTINUOUS PANEL OF GLASS OR OTHER TRANSPARENT MATERIAL, OR A SET OF TWO (2) OR MORE SUCH PANELS DIVIDED BY MULLIONS OF SIX (6) INCHES IN WIDTH OR NARROWER. PANELS SURROUNDED ON ALL SIDES BY SOLID WALLS OR MULLIONS WIDER THAN SIX (6) INCHES SHALL BE CONSIDERED INDIVIDUAL WINDOWS. SPANDREL OR OPAQUE GLASS WITH REFLECTIVITY OF 14% OR LESS SHALL NOT BE INCLUDED IN THE CALCULATION OF GLASS AREA.

FOR BUILDING FACADES WHERE THE FIST SIXTY (60) FEET FROM GRADE ARE COMPRISED OF LESS THAN FIFTY PERCENT (50%) GLASS:

A. AT LEAST EIGHTY-FIVE PERCENT (85%) OF THE GLASS ON GLASS AREAS FIFTY (50) SQUARE FEET OR OVER MUST BE TREATED; AND B. OF ALL GLASS AREAS OVER FIFTY (50) SQUARE FEET, ANY GLASS WITHIN

SUCH AS SOUND WALLS OR GLASS SCREENS MUST BE TREATED.














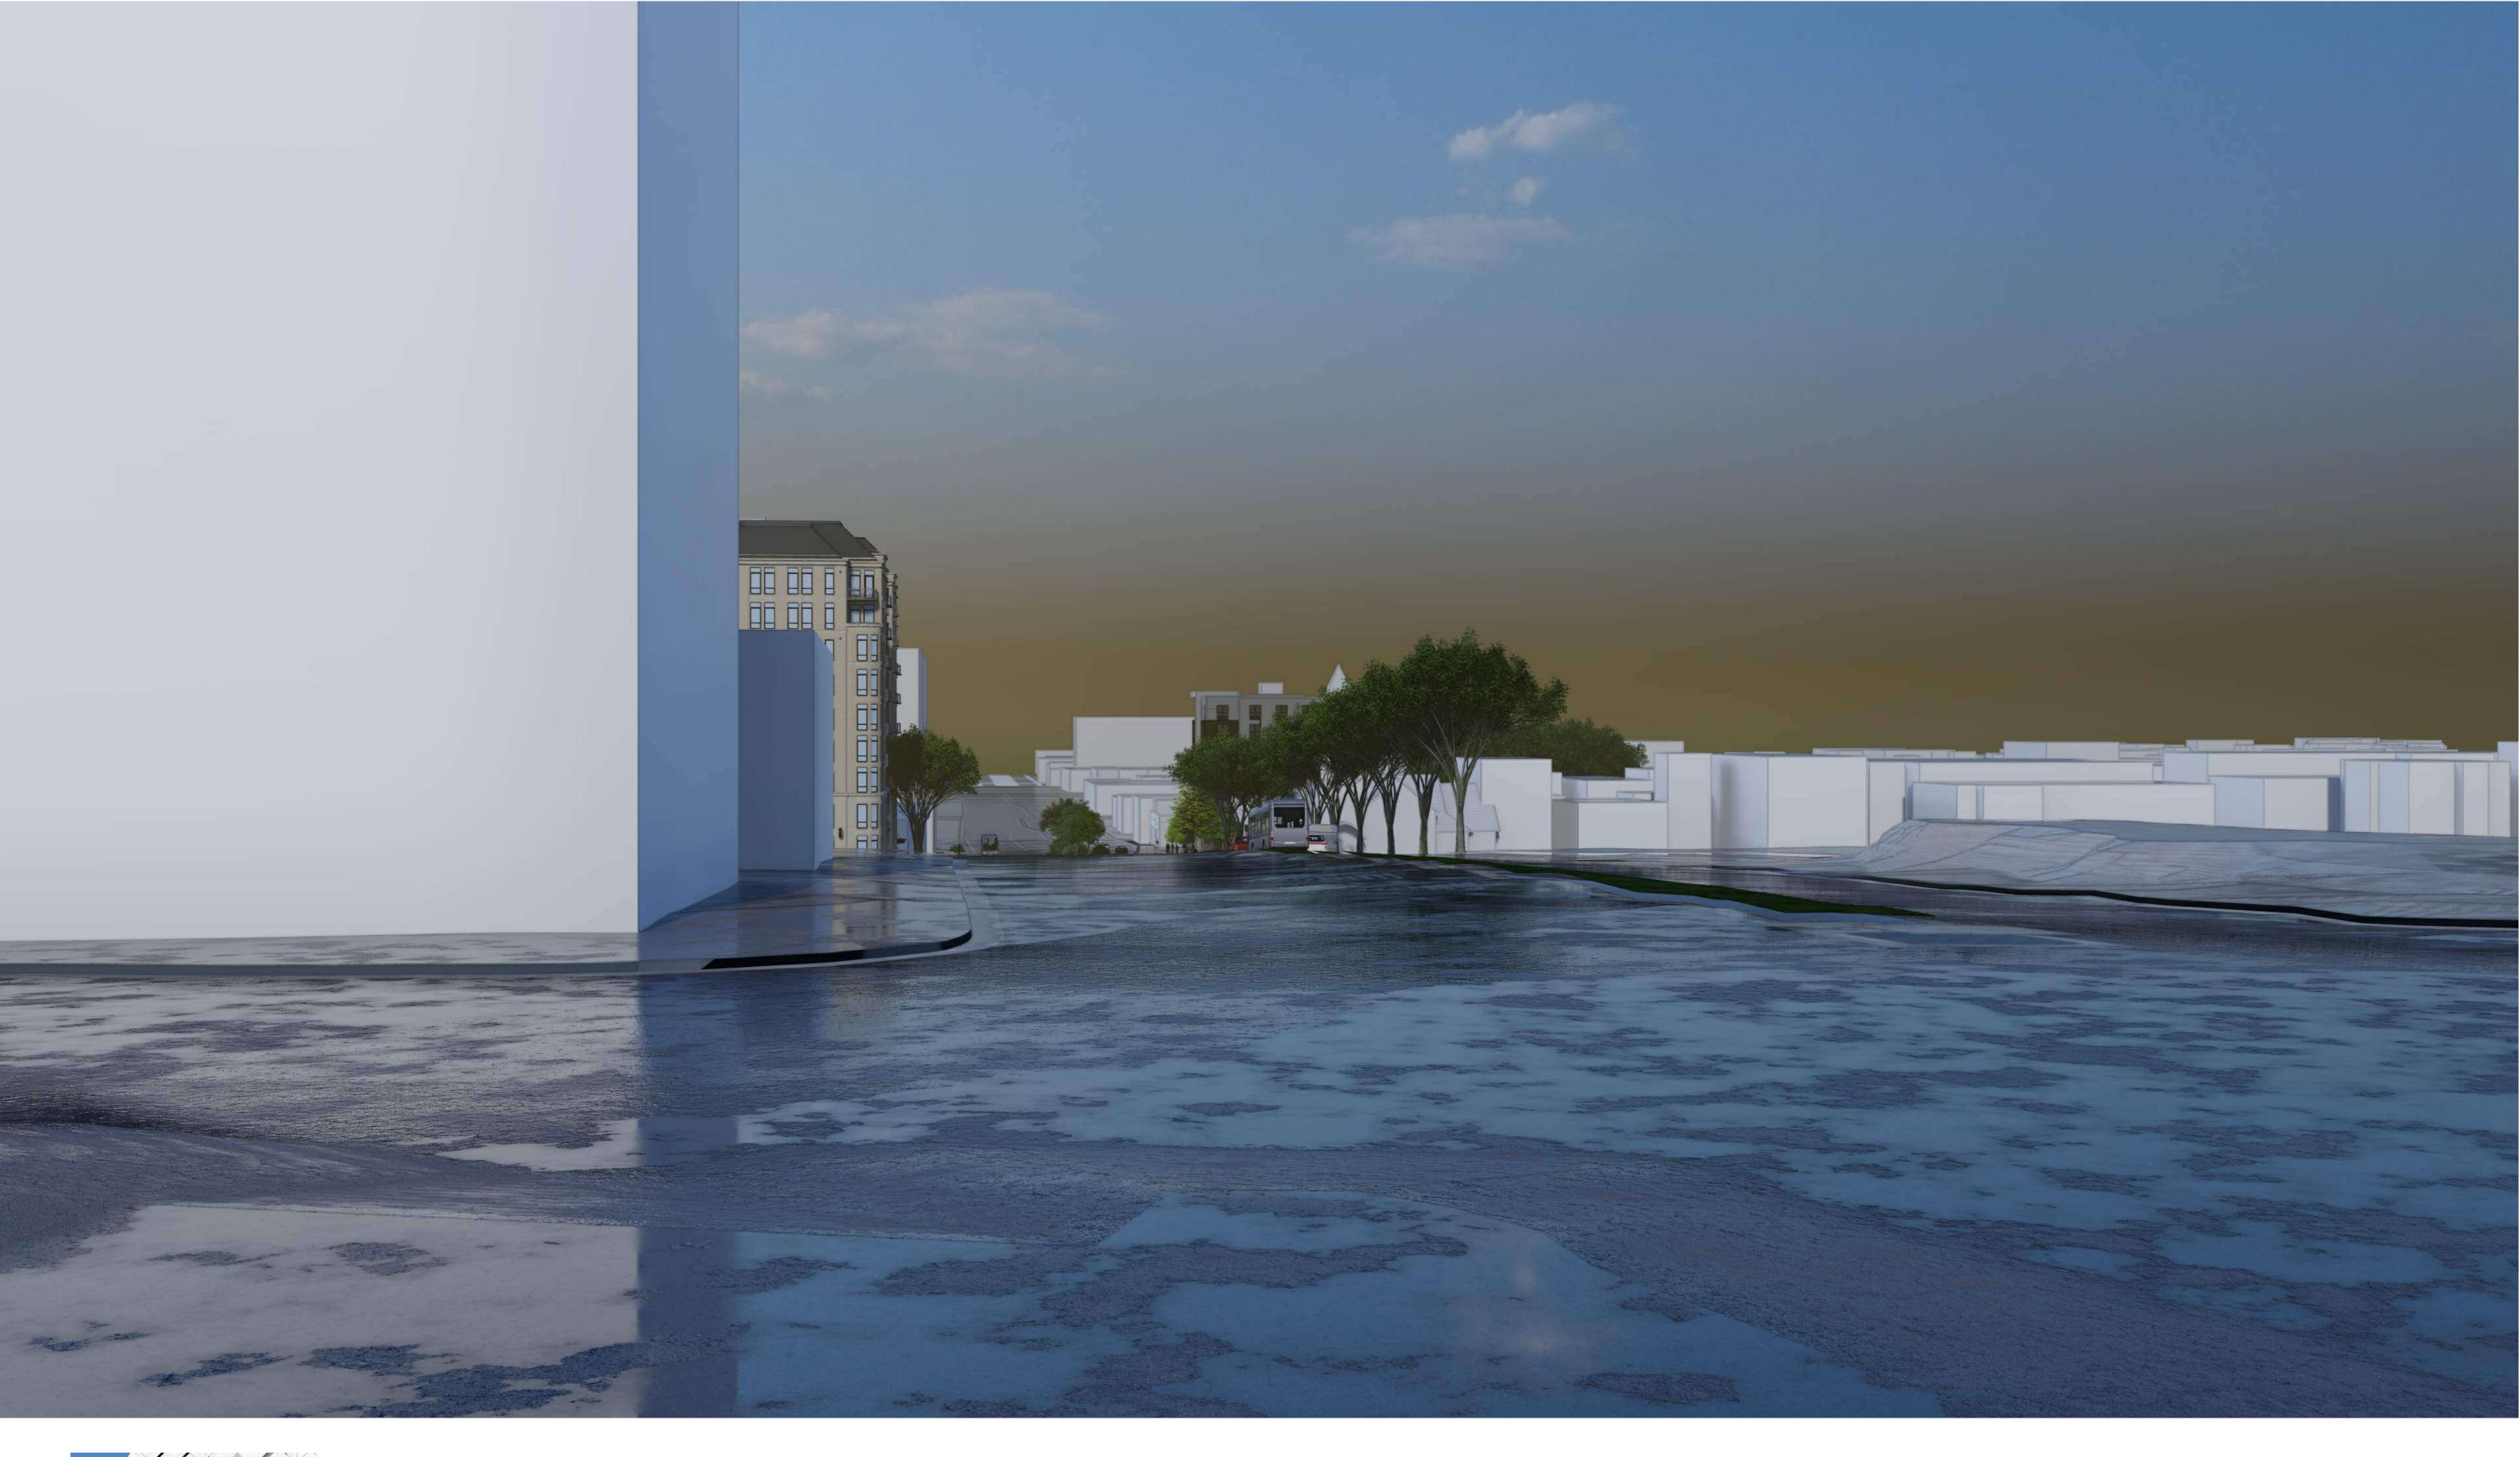


















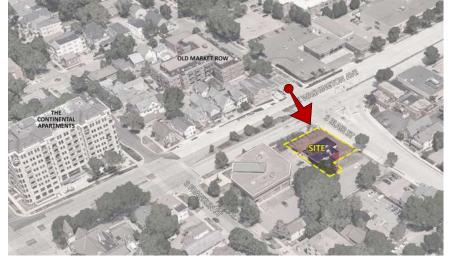



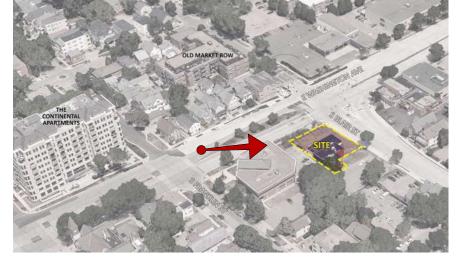

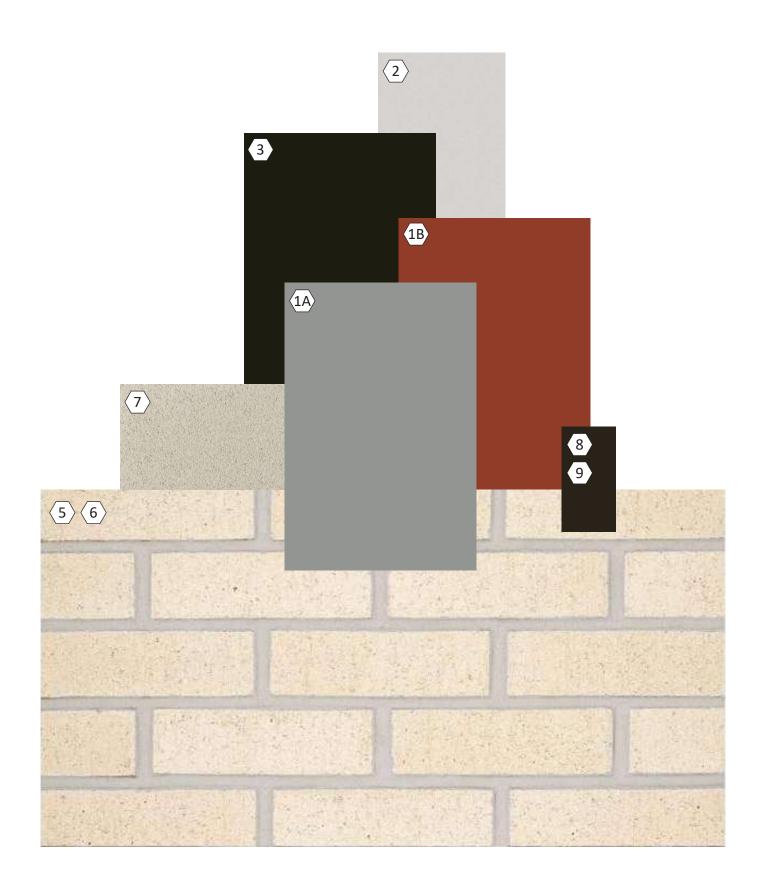



	EXTERIOR MATERIAL SCHEDULE					
MARK	BUILDING ELEMENT	MANUFACTURER	COLOR			
1A	MTL HORIZONTAL REVEAL PANEL	PAC-CLAD	SLATE GRAY			
1B	MTL HORIZONTAL REVEAL PANEL	PAC-CLAD	COLONIAL RED			
2	MCM PANEL	TBD	ASCOT WHITE			
3	STANDING SEAM VERTICAL SIDING	PAC-CLAD	MIDNIGHT-BRONZE			
5	BRICK VENEER	SUMMIT BRICK	THISTLEDOWN			
6	BRICK VENEER - SOLDIER COURSE	SUMMIT BRICK	THISTLEDOWN			
7	CAST STONE BANDS & SILLS	ROCKCAST	RIESLING			
8	COMPOSITE WINDOWS	TBD	DARK BRONZE			
9	ALUM. STOREFRONT	TBD	DARK BRONZE			

^{*}PLEASE NOTE THAT COLOR MAY DIFFER SLIGHTLY FROM HOW IT APPEARS ON YOUR SCREEN DUE TO VARYING MONITOR SETTINGS.














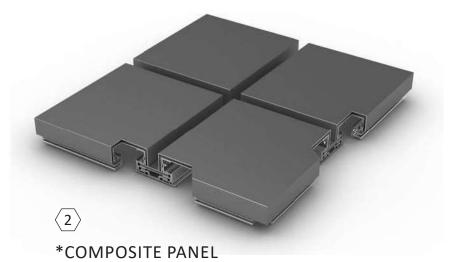

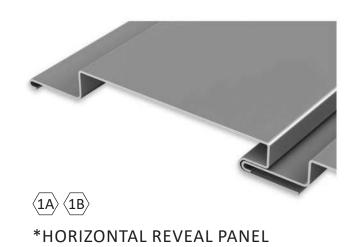

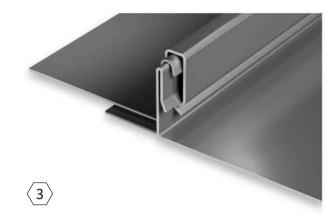

*STANDING SEAM VERTICAL SIDING