

14,595 SF POST FRAME BUILDING SIMPLY HOMES PROPERTIES

2917 DAIRY DR.
MADISON, WI
SEPTEMBER 23, 2024




PROPOSED COMPLETED ELEVATION

SUBMITTAL TYPE	NEW CONSTRUCTION
PRIMARY OCCUPANCY TYPE	STORAGE BUILDING (S-1)
SECONDARY OCCUPANCY TYPE	BUSINESS (B)
OCCUPANCY SEPARATIONS	N/A

PROJECT AREA	14,595 SQ. FT.
FLOOR LEVELS	1
CONSTRUCTION CLASS	VB
SPRINKLER PROTECTION	TBD



LOCATION PLAN
DANE COUNTY, WI

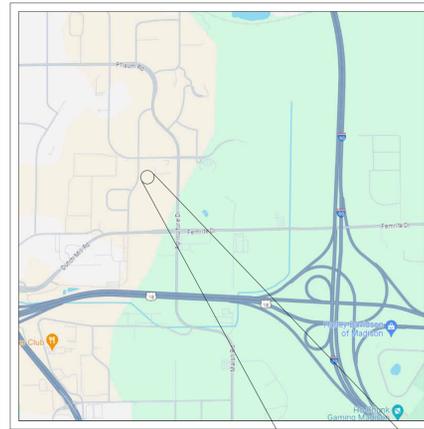

LOCATION PLAN
CITY OF MADISON

BUILDING DESIGN CRITERIA

- CODE COMPLIANCE PER 2018 WISCONSIN COMMERCIAL BUILDING CODE (CBC) (2015 IBC - CODES) ENERGY COMPLIANCE PER IECC 2015
- BUILDING ENVELOPE REQUIREMENTS-
BUILDING ROOF (U=0.027) SPS 363.0402
BLDG WALL (U=0.051) SPS 363.0402
FENESTRATIONS MTL FRAME W THERMAL BREAK (U=0.38)
DOORS, SWINGING (U=0.37)
DOORS, NON SWINGING (U=0.31)
- PROVIDED THERMAL ENVELOPE:
WOOD FRAMED WALL
CAVITY F.G. INSULATION R21 (U=0.048)
ROOF
BLOWN IN F.G. INSULATION R=50
- OCCUPANCY TYPE
IBC 508.3 SEPARATED OCCUPANCIES
S1 - MODERATE HAZARD STORAGE = 8,475 SF
B - BUSINESS GROUP = 6,120 SF
- CONSTRUCTION CLASSIFICATION - VB
POST FRAME BUILDING
- BUILDING ALLOWABLE AREA
- IBC 506.2 = 9,000 SF NON SPRINKLED
- IBC 506.3 FRONTAGE INCREASE = 6,750 SF
I₁ = (F/P-0.25)W/30
I₂ = (520/520-0.25)30/30 = 0.75 * 9000 = 6,750 SF
- TOTAL ALLOWED = 9,000 SF + 6,750 SF = 15,750 SF
- OCCUPANT LOAD
IBC 508.3 SEPARATED OCCUPANCIES
BUSINESS (B) 6,120 SF / 500 = 12 OCCUPANTS
STORAGE (S1) = 8,475 SF / 500 = 16
TOTAL = 28 OCCUPANTS

ABBREVIATIONS

- | | |
|--|--------------------------|
| EOP = EDGE OF PAVEMENT | MFG. = MANUFACTURER |
| BOC = BACK OF CURB | DIM. = DIMENSION |
| EOSW = EDGE OF SIDEWALK | SPF = SPRUCE PINE FUR |
| TOF = TOP OF FOOTING | DF = DOUGLAS FIR |
| FFE = FIRST FLOOR ELEVATION | SP = SOUTHERN PINE |
| TOW = TOP OF WALL | CONC. = CONCRETE |
| SFE = SECOND FLOOR ELEVATION | WWF = WIRE WELDED FABRIC |
| ELEV. = ELEVATION | OC = ON CENTER |
| RO = ROUGH OPENING | EW = EACH WAY |
| BM = BENCHMARK | EF = EACH FACE |
| SQ. FT. = SQUARE FEET | WH = WATER HEATER |
| DIA. = DIAMETER | DW = DISHWASHER |
| TYP. = TYPICAL | REF. = REFRIGERATOR |
| HM = HOLLOW METAL | FRZ. = FREEZER |
| SS = STAINLESS STEEL | FTG. = FOOTING |
| ALUM. = ALUMINUM | PC = PRECAST |
| IBC = INTERNATIONAL BUILDING CODE | OHD = OVERHEAD DOOR |
| WD = WOOD | T/O = TOP OF |
| MTL = METAL | GALV. = GALVANIZED |
| HSS = HOLLOW STEEL STRUCTURE | BRG. = BEARING |
| STL = STEEL | OH = OVERHANG |
| OFOI - OWNER FURNISHED OWNER INSTALLED | |

SEAL


I HEREBY CERTIFY THAT THIS PLAN SPECIFICATION OR REPORT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM DULY REGISTERED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF WISCONSIN.

INDEX OF DRAWINGS	
SHEET NO.	DESCRIPTION
GENERAL -	
G1.0	TITLE SHEET
CIVIL -	
C1.0	EXISTING PLAN
C2.0	PROPOSED SITE PLAN
C3.0	UTILITY PLAN
C4.0	GRADING PLAN
C5.0	EROSION CONTROL PLAN
C6.0	EROSION CONTROL DETAILS
C6.1-C6.2	CONSTRUCTION DETAILS
ARCHITECTURAL -	
A-001	FIRST FLOOR ARCHITECTURAL CODE
A-100	FIRST FLOOR PLAN
A-400	EXTERIOR ELEVATIONS
STRUCTURAL -	
MECHANICAL -	DESIGN BUILT
PLUMBING -	DESIGN BUILT
ELECTRICAL -	DESIGN BUILT

OWNER
LINDSAY HAGENS KELLER WILLIAMS REALTY 608.446.2224

INDEX OF DRAWINGS

NUMBERING SYSTEM:



- DISCIPLINE:
C - CIVIL
L - LANDSCAPE
A - ARCHITECTURE
M - MECHANICAL
E - ELECTRICAL
P - PLUMBING
S - STRUCTURAL
K - FOOD SERVICE
DISCIPLINE MODIFIER
- SHEET NUMBER WITHIN SERIES
- REFER TO A/E/C CAD STANDARD FOR SHEET NUMBERING STANDARDS

ARCHITECTURAL LEGEND

ANNOTATION CALLOUTS/DRAWING SYMBOLS

- INTERIOR ELEVATION SHEET NUMBER
- ELEVATION NUMBER
- EXTERIOR ELEVATION SHEET NUMBER
- SECTION SHEET NUMBER
- ENLARGEMENT, DETAIL SHEET NUMBER
- REVISION TAG
- PLAN NORTH
- NORTH ARROW w/ TRUE NORTH INDICATION
- ROOM TAG
- SPOT ELEVATION
- LEVEL NAME
- SHEET KEYNOTE
- DOOR TAG
- WINDOW TAG
- WALL TAG
- ROOM TAG
- UNIT TAG
- SMOKE TAG
- FIRE EXTINGUISHER - CABINET TYPE
- FIRE EXTINGUISHER - CYLINDER TYPE
- FIRE EXTINGUISHER 4 VALVE CABINET
- PULL STATION
- FIRE HORN
- DOOR HOLD DEVICE
- EXIT LIGHT
- EXHAUST FAN
- EMERGENCY LIGHT
- RESCUE ASSISTANCE INTERCOM
- RESCUE ASSISTANCE DIRECTIONAL SIGN
- RESCUE ASSISTANCE
- BOULDER WALL
- DRINKING FOUNTAINS
- SIGN LOCATION
- REVISION / ADDENDUM DESIGNATION
- FLOOR ELEVATION

NOTE:
ALL DIMENSIONS ARE STUD TO STUD UNLESS OTHERWISE NOTED.

REVISIONS
NO. DATE
1 1/1/24
Plan Update

SHEET NAME:
TITLE SHEET

ADDRESS:
2917 DAIRY DR.
MADISON, WI

PROJECT:
14,400 SF POST-FRAME BUILDING
SIMPLY HOMES PROPERTIES

ROUSSEV
ENGINEERING
SOLUTIONS, LLC
405 Windy Peak Rd
Verona, WI 53593
608-620-3036 (Office) • svet@rousseveengineering.com

PROJECT NO: 0824-28
PLOT DATE: 8/26/24
PLOT BY: SSR
PLOT SCALE: As indicated

SHEET # G1.0

SITE DEVELOPMENT DATA:
 SITE ADDRESS: 2917 DAIRY DR, CITY OF MADISON, WI
 CHARAL WISCONSIN PROPERTIES LLC
 FOURTH ADDITION TO WORLD DAIRY CENTER, LOT 39.



FILE NAME : E:\Projects\2024\0824-28 Lindsay Hagens Warehouse\CAD\C1.0.dwg

 ROUSSEV ENGINEERING SOLUTIONS, LLC 406 Windy Peak Rd Verona, WI 53593 • 608-620-3036 (Office) • svet@rouseveengineering.com	PROJECT:	NEW 14,400 SF BUILDING SIMPLY HOMES PROPERTIES	ADDRESS:	2917 DAIRY DR, MADISON, WI	SHEET NAME:	EXISTING PLAN	REVISIONS	NO.	DATE
	PROJECT NO:	0824-28	PLOT DATE:	9/22/24	PLOT BY:	SSR	PLOT SCALE:		
SHEET #						C1.0			

SITE DEVELOPMENT DATA:

SITE DEVELOPMENT DATA:

SITE ADDRESS: 2917 DAIRY DR, CITY OF MADISON, WI
 CHARAL WISCONSIN PROPERTIES LLC
 FOURTH ADDITION TO WORLD DAIRY CENTER, LOT 39.

PROPOSED BUILDING = 14,540SF
 CONCRETE SIDEWALK = 1,075 SF
 ASPHALT PAVEMENT = 27,685 SF
TOTAL PRO IMPERVIOUS = 43,300 SF

IMPERVIOUS/PERVIOUS = 43,300 SF/ 65,340 SF = 0.66

PROVIDED PARKING = 8 SPACES INCLUDING
 SURFACE PARKING = 4 SPACES
 BUILDING PARKING = 4 SPACES

TOTAL PARKING = 12 STALLS,
 INCLUDING 2 ADA

SHEET KEYNOTES

1. ALL EXISTING UNDERGROUND UTILITY LOCATIONS ARE APPROXIMATE AND SHOULD BE FIELD VERIFIED PRIOR TO CONSTRUCTION.

PLAN KEY

- 1 PROPOSED NEW BUILDING
- 2 7' WIDE CONCRETE SIDEWALK
- 3 ACCESSIBLE STALL 8' WIDE
- 4 SEMI TRAILER LOADING DOCK
- 5 PROPERTY LINES
- 6 PUBLIC SETBACK LINES
- 7 SAWTOOTH LOADING DOCK
- 8 DUMPSTER LOCATION
- 9 18" CURB & GUTTER
- 10 DRIVEWAY TRENCH DRAIN

PAVEMENT KEY

- ASPHALT PAVEMENT
- CONCRETE PAVEMENT



FILE NAME : E:\Projects\2024\0824-28 Lindsay Hagens Warehouse\CAD\C2.0.dwg

REVISIONS	NO.	DATE
CIP SUBMITAL	1	9/23/24

SHEET NAME:
 PROPOSED SITE PLAN

ADDRESS:
 2917 DAIRY DR,

PROJECT:
 NEW 14,400 SF BUILDING
 SIMPLY HOMES PROPERTIES


RES
 ROUSSEV
 ENGINEERING
 SOLUTIONS, LLC
 406 Windy Peak Rd
 Verona, WI 53593
 608-620-3036 (Office) • sret@rouseveengineering.com

PROJECT NO: 0824-28
 PLOT DATE: 9/22/24
 PLOT BY: SSR
 PLOT SCALE: #

SHEET # C2.0

UTILITY NOTES:

- CONTRACTOR SHALL CALL DIGGERS HOTLINE PRIOR TO ANY CONSTRUCTION.
- ALL EXISTING UTILITIES SHOWN ON THE PLAN ARE APPROXIMATE AND SHALL BE FIELD VERIFIED PRIOR CONSTRUCTION
- ALL SITE UTILITY WORK SHALL BE DONE IN ACCORDANCE WITH CITY OF MADISON STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION, LATEST ADDITION.
- PRIOR TO CONSTRUCTION, CONTRACTOR SHALL OBTAIN A STREET OPENING PERMIT FOR ANY WORK TO BE DONE WITHIN THE RIGHT-OF-WAY.
- CONTRACTOR SHALL OBTAIN ALL NECESSARY PLUGGING/CONNECTION PERMITS FROM THE CITY PRIOR TO ANY UTILITY WORK. CONTRACTOR TO NOTIFY THE DEPARTMENT OF PUBLIC WORKS A MINIMUM OF 48 HOURS BEFORE CONNECTING TO PUBLIC UTILITIES.
- RESTORATION OF PAVEMENT, CURB & GUTTER, AND SIDEWALK WITHIN THE STREET RIGHT OF WAY IS CONSIDERED INCIDENTAL AND SHALL BE INCLUDED IN THE COST OF THE UNDERGROUND IMPROVEMENTS.
- CONTRACTOR SHALL CONFIRM CONNECTION ELEVATION GRADES OF ALL PIPES PRIOR TO BEGINNING CONSTRUCTION.
- CONTRACTOR SHALL SUBMIT SHOP DRAWINGS TO THE CITY UTILITIES DIRECTOR FOR THE PROPOSED WATER IMPROVEMENTS WITHIN THE RIGHT-OF-WAY PRIOR TO CONSTRUCTION.
- NEW WATER MAIN PIPE AND FITTINGS SHALL BE CLASS 52 D.I. (8-INCH Ø).
- WATER FITTINGS AND VALVES SHALL BE AS FOLLOWS:
 - VALVES SHALL BE RESILIENT-SEATED GATE VALVES, MECHANICAL JOINT CONFORMING TO ANSI/AWWA C509 OR ANSI/AWWA C515. VALVES SHALL HAVE NON-RISING STEM, WITH 2 INCH OPERATING NUT OPENING COUNTER-CLOCKWISE. THE VALVE WEDGE SHALL BE DUCTILE IRON FULLY ENCAPSULATED WITH EPDM RUBBER, SHALL BE SYMMETRICAL AND SEAL EQUALLY WELL WITH FLOW IN EITHER DIRECTION. VALVE BOXES SHALL BE CAST IRON AND SHALL INCLUDE A GATE VALVE ADAPTOR MANUFACTURED BY ADAPTOR INC.
 - HYDRANTS AFC WATEROUS PACER BREAKAWAY MODEL WB-67 OR APPROVED EQUAL. HYDRANT MARKERS RODON HYDRAFINDER. RODONCORP.COM OR SIMILAR.
 - AMERICAN NATIONAL STANDARD FOR DUCTILE IRON AND GRAY IRON FITTINGS, 3-INCH THROUGH 48-INCH FOR WATER (ANSI/AWWA C110/A21.10 - LATEST REVISION) OR AMERICAN NATIONAL STANDARD FOR DUCTILE IRON COMPACT FITTINGS, 3-INCH THROUGH 64-INCH FOR WATER (ANSI/AWWA C153/A21.53-11 - LATEST REVISION).
 - MECHANICAL JOINT FITTING REQUIREMENTS: CLASS 250 MECHANICAL JOINT PIPE FITTINGS. CEMENT LINED. ALL BELLS. ENTIRE FITTING TARRD. ESTABLISH CONDUCTIVITY ACROSS FITTINGS IN ACCORDANCE WITH SECTION 702.3.1. FURNISHED WITH ALL NECESSARY ACCESSORIES (RUBBER GASKETS, FLANGES, BOLTS, ETC.).
 - MECHANICAL JOINT RESTRAINTS: EBAA IRON INC. - MEGALUG® SERIES 1100. STAR PIPE PRODUCTS - STARGRIP® SERIES 3000. WATER SERVICE SHALL BE TYPE "K" COPPER, 2" Ø CONFORMING TO ASTM B-88 FROM CORPORATION STOP TO CURB STOP. 4-INCH DIAMETER AND LARGER LATERALS: CLASS 52 DUCTILE IRON IN ACCORDANCE WITH SECTION 702.3.1 - DUCTILE IRON PIPE.
 - CORPORATION STOPS: MUELLER B-25000N, AWWA INLET, COPPER FLARE OUTLET BALL CORPORATION VALVE OR A.Y. MCDONALD 74701BL-X (X DENOTES SIZE), BALL STYLE FLARE CORP, LESS NUT OR FORD FB1000-X-C16198-Y-NL, BALLCORP AWWA TO CTS QUICK JOINT 45-DEG ANGLE, -ANWT-
 - CURB STOPS: ¾-INCH TO 2-INCH DIAMETER, QUARTER-TURN, BALL VALVE CURB STOPS A.Y. MCDONALD 76100 (SIZE), Q CTS FLARED, A.Y. MCDONALD 76100Q (SIZE), Q CTS COMPRESSION MÜLLER H15209N 2-INCH, COMPRESSION JOINTS, BOTH SIDES COPPER.
 - CURB STOP BOXES: MULLER H10386 FOR 2-INCH, ARCH PATTERN, 7 TO 8 FOOT EXTENSION, SLIP TYPE EXTENSION, UPPER SECTION BEING 1 ¼ INCHES IN DIAMETER, PROVIDED W/ 5-FOOT ROUND STATIONARY RODS AND GUIDE RINGS, BRASS PENTAGON HEAD PLUG-TYPE LIDS.
- ANY PERSON WHO INSTALLS A NONCONDUCTIVE WATER OR SEWER LATERALS MUST ALSO INSTALL A LOCATION WIRE OR OTHER EQUALLY EFFECTIVE MEANS FOR MARKING THE LOCATION OF THE LATERAL. METHOD SHALL BE APPROVED BY THE CITY.
- CONTRACTOR TO COORDINATE NEW, RELOCATED AND/OR ABANDONED GAS, ELECTRIC, TELEPHONE, AND CABLE WITH APPROPRIATE UTILITY COMPANIES.
- ALL WATER MAIN PIPE AND FITTINGS SHALL BE INSTALLED TO A MIN. DEPTH OF COVER OF 6.0'. AFTER RE-GRADING, EXISTING WATER MAIN PIPE WHICH DOES NOT MEET THIS REQUIREMENT SHALL BE INSULATED.
- SANITARY SEWER SERVICES SHALL BE 6" Ø SDR-35.
- BUILDING PLUMBER SHALL VERIFY SIZE, SLOPE, AND EXACT LOCATION OF PROPOSED SANITARY LATERALS AND WATER SERVICES PRIOR TO INSTALLATION.

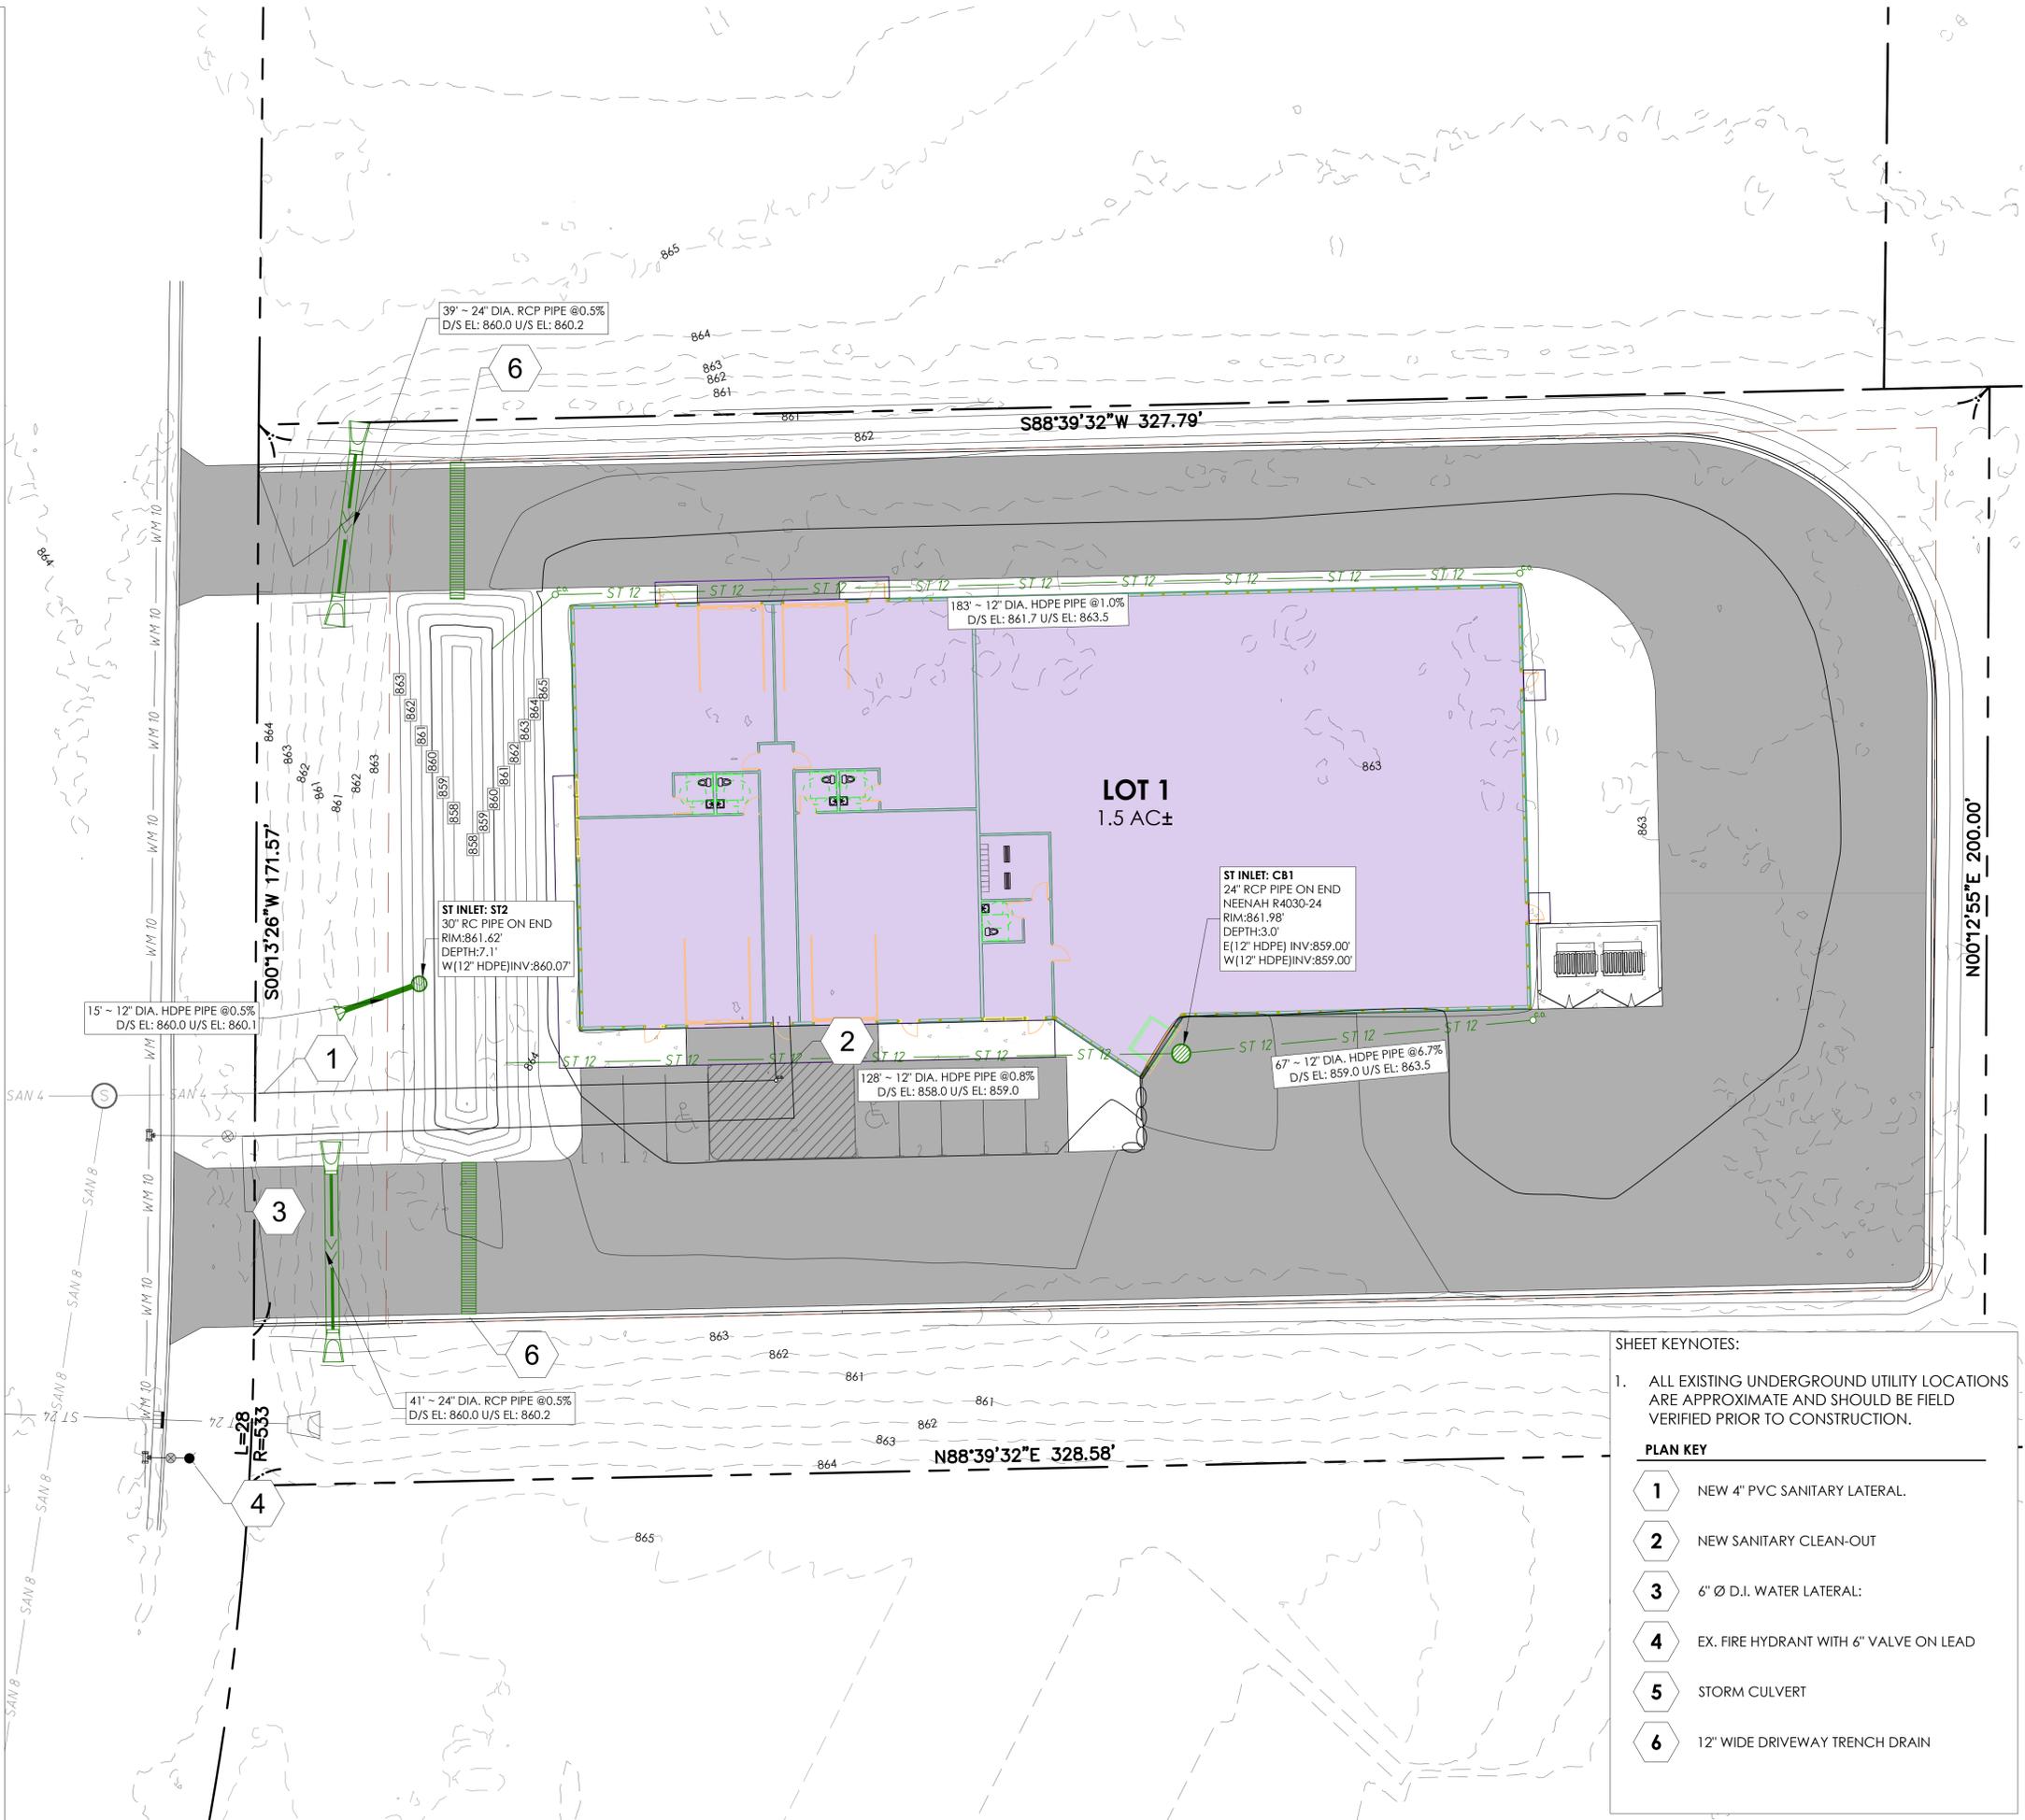

SHEET KEYNOTES:

- ALL EXISTING UNDERGROUND UTILITY LOCATIONS ARE APPROXIMATE AND SHOULD BE FIELD VERIFIED PRIOR TO CONSTRUCTION.

PLAN KEY

- 1 NEW 4" PVC SANITARY LATERAL.
- 2 NEW SANITARY CLEAN-OUT
- 3 6" Ø D.I. WATER LATERAL:
- 4 EX. FIRE HYDRANT WITH 6" VALVE ON LEAD
- 5 STORM CULVERT
- 6 12" WIDE DRIVEWAY TRENCH DRAIN

FILE NAME: E:\Projects\2024\0824-28 Lindsay Hagens Warehouse\CAD\C3.0.dwg

REVISIONS	NO.	DATE
CIP SUBMITAL	1	9/23/24

SHEET NAME:
UTILITY PLAN

ADDRESS:
2917 DAIRY DR.

PROJECT:
NEW 14,400 SF BUILDING
SIMPLY HOMES PROPERTIES

RES
ROUSSEV
ENGINEERING
SOLUTIONS, LLC
406 Windy Peak Rd
Verona, WI 53593
608-620-3036 (Office) • sret@rouseveengineering.com


PROJECT NO: 0824-28
PLOT DATE: 9/22/24
PLOT BY: SSR
PLOT SCALE:

SHEET # C3.0

- GRADING NOTES:**
1. CONTRACTOR IS RESPONSIBLE FOR VERIFYING ALL UTILITIES PRIOR TO BEGINNING GRADING OPERATIONS. NOTIFY DIGGERS HOTLINE 5 WORKING DAYS PRIOR TO START OF CONSTRUCTION.
 2. ALL MATCHING SIDEWALK ELEVATIONS SHALL BE VERIFIED IN THE FIELD TO ALLOW FOR PROPER DRAINAGE.
 3. CONTOUR AND SPOT ELEVATIONS SHOWN REPRESENT FINISH GRADE ELEVATIONS.
 4. ALL LAWN AND PLANTING AREAS WHICH HAVE BEEN COMPACTED DUE TO CONSTRUCTION SHALL BE LOOSENEED PRIOR TO ADDITION OF TOPSOIL.
 5. SIDEWALKS AND RAMPS SHALL HAVE A MAXIMUM CROSS SLOPE OF 2% (1:50).
 6. SIDEWALK LANDINGS SHALL HAVE A 2.0% (1:50) MAXIMUM CROSS SLOPE OR SLOPE IN ALL DIRECTIONS, INCLUDING DIAGONAL.
 8. ALL SIDEWALK SHALL HAVE A MAXIMUM RUNNING SLOPE OF 8%.

- GRADING LEGEND**
- EXISTING CONTOURS
 - PROPOSED MAJOR CONTOURS (5' INTERVAL)
 - - - PROPOSED MINOR CONTOURS (1' INTERVAL)
 - - - SAWCUT LINE
 - 866.00' P PAVEMENT ELEVATION
 - 866.00' FFE FINISHED FLOOR ELEVATION
 - 866.00' C CONCRETE PAVEMENT ELEVATION
 - ↘ DRAINAGE ARROWS

DIGGERS HOTLINE
 Dial 811 or (800)242-8511
 www.DiggersHotline.com



REVISIONS	NO.	DATE
CUP SUBMITTAL	1	9/23/24

SHEET NAME:
GRADING PLAN

ADDRESS:
2917 DAIRY DR.

PROJECT:
NEW 14,400 SF BUILDING
SIMPLY HOMES PROPERTIES

RES
 ROUSSEV
 ENGINEERING
 SOLUTIONS, LLC
 406 Windy Peak Rd
 Verona, WI 53593 • svet@rouseveengineering.com

PROJECT NO: 0824-28
 PLOT DATE: 9/22/24
 PLOT BY: SSR
 PLOT SCALE:

SHEET # C4.0



EROSION CONTROL NOTES:

1. THE CONTRACTOR SHALL IMPLEMENT AND MAINTAIN EROSION CONTROL DEVICES FROM THE START OF LAND DISTURBING CONSTRUCTION ACTIVITIES UNTIL FINAL STABILIZATION OF THE CONSTRUCTION SITE.
2. ALL EROSION CONTROL MEASURES SHALL BE INSTALLED IN ACCORDANCE WITH CITY EROSION CONTROL AND STORMWATER ORDINANCE AND THE APPROPRIATE WISCONSIN DNR CONSTRUCTION SITE EROSION AND SEDIMENT CONTROL TECHNICAL STANDARDS. THE CITY RESERVES THE RIGHT TO REQUIRE ADDITIONAL EROSION CONTROL MEASURES AS CONDITIONS WARRANT.
3. CLEANING RIGHT-OF-WAY SURFACES SHALL BE THOROUGHLY CLEANED BEFORE THE END OF EACH WORKING DAY WITHOUT HYDRAULIC FLUSHING.
4. RESTORATION RESTORATION SHALL BE COMPLETED AS NOTED IN THE CONSTRUCTION SCHEDULE UNLESS OTHERWISE AUTHORIZED BY THE CITY.
5. INSPECTION THE CONTRACTOR SHALL INSPECT EROSION AND SEDIMENT CONTROL PRACTICES WEEKLY, AND WITHIN 24 HOURS FOLLOWING A RAINFALL OF 0.5 INCHES OR GREATER. DOCUMENTATION OF EACH INSPECTION SHALL INCLUDE THE TIME, DATE AND LOCATION OF INSPECTION, THE PHASE OF LAND DISTURBANCE AT THE CONSTRUCTION SITE, PERSON CONDUCTING THE INSPECTION, ASSESSMENT OF CONTROL PRACTICES, AND A DESCRIPTION OF ANY EROSION OR SEDIMENT CONTROL MEASURE INSTALLATION.
6. STONE TRACKING PAD. BEFORE BEGINNING CONSTRUCTION, CONTRACTOR SHALL INSTALL A STONE TRACKING PAD AT EACH POINT WHERE VEHICLES ENTERS/EXITS THE CONSTRUCTION SITE. STONE TRACKING PADS SHOULD BE AT LEAST 24 FEET WIDE AND 50 FEET LONG, AND CONSTRUCTED OF 3-6 INCH WASHED STONE WITH A DEPTH OF AT LEAST 12 INCHES. ON SITES WITH CLAY SOILS, TONE TRACKING PADS MUST BE UNDERLAIN WITH A GEOTEXTILE LINER TO PREVENT THE STONE FROM SINKING INTO THE SOIL.
7. INLET PROTECTION. ALL INLETS SUBJECT TO DRAINAGE SHALL BE PROTECTED WITH TYPE D INLET PROTECTION OR APPROVED EQUAL. ANY DEPOSITS OF DIRT, MUD, ROCK, DEBRIS, OR OTHER MATERIAL ENTERING THE STORM SEWER SYSTEM SHALL BE PROMPTLY AND THOROUGHLY CLEANED OUT.
8. EROSION MAT. AREAS OR EMBANKMENTS HAVING SLOPES GREATER THAN OR EQUAL TO 4H:1V SHALL BE STABILIZED WITH WISCONSIN DOT CLASS 1, URBAN, TYPE B, EROSION MAT.
9. TEMPORARY EROSION CONTROL. ALL TEMPORARY EROSION AND SEDIMENT CONTROL MEASURES SHALL BE REMOVED WITHIN 30 DAYS AFTER FINAL SITE STABILIZATION IS ACHIEVED OR AFTER THE TEMPORARY MEASURES ARE NO LONGER NEEDED.
10. STABILIZATION. STABILIZE AREAS OF FINAL GRADING WITHIN 7 DAYS OF REACHING FINAL GRADE.
11. TOPSOIL. A MINIMUM OF 4 INCHES OF TOPSOIL MUST BE APPLIED TO ALL AREAS TO BE SEEDDED OR SODDED.
12. SEEDING. SEED MIXTURE SHALL BE APPLIED AT A RATE OF 2 LBS PER 1,000 SF OF AREA OR AS NOTED ON THE LANDSCAPE PLAN.
13. STOCKPILES. IMMEDIATELY STABILIZE STOCKPILES AND SURROUND STOCKPILES AS NEEDED WITH SILT FENCE OR OTHER PERIMETER CONTROL IF STOCKPILES WILL REMAIN INACTIVE FOR 7 DAYS OR LONGER.
14. EXISTING SITE HAS A REGIONAL STORM WATER FACILITY THAT PROVIDES COMPLIANCE WITH NR 151 REQUIREMENTS.

EROSION CONTROL KEY

-  TRACKING PAD
-  SF SILT FENCE, TYP.
-  IP INLET PROTECTION, TYP.
-  CLASS II RIP-RAP @ STORM SEWER OUTLET, TYP.
-  EROSION MAT
-  TEMPORARY DITCH CHECK, TYP.

DIGGERS HOTLINE
 Dial 811 or (800)242-8511
 www.DiggersHotline.com

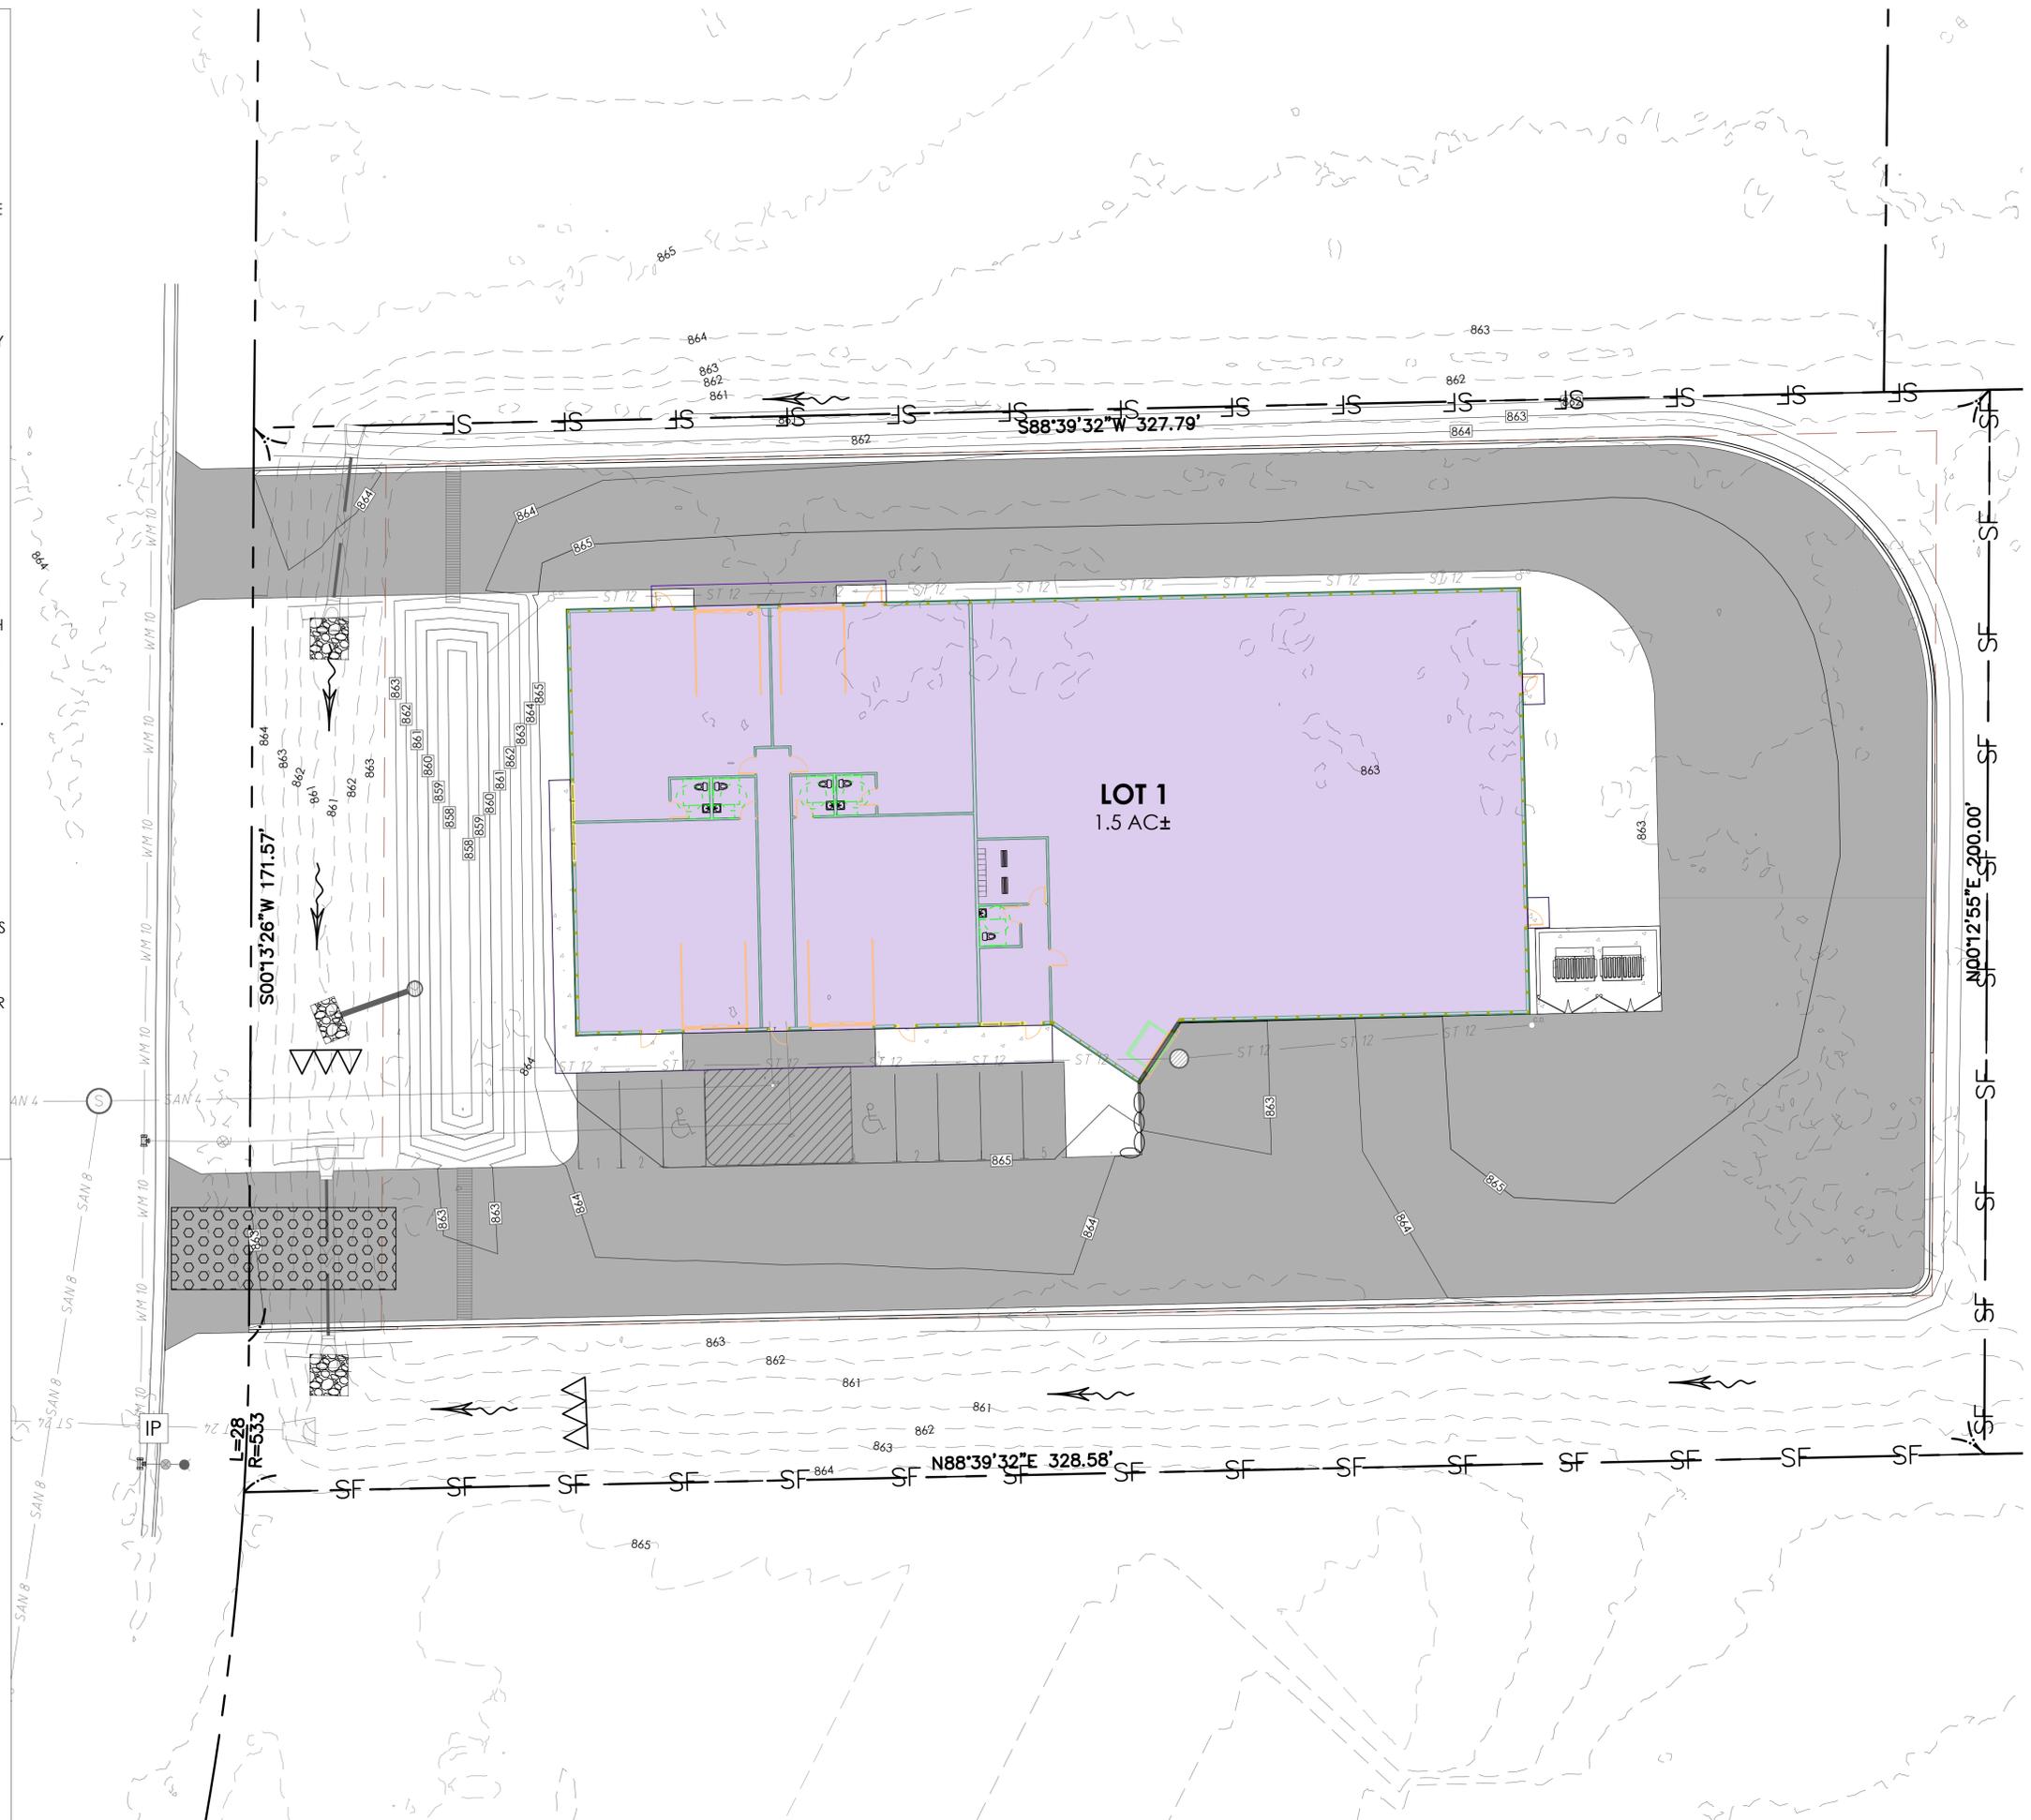

REVISIONS	NO.	DATE
CUP SUBMITAL	1	9/23/24

SHEET NAME:
EROSION CONTROL PLAN

ADDRESS:
 2917 DAIRY DR.

PROJECT:
 NEW 14,400 SF BUILDING
 SIMPLY HOMES PROPERTIES

ROUSSEV
 ENGINEERING
 SOLUTIONS, LLC
 406 Windy Peak Rd
 Verona, WI 53593 • svet@rouseveengineering.com

PROJECT NO: 0824-28
 PLOT DATE: 9/22/24
 PLOT BY: SSR
 PLOT SCALE:

SHEET # **C5.0**

LANDSCAPE KEY

 LAWN AREAS

 BARK/MULCH LANDSCAPE AREAS

PLANT LIST

KEY	QUAN	SIZE	COMMON NAME	Botanical Name	ROOT
(7) Canopy Trees					
CH	1	2 1/2"	Common Hackberry	Celtis Occidentalis	BB
EP	2	2 1/2"	Exclamation Planetree	Platanus Acerifolia	BB
KCT	1	2 1/2"	Kentucky Coffeetree	Gymnocladus Dioicus	BB
SWO	2	2 1/2"	Swamp White Oak	Quercus Bicolor	BB
T	1	2 1/2"	Tamarack	Larix Laricina	BB
(1) Ornamental Trees					
RBC	1	10'	River Birch Clump	Betula Nigra	BB
(9) Evergreen Shrubs					
EA	4	5'	Emerald Arborvitae	Thuja Occidentalis	BB
WBJ	5	5'	Wichita Blue Juniper	Juniperus Scopulorum	BB
(48) Deciduous Shrubs					
BC	12	24"	Black Chokeberry	Aronia Melanocarpa	Pot
DBH	15	24"	Dwarf Bush Honeysuckle	Diervilla Lonicera	Pot
GDP	4	18"	Gold Drop Potentilla	Potentilla Fruticosa	Pot
LDN	3	18"	Little Devil Ninebark	Physocarpus Opulifolius	Pot
MKL	2	36"	Miss Kim Lilac	Syringa Pubescence 'Miss Kim'	Pot
RTD	9	24"	Red Twig dogwood	Cornus Sericea	Pot
YTD	3	24"	Yellow Twig dogwood	Cornus Lutea	Pot
(44) Perennials					
LBS	24	1 G	Little Bluestem Grass	Schizachyrium Scoparium	Con
LH	20	1 G	Loyalist Hosta	Hosta 'Loyalist'	Con

NOTES:

- Disturbed lawn areas to receive a minimum of 4" of topsoil, premium bluegrass seed mix, starter fertilizer, and straw mulch.
- Proposed bio-retention area to receive a minimum of a minimum of 4:of topsoil, short grass turf seed mix with cover crop (supplied by Agrecol, or equal) and installed per manufacturer's recommendations.
- Disturbed lawn areas in public and utility easements to be repaired with a minimum of 4: of topsoil, turf seed to match existing turf, starter fertilize and straw mulch.
- Lawn and turf areas in swales and on slopes more than 3:1 shall be mulched with straw mat.
- Designated planting beds to be mulched with shredded hardwood bark mulch spread to a depth of 3".
- Individual trees and shrub groupings in lawn areas to receive shredded hardwood bark mulch plant rings (4' diameter) spread to a depth of 3".
- Designated planting beds to be separated from lawn and turf areas with 5" shovel cut edge.

LANDSCAPE WORKSHEET
2917 Dairy Drive, Madison, WI

Landscaping Points Required

Developed Area = 28,760 SF
Landscape Points: 28,760 SF/300 x 5 = **479 points**

Total Landscape Points Required 479 points

Landscaping Points Supplied

Existing canopy trees - 0 @ 35 =	0 points
Proposed canopy trees - 7 @ 35 =	245 points
Existing evergreen trees - 0 @ 35 =	0 points
Proposed evergreen trees - 0 @ 35 =	0 points
Existing ornamental trees - 0 @ 15 =	0 points
Proposed ornamental trees - 1 @ 15 =	15 points
Existing upright evergreen shrubs - 0 @ 10 =	0 points
Proposed upright evergreen shrubs - 9 @ 10 =	90 points
Existing deciduous shrubs - 0 @ 3 =	0 points
Proposed deciduous shrubs - 48 @ 3 =	144 points
Existing evergreen shrubs - 0 @ 4 =	0 points
Proposed evergreen shrubs - 0 @ 4 =	0 points
Existing perennials & grasses 0 @ 2 =	0 points
Proposed perennials & grasses 44 @ 2 =	88 points

Total landscape points supplied = 582 points

Lot Frontage Landscaping Required
(Section 28.142(5) Development Frontage Landscaping)

"One (1) over-story deciduous tree and five (5) shrubs shall be planted for each thirty (30) lineal feet of lot frontage. Two (2) ornamental trees or two (2) evergreen trees may be used in place of one (1) over-story deciduous tree."


Dairy Drive = 200 LF

Over story trees required 200/30' = 6.6	7 trees
Shrubs required (200/30') x 5 = 33.3	34 shrubs


Over story trees supplied	6 trees
Ornamental/Evergreen trees supplied	2 trees
Shrubs supplied	35 shrubs



NEENAH CASTING	INLET TYPE	GRATE SIZE	OPENING SIZE	ADS P/N
1040/1642/1733	ROUND	26	24	62MRDFX
3067 W/FLAP	CURB BOX	35.25X11.75	33.0X15.0	62LCBEXTFX
3067 EXTENDED BACK	CURB BOX	35.25X17.75	33.0X15.0	62LCBEXTFX
3246A	CURB BOX	35.75X23.875	33.5X21.0	62LCBFX
3030	SQUARE/RECT	23X16	20.5X13.5	62MCBFX
3067-C	SQUARE/RECT	35.25X17.75	33X15	62LSQFX

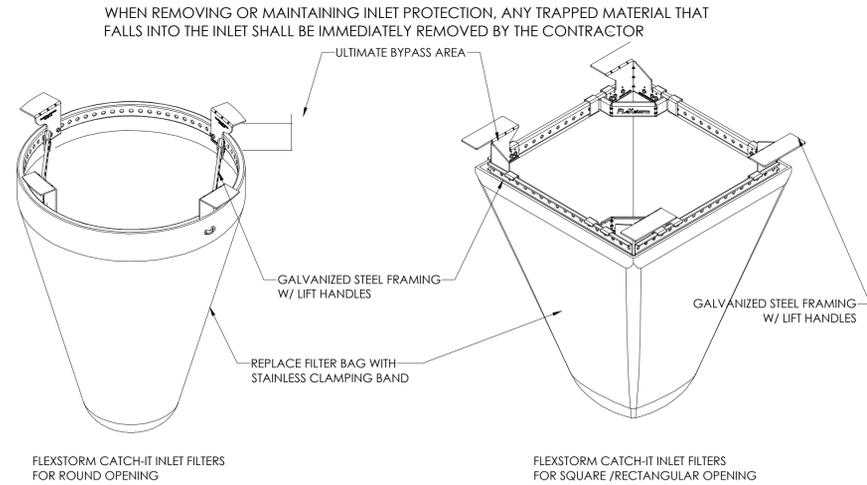

6-INLET PROTECTION

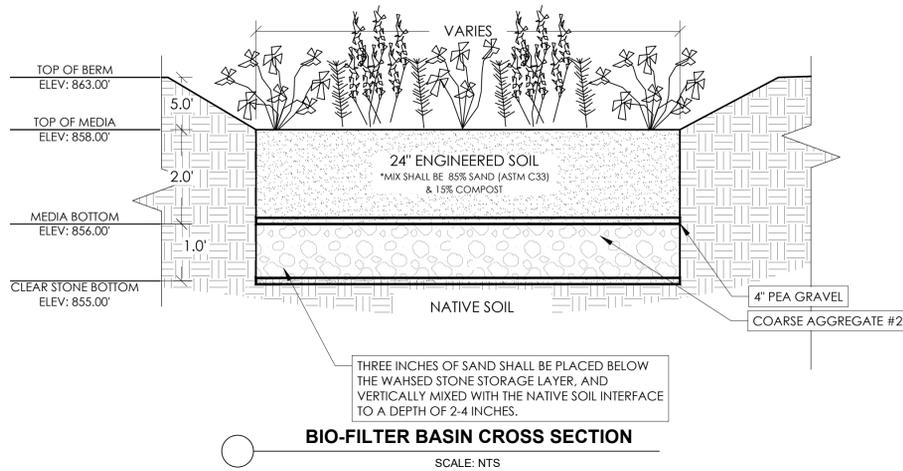

BIO-FILTER BASIN CROSS SECTION


SCALE: NTS

BIORETENTION BASIN NOTES:

1. RUNOFF SHALL NOT BE ALLOWED IN THE BASIN UNTIL AFTER THE TRIBUTARY AREA IS STABILIZED.
2. CONSTRUCTION OF THE BASIN SHOULD ONLY OCCUR DURING SUITABLE SITE CONDITIONS - IF CONSTRUCTION OF THE BASIN OCCURS DURING SATURATED SOIL CONDITIONS, THE SOIL IN THE DEVICE COULD BE UNNECESSARILY COMPACTED.
3. MATERIALS USED FOR THE ENGINEERED SOIL SHALL COMPLY WITH WISCONSIN DNR TECHNICAL STANDARD 1004.
4. PLACED SAND SHALL MEET ONE OF THE FOLLOWING REQUIREMENTS: USDA COARSE SAND (.02-.04 INCHES), ASTM C33 FINE AGGREGATE CONCRETE SAND, WISCONSIN STANDARDS AND SPECS FOR HIGHWAY AND STRUCTURE CONSTRUCTION, SECTION 501.2.5 FINE AGGREGATE CONCRETE SAND, SAND SHALL BE WASHED AND DRAINED TO REMOVE CLAY AND SILT PARTICLES PRIOR MIXING. STONE STORAGE SHALL MEET COARSE AGGREGATE #2, WISCONSIN STANDARDS AND SPECS FOR HIGHWAY AND STRUCTURE CONSTRUCTION, SECTION 501.2.5, 2003.
5. COMPACTION OF THE SOILS USED FOR THE BIORETENTION DEVICE MUST BE AVOIDED - HEAVY EQUIPMENT SHOULD NOT BE USED IN THE CONSTRUCTION OF THE BASIN.
6. LIVE PLANT PLUGS GROWN TO AT LEAST 1.25" x 2.25" IN POTS SHALL BE PLANTED AT 1' ON CENTER THROUGHOUT THE PLANTING AREA.
7. USE RAINWATER RENEWAL (#RNR) BY AGRECOL NATIVE SEED MIX FOR BOTTOM OF BIO-RETENTION BASIN IN ADDITION TO PLUG PLANTINGS. SEED AT 8 PLS LBS/ACRE OR 94 SEEDS PER SF.
8. PLANTS SHALL BE NATIVE PLANTS AS SPECIFIED BY AGRECOL OR OTHER APPROVED NURSERY.
9. INSTALL CLASS II TYPE A BIO-DEGRADABLE EROSION MAT IN BASIN BOTTOM, TYP.

5-BIO-FILTER BASIN

- NOTES:
1. TRENCH SHALL BE A MINIMUM OF 4" WIDE BY 6" DEEP TO BURY AND ANCHOR THE GEOTEXTILE FABRIC, FOLD MATERIAL TO FIT TRENCH AND BACKFILL AND COMPACT TRENCH WITH EXCAVATED SOIL.
 2. HORIZONTAL BRACE WITH 2" X 4" WOODEN FRAME OR EQUIVALENT AT TOP OF POST AS DIRECTED BY THE ENGINEER.
 3. WOOD POST SHALL BE A MINIMUM SIZE OF 1 1/8" X 1 1/8" OF OAK OR HICKORY.

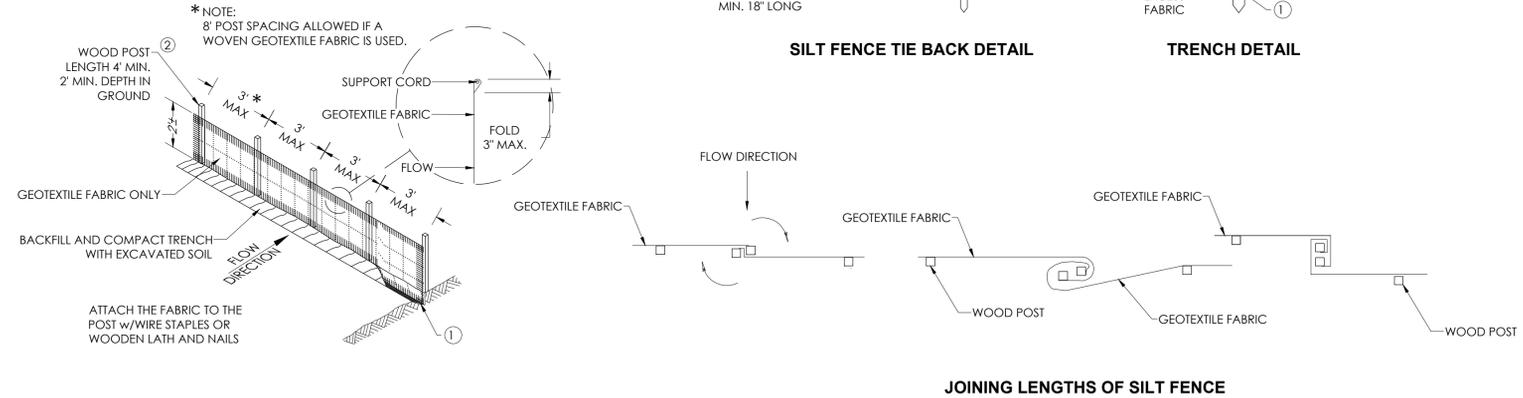


SILT FENCE TIE BACK DETAIL

TRENCH DETAIL

JOINING LENGTHS OF SILT FENCE

1-SILT FENCE

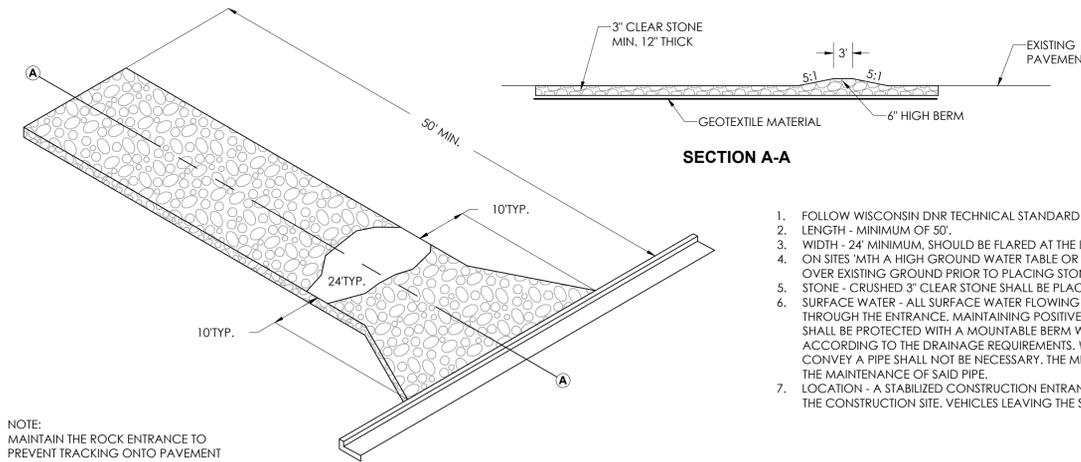


SECTION A-A


1. FOLLOW WISCONSIN DNR TECHNICAL STANDARD 1057 FOR FURTHER DETAILS AND INSTALLATION.
2. LENGTH - MINIMUM OF 50'.
3. WIDTH - 24' MINIMUM, SHOULD BE FLARED AT THE EXISTING ROAD TO PROVIDE A TURNING RADIUS.
4. ON SITES WITH A HIGH GROUND WATER TABLE OR WHERE SATURATED CONDITIONS EXIST, GEOTEXTILE FABRIC SHALL BE PLACED OVER EXISTING GROUND PRIOR TO PLACING STONE. FABRIC SHALL BE WISDOT TYPE-HR GEOTEXTILE FABRIC.
5. STONE - CRUSHED 3" CLEAR STONE SHALL BE PLACED AT LEAST 12" DEEP OVER THE ENTIRE LENGTH AND WIDTH OF ENTRANCE.
6. SURFACE WATER - ALL SURFACE WATER FLOWING TO OR DIVERTED TOWARDS CONSTRUCTION ENTRANCES SHALL BE PIPED THROUGH THE ENTRANCE, MAINTAINING POSITIVE DRAINAGE. PIPE INSTALLED THROUGH THE STABILIZED CONSTRUCTION ENTRANCE SHALL BE PROTECTED WITH A MOUNTABLE BERM WITH 5:1 SLOPES AND MINIMUM OF 6" STONE OVER THE PIPE. PIPE SHALL BE SIZED ACCORDING TO THE DRAINAGE REQUIREMENTS. WHEN THE ENTRANCE IS LOCATED AT A HIGH SPOT AND HAS NO DRAINAGE TO CONVEY A PIPE SHALL NOT BE NECESSARY. THE MINIMUM PIPE DIAMETER SHALL BE 6". CONTRACTOR SHALL BE RESPONSIBLE FOR THE MAINTENANCE OF SAID PIPE.
7. LOCATION - A STABILIZED CONSTRUCTION ENTRANCE SHALL BE LOCATED WHERE CONSTRUCTION TRAFFIC ENTERS AND/OR LEAVES THE CONSTRUCTION SITE. VEHICLES LEAVING THE SITE MUST TRAVEL OVER THE ENTIRE LENGTH OF THE TRACKING PAD.

NOTE: MAINTAIN THE ROCK ENTRANCE TO PREVENT TRACKING ONTO PAVEMENT

2-TRACKING PAD

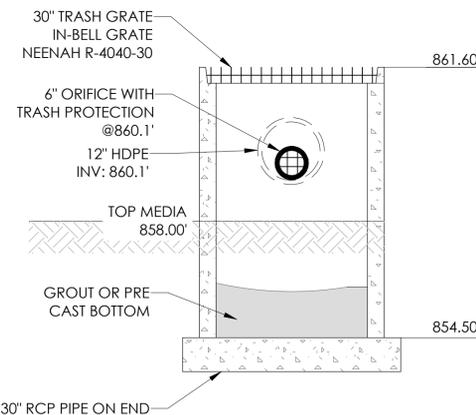

4-BIO-FILTER OUTLET

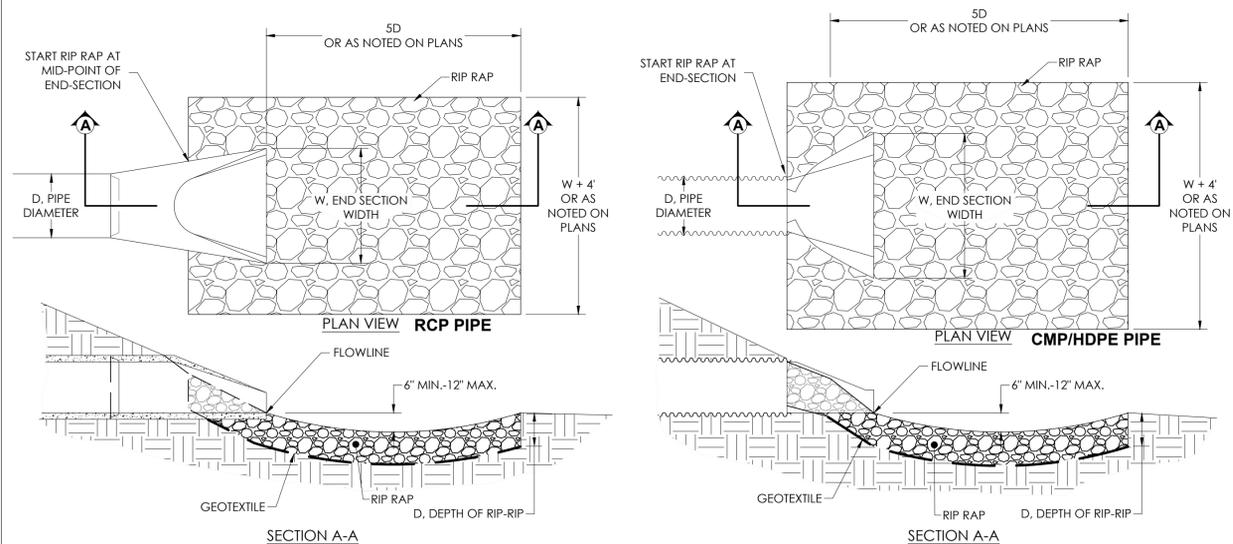


SECTION A-A


SECTION A-A

3-RIP RAP AT PIPE DISCHARGE


FILE NAME: E:\Projects\2024\0824-28 Lindsay Hagens Warehouse\CAD\C-DT.dwg

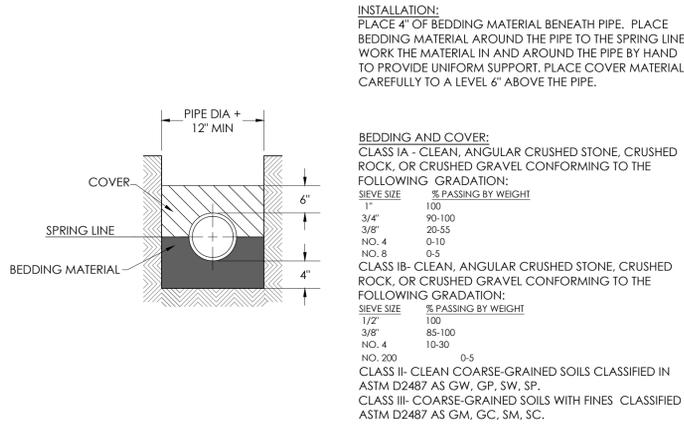

STANDARD WATER MAIN TRENCH

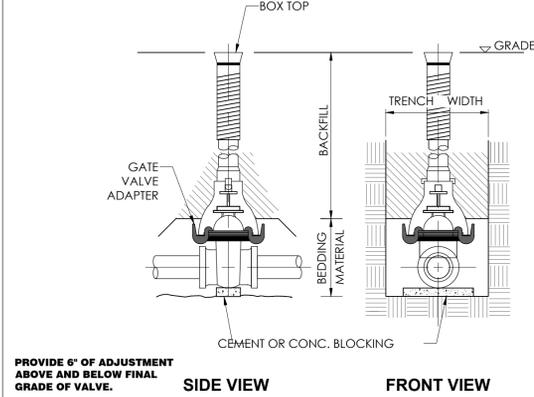


STANDARD GATE VALVE BOX SETTING

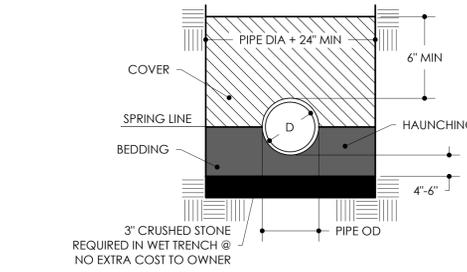


INSTALLATION:
PLACE AND COMPACT BEDDING MATERIAL AND COVER IN MAXIMUM 6" LAYERS. WORK MATERIAL IN AND AROUND PIPE BY HAND TO PROVIDE UNIFORM SUPPORT. COMPACT CLASS IB WITH HAND TAMPER OR VIBRATORY COMPACTOR TO 85% STANDARD PROCTOR.

FLEXIBLE (PVC) PIPE

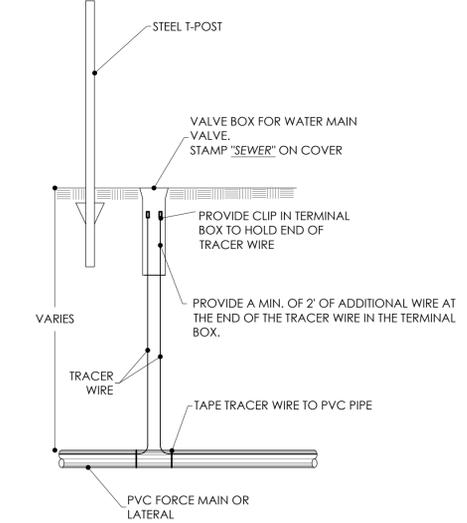


TRACER WIRE TERMINAL BOX


WYE SERVICE CONNECTION TO SEWER

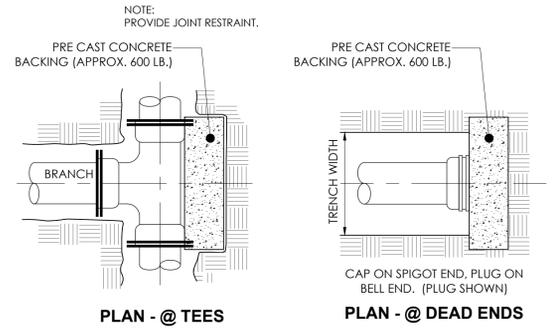


CONCRETE BACKING

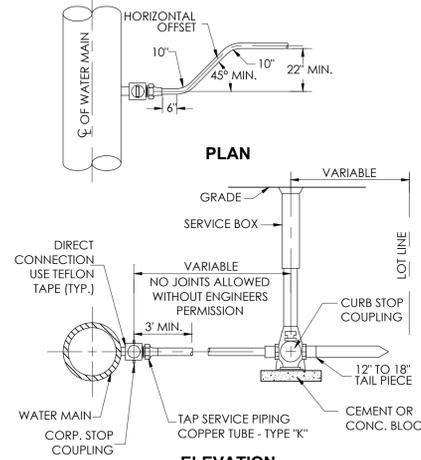

TAP SERVICE PIPING (COPPER)

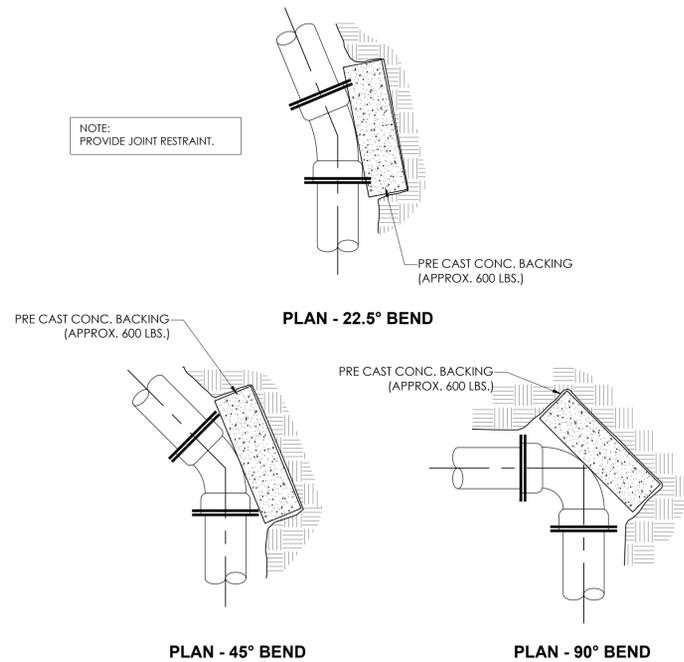

CONCRETE BACKING FOR BENDS

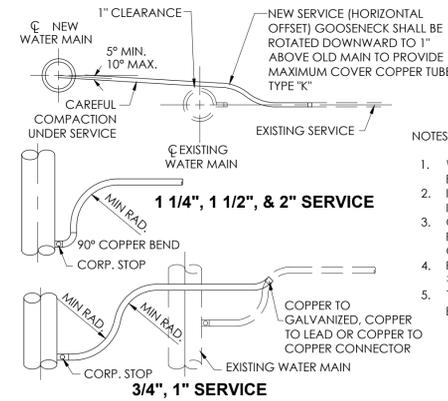


TAP SERVICE PIPING


TYPICAL PIPE BEDDING

- NOTES:**
- USE OF RISERS GOVERNED BY BASEMENT DEPTH & LOCAL CONDITIONS OR AS DIRECTED BY ENGINEER
 - LATERAL SHALL END AT PROPERTY LINE UNLESS OTHERWISE DIRECTED BY ENGINEER


- DEPTH TO LATERAL & PROPERTY LINE SHALL NOT BE DEEPER THAN NECESSARY TO SERVICE PARCEL
- ALL LATERALS TO BE 4" UNLESS OTHERWISE NOTED ON PLANS OR IN SPECIFICATIONS
- ALL HOUSE LATERAL CONNECTIONS SHALL BE CONSTRUCTED AS PER THIS DETAIL UNLESS OTHERWISE SHOWN ON PLANS, OR WITH WRITTEN APPROVAL OF THE ENGINEER

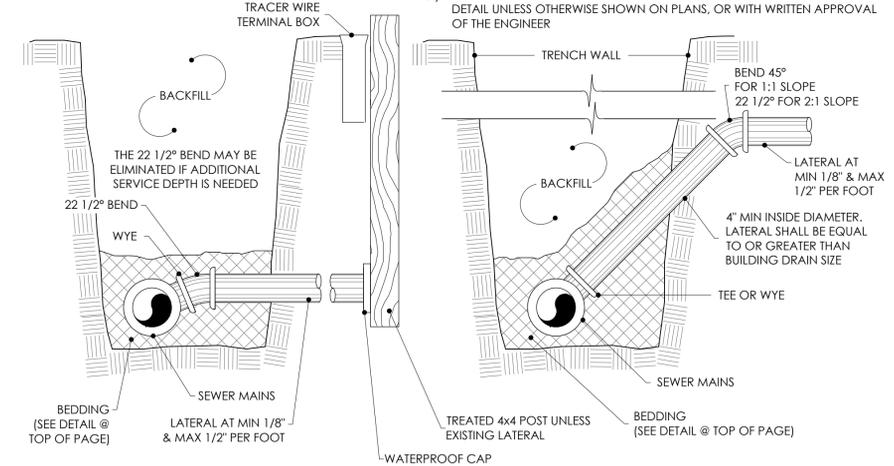


FILE NAME: E:\Projects\2024\0824-28 Lindsay Hagens Warehouse\CAD\C-DT.dwg

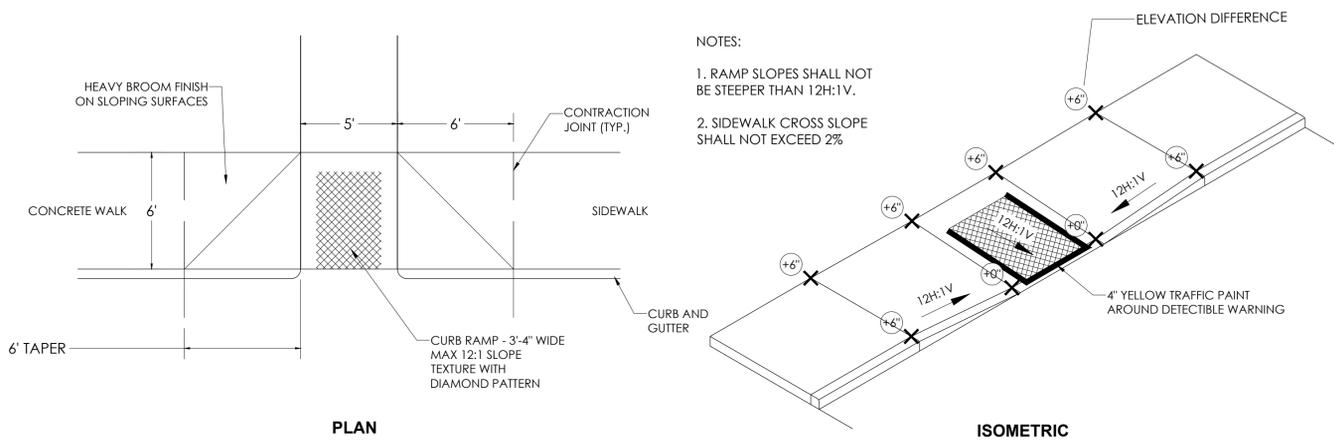






HANDICAP ACCESSIBLE CURB RAMP TYPE C

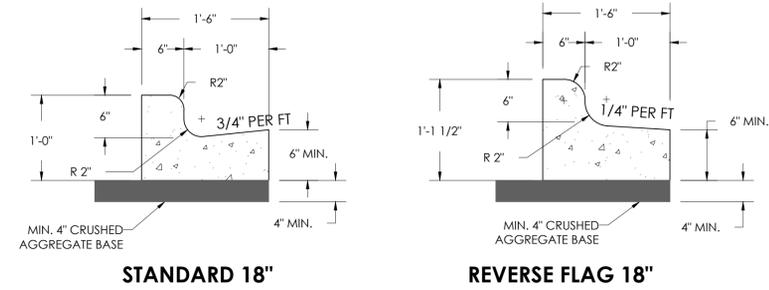

TYPICAL CURB SECTIONS

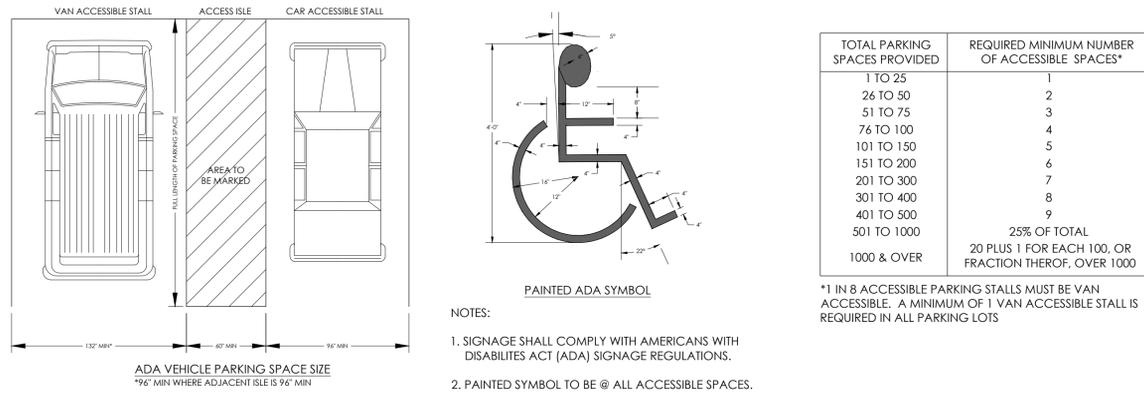

TYPICAL HANDICAP ACCESSIBLE PARKING AREA

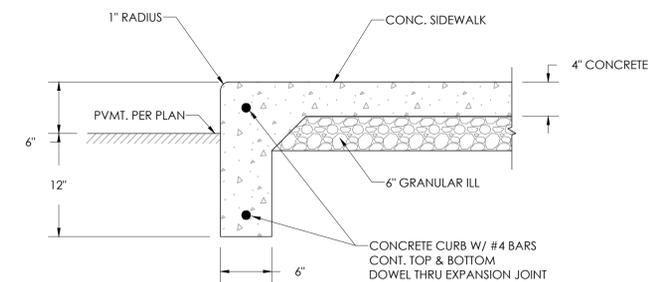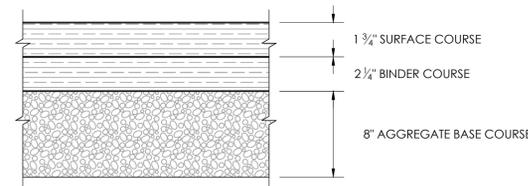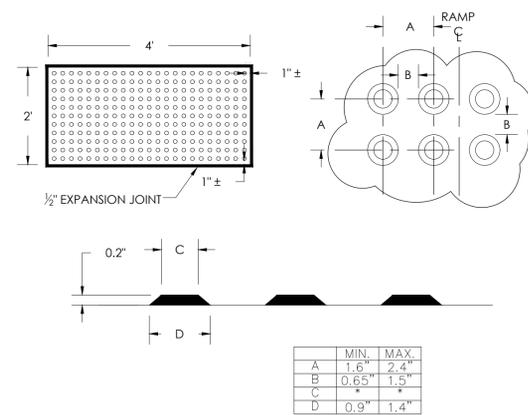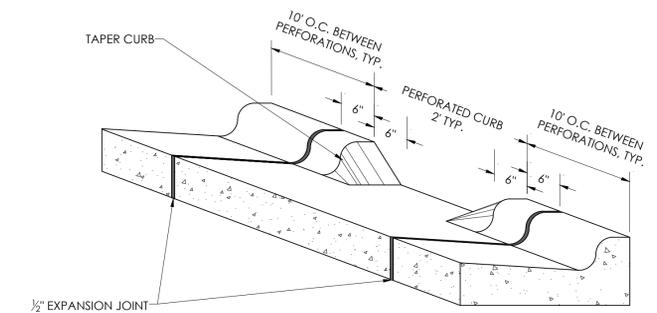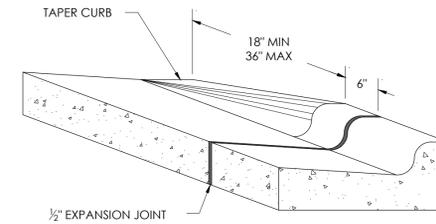

REVISIONS NO. DATE
 CUP SUBMITTAL 1 9/23/24

SHEET NAME: CONSTRUCTION DETAILS

ADDRESS: 2917 DAIRY DR.

PROJECT: NEW 14,400 SF BUILDING
 SIMPLY HOMES PROPERTIES

ROUSSEV ENGINEERING SOLUTIONS, LLC
 406 Windy Peak Rd
 Verona, WI 53593
 608-620-3036 (Office) • svet@rousevengeering.com

PROJECT NO: 0824-28
 PLOT DATE: 9/22/24
 PLOT BY: SSR
 PLOT SCALE: #

SHEET # C6.2

BUILDING CODE REVIEW

REFERENCED CODES	INTERNATIONAL BUILDING CODE (IBC) - 2015
BUILDING CLASSIFICATION	MAJOR OCCUPANCY: IBC 508.4 SEPARATED OCCUPANCIES MODERATE HAZARD STORAGE (S1) = 8,475 SF BUSINESS OCCUPANCY (B) = 6,120 SF
CONSTRUCTION TYPE	VB
FIRE PROTECTION SYSTEMS	(NOT REQUIRED, OWNER IS CONSIDERING INSTALLING COMPLETE NFPA 13)
BUILDING HEIGHT AND AREA LIMITATIONS	1 STORY
ALLOWABLE AREA	- IBC 506.2 (S1 + B) N5 = 9,000 SF
FRONTAGE INCREASE	- IBC 506.3 = (520/520 - 0.25) * 30/30 = 75% = OR 75% * 9,000 = 6,750 SF
TOTAL ALLOWABLE AREA	= 9,000 SF + 6,750 = 15,750 SF
GROSS BUILDING AREA	= 14,595 SF
BUILDING FIRE AREA	- IBC 903: STORAGE (S1) MAX. ALLOWED FIRE ARE A = 12,000 SF > 8,475 SF

ROOM OCCUPANCY						
ROOM NO	NAME	AREA	FUNCTION OF SPACE	OCCUPANT LOAD FACTOR	OCCUPANT LOAD	COMMENTS
1	WAREHOUSE	7782 SF	STORAGE	500	16	
2	SPACE	1340 SF	BUSINESS	500	3	
3	SPACE	1299 SF	BUSINESS	500	3	
4	SPACE	1343 SF	BUSINESS	500	3	
5	SPACE	1297 SF	BUSINESS	500	3	
6	OFFICE	225 SF	BUSINESS	500	0	
7	ADA TLT	59 SF	BUSINESS	500	0	
8	ADA TLT	55 SF	BUSINESS	500	0	
9	CORRIDOR	324 SF	BUSINESS	500	1	
10	ADA TLT	60 SF	BUSINESS	500	0	
11	ADA TLT	55 SF	BUSINESS	500	0	
12	ADA TLT	57 SF	BUSINESS	500	0	
13	LOCKER RM	156 SF	BUSINESS	500	0	
TOTAL: 13					28	

MEANS OF EGRESS - CHAPTER 10

OCCUPANT LOAD	28 OCCUPANTS
IBC 1005.3.2 (1): EGRESS WIDTH - 0.15" PER OCCUPANT	28 X 0.15" = 4.20"
EGRESS OPENINGS	(8) MAN DOOR @ 36"
TOTAL EXISTING EGRESS WIDTH	288" : OK
IBC 1017 EXIT TRAVEL DISTANCE	- EXIT ACCESS TRAVEL DISTANCE: MAX ALLOWED PER TABLE 1017.2 = 200' - 0" FOR BLDG W/O SPRINKLER SYSTEM FOR B + S-1 OCCUPANCY < 200' - 0"

PLUMBING FIXTURES FOR CURRENT CONSTRUCTION

SECTION 2902 - MINIMUM PLUMBING FACILITIES


PLUMBING FIXTURE CALCULATIONS:

	B / MALE	F / FEMALE
WATER CLOSETS	1 PER 25	1 PER 25
LAVATORIES	1 PER 100	1 PER 100

	SI / MALE	SI / FEMALE
WATER CLOSETS	1 PER 100	1 PER 100
LAVATORIES	1 PER 100	1 PER 100

TOTAL MENS	= 6' * 0.04 + 6' * 0.01 = 0.3 (1 REQUIRED), 2.5 PROVIDED
TOTAL WOMENS	= 6' * 0.04 + 6' * 0.01 = 0.3 (1 REQUIRED), 2.5 PROVIDED
TOTAL LAVATORIES	= 28' * 0.01 = 0.28 (1 REQUIRED), 5 PROVIDED
TOTAL DRINKING FOUNTAINS	= 12/100 (B) + 16/1000 (SI) = (1 REQUIRED), 1 PROVIDED
TOTAL SERVICE SINKS	= 1 REQUIRED, 1 PROVIDED

- EXIT LIGHT
- FIRE EXTINGUISHER
-CYLINDER TYPE -CABINET TYPE
- FIRE EXTINGUISHER
-CABINET TYPE

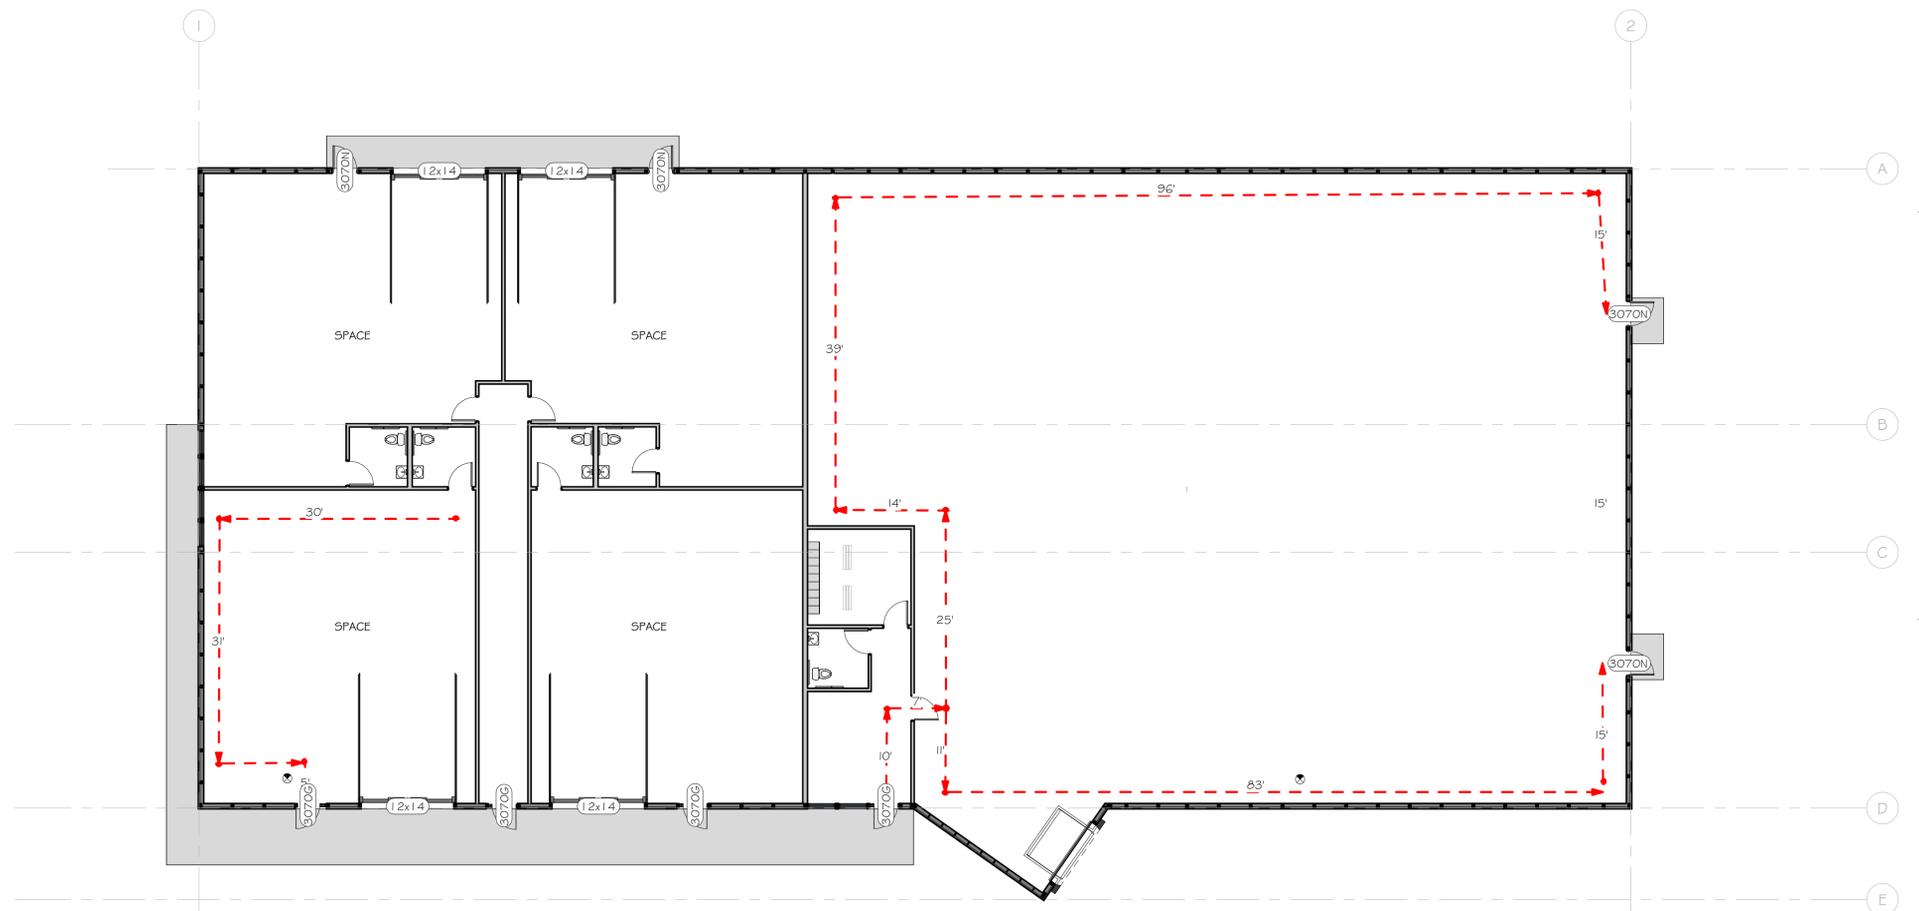


2 LIFE SAFETY & EGRESS PLANS
SCALE: 3/16" = 1'-0" on 12" x 18"
3/32" = 1'-0" on 24" x 36"




REVISIONS NO. DATE
 SHEET NAME: FIRST FLOOR ARCHITECTURAL CODE
 ADDRESS: 2917 DAIRY DR. MADISON, WI
 PROJECT: 14,400 SF POST-FRAME BUILDING SIMPLY HOMES PROPERTIES
 PROJECT NO: 0824-28
 PLOT DATE: 8/26/24
 PLOT BY: 55R
 PLOT SCALE: As indicated
 SHEET # A-001

Roussey Engineering Solutions, LLC
 405 Windy Peak Rd
 Verona, WI 53593
 608-620-3036 (Office) • viet@rouseyengineering.com




FILE NAME: E:\Projects\2024\0824-28 Lindsay Hagens Warehouse\Rev\0824Frame-2024-08-20.rvt

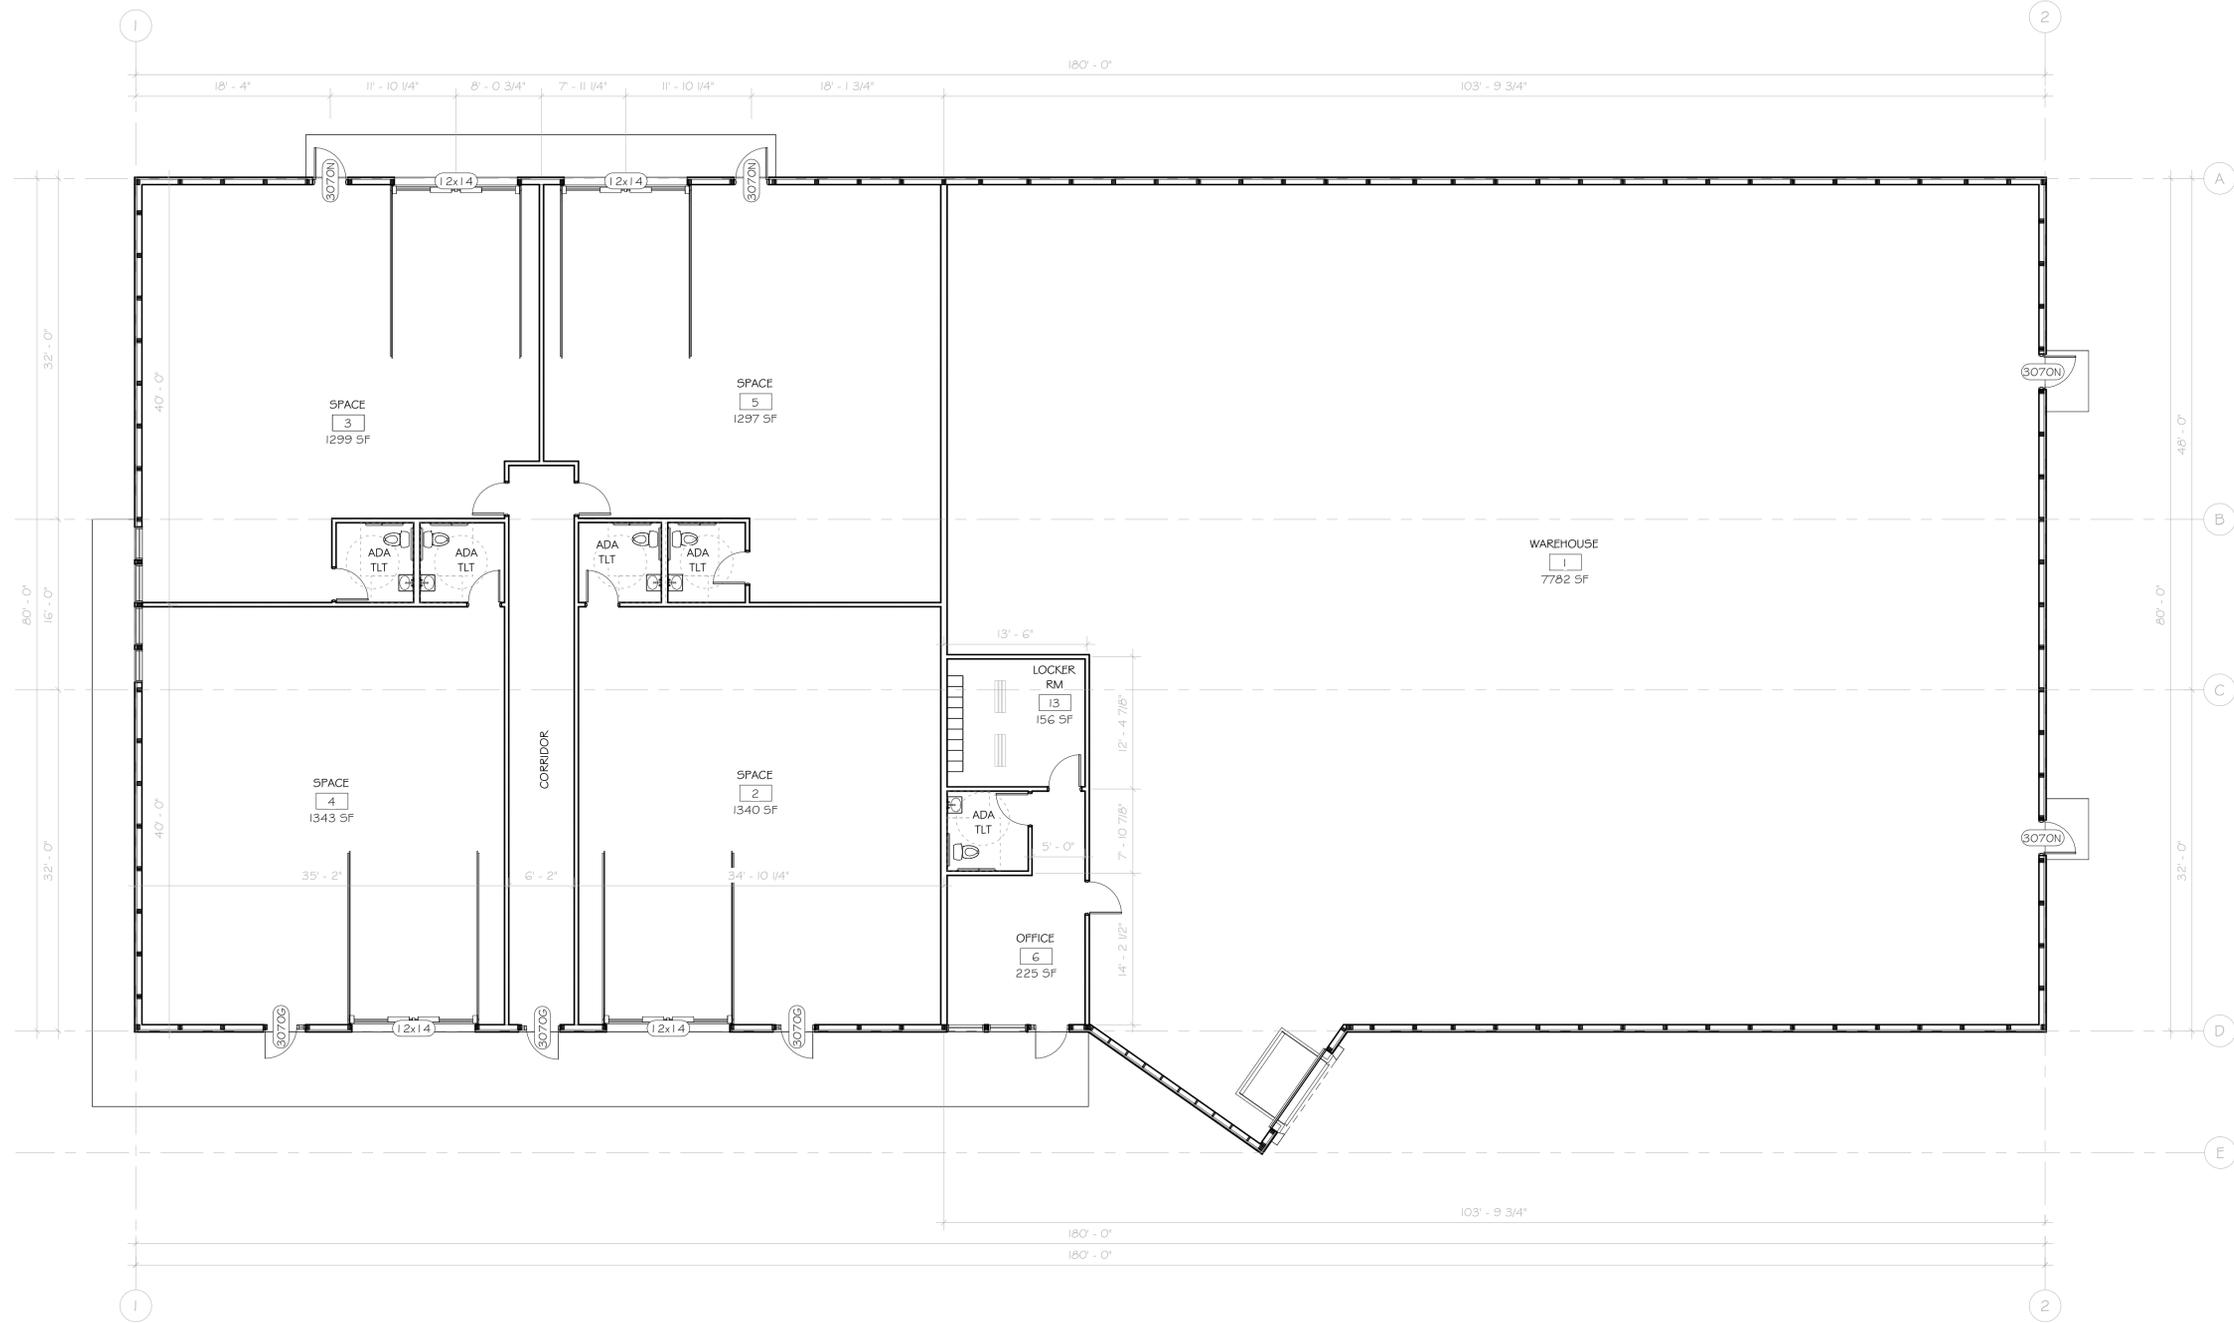

FIRST FLOOR PLAN
 SCALE: 1/16" = 1'-0" on 12" x 18"
 1/8" = 1'-0" on 24" x 36"



FILE NAME: E:\Projects\2024\0824-28 Lindsay Hugenius Warehouse\Revit\PostFrame_2024-19-20.rvt

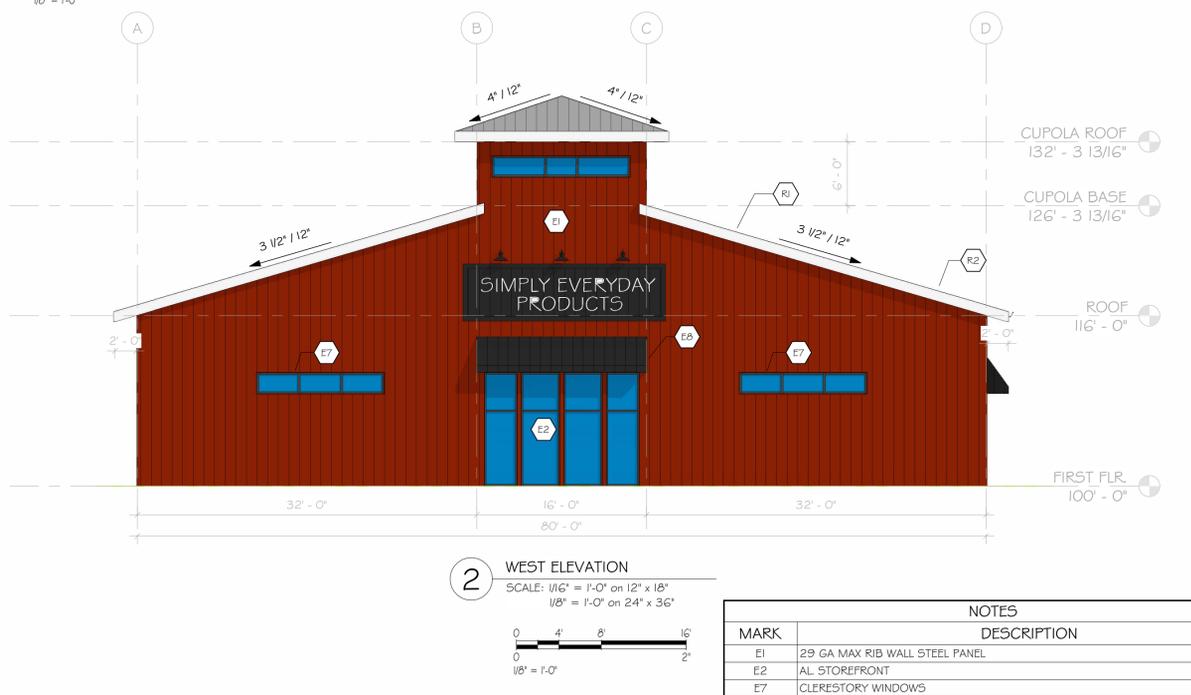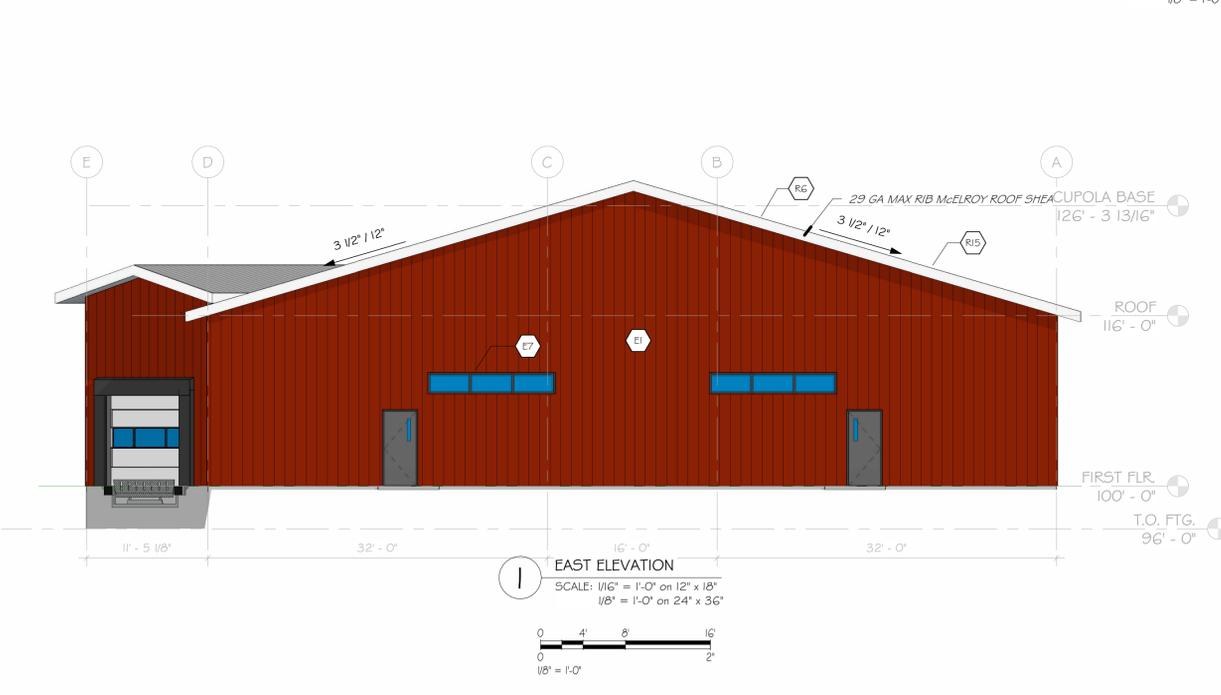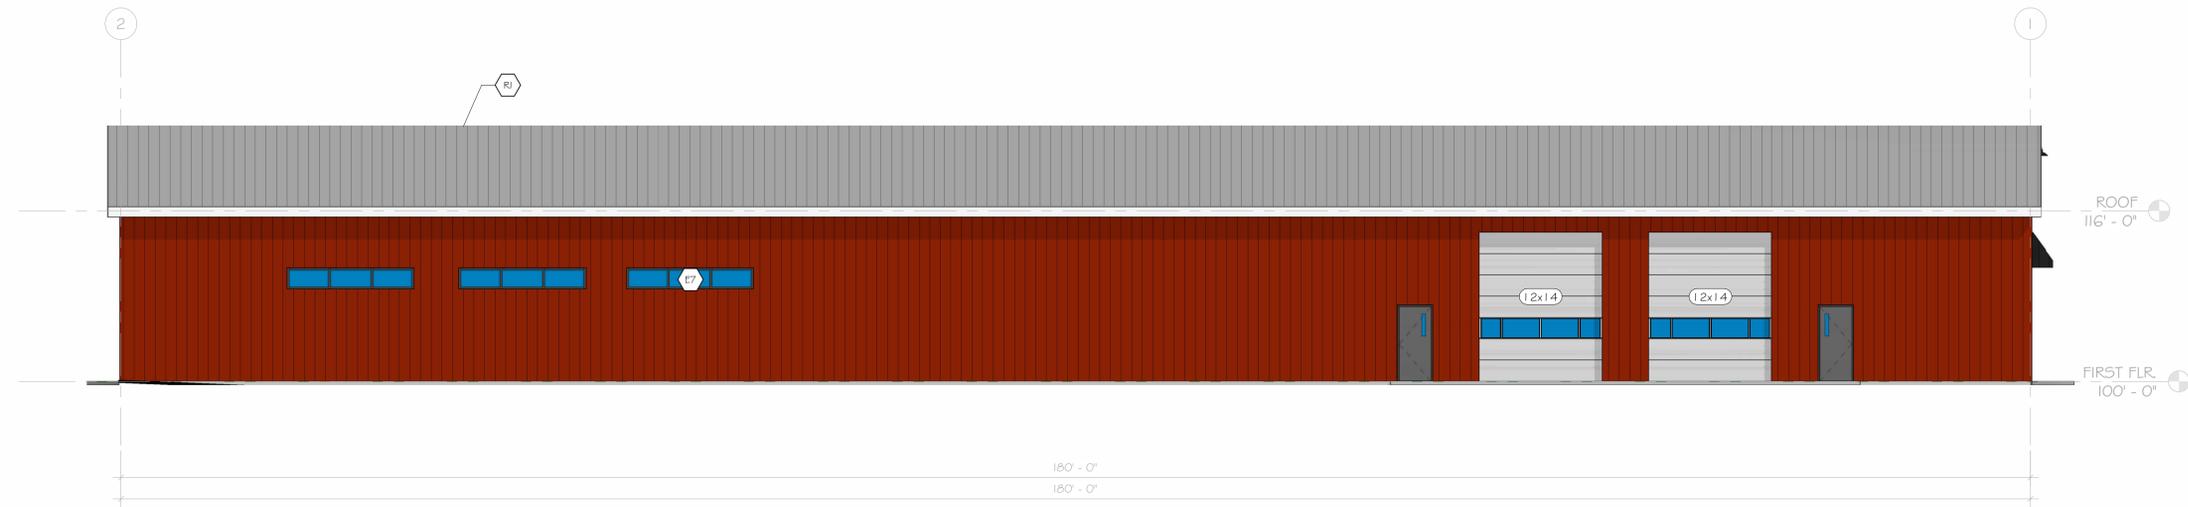

NOTES	
MARK	DESCRIPTION
E1	29 GA MAX RIB WALL STEEL PANEL
E2	AL. STOREFRONT
E7	CLERESTORY WINDOWS
E8	METAL SHEATHING AWNING
R1	29 GA MAX RIB SHEATHING, 2X4 SPF#2 PURLINS @ 24 O.C. (FLAT)
R2	METAL WRAPPED FASCIA: METAL FASCIA ON 2x WOOD BLOCKING
RG	2X6/2X6 L-GIRT W/ BR-30 TRIM

PROJECT: 14,400 SF POST-FRAME BUILDING
 ADDRESS: 2917 DAIRY DR. MADISON, WI
 SHEET NAME: EXTERIOR ELEVATIONS
 REVISIONS: NO. DATE

PROJECT: 14,400 SF POST-FRAME BUILDING
 ADDRESS: 2917 DAIRY DR. MADISON, WI
 SHEET # A-400
 PRELIMINARY NOT FOR CONSTRUCTION

ROUSSEV ENGINEERING SOLUTIONS, LLC
 405 Windy Peak Rd
 Verona, WI 53593
 608-620-3036 (Office) • svet@rousseverengineering.com

PROJECT: 14,400 SF POST-FRAME BUILDING
 ADDRESS: 2917 DAIRY DR. MADISON, WI
 SHEET NAME: EXTERIOR ELEVATIONS