
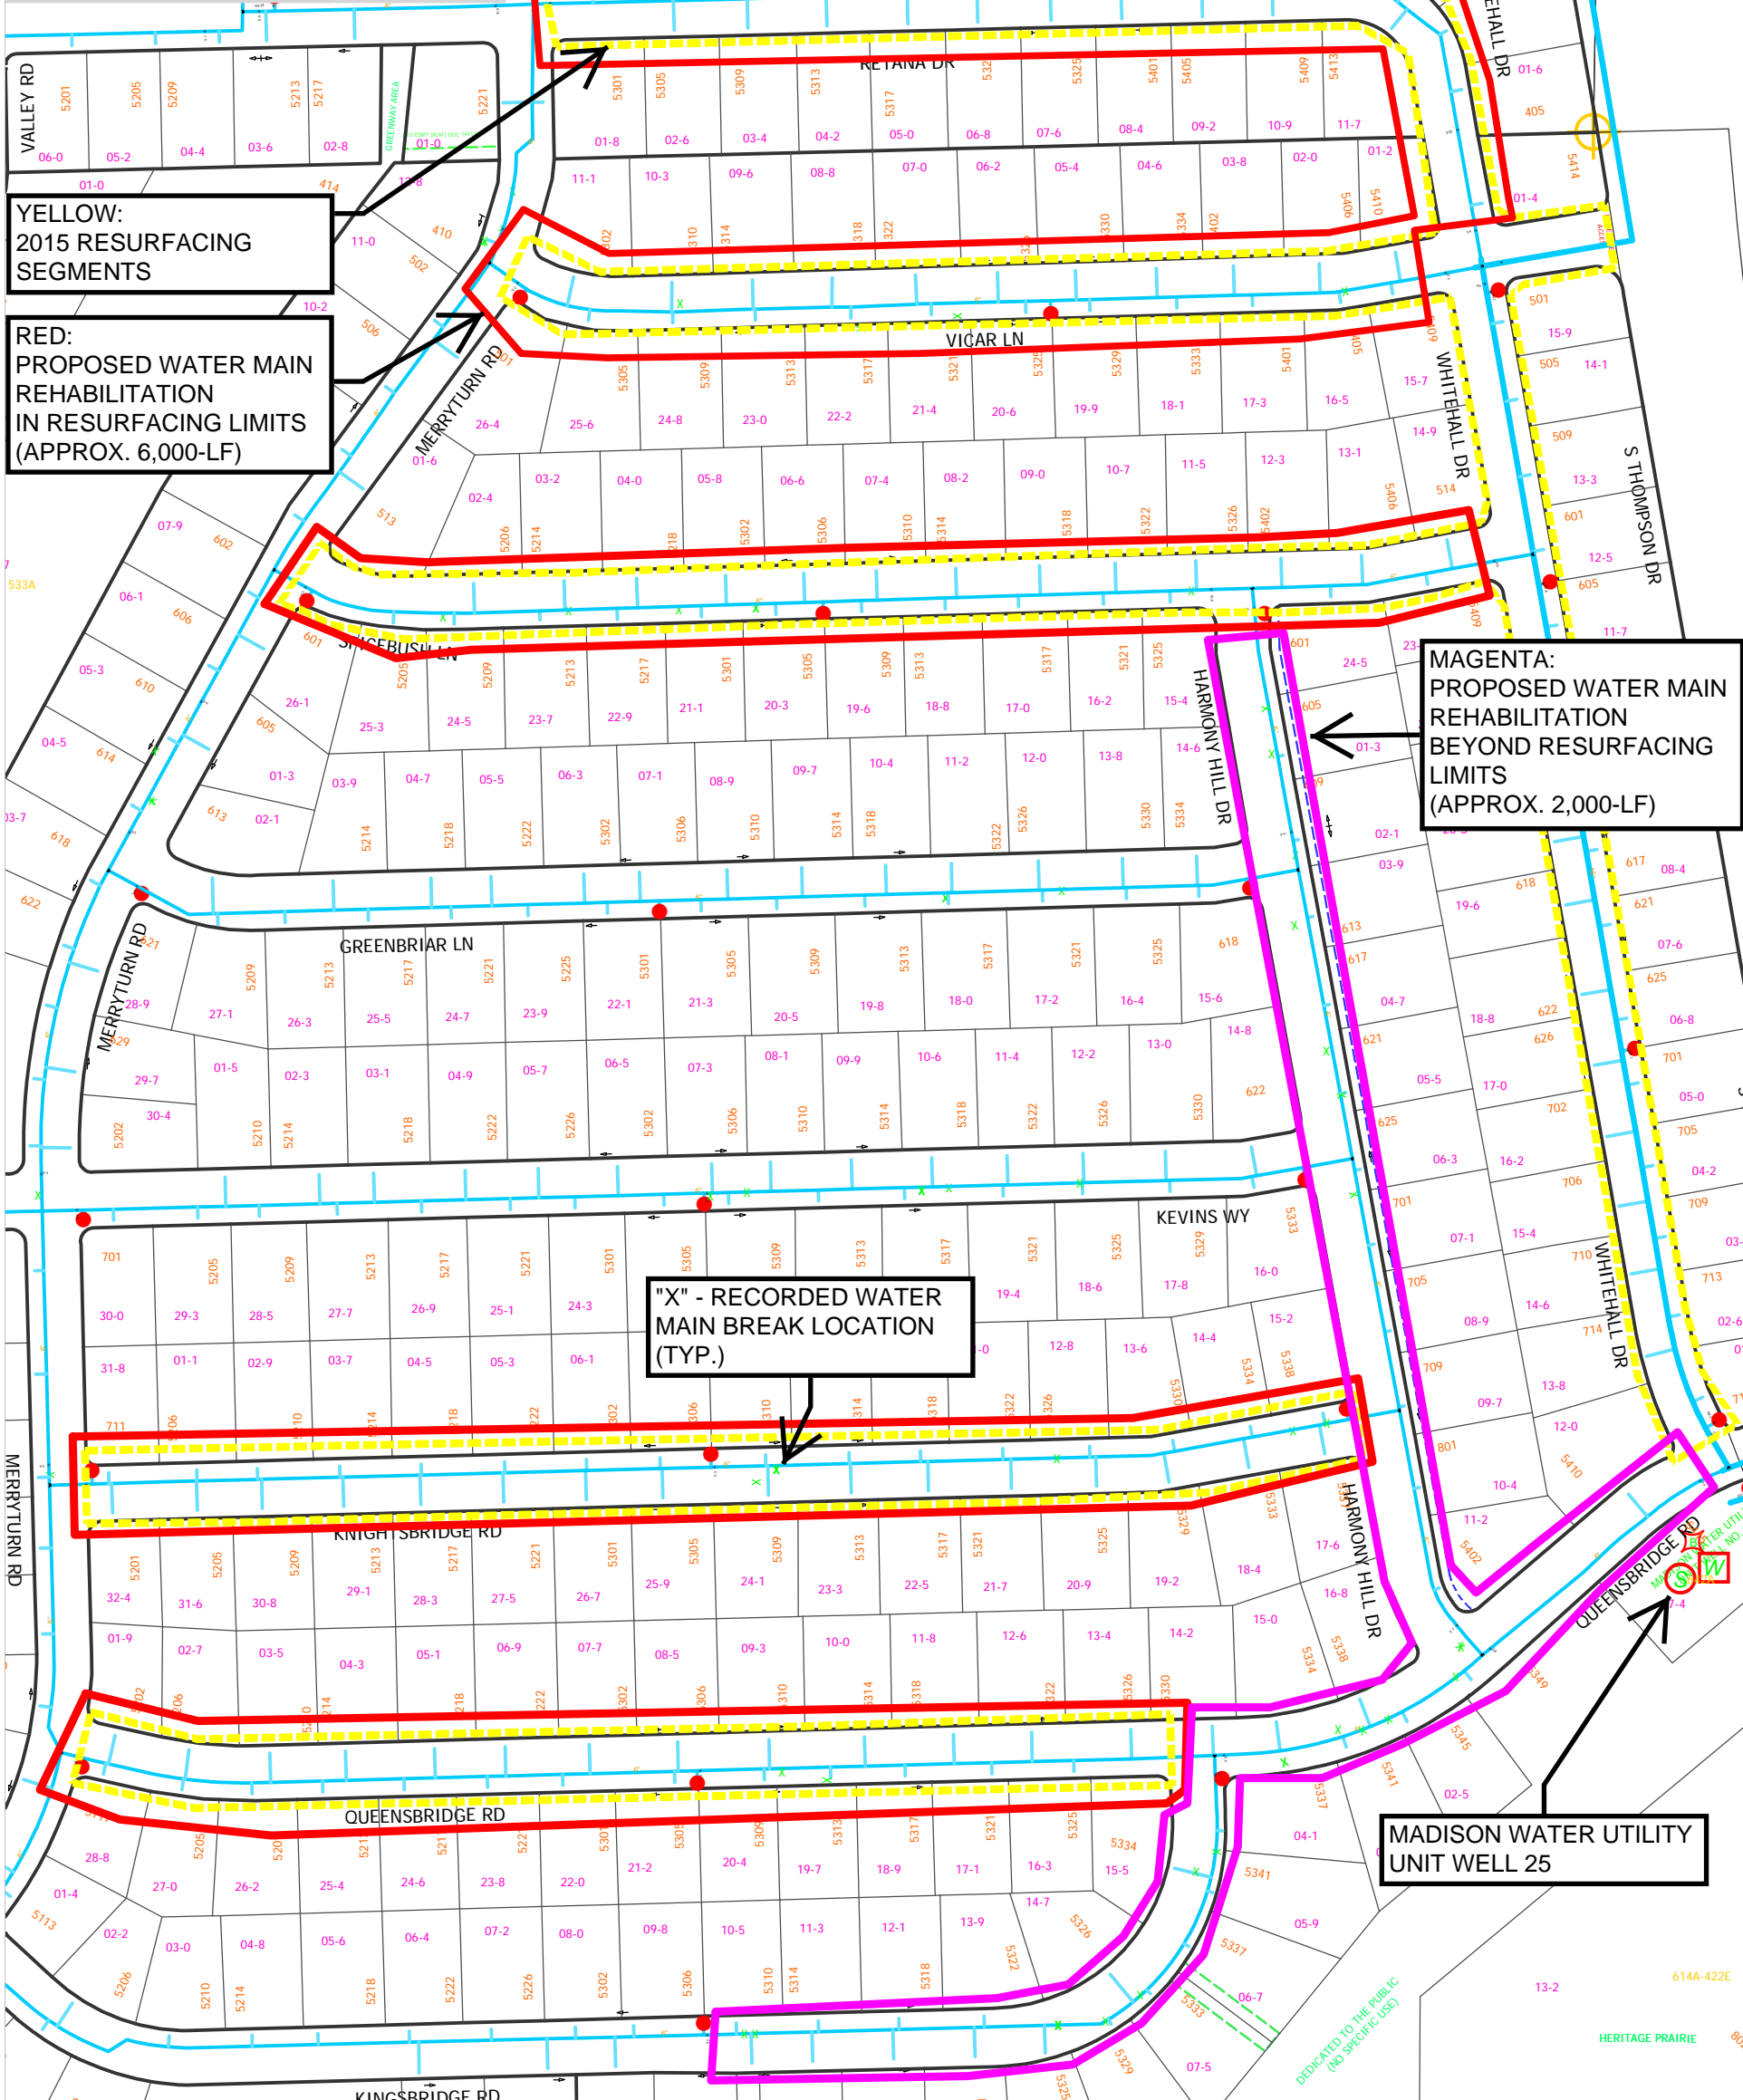


# Contract 7487 - Structural Rehabilitation of Water Mains - 2015 Proposed 2015 Project Limits

City of Madison, Board of Public Works Meeting  
February 4, 2015

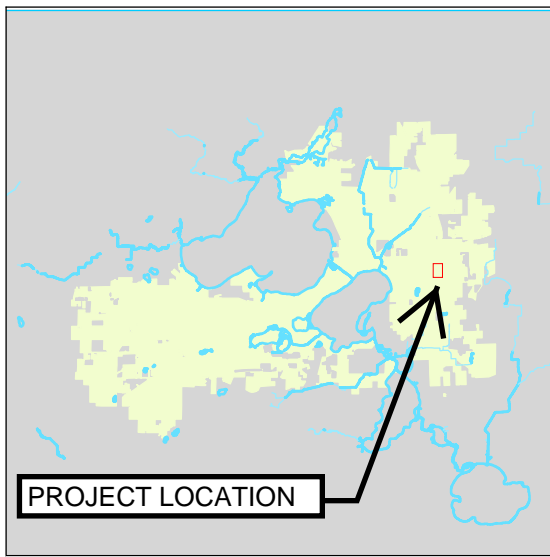

**YELLOW:**  
2015 RESURFACING  
SEGMENTS

**RED:**  
PROPOSED WATER MAIN  
REHABILITATION  
IN RESURFACING LIMITS  
(APPROX. 6,000-LF)

**MAGENTA:**  
PROPOSED WATER MAIN  
REHABILITATION  
BEYOND RESURFACING  
LIMITS  
(APPROX. 2,000-LF)

**"X" - RECORDED WATER  
MAIN BREAK LOCATION  
(TYP.)**

**MADISON WATER UTILITY  
UNIT WELL 25**

Madison Water Utility will be rehabilitating approximately 8,000-FT of existing, deteriorated water mains in the Unit Well 25 area using structural cured-in-place-pipe lining methods designed for pressurized drinking water applications. Approximately 6,000-FT of the project is located within 2015 street resurfacing segments and will be completed ahead of the proposed resurfacing. Estimated project cost: \$1,000,000.