GENERAL NOTES:

1. MINIMIZE EQUIPMENT TRAFFIC TO THE EXTENT POSSIBLE ON ALL BASEBALL FIELD INFIELD AND OUTFIELD SURFACES. CONTRACTOR SHALL BE RESPONSIBLE FOR ALL RESTORATION OF DAMAGED SURFACES DUE TO EQUIPMENT TRAFFIC.

KEY NOTES:

(1) COORDINATE WITH THE UTILITY COMPANY TO PROVIDE NEW 277/480V, 3-PHASE, 4-WIRE SERVICE. PROVIDE TRANSFORMER PAD PER UTILITY COMPANY REQUIREMENTS.

(2) ALL CONDUIT SHOWN IS 1" PVC UNLESS OTHERWISE NOTED.

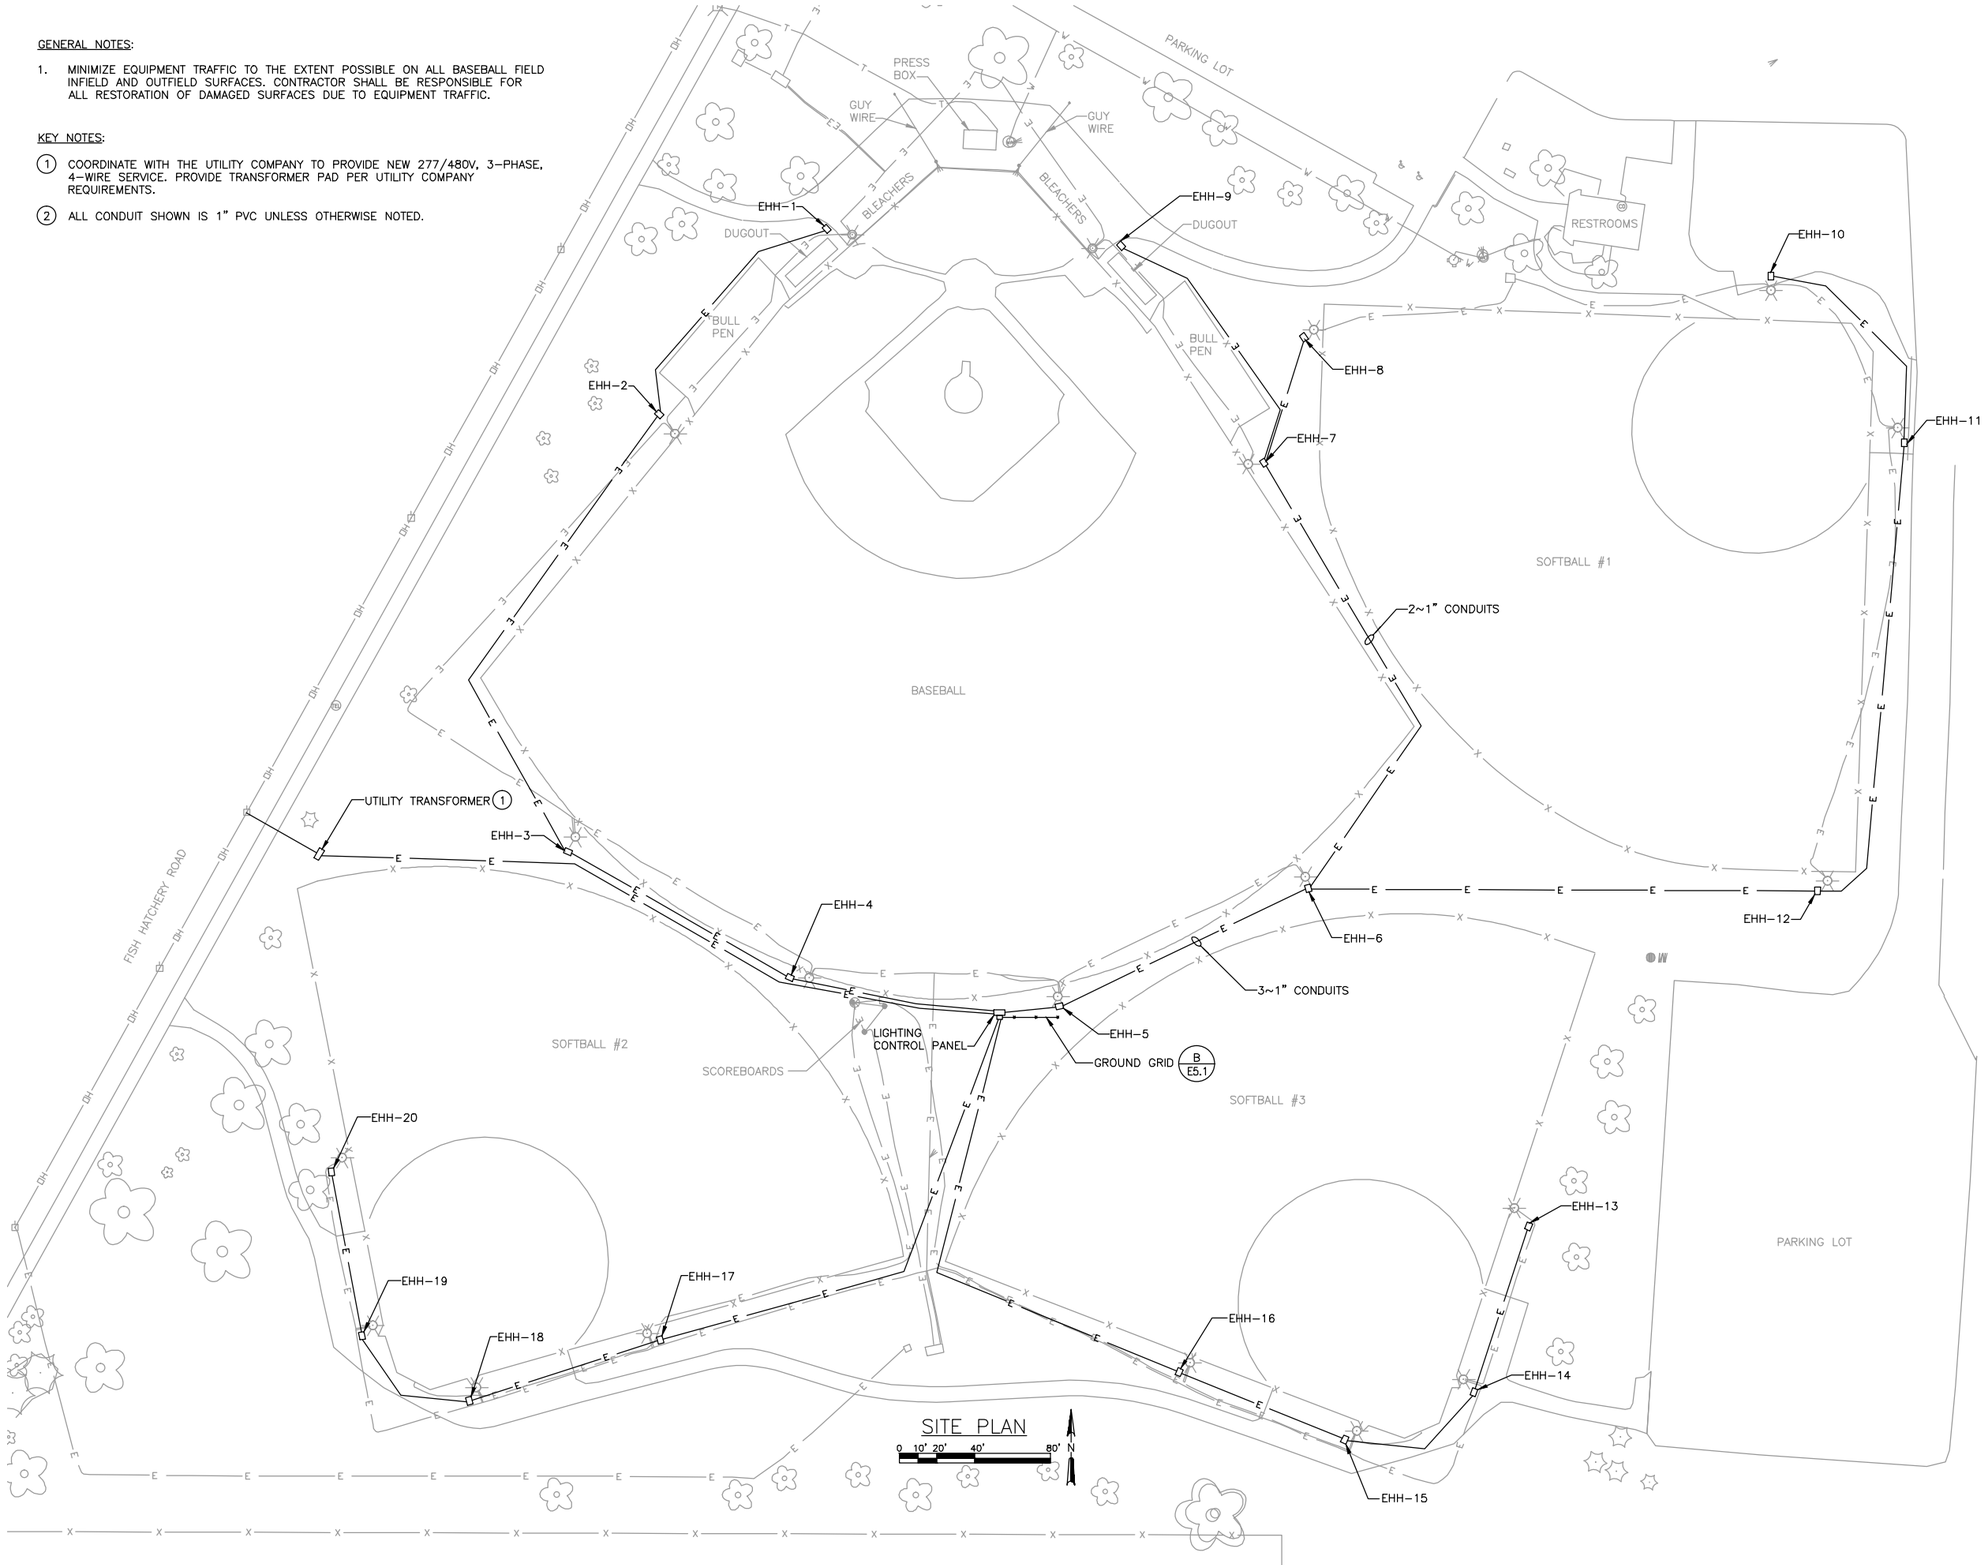


| NO. | REVISIONS | DATE: |
|---|---|---|

# ELECTRICAL SITE PLAN

BOWMAN FIELD LIGHTING DISTRIBUTION SYSTEM UPGRADE
CITY OF MADISON
MADISON, WISCONSIN

JOB NO.
1020.076

PROJECT MGR.

STRAND ASSOCIATES®

SHEET
E1.0

File: S:\MAD\1000--1099\1020\076\Acad\Drawings\E1.0.dwg Time: May 30, 2013 - 8:49am