


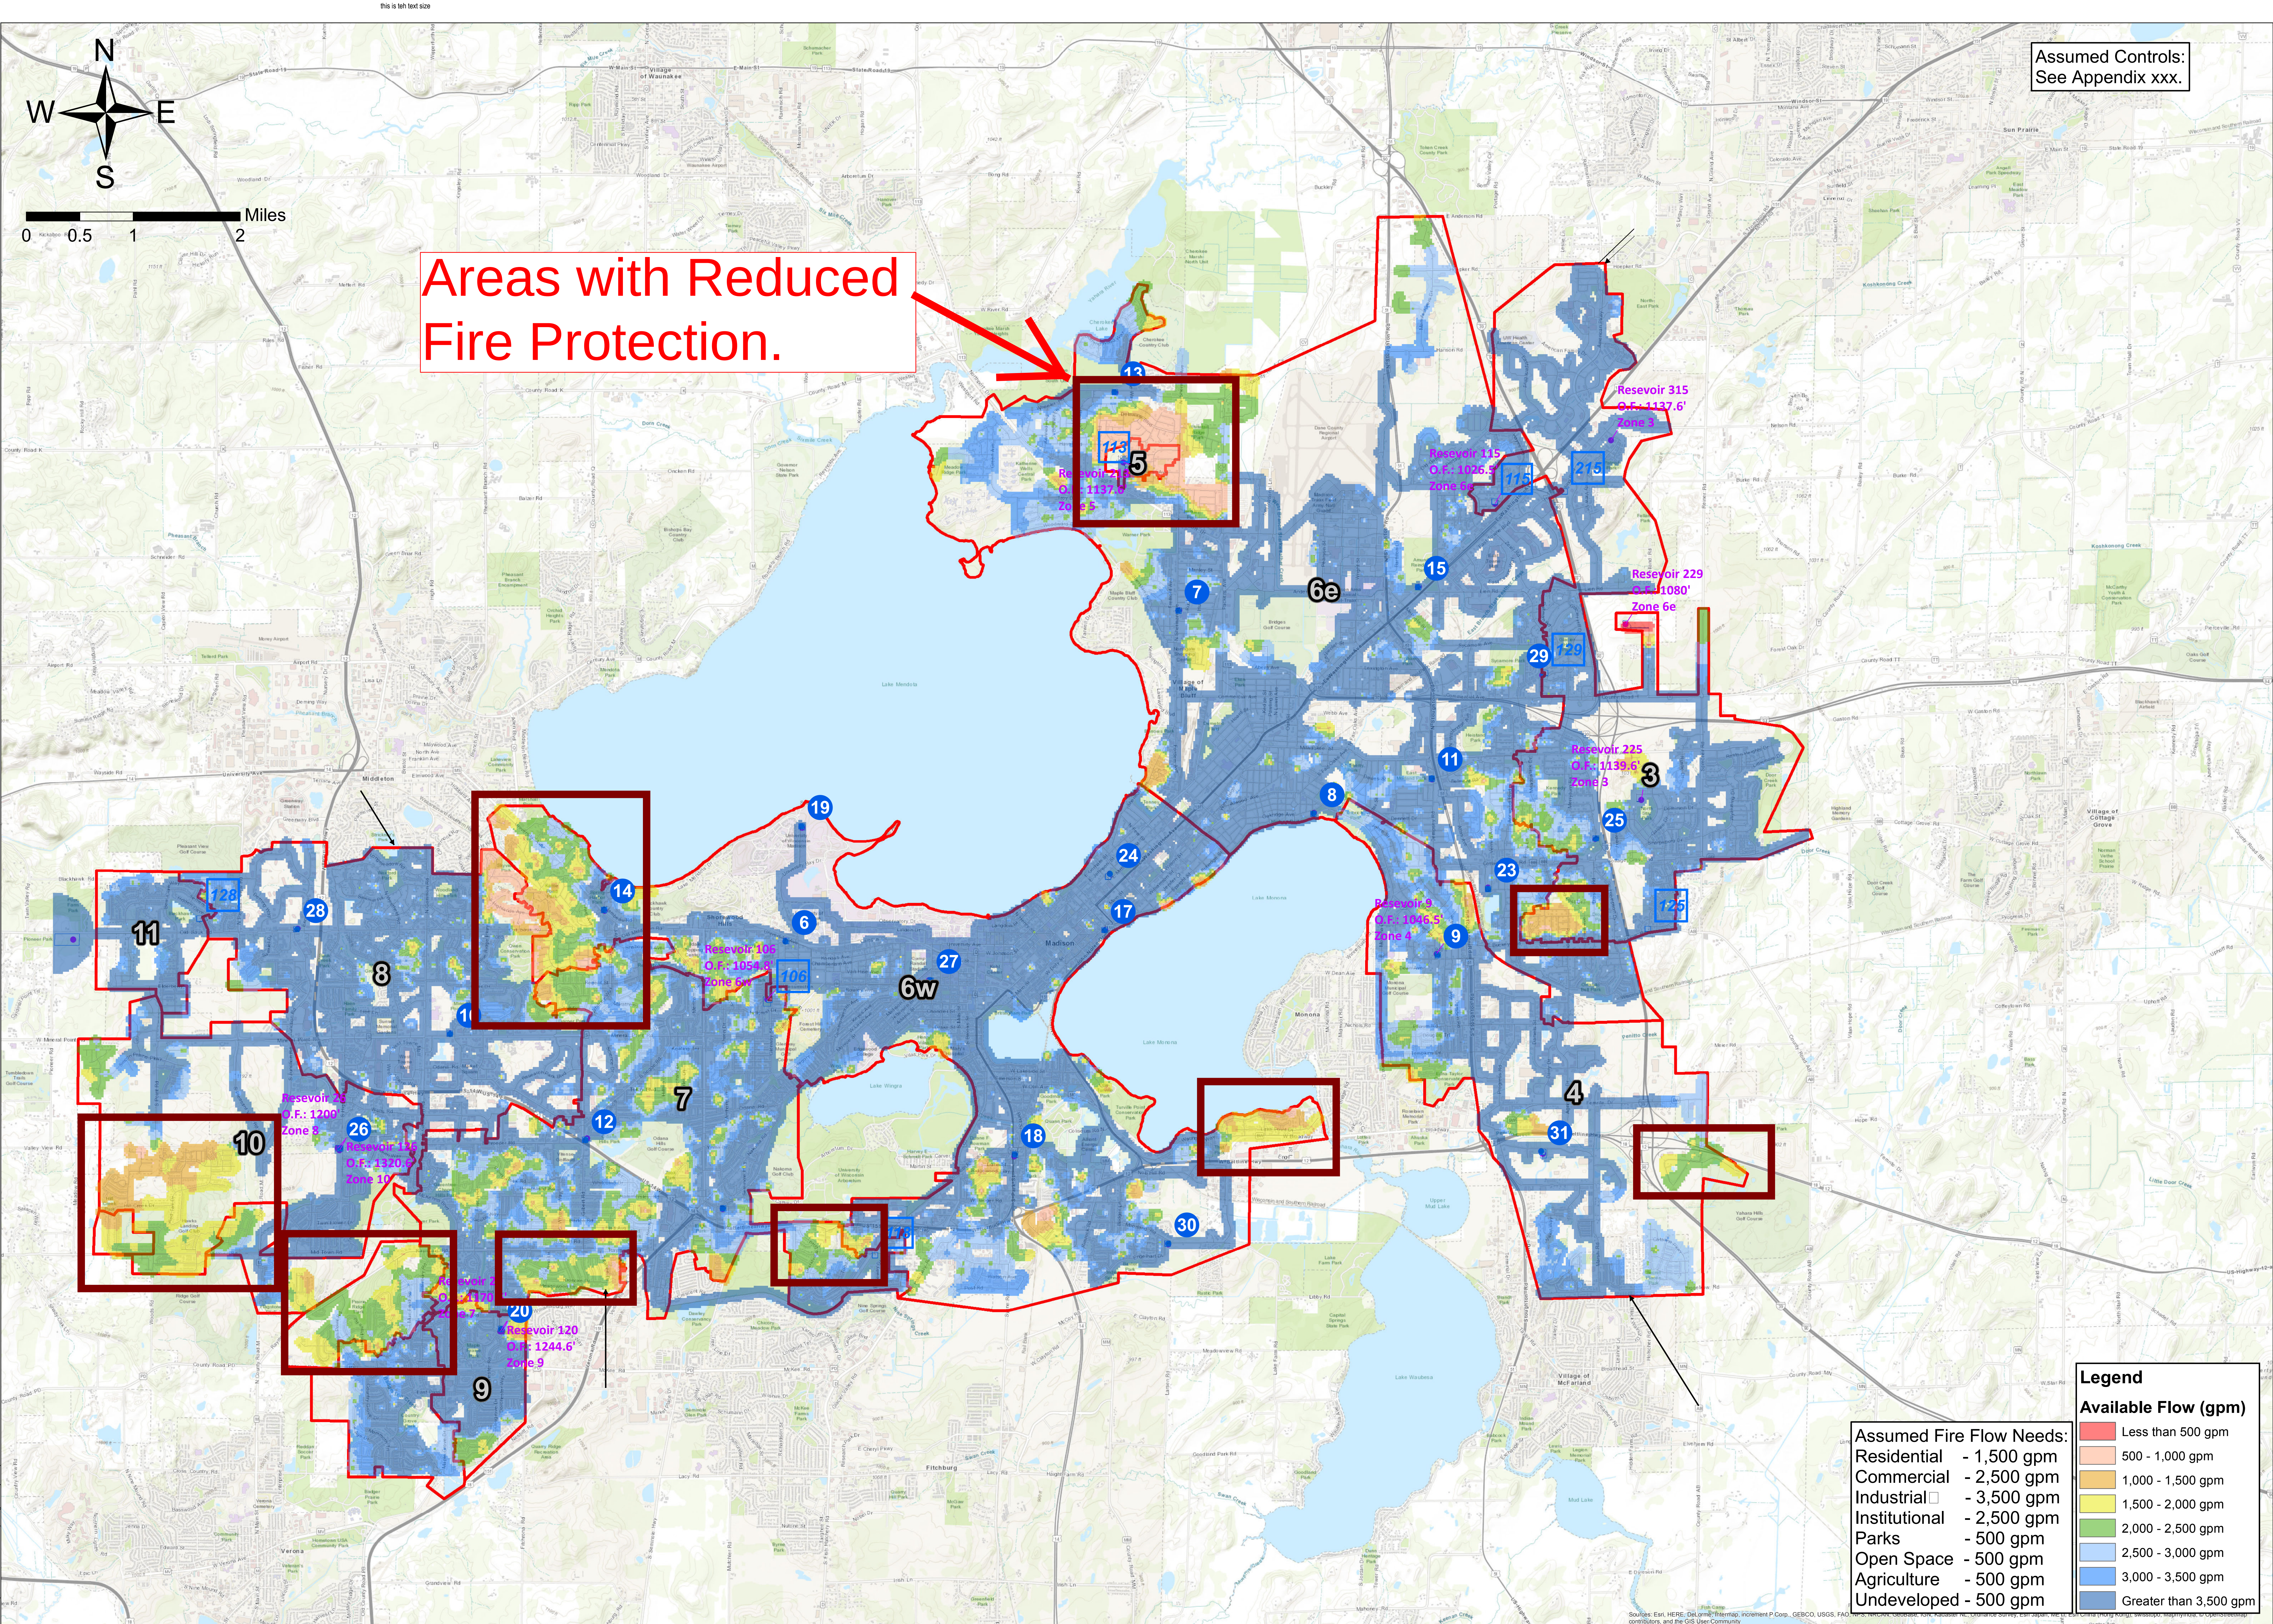

Areas with Reduced
Fire Protection.

Assumed Controls:
See Appendix xxx.

Legend

Available Flow (gpm)

Less than 500 gpm
500 - 1,000 gpm
1,000 - 1,500 gpm
1,500 - 2,000 gpm
2,000 - 2,500 gpm
2,500 - 3,000 gpm
3,000 - 3,500 gpm
Greater than 3,500 gpm

Assumed Fire Flow Needs:
Residential - 1,500 gpm
Commercial - 2,500 gpm
Industrial - 3,500 gpm
Institutional - 2,500 gpm
Parks - 500 gpm
Open Space - 500 gpm
Agriculture - 500 gpm
Undeveloped - 500 gpm

Project: MADWU 139057
Print Date: 8/25/2017

6808 Odana Road, Suite 200
Madison, WI 53719-1137
Phone: 608.620.6199
Toll Free: 800.732.4362
FAX: 608.620.6198
www.madwut.com

Available Flow at 20 psi
WATER NEEDS ASSESSMENT
Madison, Wisconsin

Figure
2

