


SHEET NO.	0	TITLE
SHEET NO.	W-1/9	APPURTENANCE SCHEDULE
SHEET NO.	W-2/9	EXISTING FLOOR PLAN
SHEET NO.	W-3/9	EXISTING PIPING PLAN
SHEET NO.	W-4/9	EXISTING PIPING SECTION
SHEET NO.	W-5/9	DEMOLITION & SEQUENCING PLAN
SHEET NO.	W-6/9	PROPOSED PIPING PLAN
SHEET NO.	W-7/9	PROPOSED PIPING SECTION
SHEET NO.	W-8/9	PHOTOS & DETAILS
SHEET NO.	W-9/9	N/A [VACANT]

# PROJECT LOCATION

801 S. WHITNEY WAY

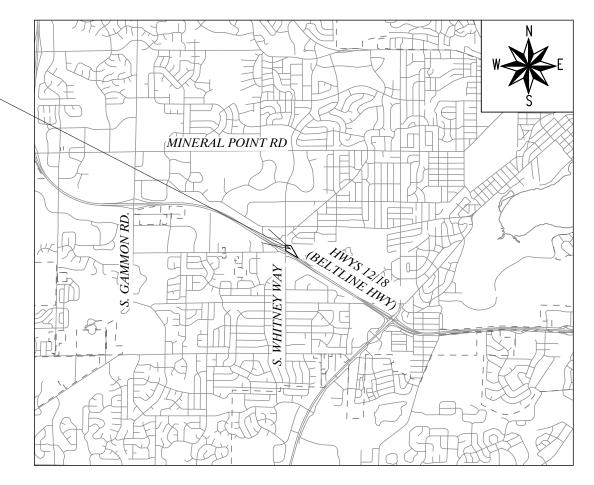

### **GENERAL NOTES**

- 1. UNLESS OTHERWISE SPECIFIED, ALL CONSTRUCTION SHALL CONFORM TO CITY OF MADISON STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION, 2022 EDITION. SEE HTTPS://WWW.CITYOFMADISON.COM/BUSINESS/PW/SPECS.CFM
- 2. PIPE MATERIAL SHALL BE CLASS 52 DUCTILE IRON PIPE
- 3. REMOVAL AND PROPER DISPOSAL OF THE OLD PUMP, AND INSTALLATION OF A NEW PUMP IS PART OF THIS CONTRACT. THE NEW PUMP AND UNIT ELECTRICAL WIRING ARE PROVIDED BY MWU. SEE SUGGESTED SEQUENCE OF DEMOLITION AND CONSTRUCTION ON SHEET W-5 FOR ADDITIONAL NOTES.
- 4. NEW PUMP IS STORED AT THE UTILITY OPERATIONS CENTER AT 110 S. PATERSON ST. ARRANGE WITH UTILITY TO PICK UP PUMP AND TRANSPORT TO JOB SITE.
- 5. ALL REQUIRED PERMITS ARE THE RESPONSIBILITY OF THE CONTRACTOR.
- 6. CONTRACTOR IS REQUIRED TO MAINTAIN A SAFE WORKSPACE THROUGHOUT THE PROJECT.
- 7. WORK SHALL COMMENCE NO MORE THAN 30 DAYS AFTER EXECUTION OF THE CONTRACT AND RECEIPT OF THE START WORK LETTER.
- 8. PROJECT DURATION IS 21 CALENDAR DAYS FROM START OF WORK.

NUMBER	SIZE	TYPE	DISPOSITION	NORMAL POSITION	FUNCTION	NOTES
V-1	12"	BUTTERFLY	EXISTING	OPEN	DEEP WELL ISOLATION	
V-2	10"	BUTTERFLY	REPLACE	OPEN	SUCTION ISOLATION	
V-3	10"	BUTTERFLY	EXISTING	OPEN	DISCHARGE ISOLATION	
V-4	10"	BUTTERFLY	NEW	OPEN	SUCTION ISOLATION	
CV-1	10"	CHECK VALVE	REPLACE	-	PREVENT BACKFLOW AT BOOSTER PUMP	
CV-2	6"	CHECK VALVE	NEW	-	PREVENT BACKFLOW AT BOOSTER PUMP	
M-1	10"	METER	EXISTING	-	METERS BOOSTER PUMP DISCHARGE	


- GENERAL NOTES

  1. CHECK VALVE SHALL BE A FLANGED SWING CHECK VALVE WITH OUTSIDE LEVER AND WEIGHT EQUIPPED WITH AN AIR-CUSHION CHAMBER TO CUSHION THE CLOSING OF THE VALVE DISC. THE VALVE SHALL BE MANUFACTURED IN ACCORDANCE WITH AWWA C508. CHECK VALVE SHALL BE MANUFACTURED BY GA INDUSTRIES OR APPROVED EQUIVALENT.
- 2. GATE VALVE SHALL BE RESILIENT WEDGE DESIGN PER AWWA C509, FLANGED AND EQUIPPED WITH HANDWHEEL OPERATOR. GATE VALVE SHALL BE MANUFACTURED BY KENNEDY, MUELLER OR CLOW.

W-1/9

# APPURTENANCE SCHEDULE


INSPECTOR: MWU	DRAWN BY: PEH
CHECKED BY: DVH	DATE: 3/29/2022

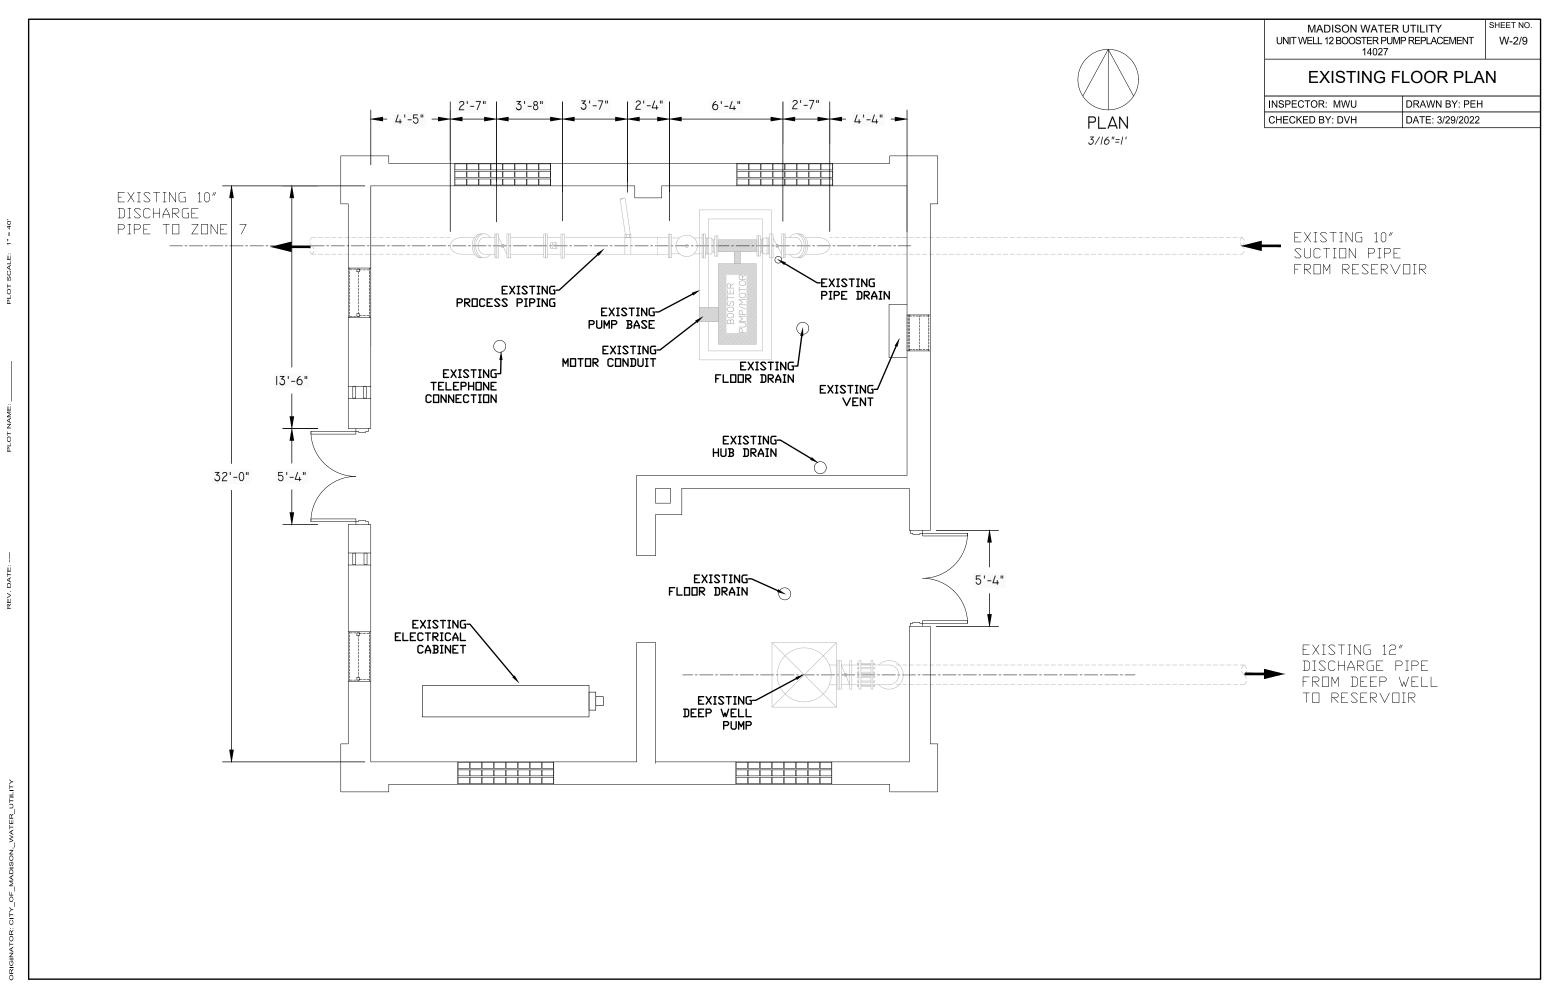

SHEET NO. W-3/9

EXISTING PIPING PLAN

INSPECTOR: MWU DRAWN BY: PEH
CHECKED BY: DVH DATE: 3/29/2022

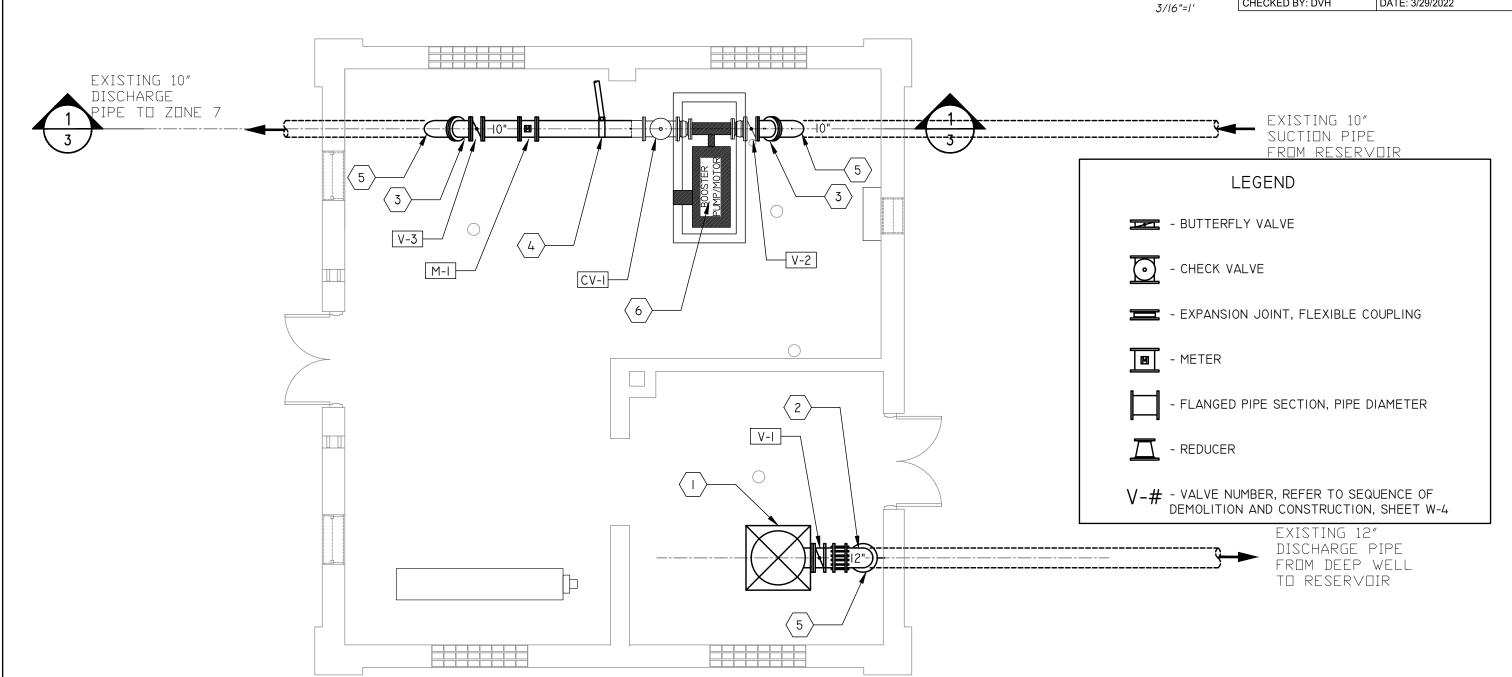

#### GENERAL NOTES

- A. PIPES & FITTINGS WRAPPED IN INSULATION WHEN MEASURED. DIMENSIONS SHOWN MAY VARY BY I"-2". VERIFY ALL DIMENSIONS FOR FABRICATED PIPING
- B. PUMPS SHOWN SCHEMATICALLY FOR INFORMATION PURPOSES.
- C. FOR FURTHER, OR CLARIFIED INFORMATION, CONTACT MADISON WATER UTILITY.
- D. SEE PHOTOS ON SHEETS 7 AND 8 FOR ADDITIONAL DETAIL.

### KEYED NOTES

- DEEP WELL PUMP
- 2. I2-IN 90° BEND (VERTICAL)
- 3. IO-IN 45° BEND (VERTICAL)
- 4. 2-IN COPPER TAP FOR SPRINKLER
- 5. PIPING TRANSITION INTO FLOOR
- 6. BOOSTER PUMP AND BASE

GENERAL NOTES

A. VERIFY ALL DIMENSIONS

# KEYED NOTES

- I. EXISTING PUMP
- 2. 2-IN TAP FOR SPRINKLER
- PIPE SUPPORT
- 4. 45° BEND

# LEGEND

- BUTTERFLY VALVE

- CHECK VALVE


= - EXPANSION JOINT, FLEXIBLE COUPLING

- METER

- FLANGED PIPE SECTION, PIPE DIAMETER

T - REDUCER

V-4 - VALVE NUMBER, REFER TO SEQUENCE OF DEMOLITION AND CONSTRUCTION, SHEET W-4

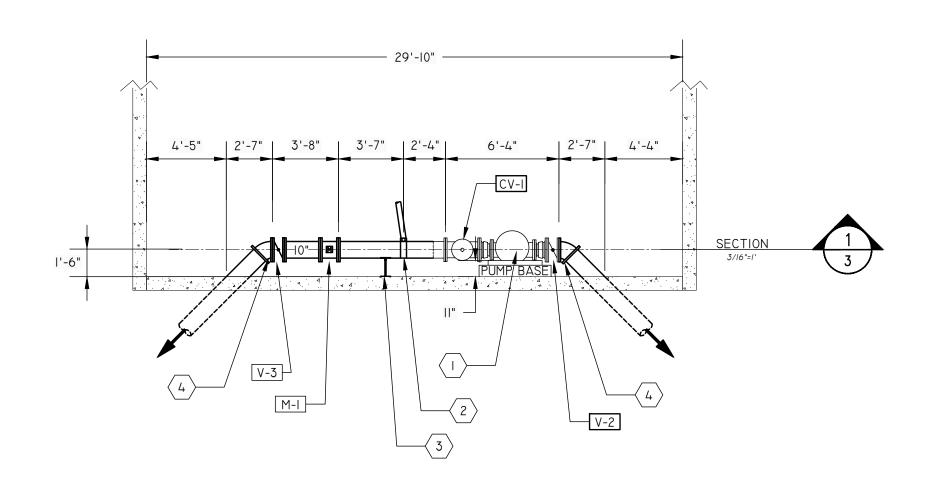

SHEET NO. **W-5/9** 

## **DEMOLITION & SEQUENCING PLAN**

INSPECTOR: MWU	DRAWN BY: PEH
CHECKED BY: DVH	DATE: 3/29/2022

#### GENERAL DEMOLITION AND CONSTRUCTION NOTES


- A. PRESENT PROPOSED DEMOLITION PLAN AND CONSTRUCTION SEQUENCE FOR REVIEW BY MWU.
- B. REFER TO VALVE SCHEDULE, SHEET W-I, EXISTING FLOOR PLAN, SHEET W-2, PROPOSED PIPING PLAN, SHEET W-6 AND PROPOSED PIPING SECTION, SHEET W-7.
- C. WORK SHALL NOT START WITHOUT AN AGREED UPON SEQUENCE OF DEMOLITION AND CONSTRUCTION.


#### SUGGESTED SEQUENCE OF DEMOLITION AND CONSTRUCTION


- A. COORDINATE WITH MWU A MINIMUM OF 2 WORKING DAYS PRIOR TO ANY SHUT DOWN OF THE FACILITY.
- B. MWU SHALL CLOSE VALVES V-I, V-3, AND ANY APPROPRIATE YARD VALVES.
- C. DEMOLISH AND REMOVE EXISTING PUMP, BASE, AND PIPE/FITTINGS AS SHOWN.
- D. INSTALL NEW PUMP, BASE (AS NECESSARY), AND CONFIGURATION AS SHOWN ON PROPOSED SHEETS.
- E. PRESSURE TEST ALL NEW PIPING AND NEW PUMP.
- F. DISINFECT ALL NEW PIPING AND PUMP.
- G. FOLLOWING INSTALLATION OF THE PUMP, MWU WILL INSTALL WIRING AND CONTROLS.
- H. ASSIST MWU IN TESTING AND STARTUP OF THE PUMP. MWU WILL PROVIDE PUMP VENDOR INSPECTION OF THE INSTALLATION PRIOR TO STARTUP.
- PUMP OPERATION, INCLUDING, BUT NOT LIMITED TO, PUMPING CAPACITY, VIBRATION, AND VFD OPERATION WILL BE TESTED PRIOR TO ACCEPTANCE OF THE WORK.

#### KEYED NOTES

- REMOVE PUMP, MOTOR AND MOUNTING BRACKETS. REMOVE OR MODIFY CONCRETE BASE.
- 2. ELECTRIC POWER SUPPLY CONDUIT TO BE PRESERVED AND RE-ROUTED AFTER REMOVAL OF CONCRETE BASE.
- 3. CUT OFF EXISTING PIPE LENGTH AS REQUIRED TO FIT NEW CONFIGURATION.
- IF NECESSARY, REPLACE EXISTING 10-IN 45° BEND TO MATCH NEW CONFIGURATION.

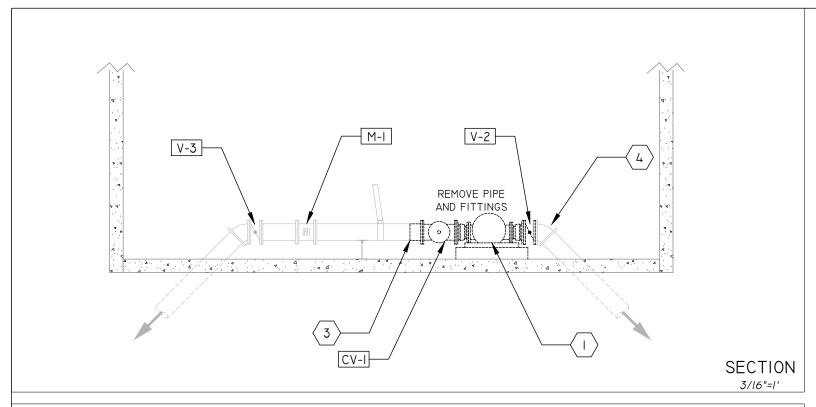

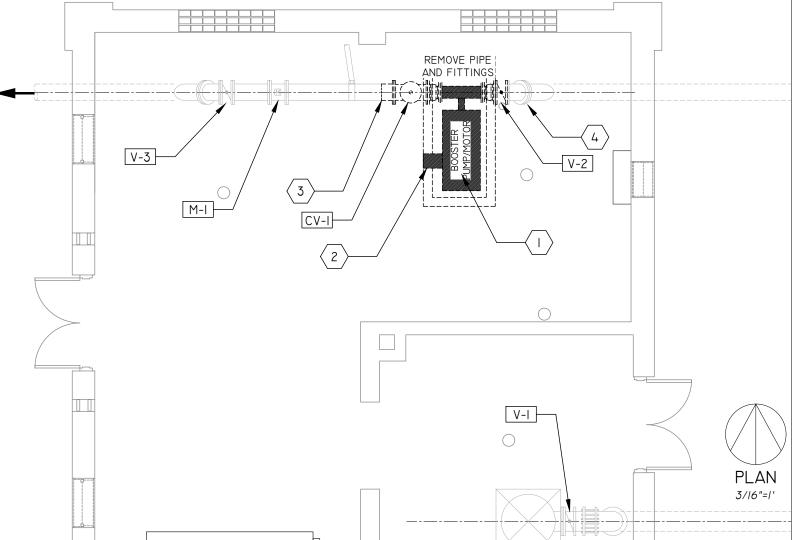

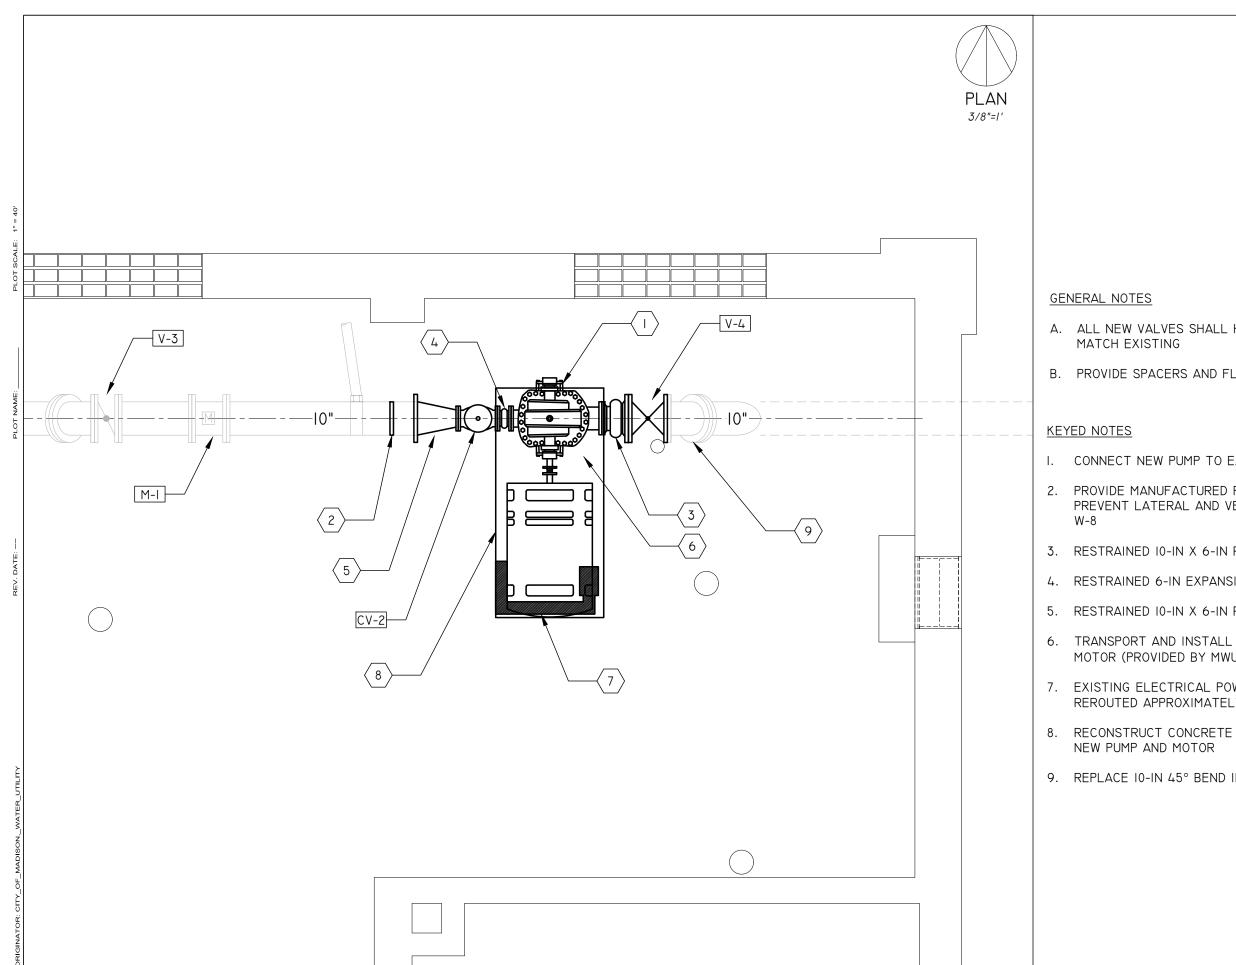

FILE NAME: \\FPS2\\Data2\\Wucommon\\Facilities\\Unit \\Well 12\\Well 12\\Well 12\\Pump Replacement 2022\\Design\\CAD Drawings\\UW12 Floor Plan\_ArchUnits.dwgDATE: 3/29/2022 2:06 PM


MADISON WATER UTILITY UNIT WELL 12 BOOSTER PUMP REPLACEMENT 14027

W-6/9

### PROPOSED PIPING PLAN

INSPECTOR: MWU	DRAWN BY: PEH
CHECKED BY: DVH	DATE: 3/29/2022

- A. ALL NEW VALVES SHALL HAVE WHEELED OPERATORS TO
- B. PROVIDE SPACERS AND FLANGE ADAPTERS AS NECESSARY
- I. CONNECT NEW PUMP TO EXISTING PUMP PRIMING SYSTEM
- 2. PROVIDE MANUFACTURED PIPE SUPPORT SYSTEM AS REQUIRED TO PREVENT LATERAL AND VERTICAL MOVEMENT. SEE DETAIL 9-I, SHEET
- 3. RESTRAINED 10-IN X 6-IN REDUCING EXPANSION JOINT
- 4. RESTRAINED 6-IN EXPANSION JOINT
- 5. RESTRAINED 10-IN X 6-IN REDUCER.
- 6. TRANSPORT AND INSTALL NEW SPLIT CASE CENTRIFUGAL PUMP & MOTOR (PROVIDED BY MWU)
- 7. EXISTING ELECTRICAL POWER SUPPLY CONDUIT TO BE REUSED AND REROUTED APPROXIMATELY AS SHOWN
- 8. RECONSTRUCT CONCRETE BASE AS NECESSARY TO FIT AND SUPPORT
- 9. REPLACE 10-IN 45° BEND IF NECESSARY FOR PROPOSED CONFIGURATION

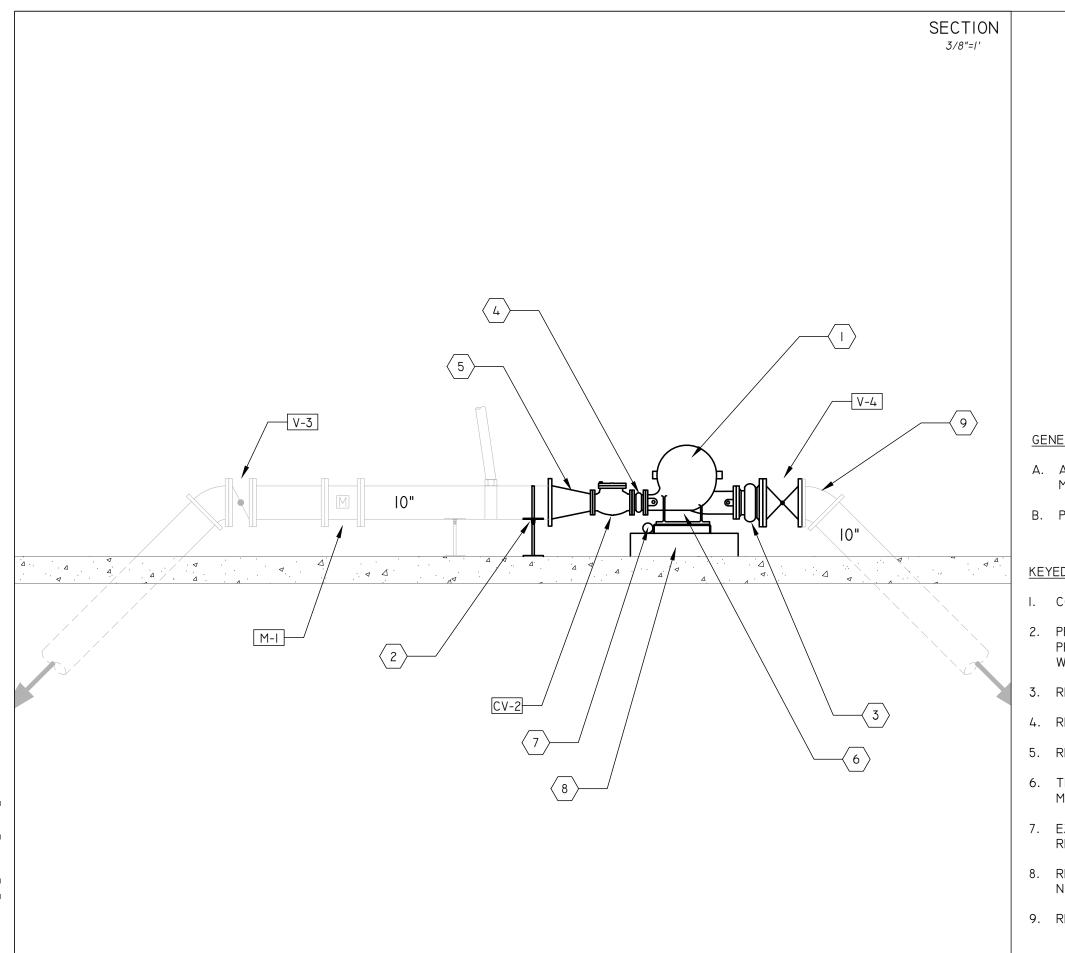

SHEET NO. W-7/9

# PROPOSED PIPING SECTION

INSPECTOR: MWU	DRAWN BY: PEH
CHECKED BY: DVH	DATE: 3/29/2022

#### GENERAL NOTES

- A. ALL NEW VALVES SHALL HAVE WHEELED OPERATORS TO MATCH EXISTING
- B. PROVIDE SPACERS AND FLANGE ADAPTERS AS NECESSARY


#### KEYED NOTES

- I. CONNECT NEW PUMP TO EXISTING PUMP PRIMING SYSTEM
- 2. PROVIDE MANUFACTURED PIPE SUPPORT SYSTEM AS REQUIRED TO PREVENT LATERAL AND VERTICAL MOVEMENT. SEE DETAIL 9-I, SHEET W-8
- 3. RESTRAINED IO-IN X 6-IN REDUCING EXPANSION JOINT
- 4. RESTRAINED 6-IN EXPANSION JOINT
- 5. RESTRAINED IO-IN X 6-IN REDUCER.
- 6. TRANSPORT AND INSTALL NEW SPLIT CASE CENTRIFUGAL PUMP & MOTOR (PROVIDED BY MWU)
- 7. EXISTING ELECTRICAL POWER SUPPLY CONDUIT TO BE REUSED AND REROUTED; SEE SHEET W-6
- 8. RECONSTRUCT CONCRETE BASE AS NECESSARY TO FIT AND SUPPORT NEW PUMP AND MOTOR
- 9. REPLACE IO-IN 45° BEND IF NECESSARY FOR PROPOSED CONFIGURATION

SHEET NO. W-8/9

PHOTOS & DETAILS

INSPECTOR: MWU DRAWN BY: PEH
CHECKED BY: DVH DATE: 3/29/2022

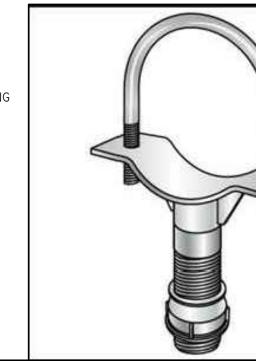




EXISTING PUMP AND MOTOR
FACING NORTHEAST CORNER

EXISTING PUMP AND MOTOR
FACING NORTHWEST

# DETAIL 9-I: TYPICAL MANUFACTURED PIPE SUPPORT COMPONENT

MANUFACTURED PIPE SUPPORT SYSTEM REQUIRED TO PREVENT LATERAL AND VERTICAL PIPE MOVEMENT (AS APPROPRIATE).
SUBMIT SHOP DRAWINGS OF PIPE SUPPORT SYSTEMS TO MWU FOR REVIEW AND APPROVAL PRIOR TO INSTALLATION.

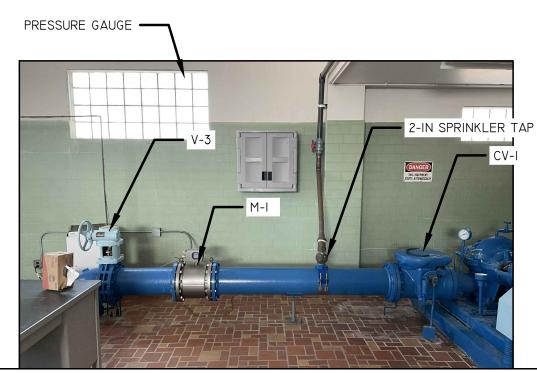

DISCHARGE-SIDE PIPING
FACING NORTH WALL



EXISTING PUMP CONFIGURATION FACING NORTH WALL

PRESSURE GAUGE

CV-I

EXISTING CONDUIT