


MONONA DRIVE

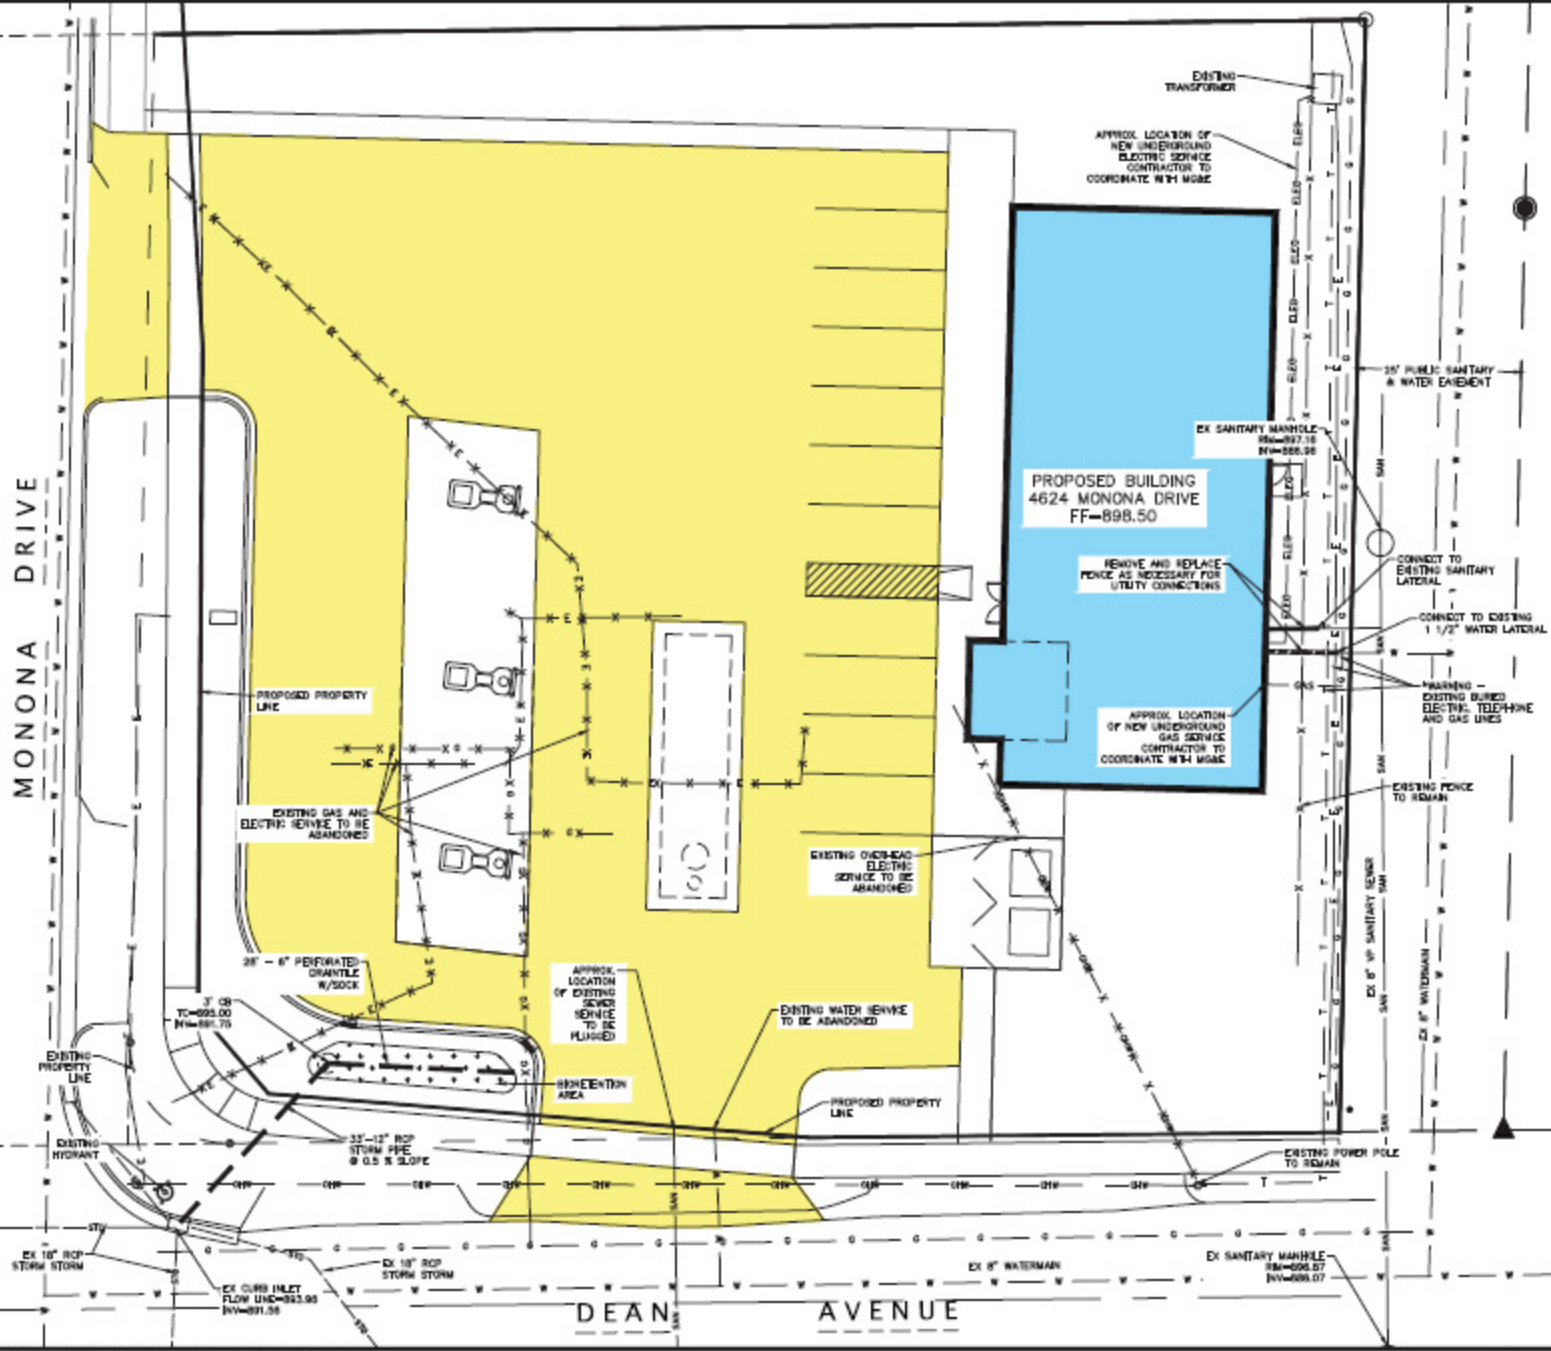

**UTILITY NOTES**

1. CONTRACTOR SHALL CALL DIGGERS HOTLINE PRIOR TO ANY CONSTRUCTION.
- UTILITIES MARKED BY DIGGERS HOTLINE INCLUDE:  
 -CITY OF MADISON - SDC  
 -MADISON GAS & ELECTRIC - CHARTER  
 -CITY OF MONONA
2. ALL EXISTING UTILITIES SHOWN ON THE PLAN ARE APPROXIMATE AND WERE FIELD LOCATED FROM GROUND MARKINGS PLACED BY THE UTILITY COMPANIES OR THEIR AGENT. THE LOCATIONS ARE SHOWN FOR INFORMATIONAL PURPOSES ONLY AND SHOULD BE FIELD VERIFIED PRIOR TO CONSTRUCTION.
3. ALL SITE UTILITY WORK SHALL BE DONE IN ACCORDANCE WITH THE CITY STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION, LATEST EDITION.
4. PRIOR TO CONSTRUCTION, CONTRACTOR SHALL OBTAIN A STREET OPENING PERMIT FOR ANY WORK TO BE DONE WITHIN THE RIGHT-OF-WAY.
5. CONTRACTOR SHALL OBTAIN ALL NECESSARY PLUMBING/CONNECTION PERMITS FROM THE CITY PRIOR TO ANY UTILITY WORK. CONTRACTOR TO NOTIFY THE PUBLIC WORKS DEPARTMENT A MINIMUM OF 48 HOURS BEFORE CONNECTING TO PUBLIC UTILITIES.
6. RESTORATION OF PAVEMENT, CURB & GUTTER, AND SIDEWALK WITHIN THE STREET RIGHT OF WAY IS CONSIDERED INCIDENTAL AND SHALL BE INCLUDED IN THE COST OF THE UNDERGROUND IMPROVEMENTS.
7. ALL STORM SEWER PIPE 12" DIA. OR LARGER IN DIAMETER TO BE ADS-102 PIPE OR RCP CLASS II REINFORCED CONCRETE WITH RUBBER GASKETS AS NOTED.
8. WATER SERVICE SHALL BE TYPE "X" COPPER.
9. SANITARY SEWER SERVICES SHALL BE SD-35 PVC.
10. ANY PERSON WHO INSTALLS A NONCONDUCTIVE WATER OR SEWER LATERAL MUST ALSO INSTALL A LOCATION MARK OR OTHER EQUALLY EFFECTIVE MEANS FOR MARKING THE LOCATION OF THE LATERAL. METHOD SHALL BE APPROVED BY THE CITY.
11. CONTRACTOR TO COORDINATE NEW, RELOCATED AND/OR ABANDONED GAS, ELECTRIC, TELEPHONE, AND CABLE WITH APPROPRIATE UTILITY COMPANIES.
12. UTILITIES SERVING PROPOSED BUILDINGS SHALL BE STUBBED TO WITHIN 5 FEET OF THE PROPOSED BUILDING(S) AND MARKED WITH A 4"x4" HARDWOOD POST.
13. ALL WATER MAIN PIPE AND FITTINGS SHALL BE INSTALLED TO A MIN. DEPTH OF COVER OF 6'-0". AFTER REGRADING, EXISTING WATER MAIN PIPE WHICH DOES NOT MEET THIS REQUIREMENT SHALL BE INSULATED.
14. STORM SEWERS WHICH CROSS AN ACTIVE SEWER OR WATER MAIN OR LATERAL SHALL HAVE A MINIMUM CLEAR VERTICAL CLEARANCE OF THREE (3) FEET. CROSSINGS WITH LESSEY VERTICAL CLEARANCE SHALL BE PROTECTED FROM FROST DAMAGE BY PLACEMENT OF 2-INCH THICK POLYSTYRENE BOARD INSULATION.
15. BUILDING PLUMBER SHALL VERIFY SIZE, SLOPE, AND EXACT LOCATION OF PROPOSED SANITARY LATERALS AND WATER SERVICES PRIOR TO INSTALLATION.

**LEGEND**

- T — T — T — EX TELEPHONE
- SAN — EX SANITARY SEWER
- OH — EX OVERHEAD ELECTRIC
- E — E — EX ELECTRIC UNDERGROUND
- W — W — W — EX WATER
- G — G — G — EX GAS UNDERGROUND
- ST — ST — EX STORM SEWER



DATE	DWG	BY	11-11		
REVISION NUMBER	DATE	BY	REASON		
818 N. Meadbrook Ln Wausau, WI 53070 phone (708) 849-9378 fax (708) 237-2129					
PROFESSIONAL ENGINEERING LLC					
STOP-N-GO UTILITY PLAN					
4624 MONONA DRIVE MADISON, WISCONSIN					
C300					